

**BEFORE THE CENTRAL ELECTRICITY REGULATORY COMMISSION**

**NEW DELHI**

Petition No.:.....

**IN THE MATTER OF**

Application under Section 63 of Electricity Act, 2003 for Adoption of Transmission Charges with respect to the Transmission System "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" being established by Raghnesda RE Transmission Limited.

**Raghnesda RE Transmission Limited .....APPLICANT**

(A 100% wholly owned subsidiary of M/s. Dineshchandra R. Agrawal Infracon Private Limited) **Registered Address:** 161, First Floor, Vardhman Crown Mall, Amberhai, South West Delhi, New Delhi, India, 110075; Address for Correspondence: DRAIPL 2 floor, Incuspaze, Plot no 17, Phase-4, Udyog Vihar, Sector 18, Gurugram, Sarhol, Haryana 122015.....**APPLICANT**

**AND**

**Central Transmission Utility of India Limited.** Saudamini, Plot No.2, Sector-29, Gurugram-122001

.....**RESPONDENT(S)**

And Others



## INDEX

Sl. No.	Description	Annexure No.	Page No.
1.	CERC Letter		4
2.	Form-I		5
3.	Memo of Appearance		9
4.	Dispatch proof		10
5.	Letter for Registration		11
6.	Memo of Parties		13
7.	Affidavit		18
8.	Application/Petition under Section 63 of Electricity Act 2003 for Adoption of Transmission Tariff		20
9.	The Gazette of India notification dated 21 <sup>st</sup> August 2024 notifying PFC Consulting Limited as the Bid Process Coordinator (BPC)	I	29-34
10.	Certificate of Incorporation, Article of Association & Memorandum of Association of Raghnesda RE Transmission Limited	II	35-97
11.	Global Invitation for Selection of Transmission Service Provided by PFC Consulting Limited	III	98-102
12.	Request for proposal along with amendments issued by BPC	IV	103-386
13.	Copy of Bid Evaluation Committee Certificate dated 28 <sup>th</sup> May 2025 issued by Bid Evaluation Committee.	V	387-388



Sl. No.	Description	Annexure No.	Page No.
14.	Copy of duly accepted Letter of Intent (LOI) issued by BPC	VI	389-394
15.	Copy of letter dated 23 <sup>rd</sup> July 2025 issued by BPC extending the time line as stated in LOI to complete the activities as mentioned in clause 2.15.2, 2.15.3 and 2.15.4 of RFP.	VII	395-396
16.	Copy of Contract Performance Guarantee	VIII	397-406
17.	Copy of BPC letters for Acquisition Price	IX	407-411
18.	Copy of Share Purchase Agreement dated 23 <sup>rd</sup> July 2025	X	412-430
19.	Copy of Transmission Service Agreement dated 23 <sup>rd</sup> July 2025	XI	431-576
20.	Prior Approval under section 68 of the Electricity Act 2003 for Transmission system	XII	577-579
21.	Power of Attorney	XIII	580-585

**Filed by**

**Raghanesda RE Transmission Limited**

(A 100% wholly owned subsidiary of Dineshchandra R. Agrawal Infracon Private Limited)

**Represented by Amit Kumar**  
**Authorised Signatory**



**Place: New Delhi**

**Date: 29<sup>th</sup> July 2025**

# RAGHANESDA RE TRANSMISSION LIMITED

2<sup>nd</sup> Floor, Incuspaze, Plot no 17, Udyog Vihar Phase IV, Sector 18, Gurugram, Haryana 122015

**Ref. No. DRAIPL/RRETL/AoTC/01**

**Dated 29<sup>th</sup> July 2025**

**To,  
The Secretary,  
Central Electricity Regulatory Commission,  
7th Floor, Tower B, World Trade Centre,  
Nauroji Nagar, New Delhi-110029.**

**Sub.: Application under Section 63 of the Electricity Act, 2003 for Adoption of Transmission Charges with respect to Transmission system being established by the Raghnesda RE Transmission Limited (A 100% wholly owned subsidiary of M/s. Dineshchandra R. Agrawal Infracon Private Limited)**

Sir,

Three copies (1 original + 2 copies) of the application for the above subject matter have been enclosed and e-filing has been done on CERC website. As per the public notice issued on 28.08.2010 by the Hon'ble Commission the amount of Rs. 25,00,000/- (Rupees Twenty Five Lakhs only) for filing the application has been paid through RTGS and in accordance with the Regulations 12 (2), Payment of Fees Regulations 2012, Form-1 duly filled in against the aforementioned application is also enclosed herewith.

Electronic copies of the application are being forwarded to the CTUIL (Nodal Agency), the Bid Process Coordinator, beneficiaries of the Northern Region and DICs. The complete application along with Annexure is posted on the website: [www.draipl.com](http://www.draipl.com)

Thanking You,

Your faithfully,



(Amit Kumar)

**Raghnesda RE Transmission Limited**

**Mob No:+91-9717196796; Email [kumar.amit@draipl.com](mailto:kumar.amit@draipl.com)**

**Enclosure As Above**

## Form-I

### Particulars

1. Name of the Petitioner	Raghanesda RE Transmission Limited  (A 100% wholly owned subsidiary of M/s. Dineshchandra R. Agrawal Infracon Private Limited)
2. Address of the Petitioner	Raghanesda RE Transmission Limited  (A 100% wholly owned subsidiary of M/s. Dineshchandra R. Agrawal Infracon Private Limited)  <b>Regd Address:</b>  161, First Floor, Vardhman Crown Mall, Amberhai, South West Delhi, New Delhi, India, 110075;  <b>Address for Correspondence:</b> DRAIPL 2 floor, Incuspaze, Plot no 17, Phase-4, Udyog Vihar, Sector 18, Gurugram, Sarhol, Haryana 122015
3. Subject Matter	Application under Section 63 of Electricity Act, 2003 for Adoption of Transmission Charges with respect to the Transmission System "Transmission system for evacuation of RE power from Raghanesda Area of Gujarat-3GW under Phase-I" being established by Raghanesda RE Transmission Limited (A 100% wholly owned subsidiary of M/s. Dineshchandra R. Agrawal Infracon Private Limited)



4. Petition No., or Application No, if any	Not Yet Received
5. Details of generation assets (a) Generating station/units (b) Capacity in MW (c) Date of commercial operation (d) Period for which fee paid (e) Amount of fee paid (f) Surcharge, if any	Not Applicable
6. Details of transmission assets (a) Transmission line and sub-stations (b) Date of commercial operation (c) Period for which fee paid (d) Amount of fee paid (e) Surcharge, if any	Assets under implementation by Raghnesda RE Transmission Limited
7. Fee paid for Adoption of tariff for (a) Generation asset (b) Transmission asset	NO YES
8. Application fee for licence (a) Trading licence (b) Transmission licence (c) Period for which paid (d) Amount of fee paid	NOT APPLICABLE
9. Fees paid for Miscellaneous Petition	Not Applicable
10. Fees paid for Interlocutory Application	Not Applicable

Handwritten signature or initials in blue ink.



11. Fees paid for Regulatory Compliance Petition	Not Applicable
12. Fees paid for Review Application	Not Applicable
13. Licence fees for inter-State Trading (a) Category (b) Period (c) Amount of fee paid (d) Surcharge, if any	Not Applicable
14. Licence fees for inter-State Transmission (a) Expected/Actual transmission charge (b) Period (c) Amount of fee calculated as a percentage of transmission charge. (d) Surcharge, if any	Not Applicable
15. Annual Registration Charge for Power Exchange/OTC Platform (a) Period (b) Amount of turnover (c) Fee paid (d) Surcharge, if any	Not Applicable



<b>16. Details of fee remitted</b>	
(a) Transaction id, Reference no./Payment id	442932907250480242CHUI745113
(b) Date of remittance	29-07-25
(c) Amount remitted	Rs.25,00,000 (Rupees Twenty Five Lakh only)

  
  
**Represented by Amit Kumar**  
**Authorised Signatory**

**Place: New Delhi**

**Date: 29<sup>th</sup> July 2025**

**BEFORE**  
**THE CENTRAL ELECTRICITY REGULATORY COMMISSION**  
**NEW DELHI**

Petition No.:.....


**IN THE MATTER OF**

Application under Section 63 of Electricity Act, 2003 for Adoption of Transmission Charges with respect to the Transmission System "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" being established by Raghnesda RE Transmission Limited (A 100% wholly owned subsidiary of M/s. Dineshchandra R. Agrawal Infracon Private Limited).

**MEMO OF APPEARANCE**

1. Amit Kumar
2. Varun Sharma
3. Biswas Ranjan Barik

**Filed by**  
**Raghnesda RE Transmission Limited**

  
**Represented by Amit Kumar**  
**Authorised Signatory**



**Place: New Delhi**

**Date: 29<sup>th</sup> July 2025**

**BEFORE**  
**THE CENTRAL ELECTRICITY REGULATORY COMMISSION**  
**NEW DELHI**

Petition No.:.....

**IN THE MATTER OF**

Application under Section 63 of Electricity Act, 2003 for Adoption of Transmission Charges with respect to the Transmission System "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" being established by Raghnesda RE Transmission Limited.

**Raghnesda RE Transmission Limited ( A 100% wholly owned subsidiary of Dineshchandra R. Agrawal Infracon Private Limited)**  
**Registered Office** 161, First Floor, Vardhman Crown Mall, Amberhai, South West Delhi, New Delhi, India, 110075; Address for Correspondence: DRAIPL 2 floor, Incuspaze, Plot no 17, Phase-4, Udyog Vihar, Sector 18, Gurugram, Sarhol, Haryana 122015.....**APPLICANT**

**AND**

**Central Transmission Utility of India Limited**, Saudamini, Plot No.2, Sector-29, Gurugram-122001.....**RESPONDENT(S)**

And Others

To,  
The Secretary,  
Central Electricity Regulatory Commission,  
New Delhi

Dispatch proof  
to be included

*[Handwritten signature]*



Sir,

The Application under Section 63 of Electricity Act, 2003 for Adoption of Transmission Charges with respect to the Transmission System "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" being established by Raghnesda RE Transmission Limited, may please be registered.



**Applicant**

**Raghnesda RE Transmission Limited**

(A 100% wholly owned subsidiary of Dineshchandra R. Agrawal Infracon  
Private Limited)



**Represented by Amit Kumar  
Authorised Signatory**

**Place: New Delhi**

**Date: 29<sup>th</sup> July 2025**

**BEFORE**  
**THE CENTRAL ELECTRICITY REGULATORY COMMISSION**  
**NEW DELHI**

Petition No.:.....

**IN THE MATTER OF**

Application under Section 63 of Electricity Act, 2003 for Adoption of Transmission Charges with respect to the Transmission System "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" being established by Raghnesda RE Transmission Limited.

**Raghnesda RE Transmission Limited (A 100% wholly owned subsidiary of Dineshchandra R. Agrawal Infracon Private Limited)**

**Registered Office** 161, First Floor, Vardhman Crown Mall, Amberhai, South West Delhi, New Delhi, India, 110075; Address for Correspondence: DRAIPL 2 floor, Incuspaze, Plot no 17, Phase-4, Udyog Vihar, Sector 18, Gurugram, Sarhol, Haryana 122015.....**APPLICANT**

**AND**

**Central Transmission Utility of India Limited**, Saudamini, Plot No.2, Sector-29, Gurugram-122001 .....**RESPONDENT(S)**

And Others

**To,**

**The Secretary,**  
**Central Electricity Regulatory Commission,**  
**New Delhi**



## MEMO OF PARTIES

**Raghanesda RE Transmission Limited (A 100% wholly owned subsidiary of Dineshchandra R. Agrawal Infracon Private Limited)**

**Registered Office:** 161, First Floor, Vardhman Crown Mall, Amberhai, South West Delhi, New Delhi, India, 110075; Address for Correspondence: DRAIPL 2 floor, Incuspaze, Plot no 17, Phase-4, Udyog Vihar, Sector 18, Gurugram, Sarhol, Haryana 122015.....**APPLICANT**

### VERSUS

1	Central Transmission Utility of India Limited Saudamini, Plot No.2, Sector-29, Gurugram-122001	....Respondent
2	PFC Consulting Limited 1st Floor, "Urjanidhi", 1, Barakhamba Lane, Connaught Place, New Delhi-110001	....Respondent
3	Chhatisgarh State Power Distribution Co. Ltd. CSPDCL, Post: Sundernagar,Dangania, Raipur-492013	....Respondent
4	Goa Electricity Deparement-WR Goa Electricity DeptCurti, Ponda 403401	....Respondent
5	Gujarat Urja Vikas Nigam Limited Sardar Patel Vidyut Bhavan, Racecourse Vadodara - 390007	....Respondent
6	Heavy Water Board O FLOOR, Vikram Sarabhai Bhavan, Trombay, Anushaktinagar, Mumbai - 400094 , Maharashtra	....Respondent
7	HVDC Bhadrawati, PGCIL RHQ, WR-I, Sampriti Nagar, , Off National Highway No. 8, Taluka : Kamrej,PO: Uppalwadi , Nagpur , 440026 Maharashtra	....Respondent

8	HVDC Vindhyachal, PGCIL PGCIL RHQ, WR-I, Sampriti Nagar, , Off National Highway No. 8, Taluka : Kamrej, PO: Uppalwadi , Nagpur , 440026 Maharashtra	....Respondent
9	M.P. Power Management Company Ltd. 14, Shakti Bhawan, Rampur, Jabalpur - 482008	....Respondent
10	MSEDCL Plot No 9, "prakashgad", A K Marg, Bandra East, Mumbai 400051	....Respondent
11	ACB India LIMITED 7th Floor, Corporate Tower, Ambience Mall, NH-8, Gurgaon-122 001(Haryana)	....Respondent
12	Torrent Power Limited Torrent Power Ltd. Naranpura Zonal Office, Sola Road, Ahmedabad, 380013	....Respondent
13	Thermal Powertech Corporation India 6-3-1090, Clock C, Level 2, TSR , Towers, Rajbhavan Road, Somajiguda , Hyderabad , 500082, Telangana	....Respondent
14	BARC Bhabha Atomic Research Centre, Anushakti Nagar, Mumbai, Maharashtra - 400085	....Respondent
15	GMR Warora Energy Limited Plot B-1,GMR Warora Energy Ltd, Mohabala MIDC Growth Centre, Post - Warora, Dist - Chandrapur, Maharashtra, PIN 442907	....Respondent

15

✓



16	HVDC Champa PGCIL RHQ, WR-I, Sampriti Nagar, , Off National Highway No. 8, Taluka : Kamrej,PO: Uppalwadi , Nagpur , 440026 Maharashtra	....Respondent
17	West Central Railway Head Office General Manager's Office,Electrical Branch, Jabalpur- 482 001.	....Respondent
18	Western Railway Office Of Chief Electrical Engineer Mumbai	....Respondent
19	DB Power Limited- Untied Opp Dena Bank, C-31, G- Block Mumbai	....Respondent
20	Chhattisgarh State Power Trading Co. Ltd. 2nd floor Vidyut Sewa BhawanRaipur	....Respondent
21	TRN Energy Private Ltd-Untied 7th Floor, Ambience Office Block Gurugram	....Respondent
22	Adani Power (Mundra) Limited. Adani Corporate House, Shantigram, Near Vaishnavdevi Circle, S G Road Ahmedabad - 382421	....Respondent
23	Raigarh HVDC Station RPT HVDC Office, Hebbal, Bangalore - 560094	....Respondent
24	Arcelor Mittal Nippon Steel India Ltd. 27,AMNS House, 2TH KM Surat Hazira road, Hazira-394270, Gujarat	....Respondent
25	Central Railway Pcee's office 2nd floor parcle building csmt mumbai-400001	....Respondent

16

*[Handwritten signature]*



26	Dadra and Nagar Haveli and Daman an Power Distribution Corporation Ltd 1st & 2nd Floor, Vidyut Bhavan, NexSilvassa & Daman	....Respondent
27	MPSEZ Utilities Ltd. 3rd Floor, Adani Corporate House, Ahmedabad	....Respondent
28	Azure Power Sixty Three Private Limited 8th Floor, Infinity Tower A, DLF Cyber City, DLF Phase - II, Gurugram, 122002	....Respondent
29	Sunsure Solarpark RJ One Private Limited 1101A-1107, 11th Floor, BPTP Park Centra, Jal Vayu Vihar, Sector 30, Gurugram, Haryana-122001	....Respondent
30	PGCIL, Banaskantha Dist. Banaskantha, Gujarat	....Respondent

**Applicant**

**Raghanesda RE Transmission Limited**

(A 100% wholly owned subsidiary of Dineshchandra R. Agrawal

Infracon Private Limited)



**Represented by Amit Kumar**

**Authorised Signatory**

**Place: New Delhi**

**Date: 29<sup>th</sup> July 2025**

**BEFORE THE CENTRAL ELECTRICITY REGULATORY COMMISSION  
NEW DELHI**

Petition No. : .....

**IN THE MATTER OF**

Application under Section 63 of Electricity Act, 2003 for Adoption of Transmission Charges with respect to the Transmission System "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" being established by Raghnesda RE Transmission Limited.

**Raghnesda RE Transmission Limited (A 100% wholly owned subsidiary of Dineshchandra R. Agrawal Infracon Private Limited)**  
**Registered Office:** 161, First Floor, Vardhman Crown Mall, Amberhai, South West Delhi, New Delhi, India, 110075; **Address for Correspondence:** DRAIPL 2 floor, Incuspaze, Plot no 17, Phase-4, Udyog Vihar, Sector 18, Gurugram, Sarhol, Haryana 122015.....**APPLICANT**

**AND**

**Central Transmission Utility of India Limited, Saudamini, Plot No.2, Sector-29, Gurugram-122001.....RESPONDENT(S)**

And Others



**Affidavit**

I, Amit Kumar, son of Shri Raj Kumar resident of C-1704, Pioneer Park Sector 61, Gurgaon, 122011 do solemnly declare and affirm as follows:-

1. That I am the Authorised Signatory of the Applicant Company in the above matter and I am competent to sign this affidavit on behalf of

NOTARY REGISTER  
Entry No. 1422/2028 -



the Applicant Company. I say that I am conversant with the facts and circumstances of this case;

2. The statements made in the paragraphs of the application, are true to my knowledge and belief based on the information received and I believe them to be true.
3. I say that there are no proceedings pending in any court of law/tribunal or arbitrator or any other authority, wherein the Applicant is a party and where issues arising and or reliefs sought are identical or similar to the issues in the matter pending before the Hon'ble Commission.



*[Handwritten Signature]*

**Authorized Signatory**

**Raghnesda RE Transmission Limited**

**I identify the deponent who has Signed to my Precence**

Verified at New Delhi on 29<sup>th</sup> day of July 2025 that the contents of the above affidavit are true and to the best of my knowledge and no part of it is false and nothing material has been concealed there from.



*[Handwritten Signature]*

**Amit Kumar**

**DEPONENT**



**NOTARY REGISTER**  
Entry No. *1422/2025*

**ATTESTED**  
*[Handwritten Signature]*  
**NOTARY PUBLIC**  
**DELHI**

**29 JUL 2025**

**BEFORE THE CENTRAL ELECTRICITY REGULATORY COMMISSION**

**NEW DELHI**

Petition No.:.....

**IN THE MATTER OF**

Application under Section 63 of Electricity Act, 2003 for Adoption of Transmission Charges with respect to the Transmission System "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" being established by Raghnesda RE Transmission Limited.

**Raghnesda RE Transmission Limited (A 100% wholly owned subsidiary of Dineshchandra R. Agrawal Infracon Private Limited)**

**Registered Office:** 161, First Floor, Vardhman Crown Mall, Amberhai, South West Delhi, New Delhi, India, 110075; Address for Correspondence: DRAIPL 2 floor, Incuspaze, Plot no 17, Phase-4, Udyog Vihar, Sector 18, Gurugram, Sarhol, Haryana 122015.....**APPLICANT**

**AND**

**Central Transmission Utility of India Limited, Saudamini, Plot No.2, Sector-29, Gurugram-122001.....RESPONDENT(S)**

And Others

**APPLICATION**

The Applicant respectfully submits as under:

1. **Raghnesda RE Transmission Limited** (hereinafter referred as "Applicant") hereby submits this application under Section 163 of the Electricity Act, 2003 for Adoption of Transmission Charges with respect to the Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW



**under Phase-I"** (hereinafter referred to as 'Project') on build, own, operate and transfer basis consisting of the following elements:

2. The Project Consist of the following elements:

Sl. No.	Name of the Transmission Element	Scheduled COD	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre-required for declaring the commercial operation (COD) of the respective Element
1.	Establishment 4x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor	27 months from effective date	52.69%	All Elements are required to be commissioned simultaneously as their utilization is dependent on commissioning of each other.
2.	Raghnesd (GIS) – Banaskantha (PG) 765 kV D/C line		36.50%	
3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s		2.80%	
4.	Creation of 220 kV switchyard (Bus Sec-I) at Raghnesda PS (GIS) along with installation of 2x500 MVA, 400/220 kV ICTs	30.09.2027*	7.28%	Elements at Sl. No. 1, 2 and 3 are pre- required for declaring the commercial operation (COD)
5.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Azure Power Sixty- Three Pvt. Ltd. (2200001107) (300 MW)	30.09.2027*	0.36%	
6.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Sunsure Solarpark RJ One Pvt. Ltd. (2200001018) (350 MW)	31.03.2028	0.37%	Element at Sl. No. 6 can be commissioned separately subject to commissioning of elements at sl. No. 1 to 4.

\*Subject to minimum schedule of 27 months from effective date.

21

*[Handwritten signature]*



3. The Central Electricity Authority, Ministry of Power, Government of India, vide its notification no. CG-DL-E-22082024-256561 dated 21<sup>st</sup> August 2024 has appointed PFC Consulting Limited to be the Bid Process Coordinator (herein after referred to as "BPC") for the purpose of selection of Bidder as Transmission Service Provider (TSP) to establish the Project through tariff based competitive bidding process. The notification dated 21<sup>st</sup> August 2024 is enclosed and marked as **ANNEXURE I** (Page.29. to Page.34..).
4. That a company under the Companies Act 2013 by the name "**Raghanesda RE Transmission Limited**" having its registered office at New Delhi has been incorporated on 03<sup>rd</sup> December 2024 by BPC as its 100% wholly owned subsidiary to initiate the activities for execution of the Project and subsequently act as Transmission Service Provider (TSP) after being acquired by the Successful Bidder selected through tariff based competitive bidding process. Copy of Certificate of Incorporation, Article of Association & Memorandum of Association of the applicant is enclosed and marked as **ANNEXURE II** (Page.35. to Page.97.).
5. BPC initiated the selection of the Successful Bidder to acquire the TSP in accordance with the "Guidelines for encouraging competition in development of Transmission Projects" and "Tariff based Competitive-bidding Guidelines for Transmission Service" issued by Government of India, Ministry of Power under Section 63 of the Electricity Act, 2003 and as amended from time to time.

It is submitted that the BPC issued the Single Stage Request for Proposal Document on 14<sup>th</sup> September 2024 for the Project (herein after referred to as the "RFP") and since then till the bid deadline BPC issued various clarifications and amendments relating to the RFP. These clarifications and amendments relating to the RFP are referred as Final RFP.



That in the RFP Document the following is stated

Quote

"The transmission charges shall be payable by the designated ISTS customer in Indian Rupees through the CTU as per central electricity Regulatory Commission (sharing of Interstate Transmission charges and losses) Regulation as amended from time to time."

The copy of the Global Invitation for Selection of TSP is enclosed and marked as **ANNEXURE III** (Page.388. to Page.102.) and copy of the Final RFP is enclosed and marked as **ANNEXURE IV.** (Page.103 to Page.386).

6. Subsequent to the process of competitive bidding conducted by BPC, M/s Dineshchandra R. Agrawal Infracon Private Limited has been declared as a Successful Bidder. Copy of certificate dated 28<sup>th</sup> May 2025 issued by Bid Evaluation Committee are enclosed and marked as **ANNEXURE V** (Page.387 to Page.388.).
7. Further, on 03<sup>rd</sup> June 2025, the BPC issued a Letter of Intent (hereinafter referred to as "LOI") to M/s Dineshchandra R. Agrawal Infracon Private Limited. A copy of the Letter of Intent (LOI) along with the details of Annual Transmission Charges is enclosed and marked as **ANNEXURE VI** (Page.389 to Page.394.).
8. As per the provisions 2.15.2 of Request for Proposal (RFP) and the Letter of Intent issued to M/s Dineshchandra R. Agrawal Infracon Private Limited, within 10 days of issuance of Letter of Intent by the BPC, the successful Bidder is required to inter-alia provide the Contract Performance Guarantee, execute Share Purchase Agreement & the Transmission Service Agreement and acquire the SPV. The BPC vide letters dated 23<sup>rd</sup> July 2025 has extended the timeline for completion of the obligations as per Clause 2.15.2, 2.15.3 and 2.15.4 of the RFP till 30<sup>th</sup> July 2025.



A copy of letters issued by the BPC are enclosed and marked as **ANNEXURE VII** (Page.395. to Page.396.).

9. That in accordance with the LOI, M/s Dineshchandra R. Agrawal Infracon Private Limited on 22<sup>nd</sup> July 2025 has furnished the Contract Performance Guarantee for an aggregate amount of Rupees Fifty-Seven Crore Fifty Lakh Only (Rs. 57.50 Crore) in favour of Central Transmission Utility of India Limited ("Nodal Agency") as per provisions of Clause 2.12 of the RFP documents.

Copy of CPG submitted is enclosed and marked as **ANNEXURE VIII** (Page.397 to Page.406.).

10. That prior to the bidding, on 20<sup>th</sup> March 2025, the BPC had intimated to the bidders that the Acquisition Price payable by the Selected Bidder for Acquisition of one hundred percent of equity shareholding of Raghnesda RE Transmission Limited along with all its related assets and liabilities as Rs. Rs. 18,98,00,581/- (Rupees Eighteen Crore Ninety Eight Lakh Five Eighty One only).

Subsequent to the bidding and during the process of acquisition, the BPC vide letter dated 13<sup>th</sup> June 2025 intimated the successful bidder - the applicant, the final Acquisition Price as Rs.19,13,95,265/- (Rupees Nineteen Crore Thirteen Lakh Ninety Five Thousand Two Sixty Five only).

The aforesaid acquisition price of Rs.19,13,95,265/- (Rupees Nineteen Crore Thirteen Lakh Ninety Five Thousand Two Sixty Five only) has been paid on 23<sup>rd</sup> July 2025 to the PFC Consulting Limited.

Copy of BPC letters dated 20<sup>th</sup> March 2025 and 13<sup>th</sup> June 2025 for Acquisition price are enclosed and marked as **ANNEXURE IX** (Page.407. to Page.411...).



11. Thereafter M/s Dineshchandra R. Agrawal Infracon Private Limited has acquired one hundred percent (100%) equity shares in **Raghanesda RE Transmission Limited** on 23<sup>rd</sup> July 2025 after execution of the Share Purchase Agreement and completing all the procedural requirements specified in the RFP documents.

A copy of the Share Purchase Agreement is enclosed and marked as **ANNEXURE X** (Page..412 to Page..430).

12. A copy of the Transmission Service Agreement (TSA) entered between Central Transmission Utility of India Limited and "Raghanesda RE Transmission Limited" on 23<sup>rd</sup> July 2025 is enclosed and marked as **Annexure XI** (Page..431 to Page..576).

13. The BPC sought prior approval of the Government of India under Section 68 of the Act for the Applicant Company in respect of the Transmission system "Transmission system for evacuation of RE power from Raghanesda Area of Gujarat-3GW under Phase-I" and the CEA conveyed the said approval to the BPC vide its letter dated 28<sup>th</sup> January 2025.

Copy of the approval granted under Section 68 of the Act is annexed herewith as **ANNEXURE XII** (Page..577 to Page..579).

14. The Applicant shall map Nodal Agency i.e. CTUIL on the e-portal of this Hon'ble Commission at the earliest as per the procedure in vogue and completion of relevant formalities. The Applicant is also sending a copy of the present Petition to CTUIL via e-mail. The Application has been hosted on the website <http://www.draipl.com> so as to facilitate the access to the Application by any person through internet.

15. It is further submitted that a copy of the Application has also been marked to BPC to enable submission of the requisite documents / information by BPC before this Hon'ble Commission regarding the



Bidding process undertaken and thereby ensure processing of application.

16. That a copy of the Application has also been marked to Designated ISTS Customers (DICs) and beneficiaries of the Northern Region as party to the Petition based on the list of the DICs and beneficiaries furnished by the CTUIL.
17. That Dineshchandra R Agrawal Infracon Private Limited has acquired the TSP on 23<sup>rd</sup> July 2025 and the same is effective date of the project as per provisions of TSA. The schedule construction period of the project is as mentioned below.

Sl. No.	Name of the Transmission Element	Scheduled COD
1.	Establishment 4x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVar, 765 kV bus reactor and 2x125 MVar, 420 kV bus reactor	27 months from effective date
2.	Raghnesd (GIS) - Banaskantha (PG) 765 kV D/C line	
3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s	
4.	Creation of 220 kV switchyard (Bus Sec-I) at Raghnesda PS (GIS) along with installation of 2x500 MVA, 400/220 kV ICTs	30.09.2027*
5.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Azure Power Sixty- Three Pvt. Ltd. (2200001107) (300 MW)	30.09.2027*
6.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Sunsure Solarpark RJ One Pvt. Ltd. (2200001018) (350 MW)	31.03.2028

\*Subject to minimum schedule of 27 months from effective date.

18. Keeping in view the above, the Applicant is hereby fulfilling the obligations as per clause 2.15.2 of the RFP documents. As per clause 2.15.4 of RFP, the TSP is required to apply for adoption of Transmission charges as per Section 63 of the Electricity Act 2003. The petitioner



therefore has approached to Hon'ble Commission through the present petition.

19. That the Applicant, **Raghanesda RE Transmission Limited**, incorporated under the Companies Act, 2013 is a 100% wholly owned subsidiary of M/s Dineshchandra R. Agrawal Infracon Private Limited who has been selected by the BPC through tariff based competitive bidding under the bidding guidelines for Transmission Service issued by Ministry of Power, Government of India and thus submits this application under section 63 of the Electricity Act 2003 for the adoption of Transmission Charges to establish the project under Build, Own, Operate & Transfer (BOOT) basis.
20. It is stipulated that Section 63 of the Electricity Act, 2003 empowers the Appropriate Commission for adoption of Transmission Charges.
21. Keeping in view of the above, the Hon'ble Commission may kindly adopt the transmission charges discovered through transparent tariff based competitive bidding process with respect to Transmission System being established by Raghanesda RE Transmission Limited is a wholly owned subsidiary of M/s Dineshchandra R. Agrawal Infracon Private Limited.
22. Prayer:

It is respectfully prayed that the Hon'ble Commission may be pleased to:

- a. Adoption of Transmission Charges for Inter State Transmission system "Transmission system for evacuation of RE power from Raghanesda Area of Gujarat-3GW under Phase-I" discovered through Competitive bidding process.
- b. Allow the recovery of Transmission Charges for Inter State Transmission system "Transmission system for evacuation of RE



- power from Raghnesda Area of Gujarat-3GW under Phase-I" as per Sharing of Inter-State Transmission Charges and Losses CERC Regulation, 2020 and any other amendment thereon issued from time to time by CERC;
- c. Condone any inadvertent errors omissions/ errors/ shortcomings and permit the Petitioner to add/ change/ modify/alter these filings and make further submissions as may be required at a future date.
- d. Pass such other order/orders, as may be deemed fit and proper in the facts & circumstances of the case.

**Applicant**

**Raghnesda RE Transmission Limited**

(A 100% wholly owned subsidiary of Dineshchandra R. Agrawal

Infracon Private Limited)



**Represented by Amit Kumar**

**Authorised Signatory**

**Place: New Delhi**

**Date: 29<sup>th</sup> July 2025**

**ANNEXURE I : THE GAZETTE OF INDIA NOTIFICATION DATED 21<sup>ST</sup> AUGUST 2024 NOTIFYING PFC CONSULTING LIMITED AS THE BID PROCESS COORDINATOR (BPC)**

29



  
**भारत का राजपत्र**  
**The Gazette of India**

सौ.जी.-डी.एल.-अ.-22082024-256561  
CG-DL-E-22082024-256561

असाधारण  
EXTRAORDINARY

भाग II—खण्ड 3—उप-खण्ड (ii)  
PART II—Section 3—Sub-section (ii)

प्राधिकार से प्रकाशित  
PUBLISHED BY AUTHORITY

सं. 3229]

नई दिल्ली, बुधवार, अगस्त 21, 2024/ श्रावण 30, 1946

No. 3229]

NEW DELHI, WEDNESDAY, AUGUST 21, 2024/ SHRAVANA 30, 1946

विद्युत मंत्रालय

अधिसूचना

नई दिल्ली, 20 अगस्त, 2024

क.आ. 3545(अ).—विद्युत अधिनियम, 2003 (2003 की सं. 36,) की धारा 63 के अंतर्गत परिचालित दिशा-निर्देशों के पैरा 3 के उप-पैरा 3.2 द्वारा प्रदत्त शक्तियों का प्रयोग करते हुए, केंद्र सरकार, राष्ट्रीय पारेषण समिति की 20वीं बैठक की सिफारिशों पर, संबंधित बोली-प्रक्रिया समन्वयकों (बीपीसी) के विवरण के साथ टीबीसीबी मोड के अंतर्गत निम्नलिखित पारेषण स्कीमों को अधिसूचित करती है:

क्र.सं.	पारेषण स्कीम का नाम और कार्यक्षेत्र	
1.	तलेगांव (पुणे) के निकट पम्ड भंडारण क्षमता को पूरा करने के लिए पश्चिमी क्षेत्र में नेटवर्क विस्तार स्कीम संभावित कार्यान्वयन समय-सीमा: तिथि 01.01.2027 एसपीवी अंतरण से 24 माह की न्यूनतम कार्यान्वयन अनुसूची के अध्यक्षीन बीपीसी: आरईसी विद्युत विकास एंड कंसल्टेंसी लिमिटेड कार्य-क्षेत्र:	
	क्र.सं.	क्षमता (एमवीए)/मार्ग लंबाई (किमी)
	1.	2x330 एमवीएआर, 765 केवी बस रिएक्टर 765/400 केवी, 1500 एमवीए आईसीटी - 2 और 2x125 एमवीएआर, 420 केवी बस (7x500 एमवीए एकल चरण यूनिटें जिसमें एक



		• 765 केवी वीआर वे: 1	
15.	लकडिया पीएस में 1x1500 एमवीए, 765/400 केवी आईसीटी द्वारा परिवर्तन क्षमता का विस्तार (तीसरा)	• 1500 एमवीएआर, 765/400 केवी आईसीटी: 1 • 400 केवी आईसीटी वे: 1 • 765 केवी आईसीटी वे: 1	कार्यान्वयन एजेंसी को आबंटन की तिथि से 18 माह
*कार्यान्वयन एजेंसी को आबंटन की तिथि से न्यूनतम 18 माह की समय-सीमा के अधीन।			
नोट: लकडिया एस/एस की टीएसपी (डब्ल्यूआरएसएस XXI(ए) ट्रांसको लिमिटेड) लकडिया एस/एस में उपरोक्त संवर्धन कार्यों के लिए स्थान उपलब्ध कराएगी।			
5.	गुजरात के राधनेस्दा क्षेत्र से नवीकरणीय ऊर्जा की निकासी के लिए पारेषण प्रणाली - चरण-I के अंतर्गत 3 गीगावाट संभावित कार्यान्वयन की समय-सीमा: एसपीवी अंतरण से 30 माह बीपीसी: पीएफसी कंसल्टिंग लिमिटेड कार्य-क्षेत्र:		
	क्रम सं.	पारेषण स्कीम का कार्य-क्षेत्र	क्षमता/किमी
	1.	2x330 एमवीएआर, 765 केवी बस रिएक्टर और 2x125 एमवीएआर, 420 केवी बस रिएक्टर के साथ राधनेस्दा (बीआईएस) के पास 3x1500 एमवीए, 765/400 केवी सबस्टेशन की संस्थापना  अविष्य के लिए प्रावधान (के लिए स्थान): ➤ 765/400 केवी आईसीटी वे सहित- 5 (सेक्शन-I में 1 और सेक्शन-II में 4) ➤ स्विचेबल लाइन रिएक्टरों के साथ 765 केवी लाइन वे - 10 (सेक्शन-I पर 4 और सेक्शन-II पर 6) ➤ 765 केवी बस रिएक्टर वे सहित: 2 (सेक्शन-II पर) ➤ 765 केवी सेक्शनलाइजर: 1 - सेट ➤ स्विचेबल लाइन रिएक्टरों के साथ 400 केवी लाइन वे - 12 (सेक्शन-I पर 4 और सेक्शन-II पर 8) ➤ 400/220 केवी आईसीटी वे सहित - 8 (प्रत्येक 400 केवी सेक्शन पर 4) ➤ 400 केवी बस रिएक्टर सहित वे : 2 (सेक्शन-II) ➤ 400 केवी सेक्शनलाइजर वे: 1- सेट ➤ 220 केवी लाइन वे: 12 (प्रत्येक 220 केवी	• 765/400 केवी, 1500 एमवीए आईसीटी - 3 (10x500 एमवीए एकल चरण युनिटें जिसमें एक अतिरिक्त आईसीटी युनिट भी शामिल है) • 765 केवी आईसीटी वे - 3 • 400 केवी आईसीटी वे - 3 • 765 केवी लाइन वे - 2 • 1x330 एमवीएआर, 765 केवी बस रिएक्टर- 2 (7x110 एमवीएआर एकल चरण रिएक्टर जिसमें बस/लाइन रिएक्टर के लिए एक अतिरिक्त इकाई शामिल है) • 765 केवी बस रिएक्टर वे- 2 • 125 एमवीएआर, 420 केवी रिएक्टर - 2 • 400 केवी बस रिएक्टर वे - 2 • 400 केवी लाइन वे - 4 (नवीकरणीय ऊर्जा परियोजनाओं के अंतर्गम्य के लिए)



	<p>सेक्शन पर 6)</p> <ul style="list-style-type: none"> <li>➤ 220 केवी सेक्शनलाइजेशन बे: 1 सेट</li> <li>➤ 220 केवी बीसी : 1</li> <li>➤ 400 केवी एचवीएसी स्विचवार्ड और सभी संबंधित उपकरण (फिल्टर सहित)/बस विस्तार आवि के साथ संबद्ध इंटरकनेक्शन सहित 6000 मेगावाट, ± 800 केवी राघनेस्टा (एचवीडीसी) [एलसीसी] टर्मिनल स्टेशन (4x1500 मेगावाट) की संस्थापना।</li> </ul>										
2.	राघनेस्टा (जीआईएस) - बनासकांठा (पीजी) 765 केवी डी/सी लाइन	95 किमी									
3.	बनासकांठा (पीजी) एस/एस में 2 765 केवी लाइन बे	765 केवी लाइन बे - 2									
<p>नोट:</p> <ul style="list-style-type: none"> <li>• बनासकांठा एस/एस (पावरग्रिड) की टीएसपी उपरोक्त क्रमांक 3 पर कार्यक्षेत्र के लिए स्थान उपलब्ध कराएगी।</li> </ul>											
6.	<p>रतले एचईपी (850 मेगावाट) और किरू एचईपी (624 मेगावाट) से विद्युत की निकासी के लिए पारेषण स्कीम: भाग-ए</p> <p>संभावित कार्यान्वयन की समय-सीमा: एसपीवी अंतरण से 24 माह</p> <p>वीपीसी: आरईसी पावर डेवलपमेंट एंड कंसल्टेंसी लिमिटेड</p> <p>कार्य-क्षेत्र:</p>										
	<table border="1"> <thead> <tr> <th>क्रम सं.</th> <th>पारेषण घटक का विवरण</th> <th>कार्य-क्षेत्र (सबस्टेशन का प्रकार /कंडक्टर क्षमता/किमी/बे की संख्या आदि।)</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>किशतवाड़ एस/एस पर संबद्ध बे सहित किशतवाड़ एस/एस पर 400 केवी किशनपुर-दुलहस्ती लाइन (द्विवन) का लीलो</td> <td> <p>लीलो की लंबाई - 3 किमी</p> <ul style="list-style-type: none"> <li>• 400 केवी किशनपुर-किशतवाड़ (लीलो सेक्शन) द्विवन एचटीएलएस (न्यूनतम 2100 एमवीए क्षमता के साथ) कॉन्फिगरेशन पर होगा</li> <li>• 400 केवी दुलहस्ती-किशतवाड़ (लीलो सेक्शन) द्विवन ज़ेबरा कॉन्फिगरेशन पर होगा</li> <li>• किशतवाड़ में 400 केवी लाइन बे - 2 (जीआईएस) (किशतवाड़ एस/एस छोर पर लाइन बे को तदनुसार रेट किया जाएगा)</li> </ul> </td> </tr> <tr> <td>2</td> <td>400 केवी किशनपुर-सांवा डी/सी लाइन (क्राइ) (किशनपुर में केवल एक सर्किट को समाप्त किया जाना है, जिसमें किशनपुर एस/एस में 400 केवी खाली लाइन बे में से एक का उपयोग किया जाएगा (जो</td> <td>लंबाई - 36 किमी (क्वाड)</td> </tr> </tbody> </table>	क्रम सं.	पारेषण घटक का विवरण	कार्य-क्षेत्र (सबस्टेशन का प्रकार /कंडक्टर क्षमता/किमी/बे की संख्या आदि।)	1	किशतवाड़ एस/एस पर संबद्ध बे सहित किशतवाड़ एस/एस पर 400 केवी किशनपुर-दुलहस्ती लाइन (द्विवन) का लीलो	<p>लीलो की लंबाई - 3 किमी</p> <ul style="list-style-type: none"> <li>• 400 केवी किशनपुर-किशतवाड़ (लीलो सेक्शन) द्विवन एचटीएलएस (न्यूनतम 2100 एमवीए क्षमता के साथ) कॉन्फिगरेशन पर होगा</li> <li>• 400 केवी दुलहस्ती-किशतवाड़ (लीलो सेक्शन) द्विवन ज़ेबरा कॉन्फिगरेशन पर होगा</li> <li>• किशतवाड़ में 400 केवी लाइन बे - 2 (जीआईएस) (किशतवाड़ एस/एस छोर पर लाइन बे को तदनुसार रेट किया जाएगा)</li> </ul>	2	400 केवी किशनपुर-सांवा डी/सी लाइन (क्राइ) (किशनपुर में केवल एक सर्किट को समाप्त किया जाना है, जिसमें किशनपुर एस/एस में 400 केवी खाली लाइन बे में से एक का उपयोग किया जाएगा (जो	लंबाई - 36 किमी (क्वाड)	
क्रम सं.	पारेषण घटक का विवरण	कार्य-क्षेत्र (सबस्टेशन का प्रकार /कंडक्टर क्षमता/किमी/बे की संख्या आदि।)									
1	किशतवाड़ एस/एस पर संबद्ध बे सहित किशतवाड़ एस/एस पर 400 केवी किशनपुर-दुलहस्ती लाइन (द्विवन) का लीलो	<p>लीलो की लंबाई - 3 किमी</p> <ul style="list-style-type: none"> <li>• 400 केवी किशनपुर-किशतवाड़ (लीलो सेक्शन) द्विवन एचटीएलएस (न्यूनतम 2100 एमवीए क्षमता के साथ) कॉन्फिगरेशन पर होगा</li> <li>• 400 केवी दुलहस्ती-किशतवाड़ (लीलो सेक्शन) द्विवन ज़ेबरा कॉन्फिगरेशन पर होगा</li> <li>• किशतवाड़ में 400 केवी लाइन बे - 2 (जीआईएस) (किशतवाड़ एस/एस छोर पर लाइन बे को तदनुसार रेट किया जाएगा)</li> </ul>									
2	400 केवी किशनपुर-सांवा डी/सी लाइन (क्राइ) (किशनपुर में केवल एक सर्किट को समाप्त किया जाना है, जिसमें किशनपुर एस/एस में 400 केवी खाली लाइन बे में से एक का उपयोग किया जाएगा (जो	लंबाई - 36 किमी (क्वाड)									

	Limited (RDSSPPL) (Appl. No. 2200000639: 350 MW)		
13.	Implementation of 220 kV line bay at Lakadia PS for Percentum Renewables Private Limited (PRPL) (Appl. No. 2200000673: 148 MW)	• 220 kV line bay - 1 No. (New Bus Section-II)	30.06.2026*
14.	Installation of 1x330 MVAR 765 kV Bus Reactor (2nd) along-with associated bay	• 330 MVAR, 765 kV Bus Reactor: 1 No. • 765 kV BR bay: 1 No.	18 months from date of allocation to implementing agency
15.	Augmentation of transformation capacity at Lakadia PS by 1x1500 MVA, 765/400 kV ICTs (3rd)	• 1500 MVA, 765/400 kV ICT: 1 No. • 400 kV ICT bay: 1 No. • 765 kV ICT bay: 1 No.	18 months from date of allocation to implementing agency
*subject to minimum schedule of 18 months from the date of allocation to implementing agency.			
Note:			
TSP of Lakadia S/s (IVRSS XXI(A) Transco Ltd.) shall provide space for above augmentation works at Lakadia S/s			
5.	Transmission system for evacuation of RE power from Raghnesda area of Gujrat - 3 GW under Phase-I		
Tentative Implementation Time: 30 months from SPV transfer			
BPC: PFC Consulting Limited			
Scope:			
	<b>Sl. No.</b>	<b>Scope of the Transmission Scheme</b>	<b>Capacity /km</b>
	1.	Establishment of 3x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor  <b>Future provision (space for):</b> <ul style="list-style-type: none"> <li>➤ 765/400 kV ICT along with bays- 5 Nos. (1 No. in Sec-I &amp; 4 Nos. on Sec-II)</li> <li>➤ 765 kV line bays along with switchable line reactors - 10 Nos. (4 Nos. on Sec-I &amp; 6 Nos. on Sec-II)</li> <li>➤ 765 kV Bus Reactor along with bay: 2 Nos. (on Sec-II)</li> <li>➤ 765 kV Sectionalizer: 1 -set</li> <li>➤ 400 kV line bays along with switchable line reactors- 12 Nos. (4 Nos. on Sec-I &amp; 8 Nos. on Sec-II)</li> <li>➤ 400/220 kV ICT along with bays - 8 Nos. (4 Nos. on each 400 kV Section)</li> <li>➤ 400 kV Bus Reactor along with bays: 2 Nos. (Sec-II)</li> <li>➤ 400 kV Sectionalization bay: 1- set</li> <li>➤ 220 kV line bays: 12 Nos. (6 Nos. on each 220 kV Section)</li> <li>➤ 220 kV Sectionalization bay: 1 set</li> <li>➤ 220 kV BC: 1 No.</li> <li>➤ Establishment of 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC] terminal station (4x1500 MW) along with</li> </ul>	<ul style="list-style-type: none"> <li>• 765/400 kV, 1500 MVA ICT - 3 Nos. (10x500 MVA single phase units including one spare ICT Unit)</li> <li>• 765 kV ICT bays - 3 Nos.</li> <li>• 400 kV ICT bays - 3 Nos.</li> <li>• 765 kV Line bays - 2 Nos.</li> <li>• 1x330 MVAR, 765 kV bus reactor- 2 Nos. (7x110 MVAR single phase Reactors including one spare Unit for bus /line reactor)</li> <li>• 765 kV Bus reactor bay - 2 Nos.</li> <li>• 125 MVAR, 420 kV reactor- 2 Nos.</li> <li>• 400 kV Reactor bay- 2 Nos.</li> <li>• 400 kV line bays - 4 Nos. (for interconnection of RE Projects)</li> </ul>



		associated interconnections with 400 kV HVAC Switchyard & all associated equipment (incl. filters)/bus extension, etc.																			
2.	Raghanesda (GIS) – Banaskantha (PG) 765 kV D/c line		95 km																		
3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s		765 kV line bays – 2 Nos.																		
<p>Note:</p> <ul style="list-style-type: none"> <li>TSP of Banaskantha S/s (POWERGRID) shall provide space for scope at Sl. 3 above.</li> </ul>																					
6.	<p>Transmission scheme for evacuation of power from Ratle HEP (850 MW) &amp; Kiru HEP (624 MW): Part-A</p> <p>Tentative Implementation Time: 24 months from SPV transfer</p> <p>BPC: REC Power Development and Consultancy Limited</p> <p>Scope:</p> <table border="1"> <thead> <tr> <th>Sl. No.</th> <th>Description of Transmission Element</th> <th>Scope of work (Type of Substation/Conductor capacity/km/no. of bays etc.)</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>LILO of 400 kV Kishenpur-Dulhasti line (Twin) at Kishtwar S/s along with associated bays at Kishtwar S/s</td> <td>           LILO Length- 3km            •400 kV Kishenpur -Kishtwar (LILO section) shall be on Twin HTLS (with minimum 2100 MVA capacity) configuration            •400 kV Dulhasti -Kishtwar (LILO section) shall be on Twin Zebra configuration            •400 kV line bays at Kishtwar – 2 Nos. (GIS) (line bays at Kishtwar S/s end shall be rated accordingly)         </td> </tr> <tr> <td>2</td> <td>400 kV Kishenpur-Samba D/c line (Quad) (only one circuit is to be terminated at Kishenpur utilizing 1 no. of 400 kV vacated line bay at Kishenpur S/s (formed with bypassing of one ckt of 400 kV Kishenpur – Kishenpur 400 kV D/c line (Quad) at Kishenpur) while second circuit would be connected to bypassed circuit of 400 kV Kishenpur – Kishenpur line (Quad))</td> <td>Length -36 km (Quad)</td> </tr> <tr> <td>3</td> <td>Bypassing of one ckt of 400 kV Kishenpur – Kishenpur 400 kV D/c line (Quad) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400 kV D/c line(Quad), thus forming 400 kV Kishenpur - Samba (Quad) direct line (one ckt)</td> <td></td> </tr> <tr> <td>4</td> <td>1x80 MVAR Switchable line reactor at Samba end of 400 kV Kishenpur-Samba 400 kV line-165 km (Quad) [formed after bypassing of 400 kV Kishenpur – Kishenpur line (Quad) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400 kV D/c line(Quad)]</td> <td>           •420 kV, 80 MVAR switchable line reactors at Samba S/s end– 1 Nos.            •Switching equipment for 420 kV, 80 MVAR switchable line reactors at Samba S/s end – 1 no         </td> </tr> <tr> <td>5</td> <td>1x63 MVAR Switchable line reactor on each ckt at Jalandhar end of Kishenpur– Jalandhar D/c direct line -171km(Twin) (formed after bypassing both ckts of 400 kV Kishenpur – Samba D/c line</td> <td>           •420 kV, 63 MVAR switchable line reactors at Jalandhar S/s end– 2 Nos.            •Switching equipment for 420 kV, 63         </td> </tr> </tbody> </table>			Sl. No.	Description of Transmission Element	Scope of work (Type of Substation/Conductor capacity/km/no. of bays etc.)	1	LILO of 400 kV Kishenpur-Dulhasti line (Twin) at Kishtwar S/s along with associated bays at Kishtwar S/s	LILO Length- 3km •400 kV Kishenpur -Kishtwar (LILO section) shall be on Twin HTLS (with minimum 2100 MVA capacity) configuration •400 kV Dulhasti -Kishtwar (LILO section) shall be on Twin Zebra configuration •400 kV line bays at Kishtwar – 2 Nos. (GIS) (line bays at Kishtwar S/s end shall be rated accordingly)	2	400 kV Kishenpur-Samba D/c line (Quad) (only one circuit is to be terminated at Kishenpur utilizing 1 no. of 400 kV vacated line bay at Kishenpur S/s (formed with bypassing of one ckt of 400 kV Kishenpur – Kishenpur 400 kV D/c line (Quad) at Kishenpur) while second circuit would be connected to bypassed circuit of 400 kV Kishenpur – Kishenpur line (Quad))	Length -36 km (Quad)	3	Bypassing of one ckt of 400 kV Kishenpur – Kishenpur 400 kV D/c line (Quad) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400 kV D/c line(Quad), thus forming 400 kV Kishenpur - Samba (Quad) direct line (one ckt)		4	1x80 MVAR Switchable line reactor at Samba end of 400 kV Kishenpur-Samba 400 kV line-165 km (Quad) [formed after bypassing of 400 kV Kishenpur – Kishenpur line (Quad) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400 kV D/c line(Quad)]	•420 kV, 80 MVAR switchable line reactors at Samba S/s end– 1 Nos. •Switching equipment for 420 kV, 80 MVAR switchable line reactors at Samba S/s end – 1 no	5	1x63 MVAR Switchable line reactor on each ckt at Jalandhar end of Kishenpur– Jalandhar D/c direct line -171km(Twin) (formed after bypassing both ckts of 400 kV Kishenpur – Samba D/c line	•420 kV, 63 MVAR switchable line reactors at Jalandhar S/s end– 2 Nos. •Switching equipment for 420 kV, 63
Sl. No.	Description of Transmission Element	Scope of work (Type of Substation/Conductor capacity/km/no. of bays etc.)																			
1	LILO of 400 kV Kishenpur-Dulhasti line (Twin) at Kishtwar S/s along with associated bays at Kishtwar S/s	LILO Length- 3km •400 kV Kishenpur -Kishtwar (LILO section) shall be on Twin HTLS (with minimum 2100 MVA capacity) configuration •400 kV Dulhasti -Kishtwar (LILO section) shall be on Twin Zebra configuration •400 kV line bays at Kishtwar – 2 Nos. (GIS) (line bays at Kishtwar S/s end shall be rated accordingly)																			
2	400 kV Kishenpur-Samba D/c line (Quad) (only one circuit is to be terminated at Kishenpur utilizing 1 no. of 400 kV vacated line bay at Kishenpur S/s (formed with bypassing of one ckt of 400 kV Kishenpur – Kishenpur 400 kV D/c line (Quad) at Kishenpur) while second circuit would be connected to bypassed circuit of 400 kV Kishenpur – Kishenpur line (Quad))	Length -36 km (Quad)																			
3	Bypassing of one ckt of 400 kV Kishenpur – Kishenpur 400 kV D/c line (Quad) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400 kV D/c line(Quad), thus forming 400 kV Kishenpur - Samba (Quad) direct line (one ckt)																				
4	1x80 MVAR Switchable line reactor at Samba end of 400 kV Kishenpur-Samba 400 kV line-165 km (Quad) [formed after bypassing of 400 kV Kishenpur – Kishenpur line (Quad) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400 kV D/c line(Quad)]	•420 kV, 80 MVAR switchable line reactors at Samba S/s end– 1 Nos. •Switching equipment for 420 kV, 80 MVAR switchable line reactors at Samba S/s end – 1 no																			
5	1x63 MVAR Switchable line reactor on each ckt at Jalandhar end of Kishenpur– Jalandhar D/c direct line -171km(Twin) (formed after bypassing both ckts of 400 kV Kishenpur – Samba D/c line	•420 kV, 63 MVAR switchable line reactors at Jalandhar S/s end– 2 Nos. •Switching equipment for 420 kV, 63																			



**ANNEXURE II : CERTIFICATE OF INCORPORATION, ARTICLE OF ASSOCIATION & MEMORANDUM  
OF ASSOCIATION OF RAGHANESDA RE TRANSMISSION LIMITED**





सत्यमेव जयते

**GOVERNMENT OF INDIA  
MINISTRY OF CORPORATE AFFAIRS**

Central Registration Centre

**Certificate of Incorporation**

[Pursuant to sub-section (2) of section 7 and sub-section (1) of section 8 of the Companies Act, 2013 (18 of 2013) and rule 18 of the Companies (Incorporation) Rules, 2014]

I hereby certify that RAGHANESDA RE TRANSMISSION LIMITED is incorporated on this **THIRD** day of **DECEMBER TWO THOUSAND TWENTY FOUR** under the Companies Act, 2013 (18 of 2013) and that the company is Company limited by shares

The Corporate Identity Number of the company is **U42201DL2024GOI439548**

The Permanent Account Number (PAN) of the company is **AAOCR1285K\***

The Tax Deduction and Collection Account Number (TAN) of the company is **DELR50823D\***

Given under my hand at Manesar this **THIRD** day of **DECEMBER TWO THOUSAND TWENTY FOUR**

Certification signature by DS MINISTRY OF CORPORATE  
AFFAIRS, CRC MANESAR 1 (ROC.CRC@MCA.GOV.IN)\*,  
Validity Unknown

Digitally signed by  
DS MINISTRY OF CORPORATE  
AFFAIRS, CRC MANESAR 1  
Date: 2024.12.03 10:13:59 IST

**PRAMOD KUMAR**

Assistant Registrar of Companies/ Deputy Registrar of Companies/ Registrar of Companies

For and on behalf of the Jurisdictional Registrar of Companies

Registrar of Companies

Central Registration Centre

**Disclaimer:** This certificate only evidences incorporation of the company on the basis of documents and declarations of the applicant(s). This certificate is neither a license nor permission to conduct business or solicit deposits or funds from public. Permission of sector regulator is necessary wherever required. Registration status and other details of the company can be verified on [mca.gov.in](http://mca.gov.in)

Mailing Address as per record available in Registrar of Companies office:

**RAGHANESDA RE TRANSMISSION LIMITED**

Urjanidhi, First Floor, 1, Barakhamba Lane, Connaught Place, New Delhi, Central Delhi- 110001, Delhi

\*as issued by Income tax Department



**Form No. INC-33**

**e-MOA (e-Memorandum of Association)**  
[Pursuant to Schedule I (see Sections 4 and 5) to  
the Companies Act, 2013]]



Form language

English  Hindi

Refer instruction kit for filing the form

All fields marked in \* are mandatory

**\* Table applicable to company as notified under schedule I of the Companies Act, 2013**

(A - MEMORANDUM OF ASSOCIATION OF A COMPANY LIMITED BY SHARES  
B - MEMORANDUM OF ASSOCIATION OF A COMPANY LIMITED BY GUARANTEE AND NOT HAVING A SHARE CAPITAL  
C - MEMORANDUM OF ASSOCIATION OF A COMPANY LIMITED BY GUARANTEE AND HAVING A SHARE CAPITAL  
D - MEMORANDUM OF ASSOCIATION OF AN UNLIMITED COMPANY AND NOT HAVING SHARE CAPITAL  
E - MEMORANDUM OF ASSOCIATION OF AN UNLIMITED COMPANY AND HAVING SHARE CAPITAL)

A - MEMORANDUM OF  
ASSOCIATION OF A COMPANY  
LIMITED BY SHARES

**Table A/B/C/D/E**

1 The name of the company is

RAGHANESDA RE TRANSMISSION  
LIMITED

2 The registered office of the company will be situated in the State of

Delhi

3 (a) The objects to be pursued by the company on its incorporation are:

1. To develop Power System Network  
To plan, promote and develop an integrated and efficient power transmission system network in all its aspects including planning, investigation, research, design and engineering, preparation of preliminary, feasibility and definite project reports, construction, operation and maintenance of transmission lines, sub-stations, load dispatch stations and communication facilities and appurtenant works, coordination of integrated operation of state, regional and national grid system, execution of turn-key jobs for other utilities/organizations and wheeling of power in accordance with the policies, guidelines and objectives laid down by the Central Government from time to time.
2. To study, investigate, collect information and data  
To study, investigate, collect information and data, review operation, plan, research, design



87

and prepare Report, diagnose operational difficulties and weaknesses and advise on the remedial measures to improve, undertake development of new and innovative product connected with business of the Company as well as modernize existing EHV, HV lines and Sub-Stations.

3. To act as Consultants/ Technical Advisers of public/ private sector enterprises etc.

To act as consultants, technical advisors, surveyors and providers of technical and other services to Public or Private Sector enterprises engaged in the planning, investigation, research, design and preparations of preliminary, feasibility and definite project reports, manufacture of power plant and equipment, construction, generation, operation and maintenance of power transmission system from power generating stations and projects, transmission, distribution and sale of power.

(b) \*Matters which are necessary for furtherance of the objects specified in clause 3(a) are

1. To obtain authority etc. to carry out its objects  
To obtain license, approvals and authorization from Governmental Statutory and Regulatory Authorities, as may be necessary to carry out and achieve the Objects of the Company and connected matters which may seem expedient to develop the business interests of the Company in India and abroad.

2. To obtain charters, concession etc.

To enter into any arrangement with the Government of India or with any State Government or with other authorities/ commissions, local bodies or public sector or private sector undertakings, Power Utilities, Financial Institutions, Banks, International Funding Agencies and obtain such charters, subsidies, loans, advances or other money, grants, contracts, rights, sanctions.



privileges, licenses or concessions whatsoever (whether statutory or otherwise) which the Company may think it desirable to obtain for carrying its activities in furthering the interests of the Company or its members.

3. To enter into Implementation/ Construction Agreement

To enter into any agreement, contract or any arrangement for the implementation of the power generation, evacuation, transmission and distribution system and network with Power/Transmission Utilities, State Electricity Boards, Vidyut Boards, Transmission Companies, Generation Companies, Licensees, Statutory bodies, other organizations (whether in Private, Public or Joint Sector Undertaking) and bulk consumers of power etc.

4. To carry on the business or purchasing, importing, exporting and trading power  
To carry on the business or purchasing, importing, exporting and trading of power subject to the provisions of Electricity Act, 2003 and to supply electric power generated by other plants to distribution companies, trading companies, other generation companies and other Persons, and in this regard execute agreements with Central and State generating authorities, departments or companies, Independent Power Producers and other Persons.

5. To enter into Agreements; etc.  
To secure the payments of money, receivables on transmission and distribution of electricity and sale of fuel, as the case may be, to the State Electricity Boards, Vidyut Boards, Transmission Utilities, Generating Companies, Transmission Companies, Distribution Companies, State Governments, Licensees, statutory bodies, other organizations (whether in



Private, Public or Joint Sector Undertaking) and bulk consumers of power etc. through Letter of Credits/ESCROW and other security documents.

6. To execute transmission service Agreements

To execute Transmission Service Agreements or other agreements for transmission of power to distribution, trading, and other companies, State Electricity Boards, State Utilities and any other organization and Persons.

7. To co-ordinate with Central Transmission Utility  
To coordinate with the Central Transmission Utility for transmission of electricity under the provisions of Electricity Act 2003.

8. To borrow money  
Subject to provisions of Sections 73, 179, 180 and other applicable provisions of the Companies Act, 2013 and subject to other laws or directives, if any, of SEBI/RBI, to borrow money in Indian rupees or foreign currencies and obtain foreign lines of credits/ grants/aids etc. or to receive money or deposits from public for the purpose of the Company's business in such manner and on such terms and with such rights, privileges and obligations as the Company may think fit. The Company may issue bonds/ debentures whether secured or unsecured; bills of exchange, promissory notes or other securities, mortgage or charge on all or any of the immovable and movable properties, present or future and all or any of the uncalled capital for the time being of the Company as the Company may deem fit and to repay, redeem or pay off any such securities or charges.

9. To lend money  
To lend money on property or on mortgage of immovable properties or against Bank guarantee and to make advances of money against future supply of



goods and services on such terms as the Directors may consider necessary and to invest money of the Company in such manner as the Directors may think fit and to sell, transfer or to deal with the same.

10. To acquire, own, lease or dispose off the property

To own, possess, acquire by purchase, lease or otherwise rights, title and interests in and to, exchange or hire real estate, equipment, Transmission lines, lands, buildings, apartments, plants, equipment, machinery, fuel blocks and hereditaments of any tenure or descriptions situated in India or abroad or any estate or interest therein and any right over or connected with land so situated and turn the same to account in any manner as may seem necessary or convenient for the purpose of business of the Company and to hold, improve, exploit, re-organize, manage, lease, sell, exchange or otherwise dispose of the whole or any part thereof.

11. To deal in Scrips/Govt. Securities

Subject to applicable provisions of law, to subscribe for, underwrite, or otherwise acquire, hold, dispose of and deal with the shares, stocks, debentures or other securities and titles of indebtedness or the right to participate in profits or other similar documents issued by any Government authority, Corporation or body or by any company or body of persons and any option or right in respect thereof.

12. To create funds and appropriate profits

To create any depreciation fund, reserve fund, sinking fund, insurance fund, gratuity, provident fund or any other fund, for depreciation or for repairing, improving extending or maintaining any of the properties of the Company or for any other purposes whatsoever conducive

to the interests of the Company.

13. To purchase or otherwise acquire companies  
To acquire shares, stocks, debentures or securities of any company carrying on any business which this Company is entitled to carry on or acquisition of undertaking itself which may seem likely or calculated to promote or advance the interests of the Company and to sell or dispose of or transfer any such shares, stocks or securities and the acquired undertaking.

14. To enter into partnership Agreement or Merge /amalgamate

To enter into partnership or into any agreement for joint working, sharing or pooling profits, joint venture, amalgamation, union of interests, co-operation, reciprocal concessions or otherwise or amalgamate with any person or company carrying on or engaged in or about to carry on or engaged in any business or transaction in India or abroad which the Company is authorized to carry on or engage in any business undertaking having objects identical or similar to, as are being carried on by this Company.

15. To have agencies and branch offices in India and abroad

To establish and maintain agencies, branch offices and local agencies, to procure business in any part of India and world and to take such steps as may be necessary to give the Company such rights and privileges in any part of the world as deemed proper in the interest of the Company.

16. To promote institutions or other companies

To promote and undertake the formation of any institution or Company or subsidiary company or for any aforesaid objects intended to benefit the Company directly or indirectly and to coordinate, control and guide



their activities.

17(a) To acquire know how and import-export of machinery and tools etc.

To negotiate and enter into agreements and contracts with domestic and foreign companies, persons or other organizations, banks and financial institutions, in relation to the business of the Company including that of technical know-how, import, export, purchase or sale of plant, machinery, equipment, tools, accessories and consumables, financial assistance and for carrying out all or any of the objects of the Company.

17(b) To negotiate and enter into agreements etc.

To negotiate and enter into agreements and contracts for execution of turnkey jobs, works, supplies and export of plant, machinery, tools and accessories etc.

18. To enter into contracts/arrangements in connection with issue of shares/securities. Upon and for the purpose of any issue of shares, debentures or any other securities of the Company, to enter into agreement with intermediaries including brokers, managers of issue/commission agents and underwriters and to provide for the remuneration of such persons for their services by way of payment in cash or issue of shares, debentures or other securities of the Company or by granting options to take the same or in any other manner as permissible under the law.

19. To enter into contracts of indemnity and/or guarantee  
To enter into contracts of indemnity and get guarantee and allocations for the business of the Company.

20. To arrange for Training and Development  
To make arrangements for training of all categories of employees and to employ or otherwise engage experts,



advisors, consultants etc. in the interest of achieving the Company's objects.

21. To promote conservation, protect environment, theft etc.  
To promote conservation and protection of electricity from theft, safety of life and to protect environments including air, land and water etc.

22. To provide for welfare of employees  
To pay and provide for the remuneration, amelioration and welfare of persons employed or formerly employed by the Company and their families providing for pension, allowances, bonuses, other payments or by creating for the purpose from time to time the Provident Fund, Gratuity and other Funds or Trusts. Further to undertake building or contributing to the building or houses, dwellings or chawls by grants of money, or by helping persons employed by the Company to effect or maintain insurance on their lives by contributing to the payment of premium or otherwise and by providing or subscribing or contributing towards educational institutions, recreation, hospitals and dispensaries, medical and other assistance as the Company may deem fit.

23. To take Insurance  
To ensure any rights, properties, undertakings, contracts, guarantees or obligations or profits of the Company of every nature and kind in any manner with any person, firm, association, institution or company.

24. To share the profits pay, dividends and provide bonus etc  
To distribute among members of the Company dividend including bonus shares out of profits, accumulated profits or funds and resources of the Company in any manner permissible under law.

44



25. To institute and defend the legal proceedings

To institute, conduct, defend, compound or abandon any legal proceedings by or against the Company or its officers or otherwise concerning the affairs of the Company and also to compound and to allow time for payment or satisfaction of any debts or recovery due, claims or demands by or against the Company and to refer any claims or demands by or against the Company or any differences arising in execution of contracts to conciliation and arbitration and to observe, comply with and/or challenge any awards preliminary, interim or final made in any such arbitration.

26. To pay and subsequently write off preliminary expenses

To pay out of the funds of the Company all costs, charges, expenses and preliminary and incidental to the promotion, formation, establishment and registration of the Company or other expenses incurred in this regard.

27. To contribute and make donations

Subject to provisions of Companies Act, 2013 to contribute money or otherwise assist to charitable, benevolent, religious, scientific national, defense, public or other institutions or objects or purposes.

28. To open accounts in Banks

To open an account or accounts with any individual, firm or company or with any bank bankers or shrofs and to pay into and withdraw money from such account or accounts.

29. To accept gifts, donations etc.

To accept gifts, bequests, devises and donations from members and others and to make gifts to members and others of money, assets and properties of any kind.

30. To pursue the objects of the Company as principal, agents,

trustee or in any other capacity  
To carry out all or any of the  
objects of the company and do  
all or any of the above things in  
any part of the world and either  
as principal, agent, contractor or  
trustee or otherwise and either  
alone or in conjunction with  
others.

31. To enter into Contracts  
To negotiate and/or enter into  
agreement and contract with  
individuals, companies,  
corporations, foreign or Indian,  
for obtaining or providing  
technical, financial or any other  
assistance for carrying on all or  
any of the objects of the  
Company and also for the  
purpose of activating, research,  
development of projects on the  
basis of know-how and/or  
financial participation and for  
technical collaboration, and to  
acquire or provide necessary  
formulate and patent rights for  
furthering the objects of the  
company.

32. To contribute towards  
promotion of trade and industry  
To aid pecuniary or otherwise,  
any association, body or  
movement having for its object  
the solution, settlement or  
surmounting of industrial or  
labour problems or trouble or  
the promotion of industry or  
trade.

33. To take all necessary  
steps for winding up of the  
company

Subject to the provisions  
of Companies Act, 2013 or any  
amendment or re-enactment  
thereof in the event of winding  
up to distribute among the  
members in specie any property  
of the Company or any proceeds  
of sale on disposal of any  
property in accordance with the  
provisions of the Act.

34. To do and perform all  
coincidental and ancillary acts for  
the attainment of its objects

To do all such other  
things as may be deemed

incidental or conducive to the attainment of the above Objects or any of them and to carry on any business which may seem to the Company capable of being conveniently carried in connection with any of the Company's Objects or calculated directly or indirectly to enhance the value of or render profitable any of the Company's property or rights.

35. To take up studies and research experiments. To establish, provide, maintain and conduct or otherwise subsidize research laboratories and experimental workshops for scientific, technical or researches, experiments and to undertake and carry on directly or in collaboration with other agencies scientific and technical research experiments and tests of all kinds and to process, improve and invent new products and their techniques of manufacture and to promote, encourage, reward in every manner studies and research, scientific and technical investigations and inventions of any kind that may be considered likely to assist, encourage and promote rapid advances in technology, economies, import substitution or any business which the Company is authorized to carry on.

36. To evolve scheme for restructuring or arrangement. Subject to provisions of the Companies Act, 2013, to evolve scheme for restructuring or arrangement, to amalgamate or merge or to enter into partnership or into any consortium or arrangement for sharing of profits, union of interests, co-operation, joint venture with any Person or Persons, partnership firm/firms, or company or companies carrying on or engaged in any operation capable of being conducted so conveniently in co-operation with the business of the Company or to benefit the



Company or to the activities for which the Company has been established.

37. To apply for purchase, or otherwise acquire.

To apply for purchase, or otherwise acquire any trademarks, patents, brevets, inventions, licenses, concessions and the like, conferring any exclusive or nonexclusive or limited rights to use, or any secret or other information as to any invention which may be capable of being used for any of the purposes of the Company, or the acquisition of which may benefit the Company and to use, exercise, develop or grant licenses in respect of or otherwise turn to account the property, rights or information so acquired.

38. To sell, dispose or hive off an undertaking of the Company

To sell, dispose or hive off an undertaking of the Company or any part thereof for such consideration as the Company may think fit and in particular for shares, debentures or securities of any other association, corporation or company.

39. To sell, improve, manage, develop  
To sell, improve, manage, develop, exchange, loan, lease or let, under-lease, sub - let, mortgage, dispose of, deal with in any manner, turn to account or otherwise deal with any rights or property of the Company.

40. To outsource parts of its activities

To outsource parts of its activities to achieve higher efficiencies and throughputs in the achievement of its business goals.

4 The liability of the member(s) is limited, and this liability is limited to the amount unpaid if any, on the shares held by them.



5 Every member of the company undertakes to contribute:

(i) to the assets of the company in the event of its being wound up while he is a member, or within one year after he ceases to be a member, for payment of the debts and liabilities of the company or of such debts and liabilities as may have been contracted before he ceases to be a member; and

(ii) to the costs, charges and expenses of winding up (and for the adjustment of the rights of the contributories among themselves), such amount as may be required, not exceeding \*  rupees.

(iii) The share capital of the company is  rupees, divided into

10000	Equity Share	Shares of	10	Rupees each	
-------	--------------	-----------	----	-------------	--

6

We, the several persons, whose names and address are subscribed, are desirous of being formed into a company in pursuance of this memorandum of association, and we respectively agree to take the number of shares in the capital of the company set against our respective names:

I, whose name and address is given below, am desirous of forming a company in pursuance of this memorandum of association and agree to take all the shares in the capital of the company:

We, the several persons, whose names and addresses are subscribed, are desirous of being formed into a company in pursuance of this memorandum of association:



**Subscriber Details**

S. No.	*Name, Address, Description and Occupation	DIN / PAN / Passport number	No. of shares taken	DSC	Dated
1	Sh. Rakesh Mohan S/o Sh. Lakshman Singh R/o Flat No-364, Sunehari Bagh Appartment, Sector-13 Rohini New Delhi Delhi 110085 NA India (As a Nominee of PFC Consulting Limited) Occupation:- Service	0*6*4*2*	100 Equity,0 Preference		02/12/2024
2	Sh. Naveen Kumar S/o Jagdish Chander R/o F-024, Assotech Windsor Court, Sector 78, Noida Gautam Buddha Nagar, Uttar Pradesh, 201301 (As a nominee of PFC Consulting Limited) Occupation - Service	1*4*7*5*	100 Equity,0 Preference		02/12/2024
3	M/s PFC Consulting Limited having its registered office at Urjanidhi, 1, Barakhamba Lane, Connaught Place, New Delhi-110001 Through Sh. Sachin Arora S/o Sh. Prem Lal Arora R/o F5 1903, Supertech Eco Village 1, Near Park, Greater Noida, 201301 (as authorized representative of PFC Consulting Limited)	A*G*A*4*4*	9400 Equity,0 Preference		02/12/2024
4	Sh. Sanjay Kumar Nayak S/o Sh. Jagabandhu Nayak R/o K 713, Jalvayu Tower, Sector 56 Gurgaon-Haryana 122011 (As a Nominee of PFC Consulting Limited) Occupation:- Service	0*1*7*9*	100 Equity,0 Preference		02/12/2024
5	Sh. Sachin Shukla S/o Sh. Raj Kumar Shukla R/o 4th Floor, House No. 6, H1 Block, Good Earth City Centre, south City 2, Gurgaon - 122018 (As a Nominee of PFC Consulting Limited) Occupation:- Service	0*6*3*6*	100 Equity,0 Preference		02/12/2024
6	Sh. Neeraj Singh S/o Sh. Dayashankar Singh R/o Flat C-703, The Crescent Apartment, Plot F-2, Sector-50, Noida, Gautam Budh Nagar, UP-201301 (As a Nominee of PFC Consulting Limited) Occupation:- Service	0*6*3*9*	100 Equity,0 Preference		02/12/2024



7	Sh. Rishab Jain S/o Naveen Jain R/o T-11, first floor, Green Park Extension, New Delhi, 110016 (As a Nominee of PFC Consulting Limited) Occupation:- Service	0*4*5*6*	100 Equity,0 Preference		02/12/2024
<b>Total shares taken</b>			10000 Equity,0 Preference		

**Signed before me**

Membership type of the witness (ACA/FCA/ACS/FCS/AC MA/FCMA)	*Name of the witness	*Address, Description and Occupation	DIN / PAN / Passport number / Membership number	DSC	Dated
FCS	Naresh Kumar Sinha	121, Vinayak Apartment, C58/19, Sector-62, Noida-201307, UP	1*0*		02/12/2024

7 Shri / Smt   Of  resident of  
 aged  years shall be the nominee in the event of death of the sole member.





**Form No. INC-34**

**e-AOA (e-Articles of Association)**

[Pursuant to Section 5 of the Companies Act, 2013 and rules made thereunder read with Schedule I]



Form language

English  Hindi

Refer instruction kit for filing the form

All fields marked in \* are mandatory

Table applicable to company as notified under schedule I of the Companies Act, 2013 (F, G, H)

F

Table F / G / H (basis on the selection of above-mentioned field) as notified under schedule I of the companies Act, 2013 is applicable to

(F - a company limited by shares

G - a company limited by guarantee and having a share capital

H - a company limited by guarantee and not having share capital)

F - A COMPANY LIMITED BY SHARES

The name of the company is

RAGHANESDA RE TRANSMISSION LIMITED

Check if not applicable	Check if altered	Article No.	Description
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<b>Interpretation</b>
			<ul style="list-style-type: none"> <li>• INTERPRETATION1. Interpretation clause In the interpretation of these Articles unless repugnant to the subject or context- Act The Act means The Companies Act 2013 as amended from time to time and includes any statutory modification or re-enactment thereof for the time being in force. Articles of the Company Articles means the articles of association of a company as originally framed or as altered from time to time or applied in pursuance of any previous company law or of this Act. Auditor(s) Auditor(s) mean and include persons appointed as such for the time being by the Comptroller Auditor General of India. Board or Board of Directors Board or Board of Directors in relation to a company means the collective body of the directors of the company. Books of Account Books of account includes records maintained in respect of (i) all sums of money received and expended by a company and matters in relation to which the receipts and expenditure take place (ii) all sales and purchases of goods and services by the company (iii) the assets and liabilities of the company and (iv) the items of cost as may be prescribed under section 148 in the case of a company which belongs to any class of companies specified under that section. Capital Capital means the share capital for the time being raised or authorized to be raised for the purpose of the Company. Company Shall means RAGHANESDA RE TRANSMISSION LIMITED Debenture Debenture includes debenture stock bonds or any other instrument of a company evidencing a debt whether constituting a charge on the assets of the company or not. Director(s) Director means a director appointed to the Board of a company under Section 2(34) of the Act. Dividend Dividend includes any interim dividend. Financial Institution Financial Institution includes a scheduled bank and any other financial institution defined or notified under the Reserve Bank of India Act 1934. Gender Words importing the masculine gender also include the feminine gender. Generation</li> </ul>



Company Generation Company shall mean any entity engaged in the business of generation of electricity. In Writing and Written In writing and Written include printing lithography and other modes of representing or reproducing words in a visible form. key managerial personnel key managerial personnel in relation to a company means (i) the Chief Executive Officer or the managing director or the manager (ii) the company secretary (iii) the whole-time director (iv) the Chief Financial Officer and (v) such other officer as may be prescribed. Meeting or General Meeting Meeting means Annual General Meeting or Extraordinary General Meeting of Members duly called and constituted including an adjourned meeting. In the context of Board of Directors it shall mean the meeting of the Directors including an adjourned meeting. Member Member in relation to a company means (i) the subscriber to the memorandum of the company who shall be deemed to have agreed to become member of the company and on its registration shall be entered as member in its register of members (ii) every other person who agrees in writing to become a member of the company and whose name is entered in the register of members of the company (iii) every person holding shares of the company and whose name is entered as a beneficial owner in the records of a depository. Month Month means a calendar month. Office Office means the Registered Office of the company for the time being. paid-up share capital or share capital paid-up means such aggregate amount of money credited as paid-up as is equivalent to the amount received as paid up in respect of shares issued and also includes any amount credited as paid-up in respect of shares of the company but does not include any other amount received in respect of such shares by whatever name called. Persons Persons include Corporations and firms as well as individuals. Power Transmission Utility Power Transmission Utility shall mean any entity engaged in the business of power transmission. Proxy Proxy includes Attorney duly constituted under a valid Power of Attorney. Project-In-Charge A Director of the Company designated as Project In-charge for administering day to day activities of the Company. Public Company Public Company means a company which a. is not a private company and b. has a minimum paid-up share capital as may be prescribed. Provided that a company which is a subsidiary of a company not being a private company shall be deemed to be public company for the purposes of this Act even where such subsidiary company continues to be a private company in its articles. Registrar Registrar means a Registrar an Additional Registrar a Joint Registrar a Deputy Registrar or an Assistant Registrar having the duty of registering companies and discharging various functions under this Act. Register of Members Register of Members means the Register of Members to be kept pursuant to the Act. Related Party Section 2(76) of the Act describes related party with reference to a company which means (i) a director or his relative (ii) a key managerial personnel or his relative (iii) a firm in which a director manager or his relative is a partner (iv) a private company in which a director or manager is a member or director (v) a public company in which a director or manager is a director or holds along with his relatives more than two per cent. of its paid-up share capital (vi) any body corporate whose Board of



Directors managing director or manager is accustomed to act in accordance with the advice directions or instructions of a director or manager (vii) any person on whose advice directions or instructions a director or manager is accustomed to act Provided that nothing in sub-clauses (vi) and (vii) shall apply to the advice directions or instructions given in a professional capacity (viii) any company which is (A) a holding subsidiary or an associate company of such company or (B) a subsidiary of a holding company to which it is also a subsidiary (ix) such other person as may be prescribed. Seal Means the common seal of the company for the time being. Securities Exchange Board Securities and Exchange Board means the Securities and Exchange Board of India established under section 3 of the Securities Exchange Board of India Act 1992. Securities Securities means the securities as defined in clause (h) of section 2 of the Securities Contracts (Regulation) Act 1956. Share Means a share in the share capital of a company and includes stock. Share Capital Share Capital means the total equity share capital of the Company agreed to be issued and called the Authorized Capital of the Company as mentioned in the Memorandum of Association of the Company. Singular Number Words importing the singular number include where the context admits the plural number and vice-versa. State Electricity Board State Electricity Board means the Electricity Board or Vidyut Board or any other body by whatever name called set up by the State Governments under Electricity (Supply) Act 1948 as amended which expression shall include its successors administrators authorized representatives and permitted assigns. Transmission Company Transmission Company shall mean any entity engaged in the business of transmission of electricity. Year or Financial Year Meaning of Words Year means English calendar year and Financial Year shall have the meaning assigned thereto by Section 2(41) of the Act. Unless the context otherwise requires words or expressions contained in these regulations shall bear the same meaning as in the Act or any statutory modification thereof in force at the date at which these regulations become binding on the company. Marginal Notes Marginal Notes are for ease of reference only and shall not affect the construction and interpretation of these Articles. Other Expressions Other words or expressions contained in these Articles shall bear the same meaning as are assigned to them in the Act or any statutory modifications thereof. 2. Table F not to Apply The regulations contained in Table F in the First Schedule to the Companies Act 2013 shall not apply except to the extent that the same are repeated or contained or expressly made applicable by these Articles or by the Act but the regulations for the management of the Company and for the observance of the members thereof and their representatives shall subject to any exercise of the statutory powers of the Company with reference to the repeal or alteration of or addition to its regulations by Special Resolution as prescribed by the said Companies Act 2013 be such as contained in these Articles. BUSINESS PURPOSE 3. Business Purpose The Company shall be engaged in the business of Transmission of Electricity including construction operation maintenance and other related activities.



		<b>Share Capital and Variation of rights</b>	
<input type="checkbox"/>	<input checked="" type="checkbox"/>	11	<ul style="list-style-type: none"> <li>4. Share Capital Increase of capital by the Company and how carried into effect The Authorized Share Capital of the Company is as mentioned in clause V of the Memorandum of Association of the Company. The Company in General Meeting may from time to time by resolution increase its authorized share capital by creation of new shares such increase to be of such aggregate amount and to be divided into shares of such respective amounts as may be determined by the General Meeting subject to the provisions of the Act.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	2	<ul style="list-style-type: none"> <li>5. New Capital same as existing capital Any capital raised by the creation of new shares shall be considered as part of the original capital and shall be subject to the same provisions herein contained with reference to the payment of calls and installments forfeiture lien surrender transfer and transmission voting and otherwise.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	3	<ul style="list-style-type: none"> <li>6. Reduction of Capital The Company may from time to time by special resolution reduce its capital which may be paid off either with or without extinguishing or reducing liability on shares which is in excess of the wants of the company or canceling such share capital which has been lost or is unrepresented by available assets.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	4	<ul style="list-style-type: none"> <li>7. Subdivision and consolidation of shares The Company in general meeting may from time to time sub-divide or consolidate its shares or any of them and exercise any of the other powers conferred by Section 61 of the Act and shall file with the Registrar such notice of exercise of any such powers as may be required by the Act.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	5	<ul style="list-style-type: none"> <li>8. Register and Index of Members Beneficial owners The Company shall cause to be kept a Register and also an Index of Members and Debenture-holders in accordance with Sections 88 of the Act. Further as permissible under Section 88 of the Act the register and Index of beneficial owners maintained by a Depository shall be deemed to be the corresponding Register and Index for the purpose of this Act.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	6	<ul style="list-style-type: none"> <li>9. Foreign Register of members The Company shall be entitled to keep in any country outside India a Foreign Register of members resident in that country subject to compliance with the provisions of Section 88 of the Act.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	7	<ul style="list-style-type: none"> <li>10. Shares to be numbered distinctively The shares in the capital held otherwise than in the depository mode shall be numbered progressively in sequence and given distinctive number Except and in the manner herein mentioned no share shall be forfeited or surrendered and shall continue to bear the number which it had originally borne.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<ul style="list-style-type: none"> <li>11. Share Application Money The Company shall ensure that the share application money paid is held by it in an account with a Scheduled Commercial Bank (in the name of the Company)</li> <li>12. Further Issue of Capital (a) Where at any time the Company wishes to raise its subscribed share capital by issue of further shares it shall first offer such shares to its existing shareholders in proportion to their existing shareholdings on the date of such issue.</li> </ul>

Such offer to the existing shareholders shall be in accordance with the provisions of Section 62 of the Act. (b) The Company shall subject to applicable provisions of the Act and Articles of Association make uniform calls from time to time upon all the Shareholders in respect of the moneys remaining unpaid on the issued share capital within 30 days or such time as the Board may deem fit and appropriate.13. Shares under control of DirectorsSubject to the provisions of these Articles and of the Act the shares including any shares forming part of any increased capital of the Company shall be under the control of the Directors who may allot or otherwise dispose off the shares to such persons in such proportion on such terms and conditions and at such times as the Directors may think fit and subject to the sanction of the Company in General Meeting subject to the provisions of Sections 52 and section 54 of the Act at a premium or par and such option being exercisable for such time and for such consideration as the Directors think fit. The Board shall cause to be filed the returns as to allotment provided for in Section 39(4) of the Act.14. Issue of shares for consideration other than cashSubject to these Articles and the provisions of the Act if any the Board may issue and allot shares in the capital of the Company as payment or in consideration or as part payment or in part consideration of the purchase or acquisition of any property or for services rendered to the Company in the conduct of its business and shares which may be so issued or allotted shall be credited or deemed to be credited as fully paid up or partly paid up shares.15. Power of Company to Issue SharesThe Company in General Meeting may subject to the provisionsof Section 42 62 of the Act provide that any shares (whether forming partof the original capital or of any increased capital of the Company) shall be offered to such persons (whether a Member or not) in such proportion and onsuch terms and conditions of the Act) at a premium or at par or at a discountas such General Meeting shall determine and with full power to give any person(whether a Member or not) the option to call for or be allotted shares of anyclass of the Company either subject to compliance with the provisions ofSections 52 and 54 of the Act at a premium or at par or at discount suchoption being exercisable at such times and for such consideration as may bedirected by such General Meeting or the Company in General Meeting may make anyother provisions whatsoever for the issue allotment or disposal of any shares.16. Acceptance of sharesAny person applying for shares in the Company followed by an allotment of any shares and subscribers to the Memorandum shall be ashareholder within the meaning of these Articles and every person whose nameis on the Register of Members shall for the purposes of these Articles be aMember of the Company.17. Deposit call to be a debt payable ImmediatelyThe Money (if any) which the Board shall on theapplication for allotment of any shares being made by them require or directto be paid by way of deposit call or otherwise in respect of any sharesallotted by them shall immediately on the insertion of the name of theallottee in the Register of Members as the name of the holder of such sharesbecome a debt due to and recoverable by the Company from the allottee thereofand shall be paid by him accordingly.18. Liability of MembersEvery Member



or his heirs executors or administrators shall pay to the Company the portion of the capital and premium if any represented by or payable on his share or shares which may for the time being remain unpaid thereon in such amounts at such time or times and in such manner as the Board shall from time to time in accordance with the Companies regulations require or fix for the payment thereof.

19. Share Certificates A certificate issued under the common seal of the company specifying the shares held by any person shall be prima facie evidence of the title of the person to such shares. (a) Every Member or allottee of shares who is holding such shares in the physical form shall be entitled without payment to receive certificate specifying the name of the person in whose favour it is issued the shares to which it relates and the amount paid-up thereof. Such certificates shall be issued only in pursuance of a resolution passed by the Board and on surrender to the Company of the letter of allotment or the fractional coupon of requisite value save in case of issues against letters of acceptance or of renunciation or in cases of issue of bonus shares. Every such certificate shall be issued under the seal of the Company which shall be affixed in the presence of two Directors and the Secretary or some other person appointed by the Board for the purpose and the two directors and the Secretary or other persons as authorized by the Board shall sign the share certificate. Provided if the composition of the Board permits of it at least one of the aforesaid two directors shall be a person other than a Managing or a Whole Time Director. Particulars of every share certificate issued shall be entered in the Register of Members against the name of the person to whom it has been issued indicating the date of issue. For issue of any further duplicate certificate the Board shall be entitled to charge such amount which shall not exceed fifty Rupees per Certificate. (b) A Director may sign a share certificate by affixing his signature thereon by means of any machine equipment or other mechanical means such as engraving in metal or lithography but not by means of a rubber stamp. PROVIDED that the Director shall be personally responsible for the safe custody of such machine equipment or other material used for the purpose.

20. Renewal of Share Certificates (a) No certificate of any share or shares shall be issued either in exchange for those which are sub-divided or consolidated or in replacement of those which are defaced mutilated torn or old decrepit destroyed or where the pages on the reverse for recording transfers have been duly utilized unless the certificate in lieu of which it is issued is surrendered to the Company and for issuing such share certificate the company may charge such fee as the Board thinks fit not exceeding twenty rupees per certificate. (b) When a new share certificate has been issued in pursuance of clause (a) of this Article it shall state on the face of it and against the stub or counterfoil to the effect that it is issued in lieu of share certificate No sub-divided replaced on consolidation. (c) If a share certificate is lost or destroyed a new certificate in lieu thereof shall be issued only with the prior consent of the Board and on such reasonable terms such as furnishing supporting evidence and indemnity and the payment of out-of-pocket expenses incurred by the Company in investigating evidence produced as the

8



5e

Board thinks fit. (d) When a new share certificate has been issued in pursuance of clause (c) of this Article it shall state on the face of it and against the stub or counterfoil to the effect that it is duplicate issued in lieu of share certificate No. and the word duplicate shall be stamped or printed prominently on the face of the share certificate. (e) Where a new share certificate has been issued in pursuance of clause (a) and or clause (c) of this Article particulars of every such share certificate shall be entered in a Register of Renewed and Duplicate Share Certificates indicating against the name(s) of the person(s) to whom the certificate is issued the number and date of issue of the share certificate in lieu of which the new certificate is issued and the necessary changes indicated in the Register of Members by suitable cross reference in the Remarks column. (f) All blank forms to be used for issue of share certificates shall be printed and the printing shall be done only on the authority of a resolution of the Board and the blank forms shall be consecutively machine-numbered and the forms and the blocks engravings facsimiles relating to the printing of such forms shall be kept in the custody of the Secretary or of such other person as the Board may appoint for the purpose and the Secretary or the other person aforesaid shall be responsible for rendering an account of these forms to the Board. (g) The Committee of the Board Company Secretary of the Company or a Director specifically authorized by the Board for such purposes shall be responsible for the maintenance preservation and safe custody of all books and documents relating to the issue of share certificates including the blank forms of share certificates referred to in clause (f). (h) All books referred to in clause (g) shall be preserved in good order for not less than thirty years and in disputed cases shall be preserved permanently.

21. Joint holders (a) Where two or more persons are registered as the holders of any share they shall be treated as a single shareholder and shall be deemed to hold the same as joint holders with benefits of survivorship subject to the following and other provisions contained in these Articles. (b) The Company shall be entitled to decline to register more than four persons as the holders of any share. (c) The Joint holders of any share shall be liable severally as well as jointly for and in respect of all calls and other payments which ought to be made in respect of such shares. (d) On the death of any such joint holder the survivor or survivors shall be the only person or persons recognized by the Company as having any title to the share but the Directors may require such evidence of death as they may deem fit and nothing herein contained shall be taken to release the estate of the deceased joint holder from any liability on shares held by him jointly with any other person. (e) Delivery of share certificate to any one of such joint holders shall be deemed to be delivery to all of them and any one of such joint holders may give effectual discharge and receipts for any dividends or other moneys payable in respect of such shares and or in respect of any other obligation of the Company towards them. (f) Only the person whose name stands in the Register of Members as the first of the joint holders of any shares shall be entitled to delivery of the certificate relating to such share or to receive notices from the Company and any notice given to such person shall be deemed proper.



			<p>notice to all joint holders. (g) Any one of two or more joint holders may vote at any meeting either personally or by proxy in respect of such share as if he were solely entitled thereto and if more than one of such joint holders be present at any meeting personally or by proxy the holder whose name stands first or higher (as the case may be) on the Register of Members in respect of such shares shall alone be entitled to vote in respect thereof. PROVIDED always that a member present at any meeting personally shall be entitled to vote in preference to a person present by proxy although the name of such person present by proxy stands first on the Register of Members in respect of such shares.</p> <p>22. Terms and Conditions of Preference Shares Subject to the provisions of section 55 any preference shares may with the sanction of an ordinary resolution be issued on the terms that they are to be redeemed on such terms and in such manner as the company before the issue of the shares may by special resolution determine.</p>
			<b>Lien</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	9	<ul style="list-style-type: none"> <li>23. Company to have lien on shares The Company shall have a first and paramount lien upon all shares (other than fully paid up shares) registered in the name of each member (whether solely or jointly with others) and upon the sale proceeds thereof for all moneys (whether presently payable or not) called or payable at a fixed time in respect of all such shares (not being fully paid up) for all moneys presently payable by him or his estate to the Company. Any such lien shall extend to all dividends payable and bonuses declared from time to time declared in respect of such shares.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	10	<ul style="list-style-type: none"> <li>24. Enforcing lien by sale For the purpose of enforcing such lien the Board may sell the shares subject thereto in such manner as they shall think fit and for that purpose it may cause to be issued a duplicate certificate in respect of such shares and may authorize one of their Directors to execute a transfer thereof on behalf of and in the name of the Board. No sale shall be made until notice period for making call as aforesaid have expired and until notice in writing of the intention to sell shall have been made known to the shareholder for default in payment and default has been made by him in the payment of money called in respect of such shares for thirty days after the date of such notice. Upon issue of a duplicate certificate or certificates in lieu of the original share the certificate or certificates originally issued shall stand cancelled and become null and void and the same shall have no effect.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	11	<ul style="list-style-type: none"> <li>25. Application of proceeds of sale The net proceeds of any such sale shall be received by the Company and applied in or towards payment of such part of the amount as is presently payable and the residue if any shall (subject to a like lien for sums not presently payable as existed upon the shares before sale) be paid to the person entitled to the shares at the date of the sale.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	12	•
			<b>Calls on shares</b>

<input type="checkbox"/>	<input checked="" type="checkbox"/>	13	<ul style="list-style-type: none"> <li>• 26. Directors may make callsThe Board may from time to time subject to the terms on which any shares may have been issued and subject to the conditions of allotment by a resolution passed at a meeting of the Board (and not by resolution by circulation) make such call as it thinks fit upon the Members in respect of all moneys unpaid on the shares held by them respectively and each member shall pay the amount of every call so made on him to the person or persons and at the times and places appointed by the board. A call may be made payable by installments.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	14	<ul style="list-style-type: none"> <li>• 27. Notice of callsNot less than thirty days notice in writing of any call shall be given by the Company specifying the time and place of payment and the person or persons to whom such call shall be paid.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	15	<ul style="list-style-type: none"> <li>• 28. When call madeA call shall be deemed to have been made at the time when the resolution of the Board authorizing such call was passed at a meeting of the Board and demand notice is issued.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	16	<ul style="list-style-type: none"> <li>• 29. Calls may be revoked or postponedA call may be revoked or postponed at the discretion of the Board.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	17	<ul style="list-style-type: none"> <li>• 30. Directors may extend time The Board may from time to time at its discretion extend the time fixed for the payment of any call and may extend such time as to all or any of the Members for reasons which the Board may consider satisfactory but no Member shall be entitled to such extension save as a matter of grace.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	18	<ul style="list-style-type: none"> <li>• 31. Calls to carry interestIf any Member fails to pay any call due from him on the day appointed for payment thereof or any such extension thereof as aforesaid he shall be liable to pay interest on the same from the day appointed for the payment thereof to the time of actual payment at rate not exceeding 10 per cent per annum as maybe decided by the Board but the Board may in its absolute discretion and in special circumstances waive or reduce the levy of interest as deemed appropriate.32. Sums deemed to be callAny sum which by the terms of issue of a share becomes payable on allotment or at any fixed date whether on account of the nominal value of the share or by way of premium shall for the purposes of these Articles be deemed to be a call duly made and payable on the date on which by the terms of issue the same becomes payable and in case of non-payment all therelevant provisions of these Articles as to payment of interest and expenses forfeiture or otherwise shall apply as if such sum had become payable by virtue of a call duly made and notified.33. Partial payment not to preclude ForfeitureNeither the receipt by the Company of a portion of any money which shall from time to time be due from any Member to the Company in respect of his shares either by way of principal or interest nor any indulgence granted by the Company in respect of the payment of any such money shall preclude the Company from thereafter proceeding to enforce a forfeiture of such shares as hereinafter provided.34. Payment in anticipation of calls may carry interestThe Board may if it thinks fit agree to and in anticipation receive from any Member willing to advance the same all of calls money or any part of the amounts of his respective shares beyond the sums actually called up and upon the moneys so paid</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		

		<p>in advance or upon so much thereof from time to time and at any time thereafter as exceeds the amount of the calls then made upon and due in respect of the shares on account of which such advances are made the Board may pay or allow interest at such rate as the Member paying the sum in advance and the Board agree upon. The Board may agree to repay at any time any amount so advanced or may at any time repay the same upon giving to the Member three months notice in writing. PROVIDED that moneys paid in advance of calls on any shares may carry interest but shall not confer a right to dividend or to participate in profits. (b) No Member paying any such sum in advance shall be entitled to voting rights in respect of the moneys so paid by him until the same would but for such payment become presently payable.</p>	
		<b>Transfer of shares</b>	
<input type="checkbox"/>	<input checked="" type="checkbox"/>	19	<ul style="list-style-type: none"> <li>35. Register of Transfers The Company shall maintain a Register of Transfers and therein shall be fairly and distinctively enter the particulars of every transfer or transmission of any share in the physical form.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	20	<ul style="list-style-type: none"> <li>36. Form of transfer The instrument of transfer shall be in writing and in such form as prescribed under the Act. All the provisions of Section 56 of the Act shall be duly complied with in respect of all transfers and of the registration thereof. The Company shall not charge any fee for registration of a transfer of shares or debentures.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	21	<ul style="list-style-type: none"> <li>37. Instrument of Transfer to be completed and presented to the Company The Instrument of Transfer duly stamped and executed by the transferor and the transferee shall be delivered to the Company in accordance with the provisions of the Act. The instrument of transfer shall be accompanied by the Share Certificate or such evidences the Board may require to prove the title of transferor and his right to transfer the shares and every registered Instrument of Transfer shall remain in the custody of the Company until destroyed by order of the Board. Any instrument of transfer which the Directors may decline to register shall be returned to the person depositing the same.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	22	<ul style="list-style-type: none"> <li>38. Transferor deemed to be holder The transferor shall be deemed to be the holder of such shares until the name of the transferee shall have entered in the Register of Members in respect thereof. Before the registration of a transfer the certificate or certificates of the shares must be delivered to the Company along with Transfer Deed.</li> <li>39. No transfer to insolvent etc. No transfer shall be made to a person of unsound mind or to an insolvent.</li> <li>40. Closure of Register of Members Debenture holders The Directors shall have power on giving not less than seven days previous notice as required by Section 91 of the Act to close the Register of Transfer Register of Members or Register of Debenture holders or the register of other security holders of the Company for any period or periods not exceeding in the aggregate forty-five days in each year (but not exceeding thirty days at any one time) as they may determine.</li> <li>41. Nomination by shareholder Every share-holder or debenture holder may at any time nominate in the prescribed manner a person to whom his shares or debentures shall vest in the event of his death as provided in Section 72 of the Act.</li> <li>42. Title to</li> </ul>

62



		<p>shares of deceased holderIn the event there is no nomination the executors or administrators of a deceased Member or the holder of a Succession Certificate in respect of the shares of a deceased Member (not being one of two or more joint holders) shall be the only persons whom the Company will be bound to recognize as having any title to the shares registered in the name of such Member and the Company shall not be bound to recognize such executors or administrators or holders unless such executors administrators or holders shall have first obtained probate or Letters of Administration or Succession Certificate as the case may be from a duly constituted Court in India. PROVIDED that the Directors may at their absolute discretion dispense with production of Probate Letters of Administration or Succession Certificate upon such terms as to indemnity or otherwise as they think fit and may enter the name of the person who claims to be absolutely entitled to the shares standing in the name of a deceased Member as a Member.</p>
		<p><b>Transmission of shares</b></p>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	<p>23</p> <ul style="list-style-type: none"> <li>43. Transmission of Shares Subject to the provisions of the Act any person becoming entitled to any share in consequence of the death lunacy or insolvency of any Member or by any lawful means other than by a transfer in accordance with these Articles may with the consent of the Directors (which they shall be under no obligation to give) and upon producing such evidence that he sustains the character in respect of which he proposes to act under this. Article or of his title as the Directors may require and upon such indemnity as the Directors may require either be registered as a Member in respect of such shares or elect to have some person nominated by him and approved by the Directors registered as a Member in respect of such shares. PROVIDED that if such person shall elect to have his nominee registered he shall testify his election by executing in favor of his nominee an instrument of transfer in accordance with these Articles and until he does so he shall not be freed from any liability in respect of such shares.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	<p>24</p> <ul style="list-style-type: none"> <li>44 Right of Board to decline or suspend registration (i) Any person becoming entitled to a share in consequence of the death or insolvency of a member may upon such evidence being produced as may from time to time properly be required by the Board and subject as hereinafter provided elect either –(a) to be registered himself as holder of the share or (b) to make such transfer of the share as the deceased or insolvent member could have made. (ii) The Board shall in either case have the same right to decline or suspend registration as it would have had if the deceased or insolvent member had transferred the share before his death or insolvency.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	<ul style="list-style-type: none"> <li>45. The Company not liable for disregard of notice prohibiting registration of transfer The Company shall incur no liability or responsibility whatever in consequence of its registering or giving effect to any transfer of shares made or purported to be made by any apparent legal owner thereof (as shown or appearing in register of Members) to the prejudice of persons having</li> </ul>



	25	<p>or claiming any equitable right title or interest to or in the same shares notwithstanding that the Company may have had notice of such equitable right title or interest or notice prohibiting registration of such transfer and may have entered such notice or referred to it in any book or attended or given effect to any notice which may have been given to it of any equitable right title or interest or be under any liability whatsoever for refusing or neglecting so to do though it may have been entered or referred to in some book of the Company but the Company shall nevertheless be at liberty to regard and attend to any such notice and give effect thereto if the Directors shall so think fit.</p>
<input type="checkbox"/> <input checked="" type="checkbox"/>	26	<ul style="list-style-type: none"> <li>46. Rights of successors A person becoming entitled to a share by reason of the death or insolvency of the holder shall be entitled to the same dividends and other advantages to which he would have been entitled if he were the registered holder of the shares except that he shall not before being registered as a Member in respect of the shares be entitled to exercise any right conferred by membership in relation to meetings of the Company. PROVIDED that the Directors shall at any time give notice requiring any such person to elect to be registered himself or to transfer the shares and if the notice is not complied within ninety days from the date of issue of the notice the Directors may thereafter withhold payment of all dividends bonuses or other moneys payable in respect of the shares until the requirements of the notice have been complied with.</li> </ul>
<input type="checkbox"/> <input checked="" type="checkbox"/>	27	•
		<b>Forfeiture of shares</b>
<input type="checkbox"/> <input checked="" type="checkbox"/>	28	<ul style="list-style-type: none"> <li>47. If money payable on shares not paid notice to be given to members If any Member fails to pay any call or installment of a call on or before the day appointed for the payment of the same or any such extension thereof as aforesaid the Board may at any time thereafter during such time as any part of the call or installment remains unpaid serve a notice on him requiring him to pay the same together with any interest which may have accrued and all expenses that may have been incurred by the Company by reason of such non-payment.</li> </ul>
<input type="checkbox"/> <input checked="" type="checkbox"/>	29	<ul style="list-style-type: none"> <li>48. Contents of Notice The notice shall name a further day (not being less than fourteen days from the date of the service of notice) and a place or places on and at which such call or installment and such interest thereon at such rate as the Directors shall determine from the day on which such call or installment ought to have been paid and expenses as aforesaid are to be paid. The notice shall also state that in the event of the non-payment on or before the day at or before the time and at the place appointed the shares in respect of which the call was made or installment is payable shall be liable to be forfeited.</li> </ul>
<input type="checkbox"/> <input checked="" type="checkbox"/>	30	<ul style="list-style-type: none"> <li>49. In default of payment shares to be Forfeited If the requirement of any such notice as aforesaid are not complied with every or any share in respect of which such notice has been given may at any time thereafter but before payment of all calls or installments interest and expenses due in respect thereof be forfeited by a</li> </ul>



		<p>resolution of the Board to that effect. Such forfeiture shall include all dividends declared or any other moneys payable in respect of the aforesaid share and not actually paid before the forfeiture. In default of payment shares to be Forfeited</p>	
<input type="checkbox"/>	<input checked="" type="checkbox"/>	31	<ul style="list-style-type: none"> <li>50. Notice of forfeiture to a Member When any share shall have been so forfeited notice of the forfeiture shall be given to the Member in whose name it stood immediately prior to the forfeiture and an entry of the forfeiture with the date thereof shall forthwith be made in the Register of Members but no forfeiture shall be in any manner invalid by any omission or neglect to make any such entry as aforesaid in the Register.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	32	<ul style="list-style-type: none"> <li>51. Forfeited share to be property of the Company and may be sold etc. Any share so forfeited shall be deemed to be the property of the Company and may be sold re-allotted or otherwise disposed of either to the original holder thereof or to any person upon such terms and in such manner as the Board shall think fit.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	33	<ul style="list-style-type: none"> <li>52. Member still liable to pay calls owing at the time of forfeiture and interest Any members whose shares have been forfeited shall notwithstanding the forfeiture be liable to pay and shall forthwith pay to the Company on demand all calls installment interest and expenses owing upon or in respect of such shares at the time of the forfeiture together with interest accrued thereon at the time of the forfeiture at such rate as the Board may determine and the Board may enforce the payment thereof if it thinks fit.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	34	<ul style="list-style-type: none"> <li>53. Effect of forfeiture The forfeiture of a share shall involve extinction at the time of the forfeiture of all interest in and all claims and demands against the Company in respect of the share and all other rights incidental to the share except only such of those rights as by these Articles are expressly saved.</li> <li>54. Evidence of forfeiture A declaration in writing by Chairman or Managing Director of the Company or by any person duly authorised in this regard that certain shares in the Company have been duly forfeited on a date stated in the declaration shall be conclusive evidence of the facts therein stated as against all persons claiming to be entitled to the shares and such declaration and the receipt of the Company for the consideration if any given for the shares on the sale or disposition thereof shall constitute a good title to such shares and the person to whom the shares are sold shall be registered as the holder of such shares and shall not be bound to see as to the application of the purchase money nor shall his title to such shares be affected by any irregularity or invalidity in the proceedings in reference to such forfeiture sale or disposition.</li> <li>55. Validity of sale under Articles of forfeited shares Upon any sale after forfeiture or for enforcing a lien in purported exercise of the powers herein before given the board may appoint some person to execute an instrument of transfer of the shares sold and cause the purchasers name to be entered in the Register of Members in respect of the shares sold and the purchaser shall not be bound to see the regularity of the proceedings or to the application of the purchase money and after his name has been entered in the Register in respect of such shares the validity of the sale</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		



			<p>shall not be impeached by any person and the remedy of any person aggrieved by the sale shall be in damages only and against the Company exclusively.56. Cancellation of Share Certificates in respect of forfeited shares Upon any sale re-allotment or other disposal under the provisions of the preceding Articles the certificate or certificates originally issued in respect of the relative shares shall (unless the same shall on demand by the Company have been (previously) surrendered to it by the defaulting member) stand cancelled and become null and void and of no effect and the Directors shall be entitled to issue a duplicate certificate or certificates in respect of the said shares to the person or persons entitled thereto.57. Power to annul forfeiture The Board may at any time before any share so forfeited shall have been sold re-allotted or otherwise disposed of annul the forfeiture thereof upon such terms and conditions as it thinks fit.</p>
			<b>Alteration of capital</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	35	<ul style="list-style-type: none"> <li>58. Alteration of Share Capital The company may from time to time by ordinary resolution increase the share capital by such sum to be divided into shares of such amount as may be specified in the resolution. Subject to the provisions of section 61 the company may by ordinary resolution the Company may from time to time—(a) consolidate and divide all or any of its share capital into shares of larger amount than its existing shares (b) convert all or any of its fully paid-up shares into stock and reconvert that stock into fully paid-up shares of any denomination (c) Sub-divide its shares or any of them into shares of smaller amount than is fixed by the memorandum so however that in the sub-division the proportion between the amount paid and the amount if any unpaid on each reduced share shall be the same as it was in the case of the share from which the reduced share is derived. (d) Cancel any shares which as the date of the passing of the resolution have not been taken or agreed to be taken by any person and diminish the amount of its share capital by the amount of the shares so cancelled. The resolution whereby any share is sub-divided may determine that as between the holders of the shares resulting from such sub-division one or more of such shares shall have some preference or special advantage as regards dividend capital voting or otherwise over or as compared with the others or other subject to the provisions of the Act. Subject to the provisions of Sections 66 of the Act the Board may accept from any member the surrender on such terms and conditions as shall be agreed of all or any of his shares. The company may by special resolution reduce in any manner and with and subject to any incident authorised and consent required by law—(a) its share capital (b) any capital redemption reserve account or (c) any share premium account.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	36	.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	37	.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	38	.
			<b>Capitalisation of profits</b>



59. Capitalization of Profits(1) Any General Meeting of the Company may resolve that any amounts standing to the credit of the Free Reserve or Share Premium Account or the Capital Redemption Reserve Account or any moneys investment or other assets forming part of the undivided profits including profits or surplus moneys arising from the realization and (when permitted by the law) from the appreciation in value of any capital assets of the Company standing to the credit of the General Reserve or any other Reserve or Reserve Fund or any other Fund of the Company or in the hands of the Company and available for dividend be capitalized-(a) by the issue and distribution of shares as fully paid-up and to the extent permitted by the Act debentures debenture stock bonds or other obligations of the Company or (b) by crediting share of the Company which may have been issued and are not fully paid-up with the whole or any part of the sum remaining unpaid thereon PROVIDED that any amounts standing to the credit of the Share Premium Account or the Capital Redemption Reserve Account shall be applied only in crediting the payment of capital on shares to be issued to Members as fully paid bonus shares (Further capitalization of reserve created by the revaluation of assets are not to be used for issuance of Bonus Shares as per section 63 of the Act).(2) Such issue and distribution under sub-clause (1) (a) of this Article and payment to the credit of unpaid share capital under sub-clause(1) (b) of this Article shall be made among and in favour of the Members or any class of them or any of them entitled thereto and in accordance with their respective rights and interests and in proportion to the amount of capital paid-up on the shares held by them respectively in respect of which such distribution or payment shall be made on the footing that such Members become entitled thereto as capital.(3) The Directors shall give effect to any such resolution and for the said purpose the Board may settle any difficulty which may arise in regard to distribution as it thinks expedient including in regard to fractional entitlements and shall apply such profits General Reserve other Reserve or any other Fund or account as aforesaid as may be required for the purpose of making payment in full on the shares or other obligations of the Company so distributed under sub clause (1) (a) of this Article or (as the case may be) for the purpose of paying in whole or in part the amount remaining unpaid on the shares which may have been issued and are not fully paid-up under sub-clause (1)(b) above. PROVIDED that no such distribution or payment shall be made unless recommended by the Directors and if so recommended such distribution and payment shall be accepted by such Members as aforesaid in full satisfaction of their interest in the said capitalized fund.(4) For the purpose of giving effect to any such resolution the Directors may settle any difficulty which may arise in regard to the distribution or payment as aforesaid as they think expedient and in particular they may issue fractional certificates and may fix the value for distribution of any specific asset and may determine that any cash payment be made to any Members on the footing of the value so fixed and may vest any such cash shares debentures stock bonds or other obligations in trustees upon such trusts for the persons entitled thereto as may seem expedient to the directors and generally may make arrangement for

39



			<p>the acceptance allotment and sale of such shares debentures debentures stock bonds or other obligations and fractional certificates or otherwise as they may think fit. (5) When deemed requisite a proper contract shall be filed in accordance with the Act and the Board may appoint any person to sign such contract on behalf of the Members entitled as aforesaid. Subject to the provisions of the Act and these Articles in cases where some of the shares of the Company are fully paid and others are partly paid such capitalization may be effected by the distribution of further shares in respect of the fully paid shares and by crediting the partly paid shares with the whole or part of the unpaid liability thereon but so that as between the holders of the fully paid shares and the partly paid shares the sums so applied in the payment of such further shares and in the extinguishment or diminution of the liability on the partly paid shares shall be applied pro rata in proportion to the amount then already paid or credited as paid on the existing fully paid and partly paid shares respectively.</p>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	40	•
			<b>Buy-back of shares</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	41	<ul style="list-style-type: none"> <li>60. Buy Back of Shares Notwithstanding anything contained in these articles but subject to the provisions of sections 68 to 70 and any other applicable provision of the Act or any other law for the time being in force the company may purchase its own shares or other specified securities.</li> </ul>
			<b>General meetings</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	42	<ul style="list-style-type: none"> <li>61. Annual General Meeting The Company shall in each year hold a General Meeting as its Annual General Meeting in addition to any other meeting in that year. All General Meetings other than Annual General Meetings shall be called Extraordinary General Meetings. If for any reason beyond the control of the Board the general meeting (including an Annual General meeting) cannot be held on the appointed day the Board shall have power to postpone the General meeting of which a notice should be given to the members. Every member of the Company shall be entitled to attend either in person or by proxy and the Auditor of the Company shall have the right to attend and to be heard at any General Meeting which he attends on any part of the business which concerns him as Auditor.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<ul style="list-style-type: none"> <li>62. Extraordinary General Meeting The Board may whenever it thinks fit call an Extraordinary General Meeting of the Company. The Board shall at the requisition in writing by a Member or Members holding in the aggregate not less than one-tenth of such of the paid-up capital of the company on that date and carries the right of voting in regard to the matter in respect of which the requisition has been made. 63. Requisition of Members to state object of Meeting Any valid requisition so made by Members must state the object or objects of the meeting proposed to be called and must be signed by the requisitionists and deposited at the registered office of the company. PROVIDED that such requisition may consist of several documents in like form each signed by one or more requisitionists. 64. On receipt of requisition Directors to call meeting and in default requisitionists</li> </ul>



		43	<p>may do so Upon the receipt of any such requisition the Board shall forthwith call an Extraordinary General Meeting and if they do not proceed within twenty-one days from the date of the requisition being deposited at the Registered Office to cause a meeting to be called on a day not later than forty-five days from the date of deposit of the requisition there requisitionists or such of their number as represent either a majority in value of the paid-up share capital held by all of them or one-tenth of such of the paid-up share capital of the Company as is referred to in Section 100(2) of the Act whichever is less may themselves call the meeting but in either case any meeting so called shall be held within three months from the date of the deposit of the requisition as aforesaid. 65. Meeting called by requisitionists Any meeting called under the foregoing Articles by the requisitionists shall be called in the same manner as nearly as possible as that in which meetings are to be called by the Board. 66. Twenty-one days notice of meeting to be given A general meeting of a Company may be called by giving not less than clear twenty-one days notice either in writing or through electronic mode in such a manner as may be prescribed. Every notice of a meeting shall specify the place, date, day and the hour of meeting and shall contain statement of the business to be transacted at such meeting. And the notice of every meeting shall be given to every member of the Company, Legal Representative of any deceased member or the assignee of an insolvent member, auditor or auditors of the Company and every director of the Company and all such persons as are under these Articles entitled to receive notice from the Company. Provided that a general meeting may be called after giving shorter notice than that specified in this sub-section if consent in writing or by electronic mode is accorded thereto (i) in the case of an annual general meeting by not less than ninety-five per cent. of the members entitled to vote thereat and (ii) in the case of any other general meeting by members of the company (a) holding if the company has a share capital majority in number of members entitled to vote and who represent not less than ninety-five per cent. of such part of the paid-up share capital of the company as gives a right to vote at the meeting or (b) having if the company has no share capital not less than ninety-five per cent. of the total voting power exercisable at that meeting. Provided further that where any member of a company is entitled to vote only on some resolution or resolutions to be moved at a meeting and not on the others those members shall be taken into account for the purposes of this sub-section in respect of the former resolution or resolutions and not in respect of the latter..</p>
			<p><b>Proceedings at general meetings</b></p>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<ul style="list-style-type: none"> <li>67. Business to be transacted at the General Meeting and nature thereof In the case of an Annual General Meeting all business to be transacted thereat shall be deemed special other than (i) the consideration of the financial statements and the reports of the Board of Directors and Auditors (ii) the declaration of any dividend (iii) the appointment of Directors in place of those retiring (iv) the appointment of and the fixing of the remuneration of the Auditors and in the case of any other meeting all business shall be deemed to be Special Business and there shall be annexed to the notice of the</li> </ul>



		44	Meeting an Explanatory statement setting out all material facts concerning each such item of special business including in particular the nature of the concern or interest financial or otherwise if any therein of (i) every Director and the Manager (if any) (ii) every other key managerial personnel and relatives of the persons mentioned in sub clauses (i) and (ii). Where any such item of Special Business relates to or affects any other company the extent of shareholding interest in such other company of every promoter director and the manager if any and of every other key managerial personnel of the Company shall also be set out in the statement if the extent of such shareholding interest is not less than two per cent of the paid-up share capital of that other company and where any item of business consists of the according of approval to any documents by the meeting the time and place where the document can be inspected shall be specified in the statement aforesaid. The annual general meeting shall be called during business hours on any day that is not a National Holiday and it is to be held either at the registered office of the company or at some other place within the city in which the registered office of the company is situated.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	45	<ul style="list-style-type: none"> <li>68. Omission to give notice not to invalidate a resolution passed. The accidental omission to give any such notice as aforesaid to any of the Members or the non-receipt thereof shall not invalidate any resolution passed at any such meeting.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	46	<ul style="list-style-type: none"> <li>69. Meeting not to transact business not mentioned in notice. No General Meeting Annual or Extraordinary shall be competent to enter upon discuss or transact any business which has not been mentioned in the notice or notices upon which it was convened.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	47	<ul style="list-style-type: none"> <li>70. Body Corporate deemed to be personally present. A body corporate being a Member shall be deemed to be personally present if it is represented in accordance with Section 113 of the Act.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<ul style="list-style-type: none"> <li>71. Quorum at General Meeting. No business shall be transacted at any general meeting unless a quorum of members is present at the time when the meeting proceeds to business. Save as otherwise provided herein the quorum for the general meetings shall be as provided in section 103 of the Companies Act 2013. If quorum not present meeting to be dissolved or adjourned. If at the expiration of half an hour from the time appointed for holding a general meeting of the Company a quorum is not present the meeting if convened by or upon the requisition of Members shall stand dissolved but in any other case the meeting shall stand adjourned to the same day in the next week or if that day is a public holiday until the next succeeding day which is not a public holiday at the same time and place or to such other day and at such other time place as the Board may determine and if at such adjourned meeting a quorum is not present at the expiration of half an hour from the time appointed for holding the meeting the Members present shall form the quorum and may transact the business for which the meeting was called.</li> <li>73. Chairman of General Meeting. The Chairman of the Board shall be entitled to take the Chair at every General Meeting whether Annual or Extraordinary. If at any meeting the</li> </ul>



Chairman is not present within fifteen minutes of the time appointed for holding such meeting or he has informed that he shall be unable or unwilling to take the Chair then any one of directors with mutual consent shall so preside at the meeting. If no Director be present or if all the Directors present decline to take the Chair then the Members present shall elect one of the members to be the Chairman of the Meeting. 74. No Business whilst chair vacant No business shall be discussed at any General Meeting except the election of a Chairman whilst the Chair is vacant. 75. Chairman with consent may adjourn meeting The Chairman with the consent of the Members may adjourn any meeting from time to time and from place to place within the city town or village in which the Registered Office of the Company is situated but no business shall be transacted at any adjourned meeting other than the business left unfinished at the meeting from which the adjournment took place. Notwithstanding the provision as above in the event of disorder at a validly convened meeting the Chairman may adjourn the meeting provided that such an adjournment shall not be a longer period than the Chairman considers necessary to bring order at the meeting and Chairman communicates his decision to those present in so far as it is possible. 76. Questions at General Meeting how Decided Every question submitted to a meeting shall be decided in the first instance unless a poll is demanded on a show of hands. Before or on the declaration of the result of the voting on any resolution on a show of hands a poll may be ordered to be taken by the Chairman of the meeting on his own motion and shall be ordered to be taken by him on a demand made in that behalf by any member or members present in person or by proxy and holding shares in the Company which confer a power to vote on the resolution not being less than one-tenth of the total voting power in respect of the Resolution or on which an aggregate sum of not less than five lakh rupees has been paid up. The demand for a poll may be withdrawn at any time by the person or persons making the demand. Unless a poll is so demanded a declaration by the Chairman that a resolution has on show of hands been carried through unanimously or by a particular majority or lost and an entry to that effect in the Minutes Book of the Company shall be conclusive evidence of the fact without proof of the number or proportion of the votes recorded in favour of or against the resolution. 77. Chairmans Casting Vote In the case of an equality of votes the Chairman shall have a casting vote in addition to the vote or votes to which he may be entitled otherwise. 78. Poll to be taken if demanded If a poll is demanded as aforesaid the same shall be taken at such time (not later than forty-eight hours from the time when the demand was made) and place in the city or town in which the Registered office of the Company is for the time being situated as the Chairman shall direct either at once or after an interval or adjournment and the result of the poll shall be deemed to be the resolution of the meeting. 79. In which case poll taken without Adjournment Any poll duly demanded on the election of the Chairman of a meeting or on any question of adjournment shall be taken at the meeting forthwith. 80. Demand for poll not to prevent transaction of other business The demand for a poll except on the questions of the election of the Chairman and of an



adjournment shall not prevent the continuance of a meeting for the transaction of any business other than the question on which the poll has been demanded. 81. Minutes of General Meetings (a) The Company shall cause minutes of the proceedings of every General Meeting or every resolution passed by postal ballot to be kept by making within thirty days of the conclusion of every such meeting concerned record thereof kept with Minute Book for that purpose with their pages consecutively numbered. (b) Each page of every such book shall be initialed or signed and the last page of the record of proceedings of each meeting in such book shall be dated and signed by the Chairman of the same meeting within the aforesaid period of thirty days or in the event of the death or inability of that Chairman within that period by a Director duly authorised by the Board for the purpose. (c) In no case the minutes of proceedings of a meeting shall be attached to any such book as aforesaid by pasting or otherwise. (d) The minutes of each meeting shall contain a fair and correct summary of the proceedings thereat. (e) All decisions taken and appointments of officers made at any meeting aforesaid shall be included in the minutes of the meeting. (f) Nothing herein contained shall require or be deemed to require the inclusion in any such minutes of any matter which in the opinion of the Chairman of the meeting (a) is or could reasonably be regarded as defamatory of any person or (b) is irrelevant or immaterial to the proceedings or (c) is detrimental to the interests of the Company. The Chairman of the meeting shall exercise an absolute discretion in regard to the inclusion or non-inclusion of any matter in the minutes on the aforesaid grounds. (g) Any such minutes shall be evidence of the proceedings recorded therein. Where the minutes have been kept in accordance with section then until the contrary is proved the meeting shall be deemed to have been duly called and held all appointments of directors key managerial personnel auditors or company secretary in practice shall be deemed to be valid. No document purporting to be a report of the proceedings of any general meeting of a company shall be circulated or advertised at the expense of the company unless it includes the matters required to be contained in the minutes of the proceedings of such meeting. The company shall observe secretarial standards with respect to general and Board meetings specified by the Institute of Company Secretaries of India constituted under section 3 of the Company Secretaries Act 1980 and approved as such by the Central Government. (h) The book containing the minutes of the proceedings of any general meeting of the Company or of a resolution passed by postal ballot shall be kept at the registered office of the Company and shall be open during business hours to the inspection by any member without any charge for such period not being less than two hours in each business day are allowed for inspection.

**Adjournment of meeting**

<input type="checkbox"/>	<input checked="" type="checkbox"/>

- 82. Adjournment of Meeting (i) The Chairperson may with the consent of any meeting at which a quorum is present and shall if so directed by the meeting adjourn the meeting from time to time and from place to place. (ii) No business shall be transacted at any



			<p>adjourned meeting other than the business left unfinished at the meeting from which the adjournment took place. (iii) When a meeting is adjourned for thirty days or more notice of the adjourned meeting shall be given as in the case of an original meeting. (iv) Save as aforesaid and as provided in section 103 of the Act it shall not be necessary to give any notice of an adjournment or of the business to be transacted at an adjourned meeting.</p>
			<b>Voting rights</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	50	<ul style="list-style-type: none"> <li>83. Members in arrears not to vote No member shall be entitled to vote either personally or by proxy at any General Meeting or Meeting of a class of shareholders either upon a show of hands or upon a poll in respect of any shares registered in his name on which any calls or other sums presently payable by him have not been paid or in regard to which the Company has exercised any right of lien.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	51	<ul style="list-style-type: none"> <li>84. Number of votes to which Member Entitled Subject to the provisions of these Articles and without prejudice to any special privileges or restrictions as to voting for the time being attached to any class of shares for the time being forming part of the capital of the Company every Member shall be entitled to be present and to speak and vote at such meeting by show of hand for which the Member present in person shall have one vote. On a poll taken at a meeting of a company a member entitled to more than one vote or his proxy need not to use all his votes or cast in the same way all the votes he uses.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	52	<ul style="list-style-type: none"> <li>85. Votes by a Member entitled to more than one vote On a poll taken at a meeting of the Company a Member entitled to more than one vote by virtue of his shareholding or his proxy or other person entitled to vote for him as the case may be need not if he votes use all his votes or cast in the same way all the votes he uses and he may vote in different manner as he deems fit.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	53	<ul style="list-style-type: none"> <li>86. Vote of Member who is a minor If any shareholder be a minor the vote in respect of his share or shares shall be by his guardian or any one of his guardians if more than one to be selected in case of dispute by the Chairman of the meeting.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	54	<ul style="list-style-type: none"> <li>87. Votes of Joint Members If there be joint registered holders of any shares the vote of the senior who tenders a vote whether in person or by proxy shall be accepted to the exclusion of the votes of the other joint holders. For this purpose seniority shall be determined by the order in which the names stand in the register of members.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	55	<ul style="list-style-type: none"> <li>88. Voting in person or by proxy or Representative Subject to the provisions of these Articles votes may be given either personally or by proxy. A body corporate being a Member may vote either by proxy or by a representative duly authorised in accordance with Section 113 of the Act and such representative shall be entitled to exercise the same rights and powers (including the right to vote by proxy) and by postal ballot on behalf of the body corporate which he represents as that body could exercise if it were an individual Member of the Company.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<ul style="list-style-type: none"> <li>89. Votes in respect of shares of Deceased Any person entitled under the Transmission Clause to transfer any</li> </ul>




		56	<p>shares may vote at any General Meeting in respect thereof in the same manner as if he were the registered holder of such shares. PROVIDED that forty-eight hours at least before the time of holding the meeting or adjourned meeting as the case may be at which he proposes to vote he shall satisfy the Chairman of his right to transfer such shares and give such indemnity (if any) as the Chairman may require or the Chairman shall have previously admitted his right to vote at such meeting in respect thereof.90. Time for objection to voteNo objection shall be made to the validity of any vote except at the meeting or poll at which such vote was tendered and every vote whether given personally or by proxy not disallowed at such meeting or poll shall be deemed valid for purposes of such meeting or poll whatsoever.91. Chairman of the meeting to be the judge of the validity of any VoteThe Chairman of any meeting shall be the sole judge of the validity of every vote tendered at such meeting. The Chairman present at the taking of a poll shall be the sole judge of the validity of every vote tendered at such poll.</p>
--	--	----	---

**Proxy**

<input type="checkbox"/>	<input checked="" type="checkbox"/>	57	<ul style="list-style-type: none"> <li>92. Appointment of proxy A person can act as proxy on behalf of members not exceeding fifty and holding in the aggregate not more than ten percent of the total share capital of the company carrying voting rights Provided that a member holding more than ten percent of the total share capital of the Company carrying voting rights may appoint a single person as proxy and such person shall not act as proxy for any other person or shareholder. Every proxy shall be appointed in writing under the hand of the Member or if such Member is a body corporate under the common seal of such corporation or be signed by an appointer or his attorney duly authorised in writing. The proxy so appointed shall not have any right to speak at the meetings.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		

<input type="checkbox"/>	<input checked="" type="checkbox"/>	58	<ul style="list-style-type: none"> <li>93. Deposit of instrument of Proxy etc. The instrument appointing a proxy and the power of attorney or other authority (if any) under which it is signed or a notarized copy of that power or authority shall be deposited at the Registered Office of the Company not later than forty-eight hours before the time for holding the meeting at which the person named in the instrument proposes to vote and in default the instrument of proxy shall not be treated as valid. No instrument appointing a proxy shall be valid after the expiration of twelve months from the date of its execution.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		

<input type="checkbox"/>	<input checked="" type="checkbox"/>	59	<ul style="list-style-type: none"> <li>94. Form of proxy An instrument appointing a proxy shall be in the form No. MGT-11 as prescribed in the rules made under section 105 of the Companies Act 2013 95. Proxy either for specified meeting or for a period An instrument of proxy may appoint a proxy either for the purpose of a particular meeting specified in the instrument and any adjournment thereof or it may appoint for the purpose of every meeting of the Company or of every meeting to be held before a date specified in the instrument and every adjournment of any such meeting.96. Validity of votes given by proxy notwithstanding death of Member A vote given in accordance with the terms of an instrument of proxy shall be valid notwithstanding the previous death or insanity of</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		



74

			the principal or the revocation of the proxy or of the authority under which the proxy was executed or the transfer of the shares in respect of which the proxy is given. Provided that no intimation in writing of such death insanity revocation or transfer shall have been received by the company at its office before the commencement of the meeting or adjourned meeting at which the proxy is used.
			<b>Board of Directors</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	60	<ul style="list-style-type: none"> <li>97. Management of Affairs The day to day management of the business and affairs of the Company shall be vested with Project-in-charge under the supervision direction control of the Board. The Board may exercise all such powers of the Company and do all such acts deeds and things as are not prohibited by the Act or any other statute or by the Memorandum of Association of the Company and without prejudice to the foregoing shall be responsible for all policy matters and the supervision direction and control of the conduct of the business affairs operations of the Company.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	61	<ul style="list-style-type: none"> <li>98. First Directors Shri Rakesh Mohan Shri Sandeep Kumar and Shri Naveen Kumar shall be the First Directors of the Company..</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<ul style="list-style-type: none"> <li>99. Number and appointment of Directors The Board of Directors of the Company shall consist of not less than 3 but not more than 15 Directors. A Director shall not be required to hold any qualification shares in the Company. Notwithstanding anything to the contrary contained in these Articles so long as any moneys remain owing by the Company to a Financial Institution or any other person by the Company or the Company has entered into any agreement or undertaking or arrangement (hereinafter refer as agreement) with Bodies (like State Electricity Board Nigam) or the Board of Directors have decided to seek nomination on the Board from the beneficiary state or any Financial Institution or PFC Consulting Limited or person holds Debentures in the Company by direct subscription or private placement the Company may agree to grant to such Financial Institution PFC Consulting Limited person or other Bodies as a condition of such loan or subscription to Debenture or any other agreement or to a Debenture Trustee the right to appoint from time to time any person or persons as Director or Directors of the Company (which director or directors is are hereinafter referred to as Nominee Directors) retiring or non-retiring subject to and on such terms and conditions as the Company may agree with such Financial Institutions PFC Consulting Limited Person other Bodies and or Debenture Trustee. The Company shall have a right to remove from office Nominee Director(s) at the option of the Company in consultation with Financial Institutions PFC Consulting Limited Bodies persons or Debenture Trustee. Such Nominee Director(s) shall not be required to hold any Share qualification in the Company. Also at the option of the Company such Nominee Director(s) shall not be liable to retirement by rotation of the Directors. Subject as aforesaid the Nominee Director(s) shall be entitled to the same rights and privileges and be subject to the same obligations as any other Director of the Company. The Nominee Director(s) so appointed shall hold the</li> </ul>



		62	<p>said office only so long as moneys remain owing by the Company to the Financial Institution or so long as the Debenture Trustee hold debenture in the Company or operation of agreement and the Nominee Directors so appointed in the exercise of the said person shall ipso facto vacate such office immediately the money owing by the Company to the Financial Institution or on the Debenture Trustee ceasing to hold Debentures Shares on the satisfaction of liability of the Company arising out of any Guarantee furnished by the Financial Institutions or satisfactory completion of term of agreement with Bodies. The Nominee Director(s) appointed under this article shall be entitled to receive all notice of and attend all General meeting Board Meeting and of the meetings of the Committee of which the Nominee Director(s) is a member(s) as also the minutes of meetings. The financial institutions Debenture Trustee persons bodies shall also be entitled to receive all such notice and minutes. The Company shall pay to the Nominee Director(s) sitting fees and expenses which other Director of the Company are entitled but if any other fees commission remuneration in any form is payable to the Director of the Company the fees commission money and remuneration in relation to such Nominee Director(s) shall accrue to Debenture Trustee and same shall accordingly be paid by the Company directly to the debenture trustee. Any expenses that may be incurred by the financial institution or such Nominee Director(s) in connection with their appointment or Directorship shall also be paid or reimbursed by the Company to the financial Institution or as the case may be to such Nominee Director(s). Provided that if any such Nominee Director(s) is an officer of the Financial Institution the sitting fees in relation to such Nominee Director(s) shall also accrue to the Financial Institution and the same shall accordingly be paid by the Company directly to that Financial Institution. Provided further that if such Nominee Director(s) is an official of any of the Reserve Bank of India the sitting fees in relation to such Nominee Director(s) shall also accrue to Financial Institution to whom here represents as Nominee Director from Reserve Bank of India and the same shall accordingly be paid by the Company directly to that Financial Institution. Provided also that in the event of the Nominee Director(s) being appointed as Whole Time Director(s) such Nominee Director(s) shall exercise such powers and duties as may be approved by the Lenders or Bodies in consultation with Board and have such rights as are usually exercised or available to a Whole Time Director in management of the Borrower or Bodies and such Nominee Director(s) shall be entitled to receive such remuneration fees commission and moneys as may be approved by the Lenders or Bodies in consultation with Board.</p>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	63	<ul style="list-style-type: none"> <li>• 100. Company may increase the number of Directors Subject to Section 149 of the Act the Company may subject to special resolution in General Meeting increase the maximum number of Directors. Further the Company may subject to the provisions of Section 169 of the Act by passing the ordinary resolution in the General Meeting of the members may remove any Director before the expiration of his period of office and appoint another person in the place of director so removed.</li> </ul>

76



<input type="checkbox"/>	<input checked="" type="checkbox"/>	64	<ul style="list-style-type: none"> <li>101. Appointment of Alternate Directors In accordance with Section 161 and other applicable provisions (if any) of the Act the Board shall have power at any time and from time to time to appoint a person not being a person holding any alternate directorship for any other Director in the Company to act as an alternate director for a director (hereinafter called the original Director) during his absence for a period of not less than three months from India.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	65	<ul style="list-style-type: none"> <li>102. Directors power to fill up casual Vacancies Casual vacancies among Directors may be filled by the Board of Directors at their meeting and any person so appointed shall hold the office as per the provision of section 161.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<ul style="list-style-type: none"> <li>103. Appointment of Additional Director Subject to the provisions of Section 161 and other applicable provisions (if any) of the Act the Board shall have power at any time and from time to time to appoint a person as an Additional Director but so that the total number of Directors shall not at any time exceed the maximum number fixed by these Articles. The Additional Director so appointed shall retire from Office at next following Annual General Meeting but shall be eligible for election by the company at that meeting as a Director.</li> <li>104. Directors may act notwithstanding any vacancy The continuing Directors may act notwithstanding any vacancy in their body but if and so long as their number is reduced below the minimum number fixed by Article 100 thereof the continuing Directors may act for the purpose of increasing the number of Directors to that number or of summoning a General Meeting for that purpose.</li> <li>105. Remuneration of Directors Subject to the provisions of the Act the Chairman or Managing Director or any other functional Directors who is in the whole-time employment of the Company may be paid remuneration either by way of a monthly payment or at a specified percentage of the net profit of the Company or partly by one way and partly by the other keeping in view the limiting provisions governing the Managerial remuneration under the provisions of the Act. Subject to the provisions of the Act a Director who is neither in the whole-time employment nor a Chairman cum Managing Director of the Company may be paid remuneration either-(a) by way of monthly quarterly or annual payment with the approval of the Central Government or (b) by way of commission if the Company by a special resolution authorizes such payment and The sitting fee payable to a Director (excluding Whole-time Director) for attending a meeting of the Board or Committee thereof shall be such sum as may be fixed by the Board provided that the same shall not exceed Rs. 100000- or such other sum as prescribed in the Act as amended from time to time. Travelling expenses incurred by Director going out on Company's Business The Board may allow and pay to any Director who is not a bona-fide resident of the place where the Registered Office of the Company or where the meetings of the Board are actually held and who has to come to such place for the purpose of attending any meeting such sum as the Board may consider fair compensation for travelling boarding lodging and other actual incidental expenses in addition to his fee for attending such meeting as specified above. If any</li> </ul>



Director be called upon to go or reside out of the bonafide place of his residence on the Company's business he shall be entitled to be paid and reimbursed any travelling or other actual expenses incurred by him in connection with the business of the Company. 106. When office of Directors to become Vacant Subject to Section 167 of the Act the office of a Director shall become vacant if-(a) he incurs any of the disqualifications specified in section 164 under the act (b) he absents himself from all the meetings of the Board of Directors held during a period of twelve months with or without seeking leave of absence of the Board (c) he acts in contravention of the provisions of entering into contracts or arrangements in which he is directly or indirectly interested (d) he fails to disclose his interest in any contract or arrangement in which he is directly or indirectly interested (e) he becomes disqualified by an order of a court or the Tribunal (f) he is convicted by a court of any offence whether involving moral turpitude or otherwise and sentenced in respect thereof to imprisonment for not less than six months Provided that the office shall be vacated by the director even if he has filed an appeal against the order of such court (g) he is removed in pursuance of the provisions of this Act (h) he having been appointed a director by virtue of his holding any office or other employment in the holding subsidiary or associate company ceases to hold such office or other employment in that company. 107. Directors may contract with Company Except with the consent of the Board of Directors given by a resolution at a meeting of the Board and subject to such conditions the company shall not enter into any contract or arrangement with a related party with respect to (a) sale purchase or supply of any goods or materials (b) selling or otherwise disposing of or buying property of any kind (c) leasing of property of any kind (d) availing or rendering of any services (e) appointment of any agent for purchase or sale of goods materials services or property (f) such related party's appointment to any office or place of profit in the company its subsidiary company or associate company (g) underwriting the subscription of any securities or derivatives thereof of the company. Every contract or arrangement entered as related party transaction shall be referred in the Board's report to the shareholders along with the justification for entering into such contract or arrangement. 108. Disclosure of interest by Directors 1) Every Director of the Company who is in any way whether directly or indirectly concerned or interested in a contract or arrangement proposed by Directors interested in a contract or arrangement or proposed contract or arrangement entered into or to be entered into by or on behalf of the Company shall disclose the nature of his concern or interest at every financial year or whenever there is change in the disclosure of interest. (2) Nothing in sub-clause (1) of this Article shall apply to any contract or arrangement entered into or to be entered into between the Company and any other company where any of the Directors of the Company or two or more of the Directors together holds or hold not more than two per cent of the paid-up share capital in the other company. 109. Interested Directors not to participate or vote in Board's proceedings An interested director who is in any way whether by himself or through any of his relatives or firm body corporate or

other association of individuals in which he or any of his relatives is a partner, director or a member interested in a contract or arrangement or proposed contract or arrangement entered into or to be entered into by or on behalf of a company shall take any part in the discussion of or vote on any contract or arrangement entered into or to be entered into by or on behalf of the Company if he is in any way whether directly or indirectly concerned or interested in such contract or arrangement nor shall his presence count for the purpose of forming a quorum at the time of any such discussion or vote and if he does vote his vote shall be void. A contract or arrangement entered into by the company without disclosure or with participation by a director who is concerned or interested in any way directly or indirectly in the contract or arrangement shall be voidable at the option of the company.

110. Register of Contracts in which Directors are interested The company shall keep registers in accordance with Section 189(1) giving separately the particulars of all contracts or arrangements to which the matter of disclosure of interest by directors and related party transaction applies in such manner and containing such particulars as may be prescribed and after entering the particulars such registers shall be placed before the next meeting of the Board and signed by all the directors present at the meeting and shall within thirty days of appointment make such disclosure as are necessary for the purpose of same. The Register shall be kept at the Registered office of the Company and shall be open to inspection at such office shall be open for inspection at such office during business hours and extracts may be taken therefrom and copies thereof as may be required by any member of the company shall be furnished by the company to such extent in such manner and on payment of same fee as in the case of the Register of Members of the Company.

111. Director may be Director of companies promoted by the Company A Director may become a Director of any other company promoted by the Company or in which it may be interested as a vendor, shareholder or otherwise and no such Director shall be accountable for any benefits received as Director or shareholder of such a company except in so far as Section 188 of the Act may be applicable.

112. Register of Directors and key managerial personnel and their Shareholding The Company shall keep at its registered office a Register containing such particulars of its Directors and key managerial personnel as may be prescribed under Section 170 of the Act and shall comply with the provisions of the said Section in all respects. The register shall include the details of securities held by each of them in the company or its holding subsidiary or associate companies.

**Proceedings of the Board**

<input type="checkbox"/>	<input checked="" type="checkbox"/>	
		67

• 113. Meetings of Directors The Directors may meet together as a Board for the dispatch of business from time to time so that at least four such meetings shall be held in every year in such a manner that not more than one hundred and twenty days shall intervene between two consecutive meetings of the Board. The Directors may adjourn and regulate their meetings as they think fit.

79



<input type="checkbox"/>	<input checked="" type="checkbox"/>	68	<ul style="list-style-type: none"> <li>114. Board may appoint ChairmanAll meetings of the Directors shall be presided over by the Chairman if present but if at any meeting of the Directors the Chairman is not present at the time appointed for holding the same then in that case the Directors shall choose one of the Directors present to preside over the meeting.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	69	<ul style="list-style-type: none"> <li>115. Certain persons not to be appointed Chairman Managing Directors Functional DirectorThe Company shall not appoint a person as its Chairman Managing Director or Whole-time Director who-(a) is an undischarged insolvent or had at any time been adjudged an insolvent(b) is or has at any time been convicted by a Court of an offence involving moral turpitude.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	70	<ul style="list-style-type: none"> <li>116. Notice of Directors MeetingA meeting of the Board shall be called by giving not less than seven days notice in writing to every director at his address registered with the company and such notice shall be sent by hand delivery or by post or by electronic means. Board may be called at shorter notice to transact urgent business where at least one independent director if any shall be present.Every notice convening a meeting of the Board of Directors shall set out the agenda of the business to be transacted thereat in sufficient detail provided however that the meeting may consider any other business with the permission of the chair.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	71	<ul style="list-style-type: none"> <li>117. When meeting to be convenedThe Company Secretary or any director of the Company may as and when directed by the Chairman to do so convene a meeting of the Board by giving a notice in writing to every Director.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	72	<ul style="list-style-type: none"> <li>118. Quorum at Board MeetingNo business shall be transacted at any Board meeting unless a quorum of Board of Director is present at the time when the meeting proceeds to business.Save as otherwise provided herein the quorum for the Board meetings shall be as provided in section 174.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	73	<ul style="list-style-type: none"> <li>119. Questions at Board meetings how to be decidedAll questions arising at a Meeting of the Board or any committee thereof shall be decided by majority of votes of directors present and in case of equality of votes the Chairperson shall have a second and casting vote.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>	74	<ul style="list-style-type: none"> <li>120. Committee of BoardSubject to the restrictions contained in Section 179 180and other applicable provisions of the Act and preceding Articles the Boardmay delegate any of its powers to Committees of the Board consisting of suchmember or members of its body as it may think fit.PROVIDED that the Board may from time to time revokemodify and discharge any such Committee of the Board either wholly or in part.Every Committee of the Board so formed shall in the exercise of the powers sodelegated conform to any Policyregulations that may from time to time belaid down by the Board. All acts done by any such Committee of the Board inconformity with such regulations and in fulfillment of the purposes of theirappointment shall have the like force and effect as if done by the Board</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<ul style="list-style-type: none"> <li>121. Meeting of Committee how to be GovernedThe meetings and proceedings of any such Committee of the</li> </ul>



			<p>Board consisting of two or more members shall be governed by the provisions of the act and guidelines laid down for regulating the meetings and proceedings of the Directors so far as the same are applicable thereto and are not superseded by any regulations made by Directors under the last preceding Article.</p>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<ul style="list-style-type: none"> <li>• 122. Resolution by circulation No resolution on matters shall be deemed to have been duly passed by the Board or by a Committee thereof by circulation unless the resolution has been circulated in draft together with the necessary papers if any to all the Directors or members of the Committee as the case may be at their addresses registered with the company in India by hand delivery or by post or by courier or through such electronic means as may be prescribed and has been approved by a majority of the directors or members who are entitled to vote on the resolution. Resolution passed in such circulation shall be made part of the minutes of such meeting. Provided that where not less than one-third of the total number of directors of the company for the time being require that any resolution under circulation must be decided at a meeting the chairperson shall put the resolution to be decided at a meeting of the Board.</li> </ul>
			<p>123. Defects in appointment of Directors not to invalidate actions taken All acts done by any meeting of the Board or by a Committee of the Board or by any person acting as a Director shall notwithstanding that it was subsequently noticed that there was some defect in the appointment of such Director or persons acting as aforesaid or that they or any of them were disqualified or had vacated office or that the appointment of any of them had been terminated by virtue of any provisions contained in the Act or these Articles be as valid as if every such person had been duly appointed and was qualified to be a Director and had not vacated his office or his appointment had not been terminated. PROVIDED that nothing in this Article shall be deemed to give validity to acts done by a Director after his appointment had been noticed by the Company to be invalid or to have terminated.</p> <p>124. Minutes of proceedings of meetings of the Board (a) The Company shall cause minutes of all proceedings of every meeting of the Board and committee thereof to be kept by making within thirty days of the conclusion of every such meeting record thereof in Minute Book kept for that purpose with their pages consecutively numbered. (b) Each page of every such book shall be initialed or signed and the last page of the record of proceedings of each meeting in such book shall be dated and signed by the Chairman of the said meeting or the Chairman of the next succeeding meeting. The minute books of the Board and committee meetings shall be preserved permanently and kept in the custody of the company secretary of the company or any director duly authorized by the Board for the purpose and shall be kept in the registered office or such place as Board may decide. The minutes shall also contain - (i) the names of the Directors present at the meeting And (ii) in the case of each resolution passed at the meeting the names of the Directors if any dissenting from or not concurring with the resolution. Nothing deemed to require the inclusion in any such minutes of any matter which in the opinion of the Chairman of the meeting (i) is or could reasonably be regarded as defamatory of any person (ii) is irrelevant or immaterial to the proceedings or (iii) is</p>

18



detrimental to the interests of the Company. The Chairman shall exercise an absolute discretion in regard to the inclusion or non-inclusion of any matter in the minutes on the grounds specified in this sub-clause. (c) Minutes of meetings kept in accordance with the aforesaid provisions shall be evidence of the proceedings recorded therein. 125. Powers of Board The Board may exercise all such powers of the Company and do all such acts and things as it is entitled to do under section 179 of the Act and rules made thereunder or by the Memorandum or Articles of the Company but shall not decide matters required to be exercised or done by the Company in General Meeting Subject to these Articles no regulation made by the Company in General Meeting shall invalidate any prior act of the Board which would have been valid if that regulation had not been so made. Certain powers of the Board Without prejudice to the general powers conferred by the Act and preceding Article and so as not in any way to limit or restrict those powers and without prejudice to the other powers conferred by these Articles and by General Body it is hereby declared that the Directors shall have the following powers that is to say power-(1) to pay and charge to the capital account of the Company any commission or interest lawfully payable there out under the provisions of Sections 40 of the Act (2) Subject to Sections 179 and 180 of the Act to purchase or otherwise acquire for the Company any property rights or privileges which the Company is authorised to acquire at or for such price or consideration and generally on such terms and conditions as they may think fit and in any such purchase or other acquisition to accept such title as the Directors may believe or may be advised to be reasonably satisfactory (3) At their discretion and subject to the provisions of the Act to pay for any property rights or privileges acquired by or services rendered to the Company either wholly or partially in cash or in shares bonds debentures mortgages or other securities of the Company and any such shares may be issued either as fully paid-up or with such amount credited as paid-up thereon as may be agreed upon and any such bonds debentures mortgages or other securities may be either specially charged upon all or any part of the property of the Company and its uncalled capital or not so charged (4) To secure the fulfillment of any contract or engagement entered into by the Company in the normal course of business by mortgage or charge any of the property of the Company and its uncalled capital for the time being or in such manner as they may think fit (5) To accept from any Member as far as may be permissible by law a surrender of his shares or any part thereof on such terms and conditions as shall be agreed upon (6) To appoint any person to accept and hold in trust for the Company any property belonging to the Company in which it is interested or for any other purposes and to execute and do all such deeds and things as may be required in relation to any such trust and to provide for the remuneration of such trust or trustees (7) To institute conduct defend compound or abandon any legal proceedings by or against the Company or its officers or otherwise concerning the affairs of the Company and also to compound and allow time for payment or satisfaction of any debts due and of any claim or demand by or against the Company and to refer any



76

differences to arbitration and observe and execute any awards made thereon(8) To act on behalf of the Company in all matters relating to bankruptcy and insolvency(9) To make and give receipts releases and other discharges for moneys payable to the Company and for the claims and demands of the Company(10) Subject to applicable provisions of the Act to invest and deal with any moneys of the Company not immediately required for the purposes thereof upon such security (not being shares of this Company) or without security and in such manner as they may think fit and from time to time to vary or realise such investments. Save as provided in Section 187 of the Act all investments shall be made and held in the Company's own name(11) To execute in the name and on behalf of the Company in favour of any Director or other person who may incur or going to incur any personal liability whether as principal or surety for the benefit of the Company such mortgages of the Company's property (present and future) as they think fit and any such mortgage may contain a power of sale and such other powers provisions covenants as shall be agreed upon(12) To open account with any bank or banks and to determine from time to time who shall be entitled to sign on the Company's behalf bills notes receipts acceptances endorsements cheques dividend warrants releases contracts and documents and to issue the necessary authority for such purpose(13) To distribute by way of bonus or commission amongst the staff of the Company on the profits of any particular business or transaction and to charge such bonus or commission as part of the working expense of the Company(14) To provide for the welfare of employees or ex-employees of the Company and their families or connections of such persons by building or contributing to the building of houses dwellings or chawls or by grants of money pension gratuities allowances bonus or other payments or by creating and from time to time subscribing or contributing to provident and other funds associations institutions or trusts and by providing or subscribing or contributing towards places of instrument and recreation hospitals and dispensaries medical and other attendance and other assistance as the Board shall think fit and to subscribe or contribute or otherwise to assist or to guarantee money to charitable benevolent religious scientific national or other institutions or objects which shall have any moral or other claim to support or aid by the Company either by reason of locality of operation or of public and general utility or otherwise(15) Before recommending any dividend to set aside out of the profits of the Company such sums as they may think proper for depreciation or to a Depreciation Fund or to an Insurance Fund or as a Reserve Fund or Sinking Fund or any Special Fund to meet contingencies or to repay debentures or debenture stock or for special dividends or for equalizing dividends or for repairing improving extending and maintaining any of the property of the Company and for such other purposes (including the purposes referred to in the preceding clause) as the Board may in their absolute discretion think conducive to the interest of the Company and subject to Section 179 of the Act to invest the several sums so set aside or so much thereof as required to be invested upon such investments (other than shares of the Company) as they may think fit and from time to



83

			<p>time to deal with and vary such investments and dispose of and apply and expend all or any part thereof for the benefit of the Company in such manner and for such purposes as the Board in their absolute discretion think conducive to the interest of the Company notwithstanding that the matters to which the Board apply or upon which they expend the same or any part thereof may be matters to or upon which the capital moneys of the Company might rightly be applied or expended and to divide the Reserve Fund or division or a Reserve Fund to another Reserve Fund or division of a Reserve Fund and with full power to employ the assets constituting all or any of the above funds including the Depreciation Fund in the business of the Company or in the purchase or repayment of Debentures or debenture stock and without being bound to keep the same separate from the other assets and without being bound to pay interest on the same with power however to the Board at their discretion to pay or allow to the credit of such funds interest at such rate as the Board may think proper (16) To appoint and at their discretion remove or suspend such officers such as Executive Director general managers managers secretaries assistants supervisors clerks agents and servants etc. for permanent temporary or special services as they may from time to time think fit and to determine their powers and duties and fix their salaries or emoluments or remunerations and to require security in such instances and to such amounts as they may think fit. And also from time to time to provide for the management and transaction of the affairs of the Company in any specified locality in India or abroad in such manner as they think fit and the provisions contained in the following sub-clauses shall be without prejudice to the general powers conferred by this sub-clause (17) From time to time and at any time to establish any number of offices and establishment for properly managing the affairs of the Company in any specified locality in India or elsewhere and to appoint staff for such offices and to fix their remuneration (18) Subject to the provisions of the Act from time to time and at any time to delegate to any such local Board or any member or member thereof or any managers or agents so appointed or to any other person(s) any of the powers authorities and discretions for the time being vested in the Board and to authorise the members for the time being of any such local Board or any of them to fill up any vacancies therein and to act notwithstanding vacancies and any such appointment or delegation under the preceding and this sub-clause may be made on such terms and subject to such conditions as the Board may think fit and the Board may at any time remove any person so appointed and may annul or vary any such delegation (19) At any time and from time to time by Power of Attorney under the Seal of the Company to appoint any person or persons to be the Attorney or Attorneys of the Company for such purposes and with such powers authorities and discretions (not exceeding those vested in or exercisable by the Board under these presents and excluding the power to make calls and excluding also those which are to be exercised by the Board in its Meetings) and for such period and subject to such conditions as the Board may from time to time think fit and any such appointment may (if the Board thinks fit) be made in favour of the members or any of the members</p>
--	--	--	---



			<p>of any local Board established as aforesaid or in favour of any company or the shareholders directors nominees or managers or any company or firm or otherwise in favour of any persons whether appointed by name or designation by the Board and any such Power of Attorney may contain such powers for the protection or convenience of such Attorney as the Board may think fit and Board may specifically bestow powers enabling any such delegate or attorneys to sub-delegate all or any of the powers authorities and discretions for the time being vested in them (20) Subject to Sections 188 of the Act for or in relation to any of the matters aforesaid or otherwise for the purposes of the Company to enter into such negotiations and contracts and rescind and vary such contracts and execute and do all such acts deeds and things in the name and on behalf of the Company as they may consider expedient (21) From time to time to make vary and repeal bye-laws for the regulations of the business of the Company regulate employment of its officers and servants by making service Rules and Regulations (22) Maintain proper records at places as per provisions of the Act and where the Company has a branch office whether in or outside India the Company shall be deemed to have complied with this Article if proper Books of Account relating to the transactions effected at the branch office are kept at the branch office and proper summarized returns made up-to-date at intervals of not more than three months are sent by the branch office to the Company at its Office or other place in India at which the Company's Books of Accounts are kept as aforesaid (23) Ensure proper maintenance of the Books of Account which shall give a true and fair view of the state of the affairs of the Company or branch office as the case may be and explain its transactions. The Books of Account and other books and papers shall be open to inspection by any Director during business hours.</p>
			<b>Chief Executive Officer, Manager, Company Secretary or Chief Financial Officer</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	77	<ul style="list-style-type: none"> <li>126. CEO MANAGER CS AND CFO Subject to the provisions of the Act –(i) A chief executive officer manager company secretary or chief financial officer may be appointed by the Board for such term at such remuneration and upon such conditions as it may think fit and any chief executive officer manager company secretary or chief financial officer so appointed may be removed by means of a resolution of the Board (ii) A director may be appointed as chief executive officer manager company secretary or chief financial officer As per provisions of the Act or these regulations requiring or authorising a thing to be done by or to a director and chief executive officer manager company secretary or chief financial officer shall not be satisfied by its being done by or to the same person acting both as director and as or in place of chief executive officer manager company secretary or chief financial officer.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	78	•
			<b>The Seal</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>		<ul style="list-style-type: none"> <li>127. The Seal its custody and use The Board shall provide a Common Seal for the purpose of the Company and shall have power from time to time to destroy the same and substitute a new Seal in lieu thereof and the Board</li> </ul>

85



		79	shall provide for the safe custody of the Seal for the time being and the seal shall never be used except on the authority of the Board or by Committee of the Board as authorised. 128. Deeds how executed Every deed or other instrument to which the Seal of the Company is required to be affixed shall unless the same is executed by a duly constituted attorney issued under the seal be signed by two Directors or one Director and Secretary or some other person authorised by the Board for the purpose PROVIDED that in respect of the Share Certificate the Seal shall be affixed in accordance with Article as mentioned above.
			<b>Dividends and Reserve</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	80	<ul style="list-style-type: none"> <li>129. Division of profits and dividends in proportion to amount paid-up (a) The profits of the Company subject to any special rights relating thereto created or authorised to be created by these Articles and subject to the provisions of these Articles shall be divisible among the Members in proportion to the amount of capital paid-up or credited as paid-up on the shares held by them. (b) All dividends shall be apportioned and paid proportionately to the amounts paid or credited as paid on the shares held during any portion or portions of the period in respect of which the dividend is paid but if any share is issued on terms providing that it shall rank for dividend from a particular date such share shall rank for dividend accordingly.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	81	<ul style="list-style-type: none"> <li>130. The Company in General Meeting may declare a dividend Company in General Meeting may declare dividends to be paid to Members according to their respective rights but no dividends shall exceed the amount recommended by the Board but the Company in General Meeting may declare a smaller dividend.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	82	<ul style="list-style-type: none"> <li>131. Dividends only to be paid out of Profits (a) No dividend shall be declared or paid by the Company for any financial year except out of its profits for that year arrived at in the manner set out in Section 123 of the Act. (b) Where owing to inadequacy or absence of profits in any financial year any Company proposes to declare dividend out of the accumulated profits earned by it in previous years and transferred by the company to reserves such declaration of dividend shall not be made except in accordance with such rules as may be made in that behalf. (c) No dividend shall be declared or paid by a company from its reserves other than free reserves.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	83	<ul style="list-style-type: none"> <li>132. Interim Dividend Subject to the provisions of Section 123 the Board may from time to time pay the Members such interim dividend as appear to it to be justified by the profits of the Company.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	84	<ul style="list-style-type: none"> <li>133. Capital paid - up in advance to carry Interest Where capital is paid in advance of calls such capital may carry interest but shall not in respect thereof confer a right to dividend or participate in profits.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	85	<ul style="list-style-type: none"> <li>134. Retention of dividends until completion of transfer The Board may retain the dividends payable on shares in terms of Section 126 in respect of which any person is entitled to become a Member or on completion</li> </ul>

			any person under those Articles is entitled to transfer or until such person shall become a Member in respect of such shares or shall duly transfer the same.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	86	<ul style="list-style-type: none"> <li>135. Transfer of shares must be Registered A transfer of shares shall not pass the right to any dividend declared thereon before the registration of transfer. Provided that where any instrument of transfer of shares has been delivered to the Company for registration and the transfer of such shares has not been registered by the Company it shall notwithstanding anything contained in any other provision of this Act) transfer the dividend in relation to such shares to the Unpaid Dividend Account referred to in Section 124 of the Act unless the Company is authorised by the registered holder of such shares in writing to pay such dividend to the transferee specified in such instrument of transfer and (b) keep in abeyance in relation to such shares any offer of rights shares under clause (a) of sub-section (1) of section 62 of the Act and any issue of fully paid-up bonus shares in pursuance of first proviso to sub-section (5) of section 123 of the Act.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	87	<ul style="list-style-type: none"> <li>136. No Member to receive dividend whilst indebted to the Company Companies right of reimbursement Thereon No Member shall be entitled to receive payment as interest or dividend in respect of his shares whilst any money may be due or owing from him to the Company in respect of such share or shares or otherwise howsoever either alone or jointly with any person or persons and the Board may deduct from the interest or dividend payable to any Member all sums of money so due from him to the Company.</li> </ul>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	88	<ul style="list-style-type: none"> <li>137. Dividends how remitted (1) Unless otherwise directed any dividend payable in cash may be paid by cheque or warrant or in any electronic mode or by a pay slip or receipt or in any other manner having the force of a cheque or warrant sent through the post to the registered address of the Member or person entitled or in case of joint holders to that one of them first named in the Register in respect of the joint holdings. Every such cheque or warrant shall be made payable to the order of the person to whom it is sent the Company shall not be liable or responsible for any cheque or warrant or pay slip or receipt lost in transmission or for any dividend lost to the Member or person entitled thereto by the forged endorsement of any cheque or warrant or the forged signature of any pay slip or receipt or the fraudulent recovery of the dividend by any other means. (2) Notwithstanding anything contained in these Articles any dividend declared may be paid by Electronic Clearing System through any Sponsor Bank after getting registration with the Reserve Bank of India for using this facility and collecting from the members necessary bank mandate in the prescribed format. 138. Dividends and call together Any General Meeting declaring a dividend may on the recommendation of the Board make a call on the Members of such amount as the meeting may fix but so that the call on each Member shall not exceed the dividend payable to him and so that the call be made payable at the same time as the dividend and the dividend may if so arranged between the Company and the Member be set off against the calls. 139. Unclaimed dividend No unclaimed dividend shall be forfeited and all unclaimed dividends shall be dealt with</li> </ul>

87



			in accordance with the provisions of Section 124 and other applicable provisions of the Act. 140. No interest against Dividend No dividend shall bear interest against the company.
			<b>Accounts</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	89	<ul style="list-style-type: none"> <li>141. Directors to keep true accounts (a) Every company shall prepare and keep at its registered office including its branch office or offices or at such other place in India as the Board thinks fit Books of Accounts and other relevant books and papers and financial statement for every financial year which give a true and fair view of the state of the affairs of the company in accordance with Section 128 of the Act with respect to - (i) all sums of money received and expended by the Company and the matters in respect of which the receipts and expenditure take place (ii) all sales and purchases of goods by the Company (iii) the assets and liabilities of the Company. (iv) state of affairs of the company. (b) Where the Board decides to keep all or any of the Books of Account at any place other than the Office of the Company the Company shall within seven days of the decision file with the Registrar a Notice in writing giving the full address of that other place in accordance with Section 128 of the Act. (c) The company may keep such books of account or other relevant papers in electronic mode in such manner as may be prescribed. (d) The Company shall preserve in good order the Books of Account relating to a period of not less than eight financial years immediately preceding a financial year. The books of account and other relevant books and papers maintained in electronic mode shall remain accessible in India so as to be usable for subsequent reference together with the vouchers relevant to any entry in such Books of Account. 142. Inspection of accounts or record by members No Member (not being a director) shall have any right of inspecting any account or books or documents of the Company except as conferred by Section 94 of the Act or authorised by the Board or by the company in general meeting. The Board may determine whether and to what extent and at what time and place and under what conditions or regulations the accounts and books of the Company or any of them may be open to inspection of the Members. Notwithstanding anything to the contrary contained herein above the authorised representative of Promoters shall have a right to inspect the accounts books plant facility documents records premises equipment and machinery and all other property of the Company at convenient time(s) after giving advance notice to the Company. 143. Statement of Accounts to be furnished to General Meeting The Directors shall from time to time in accordance with Sections 129 and 134 and other applicable provisions of the Act cause to be prepared and to be laid before the Company in General Meeting such Balance Sheets Profit and Loss Accounts and Reports as are required by these Sections. 144. Copies shall be sent to each Member Without prejudice to the provisions of Section 101 and subject to the provisions of Section 136 of the Act a copy of the financial statements including consolidated financial statements auditors report and every other document required by law to be annexed or attached to the Balance Sheet shall at least twenty one days before the General Body Meeting at which the same</li> </ul>



88



the joint names of any two or more persons or the survivor or survivors of them. 149. Funds etc. of Company may not be applied in purchase of shares of the Company. The Company shall not give either directly or indirectly and either by means of a loan guarantee the provision of security or otherwise any financial assistance for the purpose of or in connection with the purchase or subscription made or to be made by any person for purchase of any shares in the Company except in conformity with the provisions of Section 67 of the Act. 150. Underwriting and Brokerage Commission may be paid. Subject to the provisions of Section 40 of the Act the Company may at any time pay a commission to any person in consideration of his subscribing or agreeing to subscribe for any shares in or debentures of the Company or procuring or agreeing to procure subscriptions for any shares in or debentures of the Company but so that the commission shall not exceed in case of shares five percent of the price at which the shares are issued and in case of debentures two and a half percent of the price at which the debentures are issued. Such commission may be satisfied by payment in cash or by allotment of fully or partly paid shares or debentures or partly in one way and partly in the other. Brokerage The Company may also on any issue of shares or debentures pay such brokerage as may be lawful. 151. Interest out of Capital Interest may be paid out of capital. Where any shares are issued for the purpose of raising money to defray the expenses of the construction of any work or building or the provision of any plant which cannot be made profitable for a lengthy period the Company may pay interest on so much of that share capital as is for the time being paid up for the period at the rate and subject to the conditions and restrictions provided by the Company Act 2013 and may charge the same to capital as part of the cost of construction of the work or building or the provision of plant. 152. Annual Returns The Company shall comply with the provisions of Sections 92 of the Act as to the making of Annual Returns. 153. Borrowing powers As per the provisions of Section 73 76 179 180 and other applicable provisions of the Act the Board of Directors may from time to time at its discretion by resolution at a meeting of the Board and subject to the approval of the shareholders in General Meeting accept deposits from Members either in advance of calls or otherwise and generally raise or borrow or secure the payment of any sums of money for the purpose of the Company. Provided however where the moneys already borrowed (apart from temporary loans obtained from the Company's bankers in the ordinary due course of business) exceed the aggregate of the paid-up capital of the Company its free reserves (not being reserves set apart for any specific purpose) and the securities premium the Board shall not borrow such moneys without the consent of the Company in General Meeting. Payment or repayment of borrowed Moneys Subject to the provisions of Article 64 hereof of the payment and repayment of moneys borrowed as aforesaid may be secured in such manner and upon such terms and conditions in all respects as the Board of Directors may think fit by resolutions passed at a meeting of the Board and in particular by the issue of bonds or debentures of the Company whether unsecured or secured by a mortgage or charge over all or any part of



the property of the Company(both present and future) including its uncalled capital for the time being and debentures and other securities may be made assignable free from any equities between the Company and the person to whom the same may be issued. Terms of issue of Debentures Any debentures or other securities may be issued otherwise and may be issued on condition that they shall be convertible into shares of any denomination and with any privileges and conditions to redemption surrender drawing allotment of shares and attending (but not voting) at General Meetings. Debentures with the right to conversion into or allotment of shares shall be issued only with the consent of the Company in General Meetings accorded by special resolution. Register of charges to be Kept The Board shall cause a proper Register to be kept in accordance with the provisions of Section 85 of the Act of all charges and floating charges affecting the property or assets of the Company or any of its undertakings and shall cause the requirements of Sections 77 79 and 81 to 87(both inclusive) of the Act in that behalf to be duly complied with so far as they are required to be complied with by the Board. Register of Debenture holders The Company shall if at any time it issues debentures keep a Register and Index of Debenture holders in accordance with Section 88 of the Act. The Company shall have the power to keep in any Country outside India a Register of Debenture holders residing outside India in such manner as may be prescribed. Application to Debentures and other securities The provisions of the Articles shall apply mutatis mutandis to debentures bonds or other securities issued by the company. 154. Dematerialization of Securities Definitions For the purpose of this Article Depository means a depository as defined in clause (e) of sub-section (1) of section 2 of the Depositories Act 1996. Beneficial Owner means a person or persons whose name is recorded in the Register maintained by a Depository under the Depository Act 1996. SEBI means the Securities and Exchange Board of India established under section 3 of the Securities Exchange Board of India Act 1992. Securities means the securities as defined in clause (h) of section 2 of the Securities Contracts (Regulation) Act 1956 Dematerialization of Securities Notwithstanding anything contained in these Articles the Company shall be entitled to dematerialize its existing securities rematerialize its securities held in the Depositories and or offer its fresh securities in dematerialized form pursuant to the provisions of the Depositories Act 1996 and the rules framed there under if any. Option for investors Every person subscribing to or holding securities of the Company shall have the option to receive securities certificates or to hold these securities with the Depository. Such a person who is the beneficial owner of the securities can at any time opt out of the Depository if permitted by the law in respect of any security in the manner and within the time prescribed issued to the beneficial owner the required certificate of the securities. If a person opts to hold his securities with a Depository the Company shall intimate such Depository the details of allotment of the security and on receipt of the information the depository shall enter in its records the name of the allottees as the beneficial owner of the securities. Securities in Depository to be in Fungible Form All securities held by a



Depository shall be dematerialized and be in fungible form. Nothing contained in Section 88 89 112 and 186 of the Act shall apply to a Depository in respect of the securities held by it on behalf of the Beneficial Owners. Rights and Liabilities of Beneficial Owner (a) Notwithstanding anything to the contrary contained in the Act or these Articles a Depository shall be deemed to be the registered owner for the purposes of effecting transfer of ownership of security on behalf of the beneficial owners. (b) Save as otherwise provided in (a) above the Depository as the registered owner of the securities shall not have any voting rights or any other rights in respect of the securities held by it. (c) Every person holding securities of the Company and whose name is entered as the beneficial owner in the records of the Depository shall be deemed to be a member of the Company. The beneficial owner of securities shall be entitled to all the rights and benefits and be subject to all the liabilities in respect of his securities which are held by a Depository. Service of Documents Notwithstanding anything to the contrary contained in the Act or Articles to the contrary where securities are held in a Depository the records of the beneficial ownership may be served by such Depository on the Company by means of electronic mode or by delivery of floppies or discs. Provisions of Articles to apply to shares held in Depository Nothing contained in Section 56 of the Act or these Articles shall apply to a transfer of securities effected by a transferor and transferee both of whom are entered as beneficial owners in the records of a Depository. Allotment of Securities dealt within a Depository Notwithstanding anything in the Act or these Articles where securities are dealt with by the Depository the Company shall intimate the details thereof to the Depository immediately on allotment of such securities. Distinctive numbers of securities held in the depository Mode Nothing contained in the Act or these Articles regarding the necessity of having distinctive numbers on securities issued by the Company shall apply to securities held with a Depository. Register and Index of Beneficial Owners The Register and Index of Beneficial Owners maintained by a Depository under the Depositories Act 1996 shall be deemed to be the Register and Index of member and security holder for the purpose of these Articles. 155. Conversion of Shares into Stock and Reconversion Shares may be converted into stock and reconverted The Company in General Meeting may convert any paid up shares into stock and when any shares shall have been converted into stock these several holders of such stock may henceforth transfer their respective interest therein or any part of such interest in the same manner and subject to the same regulations as if no such conversion had taken place or as near thereto as circumstances will admit. The Company may at any time reconvert any stock into paid-up shares. Rights of stock holders The holders of stock shall according to the amount of stock held by them have the same rights privileges and advantages as regards dividends voting at meetings of the Company and other matters as if they held the shares from which the stock arose 156. Audit Accounts to be audited The Auditors of the Company shall be appointed or reappointed by the Comptroller and Auditor General of India and



their remuneration rights and duties shall be regulated by Section 139 to 143 and 145 to 148 of the Act. Powers of the Comptroller and Auditor General of India. The Comptroller and Auditor General of India shall have the powers-(a) to direct the manner in which the Company's accounts shall be audited by the auditors appointed in pursuance of Article hereof and to give such auditors instruction in regard to any matter relating to the performance of their functions as such. (b) to conduct a supplementary or test audit of the financial statement of the Company by such person or persons as he may authorize in this behalf and for the purposes of such audit to have access at all reasonable times to all accounts account books vouchers documents and other papers of the Company and to require information or additional information to be furnished to any person or persons so authorized on such matters by such person or persons and in such form as the Comptroller and Auditor General may by general or special order direct. Comments upon or supplement to audit report by the Comptroller Auditor General of India to be placed before the annual general meeting. The auditors aforesaid shall submit a copy of his/her audit report to the Comptroller and Auditor General of India who shall have the right to comment upon or supplement such audit report in such manner as he may think fit. Any such comments upon or supplement to the audit report shall be placed before the Annual General Meeting of the Company at the same time and in the same manner as the audit report. 157. Service of Documents Manner of Service of Documents A document or notice may be served or given by the Company to any Member either through speed post registered post or through electronic mode to his registered address or (if he has no registered address in India) to the address if any in India supplied by him to the Company for serving documents or notices on him. Notices to be sent by the company through its authorized and secured computer programme which is capable of producing confirmation and keeping record of such communication addressed to the person entitled to receive such communication at the last electronic mail address provided by the member. The notice may be sent through e-mail as a text or as an attachment to e-mail or as a notification providing electronic link or Uniform Resource Locator for accessing such notice through in-house facility or its registrar and transfer agent or authorise any third party agency providing bulk-mail facility. When notices or documents served on Members Where a document or notice is sent by post service of the document or notice shall be deemed to be effected by properly addressing prepaying and posting a letter containing the document or notice. When notice or notifications of availability of notice are sent by e-mail the company should ensure that it uses a system which produces confirmation of the total number of recipients e-mailed and a record of each recipient to whom the notice has been sent and copy of such record and any notices of any failed transmissions and subsequent re-sending shall be retained by or on behalf of the company as proof of sending. Provided that the member shall provide the updated email address to the company and for that company will provide an advance opportunity at least once in a financial year to the member to register his e-mail address and changes therein and such request may



be made by only those members who havenot got their email id recorded or to update a fresh email id. Notice will also be simultaneously updated in the website of the company. By Advertisement A document or notice advertised in a newspaper circulating in the neighborhood of the Registered Office shall be deemed to be duly served or sent on the day on which the advertisement appears on or to every Member who has no registered address in India and has not supplied to the Company an address within India for the serving of documents or sending the notices to him. Explanatory Statement of material facts under Section 102 need not be advertised but it will be mentioned in the advertisement that the Statement has been forwarded to the Members. On personal representatives etc. A document or notice may be served or given by the Company or to the persons entitled to a share in consequence of the death or insolvency of a Member by sending it through the post in prepaid letter addressed to them by name or by the title of representative of the deceased or assignee of the insolvent or by any like description at the address (if any) in India supplied for the purpose by the persons claimed to be entitled or until such an address has been so supplied by serving the document or notice in any manner in which the same might have been given if the death or insolvency had not occurred. To whom documents or notices must be served or given Documents or notices of every General Meeting shall be served or given in same manner as herein before or to (a) every member of the company legal representative of any deceased member or the assignee of an insolvent member (b) the auditor or auditors of the company and (c) every director of the company. Members bound by documents or notices served on or given to previous holders Every person who by operation of law transfer or other means whatsoever shall become entitled to any share shall be bound by every document or notice in respect of such share which previously to his name and address being entered in the Register of Members shall have been duly served on or given to the person from whom he derives his title to such shares Documents or notice by Company and signature thereto Any document or notice to be served or given by the Company may be signed by a director or key managerial personnel or an officer of the company duly authorised by the Board in this behalf. Service of document or notice by Member All documents or notices to be served or given by Members on or to the Company or any officer thereof shall be served or given by sending it to the Company or Officer at the Office by post or through electronic mode under a certificate of posting or by registered post or through email. 158. Secrecy (a) Every Director Manager Auditor Treasurer Trustee member of a committee officer servant agent accountant or other person employed in the business of the Company shall if so required by the Directors before entering upon his duties sign a declaration pledging himself to observe strict secrecy respecting all transactions and affairs of the Company with the customers and the state of the accounts with individuals and in matters relating thereto and shall by such declaration pledge himself not to reveal any of the matters which may come to his knowledge in the discharge of his duties except when required so to do by the Directors or by law or by the person to whom such



			<p>matters relate and except so far as may be necessary in order to comply with any of the provisions in these presents contained. (b) No Member shall be entitled to visit or inspect any work of the Company without the permission of the Directors or to require discovery of or any information respecting any details of the Company's trading or any matter which is or may be in the nature of a trade secret mystery of trade secret process or any other matter which may relate to the conduct of the business of the Company and which in the opinion of the Directors it would be expedient in the interest of the Company to disclose. 159. Copies of Memorandum and Articles of Association to be sent by the Company. Copies of the Memorandum and Articles of Association of the Company and other documents referred to in Section 17 of the Act shall be sent by the Company to every Member at his request within seven days of the request on payment of such fees as may be prescribed.</p>
--	--	--	---

#### Subscriber Details

S. No.	Subscriber Details				
	*Name, Address, Description and Occupation	DIN / PAN / Passport number	*Place	DSC	Dated
1	M/s PFC Consulting Limited having its registered office at Urjanidhi, 1, Barakhamba Lane, Connaught Place, New Delhi-110001 Through Sh. Sachin Arora S/o Sh. Prem Lal Arora R/o F5 1903, Supertech Eco Village 1, Near Park, Greater Noida, 201301 (as a authorized representative of PFC Consulting Limited)	A*G*A*4*4*	New Delhi		02/12/2024
2	Sh. Sanjay Kumar Nayak S/o Sh. Jagabandhu Nayak R/o K 713, Jalvayu Tower, Sector 56 Gurgaon-Haryana 122011 (As a Nominee of PFC Consulting Limited) Occupation:- Service	0*1*7*9*	New Delhi		02/12/2024
3	Sh. Sachin Shukla S/o Sh. Raj Kumar Shukla R/o 4th Floor, House No. 6, H1 Block, Good Earth City Centre, south City 2, Gurgaon - 122018 (As a Nominee of PFC Consulting Limited) Occupation:- Service	0*6*3*6*	New Delhi		02/12/2024
4	Sh. Rishab Jain S/o Naveen Jain R/o T-11, first floor, Green Park Extension, New Delhi, 110016 (As a Nominee of PFC Consulting Limited) Occupation:- Service	0*4*5*6*	New Delhi		02/12/2024
5	Sh. Rakesh Mohan S/o Sh. Lakshman Singh R/o Flat No-	0*6*4*2*	New Delhi		02/12/2024



	364, Sunehari Bagh Apartment, Sector-13 Rohini New Delhi Delhi 110085 NA India (As a Nominee of PFC Consulting Limited) Occupation:- Service				
6	Sh. Naveen Kumar S/o Jagdish Chander R/o F-024, Asso tech Windsor Court, Sector 78, Noida Gautam Buddha Nagar, Uttar Pradesh, 201301 (As a nominee of PFC Consulting Limited) Occupation - Service	1*4*7*5*	New Delhi		02/12/2024
7	Sh. Neeraj Singh S/o Sh. Dayashankar Singh R/o Flat C-703, The Crescent Apartment, Plot F-2, Sector-50, Noida, Gautam Budh Nagar, UP-201301 (As a Nominee of PFC Consulting Limited) Occupation:- Service	0*6*3*9*	New Delhi		02/12/2024

Signed before me						
Name Prefix (ACA/FCA/ACS/FCS/ACMA/FCMA)	*Name of the witness	*Address, Description and Occupation	*DIN / PAN / Passport number / Membership	*Place	DSC	Dated
FCS	1807	121, Vinayak Apartment, C58/19, Sector-62, Noida-201307, UP	1*0*	Noida		02/12/2024



**For office use only:**

eForm Service request number(SRN)

AB1851572

eForm filing date(DD/MM/YYYY)

03/12/2024

Name of the authorizing officer

PRAMOD MEENA

This e-Form is hereby approved



This e-Form is hereby rejected



Date of Signing (DD/MM/YYYY)

04/12/2024



**ANNEXURE III: Global Invitation for Selection of Transmission Service Provider**



98

ed beyond the due date  
Drafts should be

**MEMBER LIST**

Date: 14.09.2024

Category -  
Persons may  
validate their  
Association to  
Members of PCA

Name of Person	City
Virend Kumar	Jalandhar
Kamraj Aggarwal	New Delhi
Ranjinder Nanda	Jalandhar
Chander Oswala	Patiala
Anil D Mehta	Jalandhar
Madan Lal Puri	Jalandhar
Vijay Bahadur Singh	Patiala
Wazir Chand Bawal	Ludhiana
P.G. Lal	Patiala
Arvind Sur	Jalandhar
Lalit Kumar	Not known
Arvind Singh Bamala	Not known

to PCA on pca@cricketpunjab.in  
Mr. Ajay Thakur. +91 7698116659.  
Manager Corporate Affairs

**COMMITTEE AUTHORITY**

Dr. Lal Mohan Mehta, J.S. puri-202004

5/8-63 Dated: 12.09.2024

**INVITING BID**

Dir.Engg.-1/15/2024-25

1 bidders for following works :-

Est of work (Lacs)	Nature of Work	Last Date
65.95	Road	14.10.2024
68.29	Construction of Box Drain	03.10.2024
3.24	Development work	01.10.2024
4.29	Electric work	30.09.2024
8.96	Construction of Box Culvert	26.09.2024
8.31	Road	30.09.2024

pective bid may be visited on  
the [www.sppc.rajasthan.gov.in](http://www.sppc.rajasthan.gov.in)  
or [www.ida.rajasthan.gov.in](http://www.ida.rajasthan.gov.in).

Executive Engineer &  
TA to Dir.Engg-1

**वि.मध्यप्रदेश स्टेट माइनिंग कॉर्पोरेशन लिमिटेड**  
(वि.मध्यप्रदेश शासन का उपक्रम)  
पब्लिक वार्पन्टिंग : पर्यावरण प्रवर्धन, ब्लॉक नं.-1 (ए)  
श्रीगंग नगर जेल रोड, अमरावत हिल्स, भोपाल-462011  
दूरभाष : 2763391, 2763392, 2763393, फैक्स : 0755-2763394  
Website : [www.mpsmcl.mp.gov.in](http://www.mpsmcl.mp.gov.in)  
E-mail : [info.mpsmcl@mp.gov.in](mailto:info.mpsmcl@mp.gov.in), CIN : U10410MP1962SGC000937  
आवक-वि.क्र.म./म.अ.-55/2024/240 दिनांक : 12.09.2024

**रॉक फॉस्फेट खदानों से 12-14% P<sub>2</sub>O<sub>5</sub> खनिज के ई ऑक्शन के माध्यम से विक्रय की सूचना**

वि.मध्यप्रदेश स्टेट माइनिंग कॉर्पोरेशन लिमिटेड, भोपाल समूह, जिला शाबुगा की रॉक फॉस्फेट खदानों से 12-14% P<sub>2</sub>O<sub>5</sub> खनिज के 10,000 मेट्रिक टन के 15 लॉट एवं हीरपुर समूह जिला सागड़/उत्तरपुर की रॉक फॉस्फेट खदानों से 12-14% P<sub>2</sub>O<sub>5</sub> खनिज के 10,000 मेट्रिक टन के 12 लॉट का विक्रय ई ऑक्शन के माध्यम से करने का इच्छुक है।  
ई ऑक्शन, ऑनलाइन पॉर्टल <https://eauction.gov.in> के माध्यम से भोपाल समूह एवं हीरपुर समूह हेतु बुधक-बुधक संपादित किया जाएगा। निविदा की शर्तों एवं पत्रिका आदि पोर्टल <https://eauction.gov.in> एवं निगम की वेबसाइट <https://mpsmcl.mp.gov.in> पर दिनांक 13.09.2024 से देखी जा सकती है।  
म.अ. प्रा.क्र.म./116420/2024 प्रबंध संचालक.

**Bhusawal Municipal**  
Bhusawal Municipal  
Jaigaon invites E-tender  
Bhusawal water supply sc  
Or under-Amrut 2.  
Please visit website for  
more details and informat  
tender available from 14/09

**CENTRAL RAILWAY**  
NOTICE FOR E-AUCTION  
Sr. Divisional Commercial Manager,  
Pune Division has called for an  
e-auction for the below given Trains:  
Catalogue No.: PA<sup>2</sup>SLR 24-8  
Category of LOT: SLR over Pune  
Division Train No.: 11077 Auction  
Date & Time: 27/09/2024 - 11:00  
Hrs. For details visit website  
[www.reps.gov.in](http://www.reps.gov.in) [A/H/19]  
DOWNLOAD THE APPLICATIONS

**PFC CONSULTING LIMITED**  
(A wholly owned subsidiary of PFC Limited)  
Regd. Office: First Floor, "Urjanidhi", 1, Barakhamba Lane, Connaught Place, New Delhi - 110001, (India) Fax : 011-23443990

**GLOBAL INVITATION (THROUGH E-BIDDING ONLY)**  
**FOR SELECTION OF TRANSMISSION SERVICE PROVIDER ON BUILD, OWN, OPERATE AND TRANSFER (BOOT) BASIS FOR INTER-STATE TRANSMISSION PROJECTS**

PFC Consulting Limited, a wholly owned subsidiary of Power Finance Corporation Limited (A Government of India Undertaking), invites proposals for setting up of transmission projects on Build, Own, Operate and Transfer (BOOT) basis following single stage two envelope process of "Request for Proposal" (RFP). Interested bidders may refer to the RFP notification and RFP documents available on the website <https://www.mscecommerce.com> and <https://www.pfcindia.com>.  
(The Bidders may obtain the RFP documents on all working days between 10:00 hrs (IST) and 18:00 hrs (IST) from 14.09.2024 to one working day prior to bid submission for the projects mentioned below on payment of a non-refundable fee of Rs. 5,00,000/- or USD 7,000 plus applicable GST @ 18% from 8th Floor, Wing - A, Statesman House, Connaught Place, New Delhi - 110001, Tel.: 91-11-23443996, Fax: 91-11-23443990; e-mail: [pfccl.hp@pfcindia.com](mailto:pfccl.hp@pfcindia.com). The RFP documents can also be downloaded from <https://www.mscecommerce.com> and <https://www.pfcindia.com>, however, in such cases, interested party can submit Response to RFP only on submission of non-refundable fee of Rs. 5,00,000/- or USD 7,000 plus applicable GST @ 18% separately. The survey report and clarification to RFP documents shall be issued to those bidders, who have obtained/purchased RFP documents by paying requisite fee at least one working day prior to bid submission date. Bidders should regularly visit website to keep themselves updated regarding clarifications/ amendments/ time extensions etc., if any. The important timelines in this regard are as follows:

S. No.	Name of Transmission Scheme	Last Date for Seeking clarifications (dd/mm/yyyy)	Last Date for submission of response to RFP (dd/mm/yyyy) up to 15:00 hrs (IST)	Date of opening of Response to RFP (dd/mm/yyyy) up to 15:30 hrs (IST)
1.	Transmission System for evacuation of power from Mahan Energen Limited Generating Station in Madhya Pradesh	04.10.2024	18.11.2024 up to 15:00 hrs (IST)	18.11.2024 up to 15:30 hrs (IST)
2.	Transmission system for evacuation of RE power from Raghunesda Area of Gujarat-3GW under Phase-I	04.10.2024	19.11.2024 up to 15:00 hrs (IST)	19.11.2024 up to 15:30 hrs (IST)
3.	Provision of ICT Augmentation and Bus Reactor at Bhuj-II PS	04.10.2024	20.11.2024 up to 15:00 hrs (IST)	20.11.2024 up to 15:30 hrs (IST)

Note: PFC Consulting Limited reserves the right to cancel or modify the process without assigning any reason and without any liability. This is not an offer.

Bid Process Coordinator  
**PFC CONSULTING LTD.**  
(A wholly owned subsidiary of PFC Ltd.)  
(A Govt. of India Undertaking)

An Initiative of  
**Ministry of Power**  
Government of India

Initiative Partner:  
**Central Electricity Authority**

HT Paine 14-09-2024

Query related to this notice (if any) 011-435  
Please read the terms & conditions





morning, afternoon and night shifts. Night duty is the most lucrative, meaning workers relieved of it face a shortfall of hundreds of euros a month.

Benay Littau, who works in a Wolfsburg plant where the VW Golf is made, declared that while he was partly relieved to have stopped working nights two years ago, he was feeling the effects on his bank account. "Many of my colleagues started having issues with their mortgages," Littau said, while expressing frustration with the common perception that VW workers are exceptionally well off. "It is physically demanding labour... We work hard for the money."

Wolfsburg's mayor, Dennis Wellmann, said that he sensed growing frustration among residents. "Naturally, there is growing concern about jobs."

He said VW's woes, and its implications for the city and neighbouring towns, had put more than employment at stake. "My father and both my grandfathers worked for Volkswagen. Volkswagen is part of our identity."

chips in-house and to reduce its reliance on Nvidia.

Analysts say securing customers for 18A is critical for Intel's long-term fortunes. Microsoft is one of the first public customers.

Intel shares were up 5.7 per cent at lunchtime in New York yesterday.

Gelsinger has been working to separate the group's chip manufacturing business more clearly from its product operation as he seeks to compete with Taiwan's TSMC and build a client-facing chipmaking powerhouse in the US.

Filings earlier this year revealed a \$7bn loss for its chipmaking business in 2023, as the company poured billions of dollars into building facilities in Arizona, Ohio, New Mexico and Oregon.

Gelsinger said that the company's manufacturing unit would have a new governance structure with its own operating board of independent directors. Clearer separation from the rest of Intel, he wrote, would "unlock important benefits" including "flexibility to evaluate independent sources of funding" and would optimise the capital structure of each business.

## Middle East

"The comfort we are giving the US government on the export control front that we are the home for responsible AI."

Abu Dhabi - which has ambitions to become an AI hub - has sought to reassure the US over concerns about tech exports, despite its deep relationship with Beijing.

The UAE's efforts to secure access to AI are spearheaded by national security adviser and G42 chair Sheikh Khalifa bin Zayed Al Nahyan, who runs a business empire. US private equity group Silver Lake has backed G42 as Abu Dhabi sovereign investor Masdar.

People involved in the discussions in Washington said that while commerce and trade officials are broadly comfortable with Microsoft's relationship with the UAE, some security officials had been more reluctant to allow closer ties between the groups.

G42 has said it is cutting ties to Chinese suppliers including Huawei and is phasing out their hardware.

The company said that this year it had adopted a policy of not doing business with any entity "on the US exports control list. Xiao said he did not believe the company had done so previously.

### Contracts & Tenders

## PFC CONSULTING LIMITED

(A wholly owned subsidiary of PFC Limited)

Regd. Office: First Floor, 'Urjanidhi', 1, Barakhamba Lane, Connaught Place, New Delhi - 110001, (India) Fax : 011-23443990

### GLOBAL INVITATION (THROUGH E-BIDDING ONLY)

### FOR SELECTION OF TRANSMISSION SERVICE PROVIDER ON BUILD, OWN, OPERATE AND TRANSFER (BOOT) BASIS FOR INTER-STATE TRANSMISSION PROJECTS


PFC Consulting Limited, a wholly owned subsidiary of Power Finance Corporation Limited (A Government of India Undertaking), invites proposals for setting up of transmission projects on Build, Own, Operate and Transfer (BOOT) basis following single stage two envelope process of 'Request for Proposal' (RFP). Interested bidders may refer to the RFP notification and RFP documents available on the website <https://www.mtccommerce.com> and <https://www.pfcindia.com>. The Bidders may obtain the RFP documents on all working days between 10:30 hrs (IST) and 16:00 hrs (IST) from 14.09.2024 to one working day prior to bid submission for the projects mentioned below on payment of a non-refundable fee of Rs. 5,00,000/- or USD 7,000 plus applicable GST @18% from 10th Floor, Wing - A, Statesman House, Connaught Place, New Delhi - 110001, Tel: 01-11-23443996; Fax: 01-11-23443990; e-mail: [pfc@pfcindia.com](mailto:pfc@pfcindia.com). The RFP documents can also be downloaded from <https://www.mtccommerce.com> and <https://www.pfcindia.com>, however, in such case, interested party can submit Response to RFP only on submission of non-refundable fee of Rs. 5,00,000/- or USD 7,000 plus applicable GST @18% separately. The survey report and clarification to RFP documents shall be issued to those bidders, who have obtained/purchased RFP documents by paying requisite fee of at least one working day prior to bid submission date. Bidders should regularly visit website to keep themselves updated regarding clarifications/ amendment/ time extensions etc. if any. The important timelines in this regard are as follows:

S. No.	Name of Transmission Scheme	Last Date for Seeking clarifications (dd/mm/yyyy)	Last Date for submission of response to RFP (dd/mm/yyyy)	Date of opening of Response to RFP (dd/mm/yyyy)
1.	Transmission System for evacuation of power from Mahan Energy Limited Generating Station in Madhya Pradesh	04.10.2024	16.11.2024 up to 15:00 hrs (IST)	18.11.2024 up to 15:30 hrs (IST)
2.	Transmission system for evacuation of RE power from Raghunada Area of Gujarat-JGW under Phase-I	04.10.2024	18.11.2024 up to 15:00 hrs (IST)	18.11.2024 up to 15:30 hrs (IST)
3.	Provision of ICT Augmentation and Bus Reactor at Bhubli PS	04.10.2024	20.11.2024 up to 15:00 hrs (IST)	20.11.2024 up to 15:30 hrs (IST)

Note: PFC Consulting Limited reserves the right to cancel or modify the process without assigning any reason and without any liability. This is not an offer.

An Initiative of

Bid Process Coordinator



(A wholly owned subsidiary of PFC Ltd)  
(A Govt. of India Undertaking)



Ministry of Power  
Government of India

Initiative Partner



Central Electricity Authority

Financial Times 18-09-2024



Patna 14-09-2024

घटना, राबिवाट, 14 सितंबर 2024 11

### पीएफसी कंसल्टिंग लिमिटेड

(पीएफसी लिमिटेड की पूर्ण स्वामित्व वाली महासंयुक्त कंपनी)  
 पंजीकृत कार्यालय: प्रभत वत, "कजाडिगि" 1, राबिवाट क्षेत्र, कानपुर-208001 (भारत) फोन: 011-23443290

#### द्वैधिक आमंत्रण (केवल ई-निविदा के माध्यम से) अन्तर्राष्ट्रीय पारेषण परियोजनाओं के लिए निर्माण, स्वामित्व, प्रचालन और स्थानांतरण (BOOT) आधार पर पारेषण सेवा प्रदाता के चयन हेतु

पीएफसी कंसल्टिंग लिमिटेड, भारत सरकार की पूर्ण स्वामित्व वाली महासंयुक्त कंपनी एक सार्वजनिक निगम के रूप में "प्रस्ताव हेतु अधिसूचना" (आरएफटी) का प्रचलन करते हुए निर्माण, स्वामित्व, प्रचालन एवं स्थानांतरण (BOOT) आधार पर अंतर्राष्ट्रीय परियोजनाओं की स्थापना के लिए प्रस्ताव आमंत्रित करता है।

इसके अतिरिक्त वेबसाइट <https://www.mpsc.com> और <https://www.pfcindia.com> पर उपलब्ध आरएफटी और प्रस्ताव तथा आरएफटी परामर्श देता करता है।  
 निविदापत्रता अ-प्रतिदेय शुल्क ₹. 5,00,000/- या यूरसटी (यूएस डॉलर) 7,000 पर 18 प्रतिशत की दर से लागू जीएसटी का भुगतान करते आरएफटी परामर्श 14.09.2024 से निम्नलिखित परियोजनाओं के लिए निविदा जमा करने से एक कार्यदिनांक पूर्व तक सभी कार्यदिनांक में 10:30 बजे (आरएफटी) से 10:00 बजे (आरएफटी) के बीच बंद कर, किंग-पु, एंटेल्समैन हाउस, राबिवाट क्षेत्र, कानपुर-208001, फोन 01-11-23443290 फैक्स 01-11-23443290, ई-मेल: [pfcindia@pfcindia.com](mailto:pfcindia@pfcindia.com) से प्राप्त कर सकते हैं।  
 आरएफटी परामर्श <https://www.mpsc.com> तथा <https://www.pfcindia.com> से भी उपलब्ध किए जा सकते हैं।  
 ग्राहक, ऐसे प्रस्ताव में इसका पहलू को आरएफटी के तहत के साथ अलग से अ-प्रतिदेय शुल्क ₹. 5,00,000/- या यूरसटी (यूएस डॉलर) 7,000 पर 18 प्रतिशत की दर से लागू जीएसटी का जमा करने आरएफटी के तहत जमा कर सकते हैं। आरएफटी परामर्श के लिए प्रस्ताव निविदाएं एवं कार्यदिनांक एवं कोडीकरण को छोड़कर अन्य सभी कार्यदिनांक हेतु आरएफटी को निविदा जमा करने की तिथि से कम से कम एक कार्यदिनांक पूर्व आरएफटी शुल्क का भुगतान कर आरएफटी परामर्श प्राप्त/जमा था। स्वामित्व/संचालन/समय विस्तार यदि होता है, आदि के संभावित जोखिम को अमान्य रखने के लिए निविदापत्रता नियमित रूप से वेबसाइट में चेक करें। इस संकेत में महत्वपूर्ण विधियां निम्नानुसार हैं:

क्र. सं.	पारेषण योजना का नाम	स्वीकृति प्राप्त करने की अंतिम तिथि दि.दि./मा.सं./व.सं.	आरएफटी का प्रस्ताव जमा करने की अंतिम तिथि दि.दि./मा.सं./व.सं.	आरएफटी प्रस्ताव जमाने की तिथि दि.दि./मा.सं./व.सं.
1.	मध्य प्रदेश में महान एनर्जी लिमिटेड उत्पादन संयंत्रों से निर्यात की निवृत्ति के लिए पारेषण प्रणाली स्थापना कार्यालय समय - सीमा	04/10/2024	18/11/2024 को 15:00 बजे (आरएफटी) तक	18/11/2024 को 15:30 बजे (आरएफटी) तक
2.	गुजरात के सचनेला क्षेत्र से नवीकरणीय ऊर्जा की निवृत्ति के लिए पारेषण प्रणाली - संचालन - 1 के अंतर्गत 3 मीगावाट स्थापित कार्यालय समय - सीमा	04/10/2024	18/11/2024 को 15:00 बजे (आरएफटी) तक	18/11/2024 को 15:30 बजे (आरएफटी) तक
3.	यू.पी. पीएस में आर्द्रतीला संकलन और बस विस्तार का प्रस्ताव।	04/10/2024	20/11/2024 को 15:00 बजे (आरएफटी) तक	20/11/2024 को 15:30 बजे (आरएफटी) तक

नोट: पीएफसी कंसल्टिंग लिमिटेड निम्न पोस्ट जांच करता है और बिना किसी दायित्व के निविदा प्रक्रिया को प्रस्ताव या संबंधित करने का अधिकार रखता है। यह कोई प्रस्ताव नहीं है।

महोदय प्रभत वत, राबिवाट क्षेत्र, कानपुर-208001

भारत सरकार का सांविधिक निकाय

विद्युत नियंत्रण आयोग

राबिवाट क्षेत्र, कानपुर-208001

### सूचना

एएम त्वोडा समिति के मामले में)

सिधियों को क्रय करने

करने के विरुद्ध इच्छुक

आप जनता को चेतावनी

दा) में लागू जाता है कि सीए

प्रस्तावों के माध्यम से भारतीय प्रतिभूति

सिधियों के माध्यम से पाननीय भारतीय

अनुदान 02 परवरी,

अनुदान में, पीएसएल लि.

अनुदान/कार्यालय/ग्रुप और

वस्तु में अथवा इतरक बाहर उन

न लि. अथवा इतरक कोई

सी प्रकार से कोई अधिभूत/अति

अतिभूत/अतिभूत-अंतरण करने से

आप निम्न जाते हैं कि पाननीय

प्रस्ताव उपरोक्त अधिसूचना दिनांक

के माध्यम से (सोसायिटी) के माध्यम से) की पीएसएल

**अखिल भारतीय तकनीकी शिक्षा परिषद्**  
 (भारत सरकार का सांविधिक निकाय)  
 नेशनल मंडेला मार्ग, अग्रत केंद्र, नई दिल्ली-110070  
 वेबसाइट: [www.aicte-india.org](http://www.aicte-india.org)  
 फोन नं.: 011-29581000

### अभातशिप छात्रवृत्ति योजनाएँ 2024-25

अभातशिप द्वारा अनुमोदित संस्थानों/भाष्यक्रमों में अध्ययनरत वर्ष 2024-25 में प्रवेश पाए पात्र विद्यार्थियों से सौचिक वर्ष 2024-25 के लिए डीबीटी के माध्यम से छात्रवृत्ति के वितरण के लिए दिनांक 30.06.2024 से ऑनलाइन प्रस्ताव आमंत्रित किए गए हैं।

क्र. सं.	योजना का नाम	आवेदन हेतु ऑनलाइन पोर्टल	विद्यार्थी द्वारा आवेदन जमा करने की अंतिम तिथि	संस्थान द्वारा आवेदन का सत्यापन / जमा करने की अंतिम तिथि
01.	अभातशिप प्रगति छात्रवृत्ति योजना (डिग्री और डिप्लोमा) (नई और नवीकृत)			
02.	अभातशिप समाप्त छात्रवृत्ति			



**ANNEXURE IV : REQUEST FOR PROPOSAL ALONG WITH AMENDMENTS ISSUED BY BPC**



**STANDARD SINGLE STAGE REQUEST FOR PROPOSAL DOCUMENT**

**FOR**

**SELECTION OF BIDDER AS TRANSMISSION SERVICE PROVIDER THROUGH TARIFF  
BASED COMPETITIVE BIDDING PROCESS**

**TO**

**ESTABLISH INTER-STATE TRANSMISSION SYSTEM**

**FOR**

**TRANSMISSION SYSTEM FOR EVACUATION OF RE POWER FROM RAGHANESDA  
AREA OF GUJARAT-3GW UNDER PHASE-I**

**ISSUED BY**



(A wholly owned subsidiary of Power Finance Corporation Ltd.)

**Registered Office:**

**1st Floor, "Urjanidhi", 1, Barakhamba Lane,  
Connaught Place, New Delhi-110001**

**September 14, 2024**



**PFC CONSULTING LIMITED**  
(A wholly owned subsidiary of Power Finance Corporation Limited)

**Corporate Office:**  
9th Floor, A-Wing, Statesman House  
Connaught Place, New Delhi-110001

Request for Proposal Document for selection of Bidder as Transmission Service Provider through tariff based competitive bidding process to establish Inter-State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" is issued by PFC Consulting Limited.

This RFP document is issued to -

M/s. \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

**General Manager**  
**PFC Consulting Limited**  
9th Floor, A-Wing, Statesman House  
Connaught Place, New Delhi-110001  
Email: pfccl.itp@pfcindia.com  
Place: New Delhi  
Date:

PFC CONSULTING LIMITED



105

**REQUEST FOR PROPOSAL NOTIFICATION****PFC CONSULTING LIMITED**

(A wholly owned subsidiary of Power Finance Corporation Limited)

**Corporate Office:****9th Floor, A-Wing, Statesman House  
Connaught Place, New Delhi-110001**

1. The Government of India, Ministry of Power, vide its gazette notification no CG-DL-E-22082024-256561 dated August 21, 2024 has notified PFC Consulting Limited (PFCL) to be the Bid Process Coordinator (BPC) for the purpose of selection of Bidder as Transmission Service Provider (TSP) to establish Inter-State transmission system for **"Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I"** through tariff based competitive bidding process.
2. PFC Consulting Limited (PFCL) (hereinafter referred to as BPC) hereby invites all prospective Bidders for issue of Request for Proposal (RFP) for selection of Bidder as Transmission Service Provider (TSP) on the basis of international competitive bidding in accordance with the "Tariff Based Competitive Bidding Guidelines for Transmission Service" and "Guidelines for Encouraging Competition in Development of Transmission Projects" issued by Government of India, Ministry of Power under section – 63 of The Electricity Act, 2003 and as amended from time to time. The responsibility of the TSP would be to establish the following Inter-State Transmission System – **"Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I"** (hereinafter referred to as 'Project') on build, own, operate and transfer basis and to provide transmission service:

<b>Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I</b>		
<b>S No.</b>	<b>Name of Transmission Element</b>	<b>Scheduled COD from Effective Date</b>
1.	<p>Establishment 4x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor</p> <ul style="list-style-type: none"> <li>• 765/400 kV, 1500 MVA ICT – 4 Nos. (13x500 MVA single phase units including one spare ICT Unit)</li> <li>• 765 kV ICT bays – 4 Nos.</li> <li>• 400 kV ICT bays – 4 Nos.</li> <li>• 765 kV Line bays – 2 Nos.</li> <li>• 1x330 MVAR, 765 kV bus reactor- 2 Nos. (7x110 MVAR single phase Reactors including one spare Unit for bus /line reactor)</li> <li>• 765 kV Bus reactor bay – 2 Nos.</li> <li>• 125 MVAR, 420 kV reactor- 2 Nos.</li> <li>• 400 kV Reactor bay- 2 Nos.</li> <li>• 400 kV line bays - 4 Nos. (for interconnection of RE Projects)</li> </ul> <p><b>Future Scope (Space for):</b></p> <ul style="list-style-type: none"> <li>• 765/400 kV ICT along with bays- 4 Nos. (on Sec-II)</li> <li>• 765 kV line bays along with switchable line reactors – 8 Nos. (4</li> </ul>	27 Months



Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I		
S No.	Name of Transmission Element	Scheduled COD from Effective Date
	Nos. on Sec-I and 4 Nos. on Sec-II) <ul style="list-style-type: none"> <li>• 765 kV Bus Reactor along with bay: 2 Nos. (on Sec-II)</li> <li>• 765 kV Sectionalizer: 1 -set</li> <li>• 400 kV line bays along with switchable line reactors– 12 Nos. (4 Nos. on Sec-I and 8 Nos. on Sec-II)</li> <li>• 400/220 kV ICT along with bays - 6 Nos. (2 Nos. on Sec-I &amp; 4 Nos. on Sec-II) (in addn. to 2 Nos. 400/220 ICTs on Sec-I in present scope)</li> <li>• 400 kV Bus Reactor along with bays: 2 Nos. (Sec-II)</li> <li>• 400 kV Sectionalization bay: 1- set</li> <li>• 220 kV line bays: 10 Nos. (4 Nos. on Section-I and 6 Nos. on Section-II) (in addition to 2 Nos. 220 kV bays on Section-I in present scope)</li> <li>• 220 kV Sectionalization bay: 1 set</li> <li>• 220 kV BC: 1 No. (For Section-II)</li> <li>• Establishment of 6000 MW, <math>\pm</math> 800 kV Raghnesda (HVDC) [LCC] terminal station (4x1500 MW) along with associated interconnections with 400 kV HVAC Switchyard and all associated equipment (incl. filters)/bus extension, etc.</li> </ul>	
2.	Raghnesda (GIS) – Banaskantha (PG) 765 kV D/c line	
3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s <ul style="list-style-type: none"> <li>• 765 kV line bays – 2 Nos.</li> </ul>	
4.	Creation of 220kV switchyard (Bus Sec-I) at Raghnesda PS (GIS) along with installation of 2x500MVA, 400/220 kV ICTs <ul style="list-style-type: none"> <li>• 500MVA, 400/220kV ICT – 2 Nos.</li> <li>• 400kV ICT bay – 2 Nos.</li> <li>• 220kV ICT bay – 2 Nos.</li> <li>• 220kV BC – 1 No.</li> </ul>	30.09.2027 (subject to minimum 27 Months)
5.	1 no. 220kV line bay (GIS) (on 220kV Bus Sec-I) for interconnection of Solar project of Azure Power Sixty Three Pvt. Ltd. (2200001107) (300MW) <ul style="list-style-type: none"> <li>• 220kV line bay–1 no.</li> </ul>	
6.	1 no. 220kV line bay (GIS) (on 220kV Bus Sec-I) for interconnection of Solar project of Sunsure Solarpark RJ One Pvt. Ltd. (2200001018) (350MW) <ul style="list-style-type: none"> <li>• 220kV line bay–1 no.</li> </ul>	31.03.2028

**Note:**

- TSP of Banaskantha S/s (POWERGRID) shall provide space for scope at Sl. 3 above.
  - Bay(s) required for completion of diameter (GIS) in one-and-half breaker scheme shall also be executed by the TSP.
3. The TSP shall ensure that design; construction and testing of all equipment, facilities, components and systems of the Project shall be in accordance with the provisions of the



Transmission Service Agreement and applicable Rules/ Regulations, Orders and Guidelines issued by the Central Government.

4. **Transmission License:** The TSP shall obtain the Transmission License from the Commission.
5. **Bidding Process:** The Transmission Service Provider shall be selected through tariff based competitive bidding process for the Project based on meeting stipulated Qualification Requirements prescribed in Clause 2.1 of Section 2 of RFP and the lowest Quoted Transmission Charges discovered from Final Offers quoted during the e-reverse bidding. The selection of the TSP shall be subject to it obtaining Transmission License from the Commission, which, after expiry, may be further extended by such period as deemed appropriate by the Commission under powers vested with it to amend the conditions of the Transmission License.

The entire bidding process shall be conducted on electronic platform created by MSTC Limited.

The Bid shall be a single stage two envelope bid comprising the Technical Bid and the Financial Bid. The Bidders shall submit the Bid online through the electronic bidding platform. In addition to the online submission, the Bidder with lowest Final Offer will be required to submit original hard copies of Annexure 3, Annexure 4 (if applicable), Annexure 6 (if applicable) and Annexure 14 before issuance of LoI. There shall be no physical submission of the Financial Bid.

The Technical Bid shall be opened first and the Financial Bid of only the bidder who have qualified in the Technical Bid shall be opened. The Financial Bid will comprise of two rounds. In the first round the Initial Offer of the responsive bids would be opened and Quoted Transmission Charges of Initial Offer shall be ranked on the basis of ascending order. The Bidders, in the first fifty per cent of the ranking (with any fraction rounded off to higher integer) or four Bidders, whichever is higher, shall qualify for participating in the electronic reverse auction stage and submit their Final Offer.

6. The objective of the bidding process is to select a Successful Bidder pursuant to this RFP, who shall acquire one hundred percent (100%) of the equity shares of **RAGHANESDA RE TRANSMISSION LIMITED** along with all its related assets and liabilities as per the provisions of the Share Purchase Agreement, at the Acquisition Price to be intimated by the BPC, twenty (20) days prior to the Bid Deadline.

The **RAGHANESDA RE TRANSMISSION LIMITED**, of which one hundred percent (100%) equity shares will be acquired by the Selected Bidder, shall be responsible as the TSP, for ensuring that it undertakes ownership, financing, development, design, engineering, procurement, construction, commissioning, operation and maintenance of the Project, and to provide Transmission Service as per the terms of the RFP Project Documents.

The TSP shall ensure transfer of all project assets along with substation land, right of way and clearances to CTU or its successors or an agency as decided by the Central Government after 35 years from COD of project at zero cost and free from any encumbrance and liability. The transfer shall be completed within 90 days after 35 years from COD of project failing which CTU shall be entitled to take over the project assets Suo moto.

7. **Commencement of Transmission Service:** The Bidder shall have to commence Transmission Service in accordance with the provisions of the Transmission Service Agreement.
8. **Transmission Charges:** The Transmission Charges shall be payable by the Designated ISTS Customers in Indian Rupees through the CTU as per Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations as amended from time to



time. Bidders shall quote the Transmission Charges as per the pre-specified structure, as mentioned in the RFP.

9. **Issue of RFP document:** The detailed terms and conditions for qualification and selection of the Transmission Service Provider for the Project and for submission of Bid are indicated in the RFP document. All those interested in purchasing the RFP document may respond in writing to **General Manager, Tel. +91 11 23443996, Fax +91 11 23443990, Email: pfcccl.itp@pfccindia.com** at the address given in para 12 below with a non-refundable fee of **Rs.5,00,000/- (Rupees Five Lakh Only) or US\$7000/- (US Dollars Seven Thousand Only)** plus 18% GST, to be paid via electronic transfer to the following Bank Account:

**Bank Account Name : PFC Consulting Limited**  
**Account No. : 000705036117**  
**Bank Name : ICICI Bank**  
**IFSC : ICIC0000007**  
**Branch : Connaught Place, New Delhi-110001**

latest by **March 13, 2025**. Immediately after issuance of RFP document, the Bidder shall submit the Pre-Award Integrity Pact in the format as prescribed in **Annexure B**, which shall be applicable for and during the bidding process, duly signed on each page by any whole-time Director / Authorized Signatory, duly witnessed by two persons, and shall be submitted by the Bidder in two (2) originals in a separate envelope, duly superscripted with Pre-Award Integrity Pact. The Bidder shall submit the Pre-Award Integrity Pact on non-judicial stamp paper of Rs.100/- each duly purchased from the National Capital Territory of Delhi. In case the Bidder is in a consortium, the Pre-Award Integrity Pact shall be signed and submitted by each member of the Consortium separately.

The RFP document shall be issued to the Bidders on any working day from **September 14, 2024 to March 13, 2025 between 10:30 hours (IST) to 16:00 hours (IST)**. The BPC, on written request and against payment of the above mentioned fee by any Bidder shall promptly dispatch the RFP document to such Bidder by registered mail/ air mail. BPC shall, under no circumstances, be held responsible for late delivery or loss of documents so mailed.

10. **Receipt and opening of Bid:** The Bid must be uploaded online through the electronic bidding platform on or before **15:00 hours (IST) on March 17, 2025**. Technical Bid will be opened by the Bid Opening Committee on the same day at 15:30 hours (IST) in the office of Central Electricity Authority, in the online presence of Bidders' representatives who wish to attend. If the Bid Deadline is a public holiday at the place of submission of Bid, it shall be opened on the next working day at the same time and venue. In addition to the online submission, the Bidder with lowest Final Offer will be required to submit original hard copies of Annexure 3, Annexure 4 (if applicable), Annexure 6 (if applicable) and Annexure 14 before issuance of Lol. Bidders meeting the Qualification Requirements, subject to evaluation as specified in Clause 3.2 to 3.4 shall be declared as "Qualified Bidders" and eligible for opening of Initial Offer.
11. The RFP document is not transferable. BPC reserves the right to reject all Bid and/or annul the process of tariff based competitive bidding for selection of Bidder as TSP to execute the Project without assigning any reason. BPC shall not bear any liability, whatsoever, in this regard.

**12. Nodal person for enquiries and clarifications**

All correspondence and clarification in respect of RFP document shall be addressed to:

PFC CONSULTING LIMITED



109

*[Handwritten signature]*

**General Manager**  
**PFC Consulting Limited**  
9<sup>th</sup> Floor, A-Wing, Statesman House  
Connaught Place, New Delhi - 110001, India  
Tel. + 91-11-23443996  
Fax + 91-11-23443990  
Email: [pfcl.itp@pfcindia.com](mailto:pfcl.itp@pfcindia.com)

**DISCLAIMER**

1. This Request for Proposal (RFP) document is not an agreement or offer by the BPC to the prospective Bidders or to any other party. The purpose of this RFP document is to provide interested parties with information to assist the formulation of their Bid. The RFP document is based on material and information available in public domain.
2. This RFP, along with its Annexures, is not transferable and the information contained therein are to be used only by the person to whom it is issued. It may not be copied or distributed by the recipient to third parties (other than in confidence to the recipient's professional advisors). In the event that the recipient does not continue with its involvement in the Project in accordance with this RFP, this RFP must be kept confidential.
3. While this RFP has been prepared in good faith, neither the BPC nor its employees or advisors/consultants make any representation or warranty expressed or implied as to the accuracy, reliability or completeness of the information contained in this RFP. The Bidders shall satisfy themselves, on receipt of the RFP document, that the RFP document is complete in all respects. Intimation of any discrepancy shall be given to this office immediately. If no intimation is received from any Bidder within ten (10) days from the date of issue of this RFP document on or before the date & time mentioned in this RFP, it shall be considered that the issued document, complete in all respects, has been received by the Bidders.

This bidding process is in accordance with the Bidding Guidelines issued by Ministry of Power, Government of India under Section 63 of the Electricity Act, 2003. Revisions or amendments in these Bidding Guidelines may cause the BPC to modify, amend or supplement this RFP document, including the RFP Project Documents to be in conformance with the Bidding Guidelines.

4. This RFP document includes statements, which reflect various assumptions arrived at by BPC in order to give a reflection of current status in the RFP. These assumptions should not be entirely relied upon by Bidders in making their own assessments. This RFP document does not purport to contain all the information each Bidder may require and may not be appropriate for all persons. It is not possible for BPC to consider the investment objectives, financial situation and particular needs of each party who reads or uses this RFP document. Certain Bidders may have a better knowledge of the Project than the others. Each Bidder should conduct its own investigations and analysis and should check the accuracy, reliability and completeness of the information in this RFP document and obtain independent advice from appropriate sources.
5. Neither BPC nor their employees or consultants make any representation or warranty as to the accuracy, reliability or completeness of the information in this RFP document.
6. Neither BPC, its employees nor its consultants will have any liability to any Bidder or any other person under the law of contract, tort, the principles of restitution or unjust enrichment or otherwise for any loss, expense or damage which may arise from or be incurred or suffered in connection with anything contained in this RFP document, any matter deemed to form part of this

PFC CONSULTING LIMITED



RFP document, the award of the Project, the information supplied by or on behalf of BPC or its employees, any consultants or otherwise arising in any way from the qualification process for the said Project.

7. By participating in the bidding process, each of the Bidder shall have acknowledged and accepted that it has not been induced to enter into such agreement by any representation or warranty, expressed or implied, or relied upon any such representation or warranty by or on behalf of BPC or any person working in the bidding process.
8. BPC may in its absolute discretion, but without being under any obligation to do so, update, amend or supplement this RFP document. Such updation, amendments or supplements, if any, will however be circulated to the Bidders not later than 15 days prior to the last date for submission of Bid.
9. Each Bidder unconditionally agrees, understands and accepts that the BPC reserves the rights to accept or reject any or all Bids without giving any reason. Neither the BPC nor its advisers shall entertain any claim of any nature, whatsoever, including without limitations, any claim seeking expenses in relation to the preparation of Bids.
10. This RFP may be withdrawn or cancelled by the BPC at any time without assigning any reasons thereof. BPC further reserves the right, at its complete discretion to reject any or all of the Bids without assigning any reasons whatsoever.



## INDEX

SECTION	CONTENTS	PAGE NO.
	<b>DEFINITIONS</b>	<b>11</b>
<b>1.</b>	<b>INTRODUCTION</b>	<b>16</b>
<b>2.</b>	<b>INFORMATION AND INSTRUCTIONS FOR BIDDERS</b>	<b>22</b>
<b>3.</b>	<b>EVALUATION OF THE TECHNICAL AND FINANCIAL BID</b>	<b>46</b>
<b>4.</b>	<b>ANNEXURES FOR BID</b>	<b>52</b>
	<b>ANNEXURES</b>	
<b>1</b>	<b>Format for the Covering Letter</b>	<b>54</b>
<b>2</b>	<b>Format for Letter of Consent from Consortium Members</b>	<b>57</b>
<b>3</b>	<b>Format for evidence of authorized signatory's authority (Power of Attorney)</b>	<b>59</b>
<b>4</b>	<b>Format for Power of Attorney to be provided by each of the other members of the Consortium in favor of the Lead Member</b>	<b>61</b>
<b>5</b>	<b>Format for Bidder's composition and ownership structure and Format for Authorization</b>	<b>65</b>
<b>6</b>	<b>Format for Consortium Agreement</b>	<b>66</b>
<b>7A</b>	<b>Format for Qualification Requirement – Net worth</b>	<b>71</b>
<b>7B</b>	<b>Format for Technical Requirement</b>	<b>74</b>
<b>7C</b>	<b>Format for Technical and Financial Requirement – Relationship &amp; Equity Shareholding</b>	<b>77</b>
<b>7D</b>	<b>Format for Additional Information for verification of Financial and Technical Capabilities of Bidders</b>	<b>79</b>
<b>8</b>	<b>Format for Undertaking and Details of Equity Investment</b>	<b>82</b>
<b>9</b>	<b>Format for Authorization from Parent / Affiliate of Bidding Company / Member of Bidding Consortium whose technical / financial capability has been used by the Bidding Company / Member of Bidding Consortium.</b>	<b>86</b>
<b>10</b>	<b>Format for Undertaking by Technically/Financially Evaluated Entity/Ultimate Parent Company</b>	<b>90</b>
<b>11</b>	<b>Format for Board Resolution</b>	<b>91</b>
<b>11A</b>	<b>Illustration for Applicable Board Resolution Requirements under Clause 2.5.2</b>	<b>92</b>
<b>12</b>	<b>Format for illustration of Affiliates</b>	<b>93</b>
<b>13</b>	<b>Format for disclosure</b>	<b>94</b>
<b>14</b>	<b>Format For Bid Bond</b>	<b>95</b>
<b>15</b>	<b>Format for Contract Performance Guarantee</b>	<b>97</b>
<b>16</b>	<b>Format for Checklist for Technical Bid Submission Requirements</b>	<b>99</b>
<b>17</b>	<b>List of Banks</b>	<b>102</b>



SECTION	CONTENTS	PAGE NO.
18	Grid Map of the Project	103
19	Format for Clarifications / Amendments on the RFP / RFP Project Documents	104
20	Formats For RFP Project Documents	105
21	Format For Financial Bid	106
22	Format of Affidavit	107
23	Annexure A	109
24	Annexure-B	111
25	Annexure-C	117



**DEFINITIONS**

Any capitalized term, used but not defined in this RFP, shall have the meaning ascribed to such term in the RFP Project Documents, or the Bidding Guidelines, in that order. In absence of availability of definitions in the foregoing references, the capitalized terms shall be interpreted in accordance with the Electricity Act 2003, Grid Code or any other relevant electricity law, rule or regulation prevalent in India, as amended or re-enacted from time to time, in that order.

The following terms are defined for use in this RFP:

**"Acquisition Price"** shall have the same meaning as defined in the Share Purchase Agreement;

**"Affiliate"** shall mean a company that either directly or indirectly

- i. controls or
- ii. is controlled by or
- iii. is under common control with

a Bidding Company (in the case of a single company) or a Member (in the case of a Consortium) and **"control"** means ownership by one entity of at least twenty six percent (26%) of the voting rights of the entity. As an illustration a chart is annexed hereto as Annexure – 12;

**"Bid"** shall mean Technical Bid and Financial Bid (Initial Offer and Final Offer) submitted by the Bidder, in response to this RFP, in accordance with the terms and conditions thereof;

**"Bidder"** shall mean either a single company (including its permitted successors and legal assigns) or a Consortium of companies (including its permitted successors and legal assigns) submitting a Bid in response to this RFP. Any reference to the Bidder includes Bidding Company, Bidding Consortium/ Consortium, Member in a Bidding Consortium and Lead Member of the Bidding Consortium jointly and severally, as the context may require;

**"Bidding Company"** shall refer to such single company (including its permitted successors and legal assigns) that has submitted a Bid for the Project;

**"Bidding Consortium/ Consortium"** shall refer to a group of companies (including their permitted successors and legal assigns) that has collectively submitted a Bid for the Project;

**"Bidding Guidelines"** shall mean the "Tariff Based Competitive-Bidding Guidelines for Transmission Service" and "Guidelines for Encouraging Competition in Development of Transmission Projects" issued by Government of India, Ministry of Power under Section – 63 of Electricity Act as amended from time to time;

**"Bid Bond"** shall mean the unconditional and irrevocable bank guarantee for **Rs.23.00 Crore (Rupees Twenty Three Crore Only)**, to be submitted along with the Technical Bid by the Bidder under Clause 2.11 of this RFP, as per the format prescribed in Annexure 14;

**"Bid Deadline"** shall mean the last date and time for submission of online Bid in response to this RFP, specified in Clause 2.7.1;

**"Bid Process Coordinator or BPC"** shall mean a person or its authorized representative as notified by the Government of India, responsible for carrying out the process for selection of Bidder who will acquire Transmission Service Provider;

PFC CONSULTING LIMITED



**"Bid Security Declaration"** shall mean the declaration to be submitted along with the Technical Bid by the Bidder in lieu of the Bid Bond as per the format prescribed in annexure 14A (only applicable for projects for which RFP has been issued before 31.12.2021)

**"CEA"** shall mean the Central Electricity Authority constituted under Section - 70 of the Electricity Act;

**"Commission" or "CERC"** shall mean the Central Electricity Regulatory Commission of India constituted under Section-76 of The Electricity Act, 2003 and any successors and assigns;

**"Conflict of Interest"** A Bidder shall be considered to be in a Conflict of Interest with one or more Bidders in the same bidding process if they have a relationship with each other, directly or through a common company, that puts them in a position to have access to information about or influence the Bid of another Bidder.

Provided that if two or more bidders in the bidding process have formed a Joint Venture Company or Consortium to execute another project, the Bidders will not be considered to have Conflict of Interest;

**"Commercial Operation Date (COD)"** shall mean the date as per Article 6.2 of the Transmission Service Agreement;

**"Consents, Clearances, Permits"** shall mean all authorizations, licenses, approvals, registrations, permits, waivers, privileges, acknowledgements, agreements, or concessions required to be obtained from or provided by any concerned authority for the development, execution and performance of Project including without any limitation on the construction, ownership, operation and maintenance of the transmission lines and/or sub-stations;

**"Contract Performance Guarantee"** shall have the meaning as per Clause 2.12 of this RFP;

**"Contract Year"** shall mean the period beginning on the Scheduled COD, and ending on the immediately succeeding March 31 and thereafter each period of 12 months beginning on April 1 and ending on March 31 provided that:

- (i) the last Contract Year shall end on the last day of the term of the Transmission Service Agreement;

**"Infrastructure sector"** shall mean such sectors notified by Department of Economic Affairs in its Gazette Notification no. 13/1/2017-INF dated 14<sup>th</sup> November, 2017 and as amended from time to time;

**"CTU/Central Transmission Utility"** shall have same meaning as defined in the Electricity Act, 2003;

**"Designated ISTS Customers" or "DICs"** shall have the meaning as ascribed in Regulation 2(l) of Central Electricity Regulatory Commission (Sharing of inter-State Transmission Charges and Losses) Regulation 2020 and as amended or modified from time to time;

**"Effective Date"** shall have the meaning as ascribed thereto in the Transmission Service Agreement;

**"Element"** shall mean each Transmission Line or each circuit of the Transmission Lines (where there are more than one circuit) or each bay of the Sub-station or switching station or HVDC terminal or inverter station of the Project, including ICTs, Reactors, SVC, FSC, etc. forming part of the ISTS which will be owned, operated and maintained by the concerned ISTS Licensee, and which may have a separate scheduled COD as per Schedule 2 of the Transmission Service Agreement and may have a separate percentage for recovery of Transmission Charges on achieving COD as per Schedule 5 of the Transmission Service Agreement;

PFC CONSULTING LIMITED



**"National Committee on Transmission"** shall mean the committee constituted by the Ministry of Power, Government of India in term of the "Guidelines for Encouraging Competition in Development of Transmission Projects", as notified from time to time

**"Final Offer"** shall mean the Quoted Transmission Charges, required to be submitted as part of the Financial Bid on the electronic bidding platform during the e-reverse bidding stage. In case, no Final Offer is received during the e-reverse bidding stage then the lowest "Initial Offer" shall be deemed to be the Final Offer;

**"Financial Bid"** shall mean the Initial Offer and Final Offer, containing the Bidder's Quoted Transmission Charges, as per the format at Annexure – 21 of this RFP;

**"Financially Evaluated Entity"** shall mean the company which has been evaluated for the satisfaction of the financial requirement set forth in Clause 2.1.3 hereof;

**"Government"** shall mean the Central Government;

**"Grid Code" / "IEGC" or "State Grid Code"** shall mean the Grid Code specified by the Central Commission under clause (h) of sub-section (1) of Section 79 of the Electricity Act and/or the State Grid Code as specified by the concerned State Commission referred under clause (h) of sub-section (1) of Section 86 of the Electricity Act as applicable;

**"Initial Offer"** shall mean the Quoted Transmission Charges, required to be submitted as part of the Financial Bid on the electronic bidding platform along with the Technical Bid;

**"Inter State Generating Station" or "ISGS"** shall mean a Central / other generating station in which two or more states have shares and whose scheduling is to be coordinated by the Regional Load Dispatch Centre;

**"Inter-State Transmission System"** shall have same meaning as defined in the Electricity Act, 2003;

**"Lead Member of the Bidding Consortium" or "Lead Member"** shall mean a company who commits at least twenty six percent (26%) equity stake in the Project, meets the technical requirement as per Clause 2.1.2 and so designated by other Member(s) in Bidding Consortium;

**"Letter of Intent" or "LoI"** shall mean the letter to be issued by the BPC to the Bidder, who has been identified as the selected bidder, for award of the Project to such Bidder;

**"Member in a Bidding Consortium/Member"** shall mean each company in the Bidding Consortium;

**"MOP"** shall mean the Ministry of Power, Government of India;

**"MOEF"** shall mean the Ministry of the Environment and Forests, Government of India;

**"Nodal Agency"** shall mean CTU, which shall execute and implement the Transmission Service Agreement (TSA);

Provided that while taking major decisions, CTU shall consult CEA on technical matters and any other matter it feels necessary.

**"Parent Company"** shall mean an entity that holds at least twenty six percent (26%) of the paid - up equity capital directly or indirectly in the Bidding Company or in the Member in a Bidding Consortium, as the case may be;

**"Qualification Requirements"** shall mean the qualification requirements as set forth in Section-2,

PFC CONSULTING LIMITED



Clause 2.1 of this RFP;

**"Quoted Transmission Charges"** shall mean the quoted single annual Transmission Charges submitted online through the electronic bidding platform by the Bidder as part of its Financial Bid as per the format in Annexure – 21 of this RFP;

**"RFP"** shall mean Request for Proposal document along with all schedules, formats, annexure and RFP Project Documents attached hereto, issued by BPC for tariff based competitive bidding process for selection of bidder who will acquire the TSP through e-reverse bidding to execute the Project, and shall include any modifications, amendments or alterations or clarifications thereto;

**"RFP Project Documents"** shall mean the following documents to be entered into in respect of the Project, by the parties to the respective agreements:

- a. Transmission Service Agreement (TSA),
- b. Share Purchase Agreement,
- c. Agreement(s) required, if any, under Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations as amended from time to time and
- d. Any other agreement, as may be required;

**"Scheduled COD"** shall have the meaning as ascribed hereto in Clause 2.6 of this RFP;

**"Statutory Auditor"** shall mean the auditor appointed under the provisions of the Companies Act, 1956 / Companies Act, 2013 (as the case may be) or under the provisions of any other applicable governing law;

**"Share Purchase Agreement"** shall mean the agreement amongst PFC Consulting Limited, RAGHANESDA RE TRANSMISSION LIMITED and the Successful Bidder for the purchase of one hundred (100%) per cent of the shareholding of the RAGHANESDA RE TRANSMISSION LIMITED for the Acquisition Price, by the Successful Bidder on the terms and conditions as contained therein;

**"Successful Bidder"** or **"Selected Bidder"** shall mean the Bidder selected pursuant to this RFP to acquire one hundred percent (100%) equity shares of RAGHANESDA RE TRANSMISSION LIMITED, along with all its related assets and liabilities, which will be responsible as the TSP to establish the Project on build, own, operate and transfer basis as per the terms of the Transmission Service Agreement and other RFP Project Documents;

**"Survey Report"** shall mean the report containing initial information regarding the Project and other details provided as per the provisions of Clause 1.6.2.1.1 of this RFP;

**"Technical Bid"** shall mean the bid submitted online through the electronic bidding platform, containing the documents as listed out in Clause 2.5.2 of this RFP;

**"Technically Evaluated Entity"** shall mean the company which has been evaluated for the satisfaction of the technical requirement set forth in Clause 2.1.2 hereof;

**"Transmission Charges"** shall mean the Final Offer quoted by Selected Bidder and adopted by the Commission, and as computed in terms of the provisions of Schedule 4 of the TSA, payable to the ISTS Licensee by the Designated ISTS Customers, and collected / disbursed by the CTU, as per Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations as amended from time to time;

PFC CONSULTING LIMITED



**"Transmission License"** shall mean the license granted by the Commission in terms of the relevant regulations for grant of such license issued under the Electricity Act, 2003;

**"Transmission Service Agreement" or "TSA"** shall mean the agreement entered into between Nodal Agency and the TSP, pursuant to which the TSP shall build, own, operate and transfer the Project and make available the assets of the Project on a commercial basis;

**"Transmission Service Provider" or "TSP"** shall mean **RAGHANESDA RE TRANSMISSION LIMITED** which has executed the Transmission Service Agreement and which shall be acquired by the Selected Bidder;

**"Ultimate Parent Company"** shall mean an entity which owns at least twenty six percent (26%) equity in the Bidding Company or Member of a Consortium, (as the case may be) and in the Technically Evaluated Entity and/or Financially Evaluated Entity (as the case may be) and such Bidding Company or Member of a Consortium, (as the case may be) and the Technically Evaluated Entity and/or Financially Evaluated Entity (as the case may be) shall be under the direct control or indirectly under the common control of such entity.



# SECTION – 1

## INTRODUCTION



## SECTION 1

## 1. INTRODUCTION

- 1.1 The Government of India, Ministry of Power, vide its gazette notification CG-DL-E-22082024-256561 dated August 21, 2024 has notified PFC Consulting Limited (PFCCL) to be the Bid Process Coordinator (BPC) for the purpose of selection of Bidder as Transmission Service Provider (TSP) to establish Inter-State transmission system for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" through tariff based competitive bidding process.

The BPC hereby invites Bids from all prospective Bidders in accordance with this Request for Proposal (RFP) to select prospective Transmission Service Provider (TSP) in accordance with the "Tariff Based Competitive-Bidding Guidelines for Transmission Service" and "Guidelines for Encouraging Competition in Development of Transmission Projects" issued by Government of India, Ministry of Power under Section – 63 of the Electricity Act. The BPC shall select the Bidder having the prescribed technical and financial capability to become TSP and be responsible for establishing the Project in the state(s) of Gujarat. The TSP will make the Project available against payment of Transmission Charges, as adopted by the Commission, payable to the TSP, as per Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations as amended from time to time.

- 1.2 The TSP will be required to establish the following Inter State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" (hereinafter referred to as 'Project') on build, own, operate and transfer basis, and to provide transmission service.

Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I		
S No.	Name of Transmission Element	Scheduled COD from Effective Date
1.	<p>Establishment 4x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVar, 765 kV bus reactor and 2x125 MVar, 420 kV bus reactor</p> <ul style="list-style-type: none"> <li>• 765/400 kV, 1500 MVA ICT – 4 Nos. (13x500 MVA single phase units including one spare ICT Unit)</li> <li>• 765 kV ICT bays – 4 Nos.</li> <li>• 400 kV ICT bays – 4 Nos.</li> <li>• 765 kV Line bays – 2 Nos.</li> <li>• 1x330 MVar, 765 kV bus reactor- 2 Nos. (7x110 MVar single phase Reactors including one spare Unit for bus /line reactor)</li> <li>• 765 kV Bus reactor bay – 2 Nos.</li> <li>• 125 MVar, 420 kV reactor- 2 Nos.</li> <li>• 400 kV Reactor bay- 2 Nos.</li> <li>• 400 kV line bays - 4 Nos. (for interconnection of RE Projects)</li> </ul> <p><b>Future Scope (Space for):</b></p> <ul style="list-style-type: none"> <li>• 765/400 kV ICT along with bays- 4 Nos. (on Sec-II)</li> <li>• 765 kV line bays along with switchable line reactors – 8 Nos. (4 Nos. on Sec-I and 4 Nos. on Sec-II)</li> </ul>	27 Months

PFC CONSULTING LIMITED



Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I		
S No.	Name of Transmission Element	Scheduled COD from Effective Date
	<ul style="list-style-type: none"> <li>• 765 kV Bus Reactor along with bay: 2 Nos. (on Sec-II)</li> <li>• 765 kV Sectionalizer: 1 -set</li> <li>• 400 kV line bays along with switchable line reactors– 12 Nos. (4 Nos. on Sec-I and 8 Nos. on Sec-II)</li> <li>• 400/220 kV ICT along with bays - 6 Nos. (2 Nos. on Sec-I &amp; 4 Nos. on Sec-II) (in addn. to 2 Nos. 400/220 ICTs on Sec-I in present scope)</li> <li>• 400 kV Bus Reactor along with bays: 2 Nos. (Sec-II)</li> <li>• 400 kV Sectionalization bay: 1- set</li> <li>• 220 kV line bays: 10 Nos. (4 Nos. on Section-I and 6 Nos. on Section-II) (in addition to 2 Nos. 220 kV bays on Section-I in present scope)</li> <li>• 220 kV Sectionalization bay: 1 set</li> <li>• 220 kV BC: 1 No. (For Section-II)</li> <li>• Establishment of 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC] terminal station (4x1500 MW) along with associated interconnections with 400 kV HVAC Switchyard and all associated equipment (incl. filters)/bus extension, etc.</li> </ul>	
2.	Raghnesda (GIS) – Banaskantha (PG) 765 kV D/c line	
3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s <ul style="list-style-type: none"> <li>• 765 kV line bays – 2 Nos.</li> </ul>	
4.	Creation of 220kV switchyard (Bus Sec-I) at Raghnesda PS (GIS) along with installation of 2x500MVA, 400/220 kV ICTs <ul style="list-style-type: none"> <li>• 500MVA, 400/220kV ICT – 2 Nos.</li> <li>• 400kV ICT bay – 2 Nos.</li> <li>• 220kV ICT bay – 2 Nos.</li> <li>• 220kV BC – 1 No.</li> </ul>	30.09.2027 (subject to minimum 27 Months)
5.	1 no. 220kV line bay (GIS) (on 220kV Bus Sec-I) for interconnection of Solar project of Azure Power Sixty Three Pvt. Ltd. (2200001107) (300MW) <ul style="list-style-type: none"> <li>• 220kV line bay–1 no.</li> </ul>	
6.	1 no. 220kV line bay (GIS) (on 220kV Bus Sec-I) for interconnection of Solar project of Sunsure Solarpark RJ One Pvt. Ltd. (2200001018) (350MW) <ul style="list-style-type: none"> <li>• 220kV line bay–1 no.</li> </ul>	31.03.2028

**Note:**

- TSP of Banaskantha S/s (POWERGRID) shall provide space for scope at SI. 3 above.
- Bay(s) required for completion of diameter (GIS) in one-and-half breaker scheme shall also be executed by the TSP.

PFC CONSULTING LIMITED



### 1.3 Project Description

Govt. of India has set a target for establishing 500 GW capacity from non-fossil energy sources by 2030. In this direction, various RE Potential zones have been identified and declared in Gujarat. Raghnesda area of Gujarat is one among the identified zones with a RE potential of more than 5GW.

For evacuation of 3 GW capacity from Raghnesda region in Banaskantha district of Gujarat, the scheme "Transmission System for evacuation of RE power from Raghnesda area of Gujarat- 3 GW under Phase-I" was recommended under TBCB with PFCCL as BPC in the 20th meeting of NCT held on 25.06.24 with an estimated cost of ₹1855 Crore and implementation time frame of 30 months from the date of SPV transfer.

The scope of the scheme includes Establishment of 765/400 kV Raghnesda (GIS) S/s along with 3x1500 MVA 765/400 kV ICTs & Raghnesda (GIS) – Banaskantha (PG) 765 kV D/c line. At the time of scheme conceptualization, 4 Nos. 400 kV bays were kept for RE injection directly at 400 kV level of Raghnesda (GIS) S/s.

Further, in order to accommodate cumulative capacity of 650 MW at 220 kV level of Raghnesda PS (out of the 3500 MW which can be evacuated on Ph-I system) as well as additional capacity for about 500 MW (beyond 3000 MW), augmentation of Transformation Capacity at Raghnesda PS by 1x1500 MVA, 765/400 kV ICT (4th) is required. Accordingly, transmission scheme "Network Expansion in Gujarat for RE interconnection at Raghnesda PS" which includes Installation of 1x1500 MVA, 765/400 kV ICT (4th) at Raghnesda PS (Sec-I), Creation of 220 kV switchyard (Bus Sec-I) at Raghnesda PS (GIS) along with installation of 2x500 MVA, 400/220 kV ICTs, and 2 Nos. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) was deliberated & agreed in 26th NCT meeting held on 06.01.2025. The subject two schemes were deliberated in 26th NCT meeting held on 06.01.2025, wherein, it was recommended that the above augmentation scheme may be added to the transmission scheme under bidding viz. "Transmission System for evacuation of RE power from Raghnesda area of Gujarat- 3 GW under Phase-I" with modified implementation timeframe as mentioned below:

### 1.4 Transmission Grid Map

Transmission Grid Map indicating the location of the Project is enclosed as **Annexure 18** of this RFP for information and reference of the Bidders.

- 1.5 The objective of the bidding process is to select a Successful Bidder pursuant to this RFP, who shall acquire one hundred percent (100%) of the equity shares of **RAGHNESDA RE TRANSMISSION LIMITED** along with all its related assets and liabilities as per the provisions of the Share Purchase Agreement, at the Acquisition Price to be intimated by the BPC, twenty (20) days prior to the Bid Deadline.

The **RAGHNESDA RE TRANSMISSION LIMITED**, of which one hundred percent (100%) equity shares will be acquired by the Selected Bidder, shall be responsible as the TSP, for ensuring that it undertakes ownership, financing, development, design, engineering, procurement, construction, commissioning, operation and maintenance of the Project, and to provide Transmission Service as per the terms of the RFP Project Documents.

The TSP shall ensure transfer of all project assets along with substation land, right of way and clearances to CTU or its successors or an agency as decided by the Central Government after 35

PFC CONSULTING LIMITED



years from COD of project at zero cost and free from any encumbrance and liability. The transfer shall be completed within 90 days after 35 years from COD of project failing which CTU shall be entitled to take over the project assets Suo moto.

## 1.6 Brief Scope of Work

### 1.6.1 Scope of Transmission Service Provider

The TSP's scope of work for the Project shall comprise, but not necessarily be limited to the following:

- 1.6.1.1 Establishment, operation and maintenance of the Project on build, own, operate and transfer basis and completion of all the activities for the Project, including survey, detailed project report formulation, arranging finance, project management, necessary Consents, Clearances and Permits (way leave, environment and forest, civil aviation, railway/ road/river/canal/power crossing/PTCC, etc.), land compensation, design, engineering, equipment, material, construction, erection, testing and commissioning.

Further, the actual location of Greenfield substations (Switching Stations or HVDC Terminal or Inverter Stations) for a generation pooling substation and for load serving substations in the scope of TSP shall not be beyond 3 Km radius of the location proposed by the BPC in the survey report. However, actual location of any Greenfield intermediate Substations in the scope of TSP shall not be beyond 10 Km radius of the location proposed by the BPC in the Survey Report.

- 1.6.1.2 The TSP shall ensure that design, construction and testing of all equipment, facilities, components and systems of the Project shall be in accordance with Transmission Service Agreement and applicable Rules/ Regulations, Orders and Guidelines issued by the Central Government.
- 1.6.1.3 The TSP shall ensure timely completion of entire scope of Project in all respects and its operation and maintenance, as shall be specified in the RFP documents.
- 1.6.1.4 The TSP shall seek Transmission License from the Commission, as per the provisions of the Electricity Act and regulations made thereunder.
- 1.6.1.5 The TSP shall seek approval under Section 164 of Electricity Act, from CEA after acquisition of **RAGHANESDA RE TRANSMISSION LIMITED**. The approval shall be granted by CEA generally within 30 days but in no case later than 45 days from the date of receipt of application (complete in all aspects).

### 1.6.2 Scope of Bid Process Coordinator (BPC)

BPC's scope of work is briefly outlined hereunder:

- 1.6.2.1 The BPC has initiated development of the Project and shall be responsible for the tasks in this regard as specified hereunder:
1. Provide to the Bidders a Survey Report for the Project at least forty five (45) days prior to the Bid Deadline. The Survey Report shall include the suggested route with approximate route length, type of terrain likely to be encountered and its likely implication in terms of Right of Way (ROW), statutory clearances, location of substations or converter stations and land area to be acquired for the substation or converter station.

2. To obtain approval for laying of overhead transmission lines under Section 68 of Electricity Act, from the Government at least twenty (20) days prior to Bid Deadline.
3. To initiate acquisition of land for location specific substations, switching stations or HVDC terminal or inverter stations, if required.
4. To initiate process of seeking forest clearance, if required.
5. The BPC shall intimate to the Bidders, the Acquisition Price payable by the Selected Bidder to the **PFC Consulting Limited** for the acquisition of one hundred percent (100%) of the equity shareholding of **RAGHANESDA RE TRANSMISSION LIMITED**, along with all its related assets and liabilities at least twenty (20) days prior to the Bid Deadline.
6. The BPC shall ensure issuance of all finalized RFP Project Documents, at least fifteen (15) days prior to the Bid Deadline.

Provided that for any delay in meeting the above obligations of the BPC within the specified time period above, the Bid Deadline as per Clause 2.7.1 shall be extended on a day for day basis.

- 1.6.2.2 The details and documents as may be obtained by the BPC/ project specific SPV in relation to the Project shall be handed over to the TSP on an as-is-where-is basis, so that it may take further actions to obtain Consents, Clearances and Permits.
- 1.7 All costs (including direct and indirect) incurred by the BPC/ project specific SPV in connection with the activities concerning the Project shall be recovered from the TSP, which shall be included in the Acquisition Price.
- 1.8 The Project is required to be completed progressively in accordance with the schedule prescribed in this RFP.
- 1.9 A company under the Companies Act, 1956/ Companies Act, 2013 by the name **RAGHANESDA RE TRANSMISSION LIMITED** has been incorporated to initiate the activities for execution of the Project. The said company shall be acquired by the successful Bidder as per terms and conditions as may be prescribed in RFP.
- 1.10 The Ministry of Power and the appropriate state government(s) shall provide their support to the TSP, on best endeavor basis, in enabling the TSP to develop the Project.
- 1.11 All Bidders are required to submit their Bid in accordance with the instructions set forth in this RFP.
- 1.12 Once the Successful Bidder is selected, the details and documents as may be obtained by the BPC/ project specific SPV in relation to the Project, shall be handed over to the Successful Bidder on as is where basis, so that it may take further actions to obtain all necessary Consents, Clearances and Permits and the TSP shall not be entitled for any extensions in the Scheduled COD of the Project except as provided for in the TSA.
- 1.13 The assets of the Project shall be made available on a commercial basis as per the terms and conditions of the Transmission Service Agreement and Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations as amended from time to time.



# SECTION - 2

## INFORMATION AND INSTRUCTIONS FOR BIDDERS

PFC CONSULTING LIMITED



125

**SECTION – 2****2. INFORMATION AND INSTRUCTIONS FOR BIDDERS****2.1 Qualification Requirements**

2.1.1 The Bidder should be a company duly incorporated under the relevant laws (Bidding Company) or a Consortium of companies (Bidding Consortium) with one of the companies acting as the Lead Member of the Bidding Consortium. The Bidder shall be selected on meeting the Qualification Requirements specified in Section 2 of this RFP, as demonstrated by the Bidder's Technical Bid and the lowest Quoted Transmission Charges discovered from Final Offers quoted during the e-reverse bidding. A Bidding Consortium can participate in the bidding process for the Project if any Member of the Consortium has purchased the RFP document for such Project. Bidder who agrees and undertake to procure the products associated with the Transmission System as per provisions of Public Procurement (Preference to Make in India) Orders No. P45021/2/2017-PP (BE-II)-Part (4) Vol.II dated 19.07.2024, as amended from time to time read with Department for Promotion of Industry and Internal Trade (DPIIT) orders in this regard, shall be eligible hereunder. Further, it is clarified that Procuring Entity as defined in orders shall deemed to have included Selected Bidder and/ or TSP.

Besides, Department of Expenditure, Ministry of Finance vide OM No. F.7/10/2021-PPD (1) dated 23.02.2023, as amended from time to time, have issued directions regarding public procurement from a bidder of a country, which shares land border with India are also applicable.

**2.1.2 Technical requirement to be met by the Bidding Company or Lead Member of Bidding Consortium**

The Bidder must fulfill any one of the following technical requirements:

- (i) Experience of development of projects in the Infrastructure Sector in the last five (5) years with aggregate capital expenditure of not less than **Rs.1150 Crore (Rupees Eleven Hundred Fifty Crore Only)** or equivalent USD (calculated as per provisions in Clause 3.4.1). However, the capital expenditure of each project shall not be less than **Rs.230 Crore (Rupees Two Hundred Thirty Crore Only)** or equivalent USD (calculated as per provisions in Clause 3.4.1).

For this purpose, capital expenditure incurred on projects that have been commissioned/ completed at least seven (7) days prior to Bid Deadline shall be considered. The capital expenditure discussed above shall be as capitalized and reflected in the audited books of accounts of the Technically Evaluated Entity. In case a clearly identifiable part of a project has been put into commercial operation, the capital expenditure on such part of the project shall be considered. The Technically Evaluated Entity must have either executed such projects itself or must have held directly or indirectly at least twenty six percent (26%) of the shareholding in the company that has executed the project(s) from the date of financial closure of the project(s) till the time of commissioning/completion of such project(s).

OR

- (ii) Experience in construction of project in infrastructure sector: The Technically Evaluated Entity should have received aggregate payments not less than **Rs.1150 Crore (Rupees Eleven Hundred Fifty Crore Only)** or equivalent USD (calculated as per provisions in



Clause 3.4.1) from its client(s) for construction works fully completed during the last 5(five) financial years. However, the payment received from each project shall not be less than **Rs.230 Crore (Rupees Two Hundred Thirty Crore Only)** or equivalent USD (calculated as per provisions in Clause 3.4.1).

For this purpose, payments received on projects that have been commissioned/ completed at least seven (7) days prior to Bid Deadline shall be considered. Further only the payments (gross) actually received, during such 5 (five) financial years shall qualify for purposes of computing the technical capacity. For the avoidance of doubt, construction works shall not include cost of land, supply of goods or equipment except when such goods or equipment form part of a turn-key construction contract/ EPC contract for the project. Further, in cases where different individual contracts are signed between same entities for the same project, the cumulative payments received under such individual contracts shall be considered for meeting the qualification requirement.

The Technically Evaluated Entity may be the Bidding Company or the Lead Member of a Consortium or an Affiliate or Parent of such Bidding Company or the Lead Member, as the case may be.

Bidders shall furnish documentary evidence duly certified by authorized signatory of the Bidder who has been issued Power of Attorney in support of their technical capability as defined in Clause 2.1.2 of this RFP.

### 2.1.3 Financial requirement to be met by the Bidding Company/Bidding Consortium

#### 2.1.3.1 The Bidder must fulfill following financial requirements:

##### A. Network:

Network should be not less than **Rs.460 Crore (Rupees Four Hundred Sixty Crore Only)** or equivalent USD (calculated as per provisions in Clause 3.4.1) computed as the Network based on unconsolidated audited annual accounts (refer to Note below) of any of the last three (3) financial years as provided in Clause 2.2.3, immediately preceding the Bid Deadline. Also, the Network of any of the last three (3) financial years should not be negative.

**Note:** Audited consolidated annual accounts of the Bidder may be used for the purpose of financial criteria provided the Bidder has at least 26% equity in each company whose accounts are merged in the audited consolidated accounts and provided further that the financial capability of such companies (of which accounts are being merged in the consolidated accounts) shall not be considered again for the purpose of evaluation of the Technical Bid. Bidders shall furnish prescribed Annexure 7(A) duly certified by authorized signatory of the Bidder who has been issued Power of Attorney and the Statutory Auditor and separate computation sheet for Network duly certified by Statutory Auditor in support of their financial capability as defined in Clause 2.1.3 of this RFP.

#### 2.1.3.2 The Net worth shall be computed in the following manner by the Bidder:

##### A. Network

=	Equity share capital
Add:	Reserves
Subtract:	Revaluation Reserves
Subtract:	Intangible Assets
Subtract:	Miscellaneous expenditures to the extent not written off and carry forward losses



- 2.1.3.3 If the Technical Bid is submitted by a Bidding Consortium the financial requirement shall be met individually and collectively by all the Members in the Bidding Consortium. The financial requirement to be met by each Member of the Bidding Consortium shall be computed in proportion to the equity commitment made by each of them for investment in the Project.
- 2.1.4 The Bidder may seek qualification on the basis of technical and financial capability of its Parent and/ or its Affiliate(s) for the purpose of meeting the Qualification Requirements. However, in the case of the Bidder being a Consortium, the Lead Member has to meet the technical requirement on its own or by seeking the technical capability of its Parent and/or its Affiliate(s). Authorization for use of such technical or financial capability shall have to be provided from its Parent and/or Affiliate(s) as per Annexure 9. The technical and financial capability of a particular company/ particular project, including its Parents and/or Affiliates, shall not be used directly or indirectly by more than one Bidder/ Member of a Bidding Consortium/ Bidding Company. However, development and construction experience of a particular project may be used by more than one company.

The determination of the relationship of Parent or Affiliate with the Bidding Company or with the Member of the Bidding Consortium, including the Lead Member, shall be on the date at the most seven (7) days prior to the last date of submission of the Bid. Documentary evidence to establish such relationship shall be furnished by the Bidder along with the Technical Bid.

If the Technically Evaluated Entity and/or Financially Evaluated Entity is an entity other than the Bidding Company or a Member in a Bidding Consortium, the Bidding Company or Member relying on such Technically Evaluated Entity and/or Financially Evaluated Entity will have to submit a legally binding undertaking supported by a board resolution from the Technically Evaluated Entity and/or Financially Evaluated Entity or its Ultimate Parent Company, that all the equity investment obligations of the Bidding Company or the Member of the Consortium shall be deemed to be equity investment obligations of the Technically Evaluated Entity and/or Financially Evaluated Entity or its Ultimate Parent Company, and in the event of any default the same shall be met by such evaluated entity or by or the Ultimate Parent Company. The Bidding Company or the Consortium Member shall have to provide information and documents relating to its relationship with such Technically Evaluated Entity and/or Financially Evaluated Entity including details about the equity shareholding between them as per Annexure 7(C).

- 2.1.5 A Bidder shall submit only one Bid in the same bidding process, either individually as Bidding Company or as a Member of a Bidding Consortium (including the Lead Member). It is further clarified that any of the Parent/ Affiliate/Ultimate Parent of the Bidder/ Member in a Bidding Consortium shall not separately participate directly or indirectly in the same bidding process. Further, if any Bidder is having a Conflict of Interest with other Bidders participating in the same bidding process, the Bids of all such Bidders shall be rejected.
- 2.1.6 Notwithstanding anything stated above, BPC reserves the right to verify the authenticity of the documents submitted for meeting the Qualification Requirements and request for any additional information and documents. BPC reserves the right at its sole discretion to contact the Bidder's bank and project references and verify the Bidder's information and documents for the purpose of bid evaluation.
- 2.1.7 The Qualified Bidder(s) will be required to continue to maintain compliance with the Qualification Requirements throughout the bidding process and till execution of the Transmission Service Agreement. Where the Technically Evaluated Entity and/or the Financially Evaluated Entity is not the Bidding Company or a Member in a Bidding Consortium, as the case may be, the Bidding Company or Member shall continue to be an Affiliate of the Technically



Evaluated Entity and/or Financially Evaluated Entity till the execution of the Transmission Service Agreement. Failure to comply with the aforesaid provisions shall make the Bid liable for rejection at any stage.

2.1.8 The Selected Bidder will be required to continue to maintain compliance with the Qualification Requirements till the COD of the Project. Where the Technically Evaluated Entity and/or the Financially Evaluated Entity is not the Bidding Company or a Member in a Bidding Consortium, as the case may be, the Bidding Company or Member shall continue to be an Affiliate of the Technically Evaluated Entity and/or Financially Evaluated Entity till the COD of the Project. Failure to comply with the aforesaid provisions shall be dealt as per provisions of Transmission Service Agreement.

2.1.9 On the Bid Deadline, for the Bidder to be eligible to participate in the bidding process:

- a. the Bidder and any of its Affiliate including any Consortium Member and any of its Affiliate, their directors or key personnel should not have been barred or included in the blacklist by any government agency or authority in India, the government of the jurisdiction of the Bidder or Members where they are incorporated or the jurisdiction of their principal place of business, any international financial institution such as the World Bank Group, Asian Development Bank, African Development Bank, Inter-American Development Bank, Asian Infrastructure Investment Bank etc. or the United Nations or any of its agencies; or
- b. the Bidder & any of its Affiliate including any Consortium Member & any of its Affiliate or their directors should not have been convicted of any offence in India or abroad.

In case any investigation is pending against the Bidder, including any Consortium Member or Affiliate, or CEO or any of the directors/ manager/key managerial personnel of the Bidder /Consortium /Member or their Affiliates, full details of such investigation including the name of the investigating agency, the charge/offence for which the investigation has been launched, name and designation of persons against whom the investigation has been launched and other relevant information should be disclosed while submitting the Bid.

The Bidders shall confirm the above through a notarized affidavit as per Annexure 22.

## 2.2 Submission of Bid by the Bidder

2.2.1 The information and documents in Technical Bid will be submitted by the Bidder as per the formats specified in Section – 4 (Formats for RFP) of this document.

2.2.2 Strict adherence to the formats wherever specified, is required. Wherever, information has been sought in specified formats, the Bidder shall refrain from referring to brochures/ pamphlets. Non-adherence to formats and/ or submission of incomplete information may be a ground for declaring the Technical Bid as non-responsive. Each format has to be duly signed and stamped by the authorized signatory of Bidder.

2.2.3 The Technical Bid shall contain unconsolidated/consolidated audited annual accounts (consisting of unbridged Balance Sheet, Profit and Loss Account, profit appropriation account, Auditors Report, etc.), as the case may be, of Bidding Company or each Member in Consortium including Lead Member or the Financially Evaluated Entity for the last three (3) financial years immediately preceding the last date for submission of Bid for the purpose of calculation of Network.

In case the annual accounts for the financial year immediately preceding the Bid Deadline is not audited, the Bidder shall give declaration in this regard duly certified by its statutory auditor. In such a case, the Bidder shall provide the audited annual accounts for the three (3) financial years



preceding the financial year as above for which the annual accounts have not been audited.

2.2.4 Bid submitted by a Bidding Consortium:

- 2.2.4.1 The Technical Bid shall contain a legally enforceable Consortium Agreement entered amongst the Members in the Bidding Consortium, designating one of the Members to be the Lead Member (as per Annexure 6). There shall be only one Lead Member which shall continue to hold twenty six percent (26%) equity in the TSP and cannot be changed upto one (1) year from the Commercial Operation Date (COD) of the Project. Each Member in Bidding Consortium shall duly sign the Consortium Agreement making it liable for raising the required funds for its respective equity investment commitment as specified in the Consortium Agreement. In absence of Consortium Agreement, the Technical Bid will not be considered for evaluation and will be rejected.

Provided that the Lead Member of the Bidding Consortium will be required to be liable to the extent of 100% of the total proposed commitment of equity investment of the Bidding Consortium i.e. for both its own equity contribution as well as the equity contribution of other Members.

Provided further that the Consortium Agreement shall not be amended without the explicit approval of the BPC.

The Lead Member of the Consortium will be the single point of contact for the purposes of the bid process before the date of signing of Share Purchase Agreement. Settlement of any dispute amongst the Consortium Members shall not be the responsibility of the BPC and/or the CTU and the BPC and/or the CTU shall not bear any liability whatsoever on this account.

- 2.2.4.2 The Lead Member should designate at the most two persons to represent the Consortium in its dealings with the BPC. The person(s) designated by the Lead Member should be authorized through a Power of Attorney (as per Annexure 3) to perform all tasks including, but not limited to providing information, responding to enquiries, signing of Technical Bid on behalf of the Consortium, etc. The Bidding Consortium shall provide board resolutions from their respective Boards for committing their respective portion of equity requirement for the Project. Additionally, the Lead member shall provide a Board resolution committing to make good any shortfall in the equity for the project, in case of any member not meeting its equity commitment.

- 2.2.4.3 The Technical Bid should also contain signed Letter of Consent (as per Annexure 2) from each Member in Consortium confirming that the entire Technical and Financial Bids has been reviewed and each element of the Technical and Financial Bids is agreed to by them including investment commitment for the Project.

In addition, the Technical Bid should also contain Board Resolution from each Member of the Consortium other than the Lead Member in favour of their respective authorized representatives for executing the POA, Consortium Agreement and signing of the requisite formats.

2.2.5 Bid submitted by a Bidding Company

- 2.2.5.1 The Bidding Company should designate at the most two persons to represent the Bidding Company in its dealings with BPC. The person(s) should be authorized to perform all tasks including, but not limited to providing information, responding to enquiries, signing of Technical and Financial Bids etc. The Bidding Company should submit, along with Technical Bid, a Power of Attorney (as per Annexure 3), authorizing the signatory of the Technical and Financial Bids. The Bidding Company shall submit the board resolution committing 100% of equity requirement for



the Project, in the Technical Bid.

### 2.3 Clarifications & Pre-Bid Meeting

- 2.3.1 The Bidders may seek clarifications or suggest amendments to the RFP by sending an email to the BPC at the email id indicated in Clause 2.14 within the date and time mentioned in Clause 2.7.2. For any such clarifications or amendments, the Bidders should adhere to the format as per Annexure – 19.
- 2.3.2 Only those Bidders or their authorized representatives, who have purchased the RFP documents, are invited to attend the pre-bid meeting(s), which will take place on date as specified in Clause 2.7.2, or any such other date as notified by the BPC. The time and address of this would be intimated later.
- 2.3.3 The purpose of the pre-bid meeting will be to clarify any issues regarding the RFP, including in particular, issues raised in writing by the Bidders as per the provisions of Clause 2.3.1.
- 2.3.4 Non-attendance at the pre-bid meeting will not be a cause for disqualification of a Bidder.
- 2.3.5 The BPC is not under any obligation to entertain / respond to suggestions made or to incorporate modifications sought for.
- 2.3.6 In case Bidders need any further clarifications not involving any amendments in respect of final RFP, they should ensure that request for such clarification is submitted through e-mail to the BPC at least ten (10) days prior to the Bid Deadline as mentioned in Clause 2.7.1. The BPC may issue clarifications only, as per its sole discretion, which is considered reasonable by it. Any such clarification issued shall be sent to all the Bidders to whom the RFP has been issued. Clarifications sought after this date shall not be considered in any manner and shall be deemed not to have been received. There shall be no extension in Bid Deadline on account of clarifications sought as per this clause 2.3.6.

### 2.4 Amendment of RFP

- 2.4.1 At any time before the timeline mentioned in Clause 2.7.1, the BPC may, for any reason, whether at its own initiative or in response to clarifications requested by any Bidder modify or amend the RFP, including the timelines specified in Clause 2.7.2 by issuance of addendum/modification/errata and/or revised document. Such document shall be notified in writing through a letter or fax or e-mail to all the entities to whom the RFP has been issued and shall be binding on them. In order to ensure that Bidders have reasonable time to take the modification into account in preparing their Bid, or for any other reasons, BPC may at its discretion, extend the due date for submission of Bid. Late receipt of any addendum/modification/errata and/or revised document will not relieve the Bidder from being bound by that modification.
- 2.4.2 All modifications shall become part of the terms and conditions of this RFP. No interpretation, revision or communication regarding this RFP is valid, unless made in writing.
- 2.4.3 The amendment to the RFP shall be notified to all the Bidders through the electronic bidding platform and shall be binding on them.

### 2.5 The Bidding Process

The entire bidding process shall be conducted on electronic bidding platform created by **MSTC Limited**. The Bid shall comprise of the Technical Bid and the Financial Bid. The Bidders shall



submit the Technical Bid & Financial Bid through the electronic bidding platform. In addition to the online submission, the Bidder with lowest Final Offer will be required to submit original hard copies of Annexure 3, Annexure 4 (if applicable), Annexure 6 (if applicable) and Annexure 14 before issuance of Lol. There shall be no physical submission of the Financial Bid.

Evaluation of Technical Bid will be carried out considering the information and documents furnished by the Bidders as required under this RFP. This step would involve responsiveness check, technical and financial evaluation of the details/ documents furnished by the Bidding Company/ Bidding Consortium in support of meeting the Qualification Requirements. Bidders meeting the Qualification Requirements, subject to evaluation as specified in Clause 3.2 to 3.4 shall be declared as "Qualified Bidders" and eligible for opening of Initial Offer. The BPC shall also upload the list of all Qualified Bidders and Non-Qualified Bidders on the bidding portal along with the reasons for non-qualification. Also, the Financial Bids of Qualified Bidders shall be opened after at least 24 hours from the date of declaration of the Technically Qualified Bidders.

The Financial Bid will comprise of two rounds. In the first round the Initial Offer (submitted online along with the Technical Bids) of the responsive bids would be opened and Quoted Transmission Charges of Initial Offer shall be ranked on the basis of ascending order for determination of the Qualified Bidders as provided in Section-III of RFP. The Qualified Bidders, in the first fifty per cent of the ranking (with any fraction rounded off to higher integer) or four Qualified Bidders, whichever is higher, shall qualify for participating in the electronic reverse auction stage and submit their Final Offer.

Provided however, in case only one Bidder remains after the evaluation of Technical Bid as per Clause 3.2, 3.3 and Clause 3.4, the Initial Offer of such Bidder shall not be opened and the matter shall be referred to the Government.

Provided that in the event the number of qualified Technical Bids is between two and four, then each of the qualified Bidder shall be considered as "Qualified Bidders".

Provided that in the event of identical Quoted Transmission Charges discovered from the Initial Offer having been submitted by one or more Bidders, all such Bidders shall be assigned the same rank for the purposes of determination of Qualified Bidders. In such cases, all the Qualified Bidders who share the same rank till 50% of the rank (with any fraction rounded off to higher integer) determined above, shall qualify to participate in the electronic e-reverse auction stage. In case 50% of the ranks (with any fraction rounded off to higher integer) is having less than 4 (four) Bidders and the rank of the fourth (4<sup>th</sup>) Bidder is shared by more than one (1) Bidder, then all such Bidders who share the rank of the fourth (4<sup>th</sup>) Bidder shall qualify to participate in the electronic reverse auction.

The applicable ceiling for electronic reverse bidding shall be the lowest Quoted Transmission Charges discovered from the Initial Offer received from the Qualified Bidders. The Qualified Bidders shall be permitted to place their Final Offer on the electronic bidding platform, which is lower than zero point two five (0.25) % of the prevailing lowest Quoted Transmission Charges.

The initial period for conducting the e-reverse bidding should be 2 hours which will be extended by 30 minutes from the last received bid time, if the bid is received during the last 30 minutes of the scheduled or extended bid time. Subsequently, it will be extended again by 30 minutes from the latest received bid time.

The technical details with respect to access to such electronic platform are provided in **Annexure-A** (Technical Details with respect to electronic reverse auction).



In case of any technical clarification regarding access to the electronic reverse auction platform or conduct of the auction process, the Bidders may contact MSTC directly at the address provided in Annexure-A.

### 2.5.1 Bid Formats

The Bids in response to this RFP will be submitted online through the electronic bidding platform by the Bidders in the manner provided in Clause 2.9. The Bids shall comprise of the following:

### 2.5.2 Technical Bid comprising of:

1. Covering Letter (as per prescribed format enclosed as **Annexure 1**);
2. Letter of Consent from Consortium Members in **Annexure 2**;
3. Power of attorney issued by the Bidding Company or the Lead Member of the Consortium, as the case may be, in favour of the person signing the Bid, in the format attached hereto as **Annexure 3**.

Additionally, in case of a Bidding Consortium, the power of attorney in favour of the Lead Member issued by the other Members of the Consortium shall be provided in as per format attached hereto as **Annexure 4**. Further, the Lead Member shall furnish Board resolution(s) from each Member of the Consortium other than the Lead Member in favour of their respective authorized representatives for executing the POA and signing of the requisite formats.

Provided that in the event the Bidding Company or the Lead Member of the Consortium or any Member of the Bidding Consortium, as the case may be, is a foreign entity, it may issue Board resolutions in place of power of attorney for the purpose of fulfilling these requirements.

4. Bidder's composition and ownership structure in **Annexure 5**
5. Format for Authorization submitted in Non-Judicial stamp paper duly notarized as per **Annexure 5** from the Bidding Company / each Member of the Consortium authorizing the BPC to seek reference from their respective bankers & others.
6. In case of Bidding Consortium, the Consortium Agreement shall be provided in as per format attached hereto as **Annexure 6**
7. Format of Qualification Requirement (**Annexures 7A, 7B, 7C and 7D**)
8. Bidders Undertakings and details of equity investment in Project (as per prescribed formats 1 and 2 of **Annexure 8**);
9. Authorization from Parent / Affiliate of Bidding Company / Member of Bidding Consortium whose technical / financial capability has been used by the Bidding Company / Member of Bidding Consortium (**Annexure 9**).
10. Undertaking from the Technically / Financially Evaluated Entity(ies) OR Undertaking from the Ultimate Parent Company, for total equity investment commitment, in the prescribed format in **Annexure – 10**, to meet any shortfall in the equity investment by the Selected Bidder in the **RAGHANESDA RE TRANSMISSION LIMITED**.



**Note:** The effective Equity holding of the Selected Bidder in the **RAGHANESDA RE TRANSMISSION LIMITED**, as specified in Clause 2.5.8.1 shall be computed as per the provisions of Clause 2.5.8.3 of this RFP.

Provided further, in case the Bidding Company or Member of a Consortium, (as the case may be) holds at least twenty six percent (26%) equity in such Technically/ Financially Evaluated Entities, whose credentials have been considered for the purpose of meeting the Qualification Requirements as per the RFP, no such Undertaking shall be required from the Technically / Financially Evaluated Entities.

11. Board resolutions, as per prescribed formats enclosed as **Annexure – 11**, duly certified by the Company Secretary or any Whole-time Director / Manager (supported by a specific Board Resolution), as applicable to the Bidder and mentioned hereunder,
  - (a) Board resolution from the Bidding Company (and any investing Affiliate / Parent Company / Ultimate Parent Company) committing one hundred percent (100%) in aggregate of the equity requirement for the Project - Format-1 of **Annexure 11**;
  - (b) Board resolutions from each of the Consortium Member of the Bidding Consortium (and any investing Affiliate / Parent Company / Ultimate Parent Company) together committing to one hundred percent (100%) in aggregate of equity requirement for the Project, in case Bidder is a Bidding Consortium - Format-1 of **Annexure 11**;
  - (c) In either of the cases as in (a) or (b) above as applicable, Board resolutions as per Format 2 of **Annexure 11** for total equity investment commitment from the Technically / Financially Evaluated Entity(ies) whose technical / financial credentials had been considered for the purpose of meeting Qualification Requirements as per the RFP

**OR**

Board resolutions as per Format 2 of **Annexure 11** from the Parent Company or the Ultimate Parent Company for total equity investment commitment.

Provided that such Board resolutions, as specified in (a) or (b) or (c) above, in case of a foreign entity, shall be supported by an unqualified opinion issued by an independent legal counsel practicing in the relevant country, stating that the Board resolutions are in compliance with the applicable laws of the respective jurisdictions of the issuing company and the authorizations granted therein are true and valid.

For clarity sake, illustrations identifying which Board Resolution shall be applicable in typical cases are provided in **Annexure 11A**.

12. Format for Illustration of Affiliates at the most seven (7) days prior to Bid Deadline, duly certified by Company Secretary and supported by documentary evidence (**Annexure 12**).  
  
Certified copy of the Register of Members / Demat Account Statement, Share Certificate, Annual Return filed with ROC etc. submitted as documentary evidence along with **Annexure 12**.
13. Disclosure as per **Annexure 13** regarding participation of any related companies in this bidding process.



14. Bid Bond, as per the prescribed format at Annexure 14.
15. Checklist for Technical Bid submission requirements as per Annexure 16.
16. Last three (3) financial years' unconsolidated / consolidated audited annual accounts / statements, as the case may be, of the Financially Evaluated Entity / Technical Evaluated Entity.
17. Unconsolidated audited annual accounts of both the TEE and the Bidding Company/Lead member, as applicable, for the financial years in which financial closure was achieved and the financial year in which the said project was completed / commissioned.
18. Copy of the Memorandum and Articles of Association and certificate of incorporation or other organizational document (as applicable), including their amendments, certified by the Company Secretary of Bidding Company or each Member in case of a Consortium including Lead Member.
19. For each project listed in Annexure 7(D), certified true copy of the certificates of final acceptance and / or certificates of good operating performance duly issued by owners or clients for the project, duly signed by authorized signatory.

In addition to the online submission of above formats through the electronic platform, the Bidder with lowest Final Offer will be required to submit original hard copies of Annexure 3, Annexure 4 (if applicable), Annexure 6 (if applicable) and Annexure 14 before issuance of Lol. In case, there is a discrepancy between the online submission and physical documents, the bid would be out rightly rejected and the bidder shall be construed to have engaged in the fraudulent practice as defined in Clause 2.19.3 with consequences as mentioned in Clause 2.19.2.

### 2.5.3 Financial Bid (as per prescribed format at Annexure-21)

Financial Bid shall comprise of: (i) the Initial Offer; and (ii) the Final Offer. The Initial Offer is required to be submitted along with the Technical Bid. It is hereby clarified that the Financial Bid will comprise of two rounds. In the first round the Initial Offer of the responsive bids would be opened and Quoted Transmission Charges of Initial Offer shall be ranked on the basis of ascending order for determination of the Qualified Bidders as provided in Section-III of RFP.

In accordance with clause 2.5 of this RFP, the qualified Bidders shall be eligible to participate in the electronic reverse auction and submit their Final Offer.

The applicable ceiling for electronic reverse bidding shall be the lowest Quoted Transmission Charges discovered from the Initial Offer received from the Qualified Bidders. The Qualified Bidders shall be permitted to place their Final Offer on the electronic bidding platform, which is lower than zero point two five (0.25) % of the prevailing lowest Quoted Transmission Charges.

The initial period for conducting the e-reverse bidding should be 2 hours which will be extended by 30 minutes from the last received bid time, if the bid is received during the last 30 minutes of the scheduled or extended bid time. Subsequently, it will be extended again by 30 minutes from the latest received bid time.

The Bidders shall inter-alia take into account the following while preparing and submitting the Initial Offer and Final Offer of Financial Bid:-

- a. The Bidders shall quote single annual Quoted Transmission Charges for a period of 35 years commencing from the Scheduled COD of the Project.



- b. The Quoted Transmission Charges as per the format at Annexure-21 shall be inclusive of all charges and no exclusions shall be allowed. The Bidders shall take into account all costs including capital and operating, statutory taxes, duties, levies. Availability of the inputs necessary for operation and maintenance of the Project should be ensured by the TSP at the Project site and all costs involved in procuring the inputs (including statutory taxes, duties, levies thereof) at the Project site must be included in the Quoted Transmission Charges.
- c. Annexure 21 duly digitally signed by authorized signatory.
- 2.5.4 Wherever information has been sought in specified formats, the Bidders shall fill in the details as per the prescribed formats and shall refrain from referring to any other document for providing any information required in the prescribed format.
- 2.5.5 Transmission Charges**
- 2.5.5.1 The Transmission Charges shall be specified in the Transmission Service Agreement and shall be payable to the TSP in Indian Rupees only. The Bidders shall quote single Transmission Charges as per the format at Annexure – 21.
- 2.5.5.2 The Transmission Charges of the Selected Bidder shall be inserted in Schedule 5 of the Transmission Service Agreement.
- 2.5.6 Bidders may note that:**
- a) All the information and documents in Bid shall be submitted in English language only.
- b) Bidders shall mention the name, designation, telephone number, fax number, email address of the authorized signatory and complete address of the Bidder in the covering letter.
- c) All pages of the Bid submitted shall be initialed and stamped by the authorized signatory on behalf of the Bidder.
- d) A Bidder shall submit only one Bid in the same bidding process, either individually as Bidding Company or as a Member of a Bidding Consortium.
- e) The technical and financial capability of a particular company / particular project (Parent and/ or Affiliate) shall not be used directly or indirectly by more than one Bidder/ Member of a Bidding Consortium including Lead Member / Bidding Company.
- f) This Request for Proposal (RFP) document is not transferable. The RFP document and the information contained therein is for the use only by the Bidder to whom it is issued. It may not be copied or distributed by the recipient to third parties (other than in confidence to the recipient's professional advisors). In the event that the recipient does not continue with its involvement in the Project, this RFP document must be kept confidential.
- g) Though adequate care has been taken while preparing this RFP document, the Bidder shall satisfy himself that the document is complete in all respects. Intimation of any discrepancy shall be given to the BPC immediately. If no intimation is received from any Bidder within ten (10) days from the date of issue of RFP document, it shall be considered that the RFP document is complete in all respects and has been received by the Bidder.
- h) Bids submitted by the Bidder and opened on scheduled date and time as stipulated in this RFP shall become the property of the BPC and BPC shall have no obligation to return the



same to the Bidder.

- i) If any Bidder conceals any material information or makes a wrong statement or misrepresents facts or makes a misleading statement in its Bid, in any manner whatsoever, the BPC reserves the right to reject such Bid or cancel the Letter of Intent, if issued. If such event is discovered after the Effective Date, consequences specified in Transmission Service Agreement shall apply.
- j) If for any reason the Bid of the Bidder with the lowest Quoted Transmission Charges is not selected or Letter of Intent issued to such Selected Bidder is cancelled or such Bidder withdraws its Bids, the BPC may :-
  - i. Invite all the remaining Bidders to revalidate or extend their respective Bid Security, as necessary, and match the Bid of the Bidder with the lowest Quoted Transmission Charges (the "second round of bidding") with following cases:
    - If in the second round of bidding, only one Bidder matches the Bid of the Bidder with lowest Quoted Transmission Charges, it shall be the Selected Bidder.
    - If two or more Bidders match the Bid of the Bidder with the lowest Quoted Transmission Charges in the second round of bidding, then the Bidder whose Quoted Transmission Charges was lower as compared to other Bidder(s) in the first round of bidding shall be the Selected Bidder. For example, if the third and fifth lowest Bidders in the first round of bidding offer to match the Bid of the Bidder with lowest Quoted Transmission Charges in the second round of bidding, the said third lowest Bidder shall be the Successful Bidder.
    - In the event that no Bidder offers to match the Bid of the Bidder with the lowest Quoted Transmission Charges in the second round of bidding, the BPC may, in its discretion, invite fresh Bids (the "third round of bidding") from all Bidders except the Bidder which quoted the lowest Quoted Transmission Charges in the first round of bidding. In case the Bidders are invited for the third round of bidding to revalidate or extend their Bid Security, as necessary, and offer fresh Bids, they shall be eligible for submission of fresh Bids provided, however, that in such third round of bidding only such Bids shall be eligible for consideration which are lower than the Quoted Transmission Charges of the second lowest Bidder in the first round of bidding; or;
  - ii. Annul the bid process; or
  - iii. Take any such measure as may be deemed fit in the sole discretion of the BPC<sup>1</sup>
- k) The BPC may, at its sole discretion, ask for additional information / document and/or seek clarifications from a Bidder after the Bid Deadline, inter alia, for the purposes of removal of inconsistencies or infirmities in its Bid. However, no change in the substance of the Quoted Transmission Charges shall be sought or permitted by the BPC.
- l) Non submission and/or submission of incomplete data/ information required under the provisions of RFP shall not be construed as waiver on the part of BPC of the obligation of the Bidder to furnish the said data / information unless the waiver is in writing.
- m) Bidders shall familiarize itself with the procedures and time frames required to obtain all

<sup>1</sup> BPC shall record reasons for the same.



**Consents, Clearances and Permits.**

- n) All Bidders are required to ensure compliance with the standards and codes mentioned in Clause 1.6.1.2.
- o) BPC reserves the right to reject all Bids and/or annul the process of tariff based competitive bidding for selection of Bidder as TSP to execute the Project without assigning any reason. BPC shall not bear any liability, whatsoever, in this regard.
- p) Foreign companies submitting the Bid are required to follow the applicable law in their country for execution of POA, Consortium Agreement and affixation of Common Seal (wherever required) and in such cases, their Bid should be supported by an unqualified opinion issued by an independent legal counsel practicing in the relevant country, stating that execution of such POA, Consortium Agreement and the authorizations granted therein are true and valid. Foreign companies executing POA outside India shall necessarily pay the adequate stamp charges in India as per the provisions of Stamp Act.

**2.5.7 Bidders to inform themselves fully**

2.5.7.1. The Bidders shall make independent enquiry and satisfy themselves with respect to all the required information, inputs, conditions and circumstances and factors that may have any effect on his Bid. Once the Bidders have submitted their Bids, the Bidders shall be deemed to have inspected and examined the site conditions (including but not limited to its surroundings, its geological condition and the adequacy of transport facilities to the site), the laws and regulations in force in India, the transportation facilities available in India, the grid conditions, the adequacy and conditions of roads, bridges, railway sidings, ports, etc. for unloading and/or transporting heavy pieces of material and has based its design, equipment size and fixed its price taking into account all such relevant conditions and also the risks, contingencies and other circumstances which may influence or affect the transmission of power. Accordingly, each Bidder acknowledges that, on being selected as Successful Bidder and on acquisition of one hundred percent (100%) of the equity shares of the **RAGHANESDA RE TRANSMISSION LIMITED**, the TSP shall not be relieved from any of its obligations under the RFP Project Documents nor shall the TSP be entitled to any extension in Scheduled COD mentioned in this RFP or financial compensation for any reason whatsoever.

2.5.7.2. In their own interest, the Bidders are requested to familiarize themselves with all relevant laws of India, including without limitation, the Electricity Act 2003, the Income Tax Act 1961, the Companies Act, 1956 / Companies Act, 2013 (as the case may be), Environment Protection Act 1986 and Forest (Conservation) Act, 1980, the Customs Act, the Foreign Exchange Management Act, Land Acquisition Act, 1894, the Indian Telegraph Act 1885, Labour & Employment Laws of India, [Insurance Act] the regulations/standards framed by the Commissions and CEA, all other related acts, laws, rules and regulations prevalent in India, as amended from time to time.

In addition to the above, the Bidders are required to familiarize themselves with all relevant technical codes and standards, including but not limited to the Grid Code / State Grid Code, Central Electricity Authority (Installation and Operations of Meters) Regulations, 2006, Central Electricity Authority (Technical Standards for Connectivity to the Grid) Regulations, 2007, Central Electricity Regulatory Commission Grant of Connectivity, Long-term Access and Medium - Term Open Access in Inter-State Transmission and related matters) Regulations, 2009, Central Electricity Authority (Technical Standards for construction of Electrical Plants and Electric Lines) Regulation, 2010, Central Electricity Authority (Technical Standards for Communication System in Power System Operation) Regulations, 2020, Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations,



2020 and other relevant Rules/ Regulations/ Guidelines issued by the Central Government, the CERC and the CEA and amendments thereof.

The BPC shall not entertain any request for clarifications from the Bidders regarding the above laws / acts / rules / regulations / standards. Non-awareness of the same shall not be a reason for the Bidder to request for extension in Bid Deadline. The Bidders undertake and agree that, before submission of their Bid, all such factors as generally brought out above, have been fully investigated and considered while submitting their Bids.

- 2.5.7.3. The Survey Report has been prepared in good faith, and on best endeavor basis. Neither BPC & Nodal Agency nor their employees or advisors/consultants make any representation or warranty, express or implied, or accept any responsibility or liability, whatsoever, in respect of any statements or omissions made in the Survey Report, or the accuracy, completeness or reliability of information contained therein, and shall incur no liability under any law, statute, rules or regulations as to the accuracy, reliability or completeness of such Survey Report, even if any loss or damage is caused to the Bidders by any act or omission on their part.
- 2.5.7.4. Bidders shall make best efforts and carry out its own due diligence upon survey report provided by BPC and shall consider all possible techno-commercial factors before submission of Bid. Bidders may also visit the route of the Transmission Lines associated with the Project and the surrounding areas and obtain / verify all information which they deem fit and necessary for the preparation of their Bid. Bidders may also carry out required surveys and field investigation for submission of their Bid. Bidders may also opt for any other route and is not bound to follow the route suggested in survey report provided by BPC.
- 2.5.7.5. Failure to investigate, examine and to inspect site or subsurface conditions fully shall not be grounds for a Bidder to alter its Bid after the Bid Deadline nor shall it relieve a Bidder from any responsibility for appropriately eliminating the difficulty or costs of successfully completing the Project.
- 2.5.7.6. The Selected Bidder shall obtain all necessary Consents, Clearances and Permits as required. The Bidders shall familiarize itself with the procedures and time frame required to obtain such Consents, Clearances and Permits.
- 2.5.7.7. The technical requirements of integrated grid operation are specified in the Indian Electricity Grid Code (IEGC). The Bidders should particularly acquaint themselves with the requirements of connection conditions, operating code for regional grids, scheduling and dispatch instructions/codes, etc. The Bidders are also advised to fully familiarize themselves with the real time grid conditions in the country. Information regarding grid parameters such as voltage and frequency is available on the websites of Regional / State Load Dispatch Centres.

#### 2.5.8 Minimum Equity holding/Equity Lock-in

- 2.5.8.1 (a) The aggregate equity share holding of the Selected Bidder, in the issued and paid up equity share capital of **RAGHANESDA RE TRANSMISSION LIMITED** shall not be less than Fifty one percent (51%) up to a period of (1) one year after COD of the Project;

(b) In case the Selected Bidder is a Bidding Consortium, then any Member (other than the Lead Member) of such Bidding Consortium shall be allowed to divest its equity as long as the other remaining Members (which shall always include the Lead Member) hold the minimum equity specified in (a) above.

(c) If equity is held by the Affiliates, Parent Company or Ultimate Parent Company, then subject to the second proviso of this Clause 2.5.8.1 (c), such Affiliate, Parent Company or Ultimate Parent



Company shall be permitted to transfer its shareholding in **RAGHANESDA RE TRANSMISSION LIMITED** to another Affiliate or to the Parent Company / Ultimate Parent Company. If any such shareholding entity, qualifying as an Affiliate / Parent Company / Ultimate Parent Company, is likely to cease to meet the criteria to qualify as an Affiliate / Parent Company / Ultimate Parent Company, the shares held by such entity shall be transferred to another Affiliate / Parent Company / Ultimate Parent Company.

Provided that in case the Lead Member or Bidding Company is holding equity through Affiliate/s, Ultimate Parent Company or Parent Company, such restriction shall apply to such entities.

Provided further, that the aggregate equity share holding of the Bidding Consortium or a Bidding Company in the issued and paid up equity share capital of **RAGHANESDA RE TRANSMISSION LIMITED** shall not be less than fifty one percent (51%) up to a period of one (1) year after COD of the Project and the lead Member of the Consortium shall have the equity share holding not less than twenty six percent (26%). In case the Selected Bidder is a Bidding Consortium, then any Member (other than the Lead Member) of such Bidding Consortium shall be allowed to divest its equity as long as the other remaining Members (which shall always include the Lead Member) hold the minimum equity specified in (a) above.

(d) All transfer(s) of shareholding of **RAGHANESDA RE TRANSMISSION LIMITED** by any of the entities referred to above, shall be after prior written intimation to the Nodal Agency.

2.5.8.2 The Selected Bidder may invest in the equity share capital of **RAGHANESDA RE TRANSMISSION LIMITED** through its Affiliate(s) or Ultimate Parent Company or Parent Company. Details of such investment will have to be specified in the Technical Bid as per Format 2 of Annexure 8 of the RFP. If the Selected Bidder so invests through any Affiliate(s) or Ultimate Parent Company or Parent Company, the Selected Bidder shall be liable to ensure that minimum equity holding/lock-in limits specified in Clause 2.5.8.1 and as computed as per the provisions of Clause 2.5.8.3 are still maintained.

2.5.8.3 For computation of effective Equity holding, the Equity holding of the Selected Bidder or its Ultimate Parent Company in such Affiliate(s) or Parent Company and the equity holding of such Affiliate (s) or Ultimate Parent Company in **RAGHANESDA RE TRANSMISSION LIMITED** shall be computed in accordance with the example given below:

If the Parent Company or the Ultimate Parent Company of the Selected Bidder A directly holds thirty percent (30%) of the equity in **RAGHANESDA RE TRANSMISSION LIMITED** then holding of Selected Bidder A in **RAGHANESDA RE TRANSMISSION LIMITED** shall be thirty percent (30%);

If Selected Bidder A holds thirty percent (30%) equity of the Affiliate and the Affiliate holds fifty percent (50%) equity in **RAGHANESDA RE TRANSMISSION LIMITED**, then for the purposes of ascertaining the minimum equity/equity lock-in requirements specified above, the effective holding of Bidder A in **RAGHANESDA RE TRANSMISSION LIMITED** shall be fifteen percent (15%), (i.e.,  $30\% * 50\%$ );

2.5.8.4 The provisions as contained in this Clause 2.5.8 and Article 19.1 of the Transmission Service Agreement shall override the terms of the Consortium Agreement submitted by the Bidder as part of the RFP.

## 2.6 Project Schedule

2.6.1. All Elements of the Project are required to be commissioned progressively as per the schedule given in the following table;

Sl. No.	Name of the Transmission Element	Scheduled COD	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre-required for declaring the commercial operation (COD) of the respective Element
1.	Establishment 4x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVar, 765 kV bus reactor and 2x125 MVar, 420 kV bus reactor	27 months from effective date	52.69%	All Elements are required to be commissioned simultaneously as their utilization is dependent on commissioning of each other.
2.	Raghnesda (GIS) – Banaskantha (PG) 765 kV D/C line		36.50%	
3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s		2.80%	
4.	Creation of 220 kV switchyard (Bus Sec-I) at Raghnesda PS (GIS) along with installation of 2x500 MVA, 400/220 kV ICTs	30.09.2027*	7.28%	Elements at Sl. No. 1, 2 and 3 are pre-required for declaring the commercial operation (COD)
5.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Azure Power Sixty-Three Pvt. Ltd. (2200001107) (300 MW)	30.09.2027*	0.36%	
6.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Sunsure Solarpark RJ One Pvt. Ltd. (2200001018) (350 MW)	31.03.2028	0.37%	Element at Sl. No. 6 can be commissioned separately subject to commissioning of elements at sl. No. 1 to 4.

\*Subject to minimum schedule of 27 months from effective date.

The payment of Transmission Charges for any Element irrespective of its successful commissioning on or before its Scheduled COD shall only be considered after successful commissioning of the Element(s) which are pre-required for declaring the commercial operation of such Element as mentioned in the above table.

## 2.7 Due dates

2.7.1 The Bidders should submit the Bids online through the electronic bidding platform before the Bid Deadline i.e. on or before **15:00 hours (IST) on March 17, 2025**. In addition to the online submission, the Bidder with lowest Final Offer will be required to submit original hard copies of Annexure 3, Annexure 4 (if applicable), Annexure 6 (if applicable) and Annexure 14 before issuance of Lol.

## 2.7.2 Important timelines are mentioned below:

Date	Event
14-09-2024	Issuance of RFP
04-10-2024	Submission of written clarifications/amendments, if any, on the RFP / RFP Project Documents by Bidders so as to reach BPC by 1700 hours. Such written clarifications/amendments shall be in the format provided in Annexure-20.
11-10-2024	Pre-Bid meeting(s)
22-10-2024	Issue of written clarifications and revised RFP documents
01-11-2024	Issue of final RFP Project Documents
17-03-2025	Submission of Bid (Online submission of Bid through electronic bidding portal)
17-03-2025	Opening of Technical Bid
25-03-2025	Shortlisting and announcement of Qualified Bidders on bidding portal
26-03-2025	Opening of Financial Bid - Initial Offer
27-03-2025	Electronic reverse auction (Financial Bid – Final Offer) for the Qualified Bidders.
31-03-2025	Submission of original hard copies of Annexure 3, Annexure 4, Annexure 6, as applicable and Annexure 14 by the bidder with lowest Final Offer
04-04-2025	Selection of Successful Bidder and issue of LOI
14-04-2025	Signing of RFP Project Documents and transfer of RAGHANESDA RE TRANSMISSION LIMITED

To enable BPC to meet the schedule, all Bidders are expected to respond expeditiously during the bidding process. If any milestone/activity falls on a day which is not a working day or which is a public holiday then the milestone/activity shall be achieved/ completed on the next working day.

## 2.8 Validity of the Bid

- 2.8.1 The Bid shall remain valid for a period of one hundred and eighty (180) days from the Bid Deadline. The BPC reserves the right to reject any Bid which does not meet aforementioned validity requirement.
- 2.8.2 The BPC may solicit the Bidders' consent for an extension of the period of validity of the Bid. The request and the response, thereafter, shall be in writing. In the event any Bidder refuses to extend its Bid validity as requested by the BPC, the BPC shall not be entitled to invoke the Bid Bond. A Bidder accepting the BPC's request for validity extension shall not be permitted to modify its Bid and such Bidder shall, accordingly, extend the validity of the Bid Bond as requested by the BPC within seven (7) days of such request, failing which the Bid shall not be considered as valid.



**2.9 Method of Submission**

- 2.9.1 Both the Technical and Financial Bids duly filled in, all formats and supporting shall be scanned and uploaded online through electronic bidding platform in the manner specified in **Annexure A**.
- 2.9.2 It may be noted that Technical Bid shall not contain any information/document relating to Financial Bid. If Technical Bid contains any such information/documents, the BPC shall not be responsible for premature opening of the Financial Bid.

All pages of the Bid, except for the Bid Bond (**Annexure 14**) and any other document executed on non-judicial stamp paper, forming part of the Bid and corrections in the Bid, if any, must be signed by the authorized signatory on behalf of the Bidder. It is clarified that the same authorized signatory shall sign all pages of the Bid. However, any published document submitted in this regard shall be signed by the authorized signatory at least on the first and last page of such document.

- 2.9.3 No change or supplemental information to a Bid already submitted will be accepted after the Bid Deadline, unless the same is requested for by the BPC as per Clause 2.5.6 (k).

Provided that a Bidder shall always have the right to withdraw / modify its Bid before the Bid Deadline. No Technical Bid or Initial Offer shall be modified, substituted or withdrawn by the Bidder on or after the Bid Deadline.

**2.10 Preparation cost**

- 2.10.1 The Bidders shall be responsible for all the costs associated with the preparation of the Bid and participation in discussions and attending pre-bid meetings, and finalization and execution of the RFP Project Documents (other than the TSA), etc. BPC shall not be responsible in any way for such costs, regardless of the conduct or outcome of the process of tariff based competitive bidding for selection of Bidder as TSP as per Bidding Guidelines.
- 2.10.2 The cost of this RFP is **Rupees Five Lakh (Rs.5,00,000/-) or U.S. Dollar Seven Thousand Only (US\$7,000 /-) plus GST** as per applicable rate, which shall be non-refundable. This amount shall be paid via electronic transfer to the following Bank Account:

<b>Bank Account Name</b>	<b>: PFC Consulting Limited</b>
<b>Account No.</b>	<b>: 000705036117</b>
<b>Bank Name</b>	<b>: ICICI Bank</b>
<b>IFSC</b>	<b>: ICIC0000007</b>
<b>Branch</b>	<b>: Connaught Place, New Delhi-110001</b>

Immediately after issuance of RFP document, the Bidder shall submit the Pre-Award Integrity Pact in the format as prescribed in **Annexure B**, which shall be applicable for and during the bidding process, duly signed on each page by any whole-time Director / Authorized Signatory, duly witnessed by two persons, and shall be submitted by the Bidder in two (2) originals in a separate envelope, duly superscripted with Pre-Award Integrity Pact. The Bidder shall submit the Pre-Award Integrity Pact on non-judicial stamp paper of Rs.100/- each duly purchased from the National Capital Territory of Delhi. In case the Bidder is in a consortium, the Pre-Award Integrity Pact shall be signed and submitted by each member of the Consortium separately.

**2.11 Bid Bond**

- 2.11.1 Each Bidder shall submit the Bid accompanied by Bid Bond issued by any of the Banks listed in Annexure-17. The Bid Bond shall be valid for a period of thirty (30) days beyond the validity of the



Bid.

2.11.2. Subject to the provisions of Clause 2.15.5, the Bid Bond may be invoked by the BPC or its authorized representative, without any notice, demure, or any other legal process upon occurrence of any of the following:

- Bidder withdraws during the period of Bid Validity as specified in this RFP or as extended by mutual consent of the respective Bidder(s) and the BPC
- Failure to execute the Share Purchase Agreement as per the provisions of Clause 2.15.2; or
- Failure to furnish the Contract Performance Guarantee as per Clause 2.12; or
- Failure to acquire one hundred percent (100%) equity shares of **RAGHANESDA RE TRANSMISSION LIMITED**, along with all its related assets and liabilities, in accordance with the provisions of Clause 2.15.2; or
- Failure to comply with the provisions of Clause 2.15.5 and Clause 2.15.6, leading to annulment of the award of the Project.
- Bidders submitting any wrong information or making any misrepresentation in their Bid as mentioned in Clause 2.5.6.

Intimation of the reasons of the invocation of the Bid Bond shall be given to the Selected Bidder by the BPC within three (3) working days after such invocation.

2.11.3. The Bid Bond of the Selected Bidder shall be returned on submission of the Contract Performance Guarantee as per Clause 2.12 and the relevant provisions of the Transmission Service Agreement.

2.11.4. The Bid Bond of all the Bidders, whose Bids are declared non-responsive, shall be returned within a period of thirty (30) days after the date on which the Financial Bids are opened.

2.11.5. The Bid Bond of all unsuccessful Bidders shall be returned and released by the BPC on the same day on which the **RAGHANESDA RE TRANSMISSION LIMITED** is transferred to the Selected Bidder. The Bid Bond of the Successful Bidder shall be returned on submission of Contract Performance Guarantee as per Clause 2.12 of this RFP and the provisions of the Transmission Service Agreement.

## 2.12 Contract Performance Guarantee

Within ten (10) days from the date of issue of the Letter of Intent, the Selected Bidder, on behalf of the TSP, will provide to the Nodal Agency the Contract Performance Guarantee for an amount of **Rs.57.50 Crore (Rupees Fifty Seven Crore Fifty Lakh Only)**. The Contract Performance Guarantee shall be initially valid for a period up to three (3) months after the Scheduled COD of the Project and shall be extended from time to time to be valid for a period up to three (3) months after the COD of the Project and thereafter shall be dealt with in accordance with the provisions of the Transmission Service Agreement. The Contract Performance Guarantee shall be issued by any of the banks listed in Annexure-17.

In case the Selected Bidder is unable to obtain the Contract Performance Guarantee for the total amount from any one bank specified in **Annexure-17**, the Selected Bidder may obtain the same from not more than three (3) banks specified in Annexure-17.



144

**2.13 Opening of Bids**

Technical Bid will be opened by the Bid Opening Committee as per the following time schedule and in the office of Central Electricity Authority, in the online presence of Bidders' representatives who wish to attend:

Opening of Envelope (Technical Bid): **15:00 hours (IST) on March 17, 2025** or such other dates as may be intimated by BPC to the Bidders.

In the event of any of above dates falling on a day which is not a working day or which is a public holiday, then the bids shall be opened on the next working day at the same venue and time.

Opening of Initial Offer: Initial Offer shall be opened by the Bid Opening Committee in presence of the Bid Evaluation Committee at **15:30 hours (IST) on March 17, 2025** in the office of CEA.

The following information from each Bid will be read out to all the Bidders at the time of opening of Technical Bid:

- Name of the Bidding Company / Consortium Members in case of Bidding Consortium.

**Information to be provided after opening of Initial Offer:**

Only the lowest Initial Offer (s) shall be communicated to all the Qualified Bidders to participate in the e-reverse bidding process. During the e-reverse bidding process only the lowest prevailing bid should be visible to all the bidders on the electronic platform.

**2.14 Enquiries**

Written clarifications on the RFP and other RFP Project Documents as per Clause 2.3 and 2.4 may be sought from:

**General Manager**  
**PFC Consulting Limited**  
 9th Floor, Wing-A, Statesman House,  
 Connaught Place, New Delhi - 110001  
 Tel. + 91 11 23443996  
 Fax + 91 11 23443990  
 Email: [pfcl.itp@pfcindia.com](mailto:pfcl.itp@pfcindia.com)

**2.15 Other Aspects**

2.15.1 The draft of the Transmission Service Agreement has been attached to this RFP. In addition to above, the following documents have also been attached to this RFP:

- Share Purchase Agreement

When the drafts of the above RFP Project Documents are provided by the BPC, these RFP Project Documents shall form part of this RFP as per **Formats – 1 & 2 of Annexure 20**.

Upon finalization of the RFP Project Documents after incorporating the amendments envisaged in Clause 2.4 of this RFP, all the finalized RFP Project Documents shall be provided by BPC to the Bidders at least fifteen (15) days prior to the Bid Deadline.

The Transmission Service Agreement and Share Purchase Agreement shall be signed in required



145

number of originals so as to ensure that one (1) original is retained by each party to the Agreement(s) on the date of transfer of SPV.

Note: Kindly check 2.15.2. (b) point from SBDs

2.15.2 Within ten (10) days of the issue of the Letter of Intent, the Selected Bidder shall:

- a) Provide the Contract Performance Guarantee in favour of the Nodal Agency as per the provisions of Clause 2.12;
- b) Execute the Share Purchase Agreement and the Transmission Service Agreement;
- c) acquire, for the Acquisition Price, one hundred percent (100%) equity shareholding of **RAGHANESDA RE TRANSMISSION LIMITED** from PFC Consulting Limited, who shall sell to the Selected Bidder, the equity shareholding of **RAGHANESDA RE TRANSMISSION LIMITED**, along with all its related assets and liabilities;

Stamp duties payable on purchase of one hundred percent (100%) of the equity shareholding of **RAGHANESDA RE TRANSMISSION LIMITED**, along with all its related assets and liabilities, shall also be borne by the Selected Bidder.

Provided further that, if for any reason attributable to the BPC, the above activities are not completed by the Selected Bidder within the above period of ten (10) days as mentioned in this Clause, such period of ten (10) days shall be extended, on a day for day basis till the end of the Bid validity period.

2.15.3 After the date of acquisition of the equity shareholding of **RAGHANESDA RE TRANSMISSION LIMITED**, along with all its related assets and liabilities, by the Selected Bidder,

- i. the authority of the BPC in respect of this Bid Process shall forthwith cease and any actions to be taken thereafter will be undertaken by the Nodal Agency,
- ii. all rights and obligations of **RAGHANESDA RE TRANSMISSION LIMITED**, shall be of the TSP,
- iii. any decisions taken by the BPC prior to the Effective Date shall continue to be binding on the Nodal Agency and
- iv. contractual obligations undertaken by the BPC shall continue to be fulfilled by the TSP.
- v. Further, the TSP shall execute the Agreement(s) required, if any, under Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations as amended from time to time.

2.15.4 Within five (5) working days of the issue of the acquisition of the SPV by the Successful Bidder, the TSP shall apply to the Commission for grant of Transmission License and make an application to the Commission for the adoption of Transmission Charges, as required under Section – 63 of The Electricity Act 2003.

2.15.5 If the Selected Bidder / TSP fails or refuses to comply with any of its obligations under Clauses 2.15.2, 2.15.3 and 2.15.4, and provided that the other parties are willing to execute the Share Purchase Agreement and PFC Consulting Limited is willing to sell the entire equity shareholding of **RAGHANESDA RE TRANSMISSION LIMITED**, along with all its related assets and liabilities, to the Selected Bidder, such failure or refusal on the part of the Selected Bidder shall constitute sufficient



grounds for cancellation of the Letter of Intent. In such cases, the BPC / its authorized representative(s) shall be entitled to invoke the Bid Bond of the Selected Bidder.

- 2.15.6 If the TSP fails to obtain the Transmission License from the Commission, it will constitute sufficient grounds for annulment of award of the Project.
- 2.15.7 The annulment of award, as provided in Clauses 2.15.5 and 2.15.6 of this RFP, will be done by the Government on the recommendations of National Committee on Transmission. However, before recommending so, National Committee on Transmission will give an opportunity to the Selected Bidder / TSP to present their view point.
- 2.15.8 The annulment of the award, under Clause 2.15.5 or 2.15.6 of this RFP, shall be sufficient grounds for blacklisting the bidder, whose award has been annulled, for a period of five years or more, as decided by the National Committee on Transmission, provided that the blacklisting shall be done only after giving the bidder an opportunity for showing cause.

## 2.16 Confidentiality

- 2.16.1 The parties undertake to hold in confidence this RFP and RFP Project Documents and not to disclose the terms and conditions of the transaction contemplated hereby to third parties, except:
- a) to their professional advisors;
  - b) to their officers, contractors, employees, agents or representatives, financiers, who need to have access to such information for the proper performance of their activities;
  - c) disclosures required under Law, without the prior written consent of the other parties of the concerned agreements.

Provided that the TSP agrees and acknowledges that the Nodal Agency may at any time, disclose the terms and conditions of the RFP and RFP Project Documents to any person, to the extent stipulated under the Law or the Bidding Guidelines.

## 2.17 Right of the BPC to reject any Bid

BPC reserves the right to reject all or any of the Bids/ or cancel the RFP without assigning any reasons whatsoever and without any liability.

- 2.18 Non submission and/or submission of incomplete data/ information required under the provisions of RFP shall not be construed as waiver on the part of BPC of the obligation of the Bidder to furnish the said data / information unless the waiver is in writing.

## 2.19 Fraudulent and Corrupt Practices

- 2.19.1. The Bidders and their respective officers, employees, agents and advisers shall observe the highest standard of ethics during the Bid process and subsequent to the issue of the Lol Notwithstanding anything to the contrary contained herein, or in the Lol, the BPC shall reject a Bid, withdraw the Lol, as the case may be, without being liable in any manner whatsoever to the Bidder, if it determines that the Bidder has, directly or indirectly or through an agent, engaged in corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice in the Bid process. In such an event, the BPC shall forfeit the Bid Bond, without prejudice to any other right or remedy that may be available to the BPC hereunder or otherwise.



- 2.19.2. Without prejudice to the rights of the BPC under Clause 2.19.1 hereinabove and the rights and remedies which the BPC may have under the Lol, if a Bidder is found by the BPC to have directly or indirectly or through an agent, engaged or indulged in any corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice during the Bid process, or after the issue of the Lol, such Bidder & its Affiliates shall not be eligible to participate in any tender or RFP issued by any BPC for an indefinite period from the date such Bidder is found by the BPC to have directly or indirectly or through an agent, engaged or indulged in any corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practices, as the case may be.
- 2.19.3. For the purposes of this Clause 2.19, the following terms shall have the meaning hereinafter respectively assigned to them:
- a) **"corrupt practice"** means (i) the offering, giving, receiving, or soliciting, directly or indirectly, of anything of value to influence the actions of any person connected with the Bid process (for avoidance of doubt, offering of employment to or employing or engaging in any manner whatsoever, directly or indirectly, any official of the BPC who is or has been associated or dealt in any manner, directly or indirectly with the Bid process or the Lol or has dealt with matters concerning the Transmission Service Agreement or arising there from, before or after the execution thereof, at any time prior to the expiry of one year from the date such official resigns or retires from or otherwise ceases to be in the service of the BPC, shall be deemed to constitute influencing the actions of a person connected with the Bid Process); or (ii) engaging in any manner whatsoever, whether during the Bid Process or after the issue of the Lol or after the execution of the Transmission Service Agreement, as the case may be, any person in respect of any matter relating to the Project or the Lol or the Transmission Service Agreement, who at any time has been or is a legal, financial or technical adviser of the BPC in relation to any matter concerning the Project;
  - b) **"Fraudulent practice"** means a misrepresentation or omission of facts or suppression of facts or disclosure of incomplete facts, in order to influence the Bid process;
  - c) **"Coercive practice"** means impairing or harming, or threatening to impair or harm, directly or indirectly, any person or property to influence any person's participation or action in the Bid process;
  - d) **"undesirable practice"** means (i) establishing contact with any person connected with or employed or engaged by the BPC with the objective of canvassing, lobbying or in any manner influencing or attempting to influence the Bid process; or (ii) having a Conflict of Interest; and
  - e) **"Restrictive practice"** means forming a cartel or arriving at any understanding or arrangement among Bidders with the objective of restricting or manipulating a full and fair competition in the Bid process.



# SECTION - 3

## EVALUATION OF THE TECHNICAL AND FINANCIAL BID

149



## SECTION 3

## 3. EVALUATION OF BID

## 3.1. The evaluation process of Technical Bid comprises the following five steps:

- Step I – Responsiveness check
- Step II- Compliance with submission requirements
- Step III– Evaluation of Technical Bids
- Step IV– Evaluation of Financial Bids
- Step V – Bidder Selection

## 3.2. STEP I – Responsiveness check

The Technical Bid submitted by the Bidder shall be initially scrutinized to establish "Responsiveness". Subject to clause 2.5.6 (k), any of the following conditions shall cause the Technical Bid to be "Non-responsive":

- a) Technical Bid that are incomplete.
- b) Technical Bid not signed by authorized signatory and / or stamped in the manner indicated in this RFP.
- c) All pages of the Technical Bid submitted but not initialed by the authorized signatories on behalf of the Bidder.
- d) Technical Bid not including the covering letter as per Annexure 1.
- e) Technical Bid submitted by a Bidding Consortium not including the Consortium Agreement.
- f) Technical Bid contains material inconsistencies in the information and documents submitted by the Bidder, affecting the Qualification Requirements.
- g) Bidder submitting or participating in more than one Bid either as a Bidding Company or as a Member of Bidding Consortium.
- h) More than one Member of the Bidding Consortium or a Bidding Company using the credentials of the same Parent/Affiliate.
- i) Information not submitted in formats specified in the RFP.
- j) Applicable Board resolutions, or any other document, as provided in Clause 2.5.2, not being submitted;
- k) Bid not accompanied by a valid Bid Bond;
- l) Non submission of power of attorney, supported by a Board resolution;
- m) Bid validity being less than that required as per Clause 2.8 of this RFP;
- n) Bid not containing Format-1 (Bidders' Undertakings) of Annexure-8;

- o) Bidder having Conflict of Interest
- p) The Bidder has not submitted a disclosure as per Annexure 13.
- q) Bidders delaying in submission of additional information or clarifications sought by the BPC.
- r) If the Bidder makes any misrepresentation as specified in Clause 3.7.
- s) Bid being conditional in nature.

### 3.3. STEP II - Compliance with submission requirements

Each Bidder's Technical Bid shall be checked for compliance with the submission requirements set forth in this RFP before the evaluation of Technical Bid is taken up. Annexure 16 and Annexure 11A shall be used to check whether each Bidder meets the stipulated requirements.

### 3.4. STEP III -Evaluation of Technical Bid

Evaluation of Technical Bid will be carried out considering the information and documents furnished by the Bidders as required under this RFP. This step would involve technical and financial evaluation of the details/ documents furnished by the Bidding Company / Bidding Consortium in support of meeting the Qualification Requirements.

#### 3.4.1. Interpolation of financial data.

For the Qualification Requirements data provided by the Bidders in foreign currency, equivalent rupees of Networth will be calculated using bills selling exchange rates (card rate) USD/INR of State Bank of India prevailing on the date of closing of the accounts for the respective financial year as certified by their Banker.

For the purpose of calculating the aggregate capital expenditure/construction experience of the projects completed/ commissioned where such projects are executed outside India and capital expenditure is denominated in foreign currency, bills selling exchange rates (card rate) USD/INR of State Bank of India prevailing on the date of closing of the financial year in which the projects were completed and as certified by their Banker shall be considered.

For the projects executed in the current financial year bills selling (card rate) USD/INR of State Bank of India prevailing on seven (7) days prior to the last date of submission of Technical Bid and as certified by their Banker shall be considered.

For currency other than USD, Bidders shall convert such currency into USD as per the exchange rates certified by their Banker prevailing on the relevant date and used for such conversion. Such Bidders shall submit necessary certification from their Banker for the exchange rate used in the conversation.

If the exchange rate for any of the above dates is not available, the rate for the immediately available previous day shall be taken into account.

- 3.4.2. Bidders meeting the Qualification Requirements, subject to evaluation as specified in Clauses 3.2 to 3.4 shall be declared as Qualified Bidders and eligible for opening of Initial Offer.
- 3.4.3. The BPC shall upload the list of all Qualified Bidders and Non-Qualified Bidders on the bidding



portal along with the reasons for non-qualification.

### 3.5. STEP IV - Evaluation of Financial Bids

- 3.5.1. The Bids which have been found Qualified by the BPC, based on the Steps I to III as specified above in Clauses 3.2.to 3.4, shall be opened and Quoted Transmission Charges of such Initial Offer shall be ranked on the basis of the ascending Initial Offer submitted by each Qualified Bidder.

Based on such ranking of the Qualified Bidders, in the first fifty per cent of the ranking (with any fraction rounded off to higher integer) or four Qualified Bidders, whichever is higher, shall qualify for participating in the electronic reverse auction.

Provided however, in case only one Bidder remains after the Evaluation of Technical Bid (Steps 1 to III) as per Clause 3.2 to 3.4, the Initial Offer of such Bidder shall not be opened and the matter shall be referred to the Government.

Provided that in the event the number of Qualified Bidders is between two and four, then each of the responsive Bidder shall be considered as Qualified Bidders.

Provided that in the event of identical Quoted Transmission Charges discovered from the Initial Offer having been submitted by one or more Bidders, all such Bidders shall be assigned the same rank for the purposes of determination of Qualified Bidders. In such cases, all Qualified Bidders who shares the same rank till 50% of the rank (with any fraction rounded off to higher integer) determined above, shall qualify to participate in the electronic reverse auction stage. In case 50% of the rank is having less than four (4) Bidders and the rank of the fourth (4<sup>th</sup>) Bidder is shared by more than one Bidder, then all such all such Bidders who share the rank of the fourth Bidder shall qualify to participate in the electronic reverse auction.

- 3.5.2. The Financial Bids comprising of both Initial Offer and Final Offer submitted by the Bidders shall be scrutinized to ensure conformity with the provisions of Clause 2.5.3 of this RFP. Any Bid not meeting any of the requirements as per Clause 2.5.3 of this RFP may cause the Bid to be considered "Non-responsive", at the sole decision of the BPC. Financial Bid not in conformity with the requirement of SI. No. (c) of Clause 2.5.3 of this RFP shall be rejected.
- 3.5.3 The Bidders shall quote the single annual Quoted Transmission Charges as specified in the format at Annexure – 21.

### 3.6. STEP V - Bidder Selection

- 3.6.1. The prevailing lowest Quoted Transmission Charges discovered from Final Offers shall only be displayed during the e-reverse bidding and the Bidder quoting such Final Offer will always remain anonymous during the e-reverse bidding. The Bidder with the prevailing lowest Quoted Transmission Charges discovered from Final Offers at the close of the scheduled or extended period of e-reverse bidding as mentioned in clause 2.5 shall be declared as the Successful Bidder, subject to verification of the original hard copies of Annexure 3, Annexure 4 (if applicable), Annexure 6 (if applicable) and Annexure 14. The Letter of Intent shall be issued to such Successful Bidder in two (2) copies.

However, if no bid is received during the e-reverse bidding stage then the Bidder with lowest quoted initial transmission charges ("Initial Offer") during e-bidding stage shall be declared as the Successful Bidder, subject to verification of the original hard copies of Annexure 3, Annexure 4 (if applicable),



Annexure 6 (if applicable) and Annexure 14. The Letter of Intent shall be issued to such Successful Bidder in two (2) copies.

In case, there is a discrepancy between the online submission and physical documents, the bid would be out rightly rejected and the bidder shall be construed to have engaged in the fraudulent practice as defined in Clause 2.19.3 with consequences as mentioned in Clause 2.19.2. Further, in such a case, the provisions of Clause 2.5.6 (j) shall apply.

- 3.6.2. The Selected Bidder shall unconditionally accept the Lol, and record on one (1) copy of the Lol, "Accepted unconditionally", under the signature of the authorized signatory of the Successful Bidder and return such copy to the BPC within seven (7) days of issue of Lol.
- 3.6.3. If the Successful Bidder, to whom the Letter of Intent has been issued, does not fulfill any of the conditions specified in Clauses 2.15.2, 2.15.3 and Clause 2.15.4, then subject to Clause 2.15.5, the BPC reserves the right to annul the award of the Project and cancel the Letter of Intent. Further, in such a case, the provisions of Clause 2.5.6 (j) shall apply.
- 3.6.4. The BPC, in its own discretion, has the right to reject all Bids if the Quoted Transmission Charges are not aligned to the prevailing prices.

### 3.7. Misrepresentation by the Bidder

If the Bidder conceals any material information or makes a wrong statement or misrepresents facts or makes a misleading statement in the Technical Bid or Bid, as the case may be, in any manner whatsoever, in order to create circumstances for the acceptance of its Technical Bid/Bid, the BPC reserves the right to reject such Technical Bid/Bid, and/ or cancel the Letter of Intent, if issued. Further, in case Letter of Intent is cancelled, consequences as per provisions of the RFP shall follow.

### 3.8. Disposition of Technical Bid

- 3.8.1. Technical Bid found to be non-responsive as per Clause 3.2, due to any of the following conditions, shall be liable for rejection.
- Technical Bid that is incomplete.
  - Technical Bid not signed by authorized signatory and / or stamped in the manner indicated in this RFP.
  - All pages of the Technical Bid submitted but not initialed by the authorized signatories on behalf of the Bidder.
  - Technical Bid not including the covering letter as per Annexure 1.
  - Technical Bid contains material inconsistencies in the information and documents submitted by the Bidder, affecting the Qualification Requirements.
  - Information not submitted in formats specified in the RFP.
  - The Bidder has not submitted a disclosure as per Annexure 13.
  - Bidders delaying in submission of additional information or clarifications sought by the BPC.
- 3.8.2. Technical Bid found to be non-responsive as per Clause 3.2, due to any of the following conditions, shall be rejected.
- Technical Bid not received by the scheduled date and time.
  - Technical Bid submitted by a Bidding Consortium not including the Consortium Agreement.



- Bidder submitting or participating in more than one response either as a Bidding Company or as a Member of Bidding Consortium.
  - More than one Member of the Bidding Consortium or a Bidding Company using the credentials of the same Parent/Affiliate.
  - Technical Bid having Conflict of Interest.
  - If the Bidder makes any misrepresentation as specified in Clause 3.7.
- 3.9. BPC reserves the right to interpret the Bid in accordance with the provisions of this RFP document and make its own judgment regarding the interpretation of the same. In this regard, BPC shall have no liability towards any Bidder and no Bidder shall have any recourse to BPC with respect to the qualification process.

BPC shall evaluate Bid using the process specified in Clause 3.1 to 3.6, at its sole discretion. BPC's decision in this regard shall be final and binding.



# SECTION - 4

## ANNEXURES FOR BID



155

**SECTION – 4****I. Formats for Bid**

The following formats are required to be included in the Bidder's Technical and Financial Bid. These formats are designed to demonstrate the Bidder's compliance with the Qualification Requirements set forth in Clause 2.1 of Section – 2.

**Technical Bid**

1. Format for the Covering Letter
2. Format for Letter of Consent from Consortium Members
3. Format for evidence of authorized signatory's authority (Power of Attorney)
4. Format for Power of Attorney from to be provided by each of the other Members of the Consortium in favour of the Lead Member
5. Format for Bidder's composition and ownership structure and Format for Authorization
6. Format for Consortium Agreement
7. Formats for Qualification Requirement
8. Format of Bidders Undertaking and details of Equity Investment
9. Authorization from Parent/Affiliate of Bidding Company/Member of Bidding Consortium whose technical/financial capability has been used by the Bidding Company/Member of Bidding Consortium.
10. Undertaking from the Technically / Financially Evaluated Entity(ies) or from Ultimate Parent Company for equity investment
11. Format of Board Resolutions
12. Format for Illustration of Affiliates
13. Format for Disclosure
14. Format for Bid Bond
- 14A. Format for Bid Security Declaration
15. Format for Contract Performance Guarantee
16. Checklist for Technical Bid submission requirements
22. Format for Affidavit

In addition to the online submission, the Bidder with lowest Final Offer will be required to submit original hard copies of Annexure 3, Annexure 4 (if applicable), Annexure 6 (if applicable) and Annexure 14 before issuance of Lol.

**Financial Bid**

21. Format for Financial Bid

**II. The following formats are for the information to the Bidders to enable them to submit their Bid.**

- 11A. Illustration for Applicable Board Resolution Requirements Under Clause 2.5.2
17. List of Banks
18. GRID Map of the Project
19. Format for clarification/amendments on the RFP/RFP Project Documents
20. Formats for RFP Project Documents

Bidder may use additional sheets to submit the information for its detailed Bid.

**ANNEXURE 1 - COVERING LETTER**

**(The covering letter should be on the Letter Head of the Bidding Company/ Lead Member of the Consortium)**

Date: .....  
From: .....  
.....  
.....  
Tel. No.: .....  
Fax No.: .....  
E-mail address: .....

To,  
**PFC Consulting Limited**  
**9th Floor, Wing-A, Statesman House,**  
**Connaught Place, New Delhi - 110001**

Dear Sir,

**Sub: Bid for selection of Bidder as Transmission Service Provider to establish Inter-State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" through tariff based competitive bidding process.**

1. Being duly authorized to present and act on behalf of M/s ..... (insert name of Bidding Company / Bidding Consortium) (hereinafter called the "Bidder") and having read and examined in detail the Request for Proposal (RFP) document, the undersigned hereby submit our Technical Bid with duly signed formats and Financial Bid (Initial Offer) as stipulated in RFP document for your consideration.
2. It is confirmed that our Bid is consistent with all the requirements of submission as stated in the RFP document and subsequent clarifications/amendments as per Clause 2.3 and 2.4 of RFP.
3. The information submitted in our Bid is complete, is strictly as per the requirements stipulated in the RFP document and is correct to the best of our knowledge and understanding. We would be solely responsible for any errors or omissions in our Bid.
4. We hereby agree and undertake to procure the products associated with the Transmission System as per provisions of Public Procurement (Preference to Make in India) orders issued by Ministry of Power vide Order No. P-45021/2/2017-PP (BE-II)-Part (4) Vol.II dated 19.07.2024 for transmission sector, as amended from time to time read with Department for Promotion of Industry and Internal Trade (DPIIT) orders in this regard.

We hereby also agree and undertake to comply with Department of Expenditure, Ministry of Finance vide Order OM No. F.7/10/2021-PPD (1) dated 23.02.2023, as amended from time to time, regarding public procurement from a bidder of a country, which shares land border with India.

5. We hereby agree to comply with Ministry of Power order no. 25-11/6/2018 – PG dated 02.07.2020 as amended from time to time.

**PFC CONSULTING LIMITED**

54



157

6. We are herewith submitting legally binding board resolution for the total equity requirement of the Project.
7. We hereby confirm that in accordance with Clause 2.1.4 of the RFP, we are herewith submitting legally binding undertaking supported by a board resolution from the .....(Insert name of Technically Evaluated Entity and/or Financially Evaluated Entity or its Ultimate Parent Company, as the case may be) that all the equity investment obligations of ..... (Insert name of the Bidding Company) shall be deemed to be equity investment obligations of the ..... (Insert name of Technically Evaluated Entity and/or Financially Evaluated Entity or its Ultimate Parent Company, as the case may be) and in the event of any default by..... (Insert name of the Bidding Company), the same shall be met by ..... (Insert name of Technically Evaluated Entity and/or Financially Evaluated Entity or its Ultimate Parent Company, as the case may be).

**[Sl. No 7 to be inserted only in case the Bidder is a Bidding Company / Lead Member of a Consortium and has sought qualification on the basis of technical and financial capability of its Affiliate(s) and/or its Parent]**

8. We confirm that there are no litigations or disputes against us, which materially affect our ability to fulfill our obligations with regard to the Project.
9. We hereby confirm that we shall continue to maintain compliance with Qualification Requirements till the execution of the Transmission Service Agreement. Further, in case we emerge as Selected Bidder for the Project, we shall continue to maintain compliance with Qualification Requirements till the COD of the Project.
10. We confirm that we have studied the provisions of relevant Indian laws and regulations required to enable us to build, own, operate and transfer the said Project and to prepare this Bid.
11. We hereby confirm that we shall abide unreservedly with BPC's decision in the qualification process for selection of Qualified Bidder and further warrant that under no circumstances we shall challenge either the BPC's decision or its right to make such decision at any time in the future.
12. We confirm that the Bid shall remain valid for a period of one eighty (180) days from the Bid Deadline.
13. The details of contact person are furnished as under:  
Name: .....  
Designation: .....  
Name of the Company: .....  
Address of the Bidder: .....  
Phone Nos.: .....  
Fax Nos.: .....  
E-mail address: .....



**14. Bid Bond**

We have enclosed a Bid Bond of Rupees ..... Crores (Rs. ....) only or US\$ ..... (.....US Dollars), in the form of bank guarantee no ..... [Insert number of the Bank Guarantee] dated.....[Insert Date of the Bank Guarantee] as per your proforma (Annexure-14) from.....[Insert name of bank providing Bid Bond] and valid up to .....in terms of Clause 2.11 of the RFP.

**15. Acceptance**

We hereby unconditionally and irrevocably agree and accept that the decision made by the BPC on any matter regarding or arising out of the RFP shall be binding on us. We hereby expressly waive any and all claims in respect of Bid process.

**16. Familiarity With Relevant Indian Laws & Regulations**

We confirm that we have studied the provisions of relevant Indian laws and regulations as required to enable us to submit this Bid and execute the RFP Project Documents (other than TSA), in the event of our selection as the TSP. We further undertake and agree that all such factors as mentioned in Clause 2.5.7 of RFP have been fully examined and considered while submitting the Bid.

It is confirmed that our Bid is consistent with all the requirements of submission as stated in the RFP and subsequent communications from BPC.

The information submitted in our Bid is complete, strictly as per the requirements stipulated in the RFP and is correct to the best of our knowledge and understanding. We would be solely responsible for any errors or omissions in our Bid.

We confirm that we have not taken any deviation so as to be deemed non-responsive with respect to the provisions stipulated at Clause 2.5.1, of this RFP.

Thanking you,

Yours sincerely,

.....  
**(Name and Signature of the authorized signatory in whose name Power of Attorney/ Board Resolution as per Clause 2.5.2 is issued)**

Name: .....  
Designation: .....  
Address: .....

Date: .....  
Place: .....

**Company Rubber Stamp**

PFC CONSULTING LIMITED 56



159

**ANNEXURE 2 - LETTER OF CONSENT FROM CONSORTIUM MEMBERS**

**(On the letter head of each Member of the Consortium including Lead Member)**

Date: .....  
From: .....  
.....  
.....  
Tel. No.: .....  
Fax No.: .....  
E-mail address: .....

To,  
**PFC Consulting Limited**  
**9thFloor, Wing-A, Statesman House,**  
**Connaught Place, New Delhi - 110001**

Dear Sir,

**Sub: Bid for selection of Bidder as Transmission Service Provider to establish Inter-State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" through tariff based competitive bidding process.**

We, the undersigned Member of ..... (Insert name of the Bidding Consortium) have read, examined and understood the RFP document for the short-listing of Bidders as prospective TSP to establish Inter-State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" through tariff based competitive bidding process. We hereby confirm our concurrence with the Bid including in particular the Consortium Agreement submitted by ..... (Insert name of the Lead Member) in response to the RFP document.

We hereby confirm our commitment to participate in the said Bidding Consortium and invest ..... % of the total equity requirement for the Project as per the terms of the Consortium Agreement dated ..... and board resolution for such investment commitment is enclosed herewith.

We hereby confirm that in accordance with Clause 2.1.4 of the RFP, we are enclosing legally binding undertaking supported by a board resolution from the ..... (Insert name of Technically Evaluated Entity and / or Financially Evaluated Entity or its Ultimate Parent Company, as the case may be) that all the equity investment obligations of ..... (Insert name of the Member) shall be deemed to be equity investment obligations of the ..... (Insert name of Technically Evaluated Entity and / or Financially Evaluated Entity or its Ultimate Parent Company, as the case may be) and in the event of any default by..... (Insert name of the Member), the same shall be met by..... (Insert name of Technically Evaluated Entity and / or Financially Evaluated Entity or its Ultimate Parent Company, as the case may be). [Insert if applicable]

**[To be inserted by the Lead Member only]** We are also enclosing legally binding board resolution for the total equity requirement of the Project in case of any breach of any of the equity investment commitment by any of the Consortium Members, in line with the provisions of the Consortium Agreement dated ..... [Bidder to insert date of Consortium Agreement].

The details of contact person are furnished as under:

Name: .....  
Designation: .....



160

Name of the Company: .....  
Address: .....  
Phone Nos.: .....  
Fax Nos.: .....  
E-mail address: .....

Dated the ..... day of ..... of 20...

Thanking you,

Yours faithfully,

.....  
(Signature)

Name: .....  
Designation: .....

(Signature, Name, Designation of Authorized Signatory of Consortium Member and Company's Seal)



**ANNEXURE 3 - FORMAT FOR EVIDENCE OF AUTHORIZED SIGNATORY'S AUTHORITY (POWER OF ATTORNEY)**

**POWER OF ATTORNEY**

**(To be on non-judicial stamp paper of appropriate value as per Stamp Act relevant to place of execution. Foreign companies submitting bids are required to follow the applicable law in their country)**

Know all men by these presents, We .....(name and address of the registered office of the Bidder) do hereby constitute, appoint and authorize Mr./Ms. ....(name and residential address) who is presently employed with us and holding the position of ..... as our attorney, to do in our name and on our behalf, all such acts, deeds and things necessary in connection with or incidental to our Bid for selection of Bidder as Transmission Service Provider to establish Inter-State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" through tariff based competitive bidding process in the country of India, including signing and submission of all documents related to the Bid, including, undertakings, letters, certificates, acceptances, clarifications, guarantees, etc., making representations to the BPC, and providing information / responses to the BPC, representing us in all matters before the BPC, and generally dealing with the BPC in all matters in connection with our Bid for the said Project till the completion of the bidding process in accordance with the RFP and signing of the Share Purchase Agreement by all the parties thereto.

We hereby agree to ratify all acts, deeds and things lawfully done by our said attorney pursuant to this Power of Attorney and that all acts, deeds and things done by our aforesaid attorney shall and shall always be deemed to have been done by us.

All the terms used herein but not defined shall have the meaning ascribed to such terms under the RFP.

For ..... [Insert name of the Bidder on whose behalf PoA is executed]

.....  
**(Signature)**

Name: .....  
Designation: .....

**Accepted**

.....  
**(Signature of the Attorney)**

Name: .....  
Designation: .....  
Address: .....

.....  
**(Name, Designation and Address of the Attorney)**

Specimen signatures of attorney attested by the Executant

.....  
**(Signature of the Executant)**

162



.....  
**(Signature of Notary Public)**

Place: .....

Date: .....

**Notes:**

- 1) To be executed by Bidding Company or the Lead Member, in the case of a Bidding Consortium, as the case maybe.
- 2) The mode of execution of the Power of Attorney should be in accordance with the procedure, if any, laid down by the applicable law and the charter documents of the executant(s) and when it is so required, the same should be under common seal of the executant affixed in accordance with the applicable procedure. Further, the person whose signatures are to be provided on the power of attorney shall be duly authorized by the executant(s) in this regard.
- 3) Also, wherever required, the executant(s) should submit for verification the extract of the charter documents and documents such as a Board resolution / power of attorney, in favour of the Person executing this power of attorney for delegation of power hereunder on behalf of the executant(s).
- 4) In case of foreign Bidders, refer to clause 2.5.6 (p)

PFC CONSULTING LIMITED



163

**ANNEXURE 4 - FORMAT FOR POWER OF ATTORNEY TO BE PROVIDED BY EACH OF THE OTHER MEMBERS OF THE CONSORTIUM IN FAVOUR OF THE LEAD MEMBER**

**POWER OF ATTORNEY**

(To be on non-judicial stamp paper of appropriate value as per Stamp Act relevant to place of execution. Foreign companies submitting bids are required to follow the applicable law in their country)

KNOW ALL MEN BY THESE PRESENTS THAT M/s....., having its registered office at ....., and M/s ..... having its registered office at ....., (Insert names and registered offices of all Members of the Consortium), the Members of Consortium, have formed a Bidding Consortium named ..... (insert name of the Consortium) (hereinafter called the "Consortium") vide Consortium Agreement dated..... and having agreed to appoint M/s..... as the Lead Member of the said Consortium do hereby constitute, nominate and appoint M/s..... a company incorporated under the laws of ..... and having its Registered / Head Office at ..... as our duly constituted lawful Attorney (hereinafter called as "Lead Member") which is one of the Members of the Consortium, to act as the Lead Member and our true and lawful attorney, to do in our name and on our behalf, all such acts, deeds and things necessary in connection with or incidental to submission of Consortium's Bid for the Project, including signing and submission of the Bid and all documents related to the Bid, including, undertakings, letters, certificates, acceptances, clarifications, guarantees, etc, making representations to the BPC, and providing information / responses to the BPC, representing us and the Consortium in all matters before the BPC, and generally dealing with the BPC in all matters in connection with our Bid for the said Project, till completion of the bidding process in accordance with the RFP and signing of the Share Purchase Agreement by all the parties thereto.

It is expressly understood that in the event of the Consortium being selected as Successful Bidder, this Power of Attorney shall remain valid, binding and irrevocable until the Bidding Consortium achieves execution of all RFP Project Documents.

We, as the Member of the Consortium, agree and undertake to ratify and confirm all whatsoever the said Attorney/Lead Member has done on behalf of the Consortium Members pursuant to this Power of Attorney and the same shall bind us and deemed to have been done by us.

All the terms used herein but not defined shall have the meaning ascribed to such terms under the RFP.

IN WITNESS WHEREOF M/s ..... as the Member of the Consortium have executed these presents on this..... day of .....

For and on behalf of  
Consortium Member

.....  
(Signature of the Authorized Signatory)

Name: .....  
Designation: .....  
Place: .....  
Date: .....

Name: .....  
Designation: .....

PFC CONSULTING LIMITED

164



Place: .....

Date: .....

**Accepted**

Specimen signatures of attorney attested

.....  
(Signature)

(Signature of Notary Public)

.....  
.....  
.....  
(Name, Designation and Address  
of the Attorney)

Place: .....

Date: .....

**Notes:**

1. The mode of execution of the power of attorney should be in accordance with the procedure, if any, laid down by the applicable law and the charter documents of the executant(s) and when it is so required, the same should be under common seal of the executant affixed in accordance with the applicable procedure. Further, the person whose signatures are to be provided on the power of attorney shall be duly authorized by the executant(s) in this regard.
2. Also, wherever required, the executant(s) should submit for verification the extract of the charter documents and documents such as a Board resolution / power of attorney, in favour of the Person executing this power of attorney for delegation of power hereunder on behalf of the executant(s).
3. In case of foreign Bidders, refer to clause 2.5.6 (p)



**ANNEXURE 5 - FORMAT FOR BIDDER'S COMPOSITION AND OWNERSHIP STRUCTURE**

1. **Corporate Details:**  
Please provide the following information for the Bidder. If the Bidder is a Consortium, please provide this information for each Member including the Lead Member:

**a. Company's Name, Address, and Nationality:**

Name: .....

Address: .....

.....

.....

Website Address: .....

Country of Origin: .....

**b. Year Organized:** .....**c. Company's Business Activities:** .....

.....

**d. Status as a Bidder:**

- i. Bidding Company
- ii. Lead Member of the Bidding Consortium
- iii. Member of the Bidding Consortium

**Note: tick the applicable serial number****e. Company's Local Address in India (if applicable):**

.....

.....

.....

**f. Name of the Authorized Signatory:** .....**g. Telephone Number:** .....**h. Email Address:** .....**i. Telefax Number:** .....**j. Please provide the following documents:**

- i. Copy of the Memorandum and Articles of Association and certificate of incorporation or other equivalent organizational document (as applicable), including their amendments, certified by the Company Secretary as **Attachment 1** for Bidding Company / each Member of Bidding Consortium including Lead Member.
- ii. Authority letter (as per format for authorization given below) in favour of BPC from the Bidder/every Member of the Consortium authorizing BPC to seek reference



from their respective bankers & others as Attachment 2 as per Clause 2.1.6 of the RFP.

**2. Details of Ownership Structure:**

Equity holding of Bidding Company/ each Member of Bidding Consortium including Lead Member owning 10% or more of total paid up equity.

Name of the Bidding Company / Consortium Member: .....

Status of equity holding as on .....

Name of the Equity Holder	Type and No. of Shares owned	Extent of Voting Control (%)
1. ....		
2. ....		
3. ....		
4. ....		
5. ....		
6. ....		
7. ....		
8. ....		
....		

**Notes:**

1. The above table is to be filled in separately for each Consortium Member.
2. Status of equity holding should be provided not earlier than thirty (30) days prior to Bid Deadline.

**For and on behalf of Bidding Company / Lead Member of the Bidding Consortium**

M/s.....

.....  
(Signature of authorized representative)

Name: .....

Designation: .....

.....  
(Stamp)

Date: .....

Place: .....



167

**FORMAT FOR AUTHORISATION**

**(In case of Bidding Consortium, to be given separately by each Member)**  
**(On Non – judicial stamp paper duly attested by notary public. Foreign companies submitting bids are required to follow the applicable law in their country)**

The undersigned hereby authorize(s) and request(s) all our Bankers, including its subsidiaries and branches, any person, firm, corporation or authority to furnish pertinent information deemed necessary and requested by **PFC Consulting Limited** to verify our Bid for selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for **“Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I”** through tariff based competitive bidding process or regarding our project development experience, financial standing and general reputation.

**For and on behalf of M/s..... (Insert Name of Bidding Company or Member of the Consortium)**

.....  
**(Signature)**

Name of Authorized Signatory: .....

**(Signature and Name of the authorized signatory of the Company)**

Place: .....

Date: .....

.....  
**(Company rubber stamp/seal)**

.....  
**(Signature of Notary Public)**

Place: .....

Date: .....

**PFC CONSULTING LIMITED**



168

**ANNEXURE 6 - FORMAT FOR CONSORTIUM AGREEMENT**

(To be on non-judicial stamp paper of appropriate value as per Stamp Act relevant to place of execution. Foreign companies submitting bids are required to follow the applicable law in their country)

**THIS CONSORTIUM AGREEMENT** executed on this..... day of .....Two thousand.....between M/s....., a company incorporated under the laws of ..... and having its Registered Office at ..... (hereinafter called the "Party 1", which expression shall include its successors, executors and permitted assigns) and M/s.....a Company incorporated under the laws of ..... and having its Registered Office at ..... (hereinafter called the "Party n", which expression shall include its successors, executors and permitted assigns) and for the purpose of submitting the Bid, acquisition of **RAGHANESDA RE TRANSMISSION LIMITED** (in case of award) and entering into other Agreement(s) as specified in the RFP (hereinafter referred to as "Agreements") as may be entered into with the Nodal Agency.

**WHEREAS**, the BPC had invited Bid in response to RFP issued to ..... (insert the name of purchaser of RFP) for selection of the bidder as the Transmission Service Provider to establish Inter-State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I".

**AND WHEREAS**, Clause 2.2.4 of the RFP document stipulates that the Bidders qualifying on the strength of a Bidding Consortium will have to submit a legally enforceable Consortium Agreement in a format specified in the RFP document wherein the Consortium Members have to commit equity of a specific percentage in the Project.

**AND WHEREAS**, Clause 2.2.4 of the RFP document also stipulates that the Bidding Consortium shall provide along with the Bid, a Consortium Agreement as per prescribed format whereby the Consortium Members undertake to be liable for raising the required funds for its respective equity investment commitment as specified in Consortium Agreement.

**NOW THEREFORE, THIS INDENTURE WITNESSTH AS UNDER:**

In consideration of the above premises and agreement all the parties in this Consortium do hereby mutually agree as follows:

1. In consideration of the selection of the Consortium as the selected bidder by the BPC, we the Members of the Consortium and parties to the Consortium Agreement do hereby unequivocally agree that M/s..... (Insert name of the Lead Member), shall act as the Lead Member as defined in the RFP for self and agent for and on behalf of ....., ....., ..... (the names of all the other Members of the Consortium to be filled in here).
2. The Lead Member is hereby authorized by the Members of Consortium and parties to the Consortium Agreement to bind the Consortium and receive instructions for and on behalf of the Members.
3. Notwithstanding anything contrary contained in this Consortium Agreement, the Lead Member shall always be liable for the equity investment obligations of all the Consortium Members, i.e., for both its own equity contribution as well as the equity contribution of other Members.

PFC CONSULTING LIMITED



169

4. The Lead Member shall be liable and responsible for ensuring the individual and collective commitment of each of the Members of the Consortium in discharging all their respective equity obligations. Each Consortium Member further undertakes to be individually liable for the performance of its part of the obligations without in any way limiting the scope of collective liability envisaged in this agreement.
5. Subject to the terms of this agreement, the share of each Member of the Consortium in the "issued equity share capital of the project company" shall be in the following proportion: (if applicable)

Name	Percentage of equity holding in the Project
Party 1	.....
.....	.....
Party n	.....
<b>Total</b>	<b>100%</b>

[Note: The percentage equity holding for any Consortium Member in the Project cannot be zero in the above table]

6. The Lead Member shall inter alia undertake full responsibility for liaising with lenders and mobilizing debt resources for the Project and achieving financial closure.
7. In case of any breach of any of the equity investment commitment by any of the Consortium Members, the Lead Member shall be liable for the consequences thereof.
8. Except as specified in the Agreement, it is agreed that sharing of responsibilities as aforesaid and equity investment obligations thereto shall not in any way be a limitation of responsibility of the Lead Member under these presents.
9. It is further specifically agreed that the financial liability for equity contribution of Lead Member shall, not be limited in any way so as to restrict or limit its liabilities. The Lead Member shall be liable irrespective of their scope of work or financial commitments.
10. It is expressly understood and agreed between the Members that the responsibilities and obligations of each of the Members shall be as delineated as annexed hereto as **Appendix-I**, forming integral part of this Agreement. It is further agreed by the Members that the above sharing of responsibilities and obligations shall not in any way be a limitation of joint and several responsibilities and liabilities of the Members, with regards to all matters relating to the Project.
11. It is clearly agreed that the Lead Member shall ensure performance under the Agreements and if one or more Consortium Members fail to perform its /their respective obligations under the Agreement(s), the same shall be deemed to be a default by all the Consortium Members.
12. This Consortium Agreement shall be construed and interpreted in accordance with the Laws of India and courts at Delhi alone shall have the exclusive jurisdiction in all matters relating thereto and arising there under.
13. It is hereby agreed that, the Lead Member shall furnish the bid bond, as stipulated in the RFP, on behalf of the Consortium Members.
14. It is hereby agreed that in case of selection of Bidding Consortium as the selected bidder, the parties to this Consortium Agreement do hereby agree that they shall furnish the contract



performance guarantee on behalf of the TSP in favour of the Nodal Agency, as stipulated in the RFP and Transmission Service Agreement.

- 15. It is further expressly agreed that the Consortium Agreement shall be irrevocable and shall form an integral part of the RFP Project Document and shall remain valid till the execution of the Share Purchase Agreement, unless expressly agreed to the contrary by the Nodal Agency. Over the term of the Transmission Service Agreement, Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations as amended from time to time shall apply on the Consortium Members.
- 16. The Lead Member is authorized and shall be fully responsible for the accuracy and veracity of the representations and information submitted by the Consortium Members respectively from time to time in response to the RFP and for the purposes of the Project.
- 17. It is hereby expressly agreed between the parties to this Consortium Agreement that neither party shall assign or delegate its rights, duties or obligations under this Agreement except with the prior written consent of the Nodal Agency.

**THIS CONSORTIUM AGREEMENT:**

- a. has been duly executed and delivered on behalf of each party hereto and constitutes the legal, valid, binding and enforceable obligation of each such party,
- b. sets forth the entire understanding of the parties hereto with respect to the subject matter hereof;
- c. may not be amended or modified except in writing signed by each of the parties and with prior written consent of the Nodal Agency.

**IN WITNESS WHEREOF**, the parties to the Consortium Agreement have, through their authorized representatives, executed these present on the Day, Month and Year first mentioned above.

For and on behalf of Consortium Member 1 (Party 1)  
M/s.....

.....  
(Signature of authorized signatory)

Name: .....  
Designation: .....  
Place: .....  
Date: .....

For and on behalf of Consortium Member n (Party n)  
M/s.....

.....  
(Signature of authorized signatory)



171

Name: .....  
Designation: .....  
Place: .....  
Date: .....

**Attested:**

.....  
(Signature)  
(Notary Public)

Place: .....  
Date: .....

Note: In case of foreign Bidders, refer to clause 2.5.6 (p)



**Appendix 1 to the Consortium Agreement:**

Name of the Consortium Member	Responsibilities under the Consortium Agreement
M/s ..... (Party 1)	
M/s .....	
M/s ..... (Party n)	



**ANNEXURE 7A - FORMAT FOR QUALIFICATION REQUIREMENT****A. NET WORTH**

To,  
**PFC Consulting Limited**  
 9<sup>th</sup> Floor, Wing-A, Statesman House,  
 Connaught Place, New Delhi - 110001

Dear Sir,

**Sub: Bid for selection of Bidder as Transmission Service Provider to establish Inter-State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" through tariff based competitive bidding process**

**1. [Note: Applicable in case of Bidding Company]**

We certify that the Financially Evaluated Entity (ies) had a Networth of Rs. .... Crore or equivalent USD\* computed as per instructions in this RFP based on unconsolidated audited annual accounts (refer Note-2 below) of any of the last three (3) financial years as provided in Clause 2.2.3, immediately preceding the Bid Deadline. Also, the Networth of any of the last three (3) financial years is not negative.

Name of Financially Evaluated Entity(ies)	Relationship with Bidding Company**	Financial Year	Networth (Rs. Crore)
1. ....			
2. ....			
3. ....			
....			
<b>Total Net worth</b>			

\*Equivalent USD shall be calculated as per provisions of Clause 3.4.1.

\*\* The column for "Relationship with Bidding Company" is to be filled in only in case financial capability of Parent/Affiliate has been used for meeting Qualification Requirements.

**2. [Note: Applicable in case of Bidding Consortium]**

We certify that the Financially Evaluated Entity (ies) had a minimum Networth of Rs. .... Crore or equivalent USD\* computed as per instructions in the RFP and based on unconsolidated audited annual accounts (refer Note-2 below) of any of the last three (3) financial years as provided in Clause 2.2.3, immediately preceding the Bid Deadline. Also, the Networth of any of the last three (3) financial years is not negative.



Name of Consortium Member	Equity Commitment in the Project (%)	Networth of Member (Rs. Crore)	Network Requirement to be met by Member in proportion to the Equity Commitment (Rs. Crore)	Whether the Member meets the Network Requirement
(1)	(2)	(3) (As per table below)	(4) = (2 x Total Network requirement for the Project)	(5)
1. ....				Yes / No
2. ....				Yes / No
..				Yes / No
<b>Total Network for financial requirement</b>				

**Member – I (Lead Member)**

[Note: Similar particulars for each Member of the Consortium is to be furnished, duly certified by the Member's Statutory Auditors]

- i. Name of Member: .....
- ii. Total Network requirement: Rs ..... Crore
- iii. Percentage of equity commitment for the Project by the Member: .....%
- iv. Network requirement for the Member\*\*\*: Rs ..... Crore
- v. Financial year considered for the Member: .....

Name of Financially Evaluated Entity(ies)	Relationship** with Member of Consortium	Financial Year	Networth (Rs. Crore)
1. ....			
2. ....			
3. ....			
<b>Total Net worth</b>			

- \* Equivalent USD shall be calculated as per provisions of Clause 3.4.1;
- \*\* The column for "Relationship with Member of Consortium" is to be filled in only in case the financial capability of Parent / Affiliate has been used for meeting Qualification Requirements;
- \*\*\* Network requirement to be met by Member should be in proportion to the equity commitment of the Member for the Project.



Yours faithfully

.....  
(Signature and name of the authorized signatory of the Company and Stamp)

Name : .....  
Date : .....  
Place : .....

.....  
(Signature and Stamp of statutory Auditors of Bidding Company / each Member of Consortium)

Name : .....  
Date : .....  
Place : .....  
  
Date : .....

**Notes:**

1. Along with the above format, in a separate sheet, please provide details of computation of Networth of last three (3) financial years duly certified by Statutory Auditor.
2. Audited consolidated annual accounts of the Bidder may be used for the purpose of financial criteria provided the Bidder has at least 26% equity in each company whose accounts are merged in the audited consolidated accounts and provided further that the financial capability of such companies (of which accounts are being merged in the consolidated accounts) shall not be considered again for the purpose of evaluation of the Bid.
3. In case Bidder or a Member of Consortium takes recourse to its Parent/Affiliate for meeting technical / financial requirements, then the financial years considered for such purpose should be same for the Bidder / Member of Consortium and their respective Parent / Affiliate.



**ANNEXURE 7B - FORMAT FOR TECHNICAL REQUIREMENT**

To,  
**PFC Consulting Limited**  
 9<sup>th</sup> Floor, Wing-A, Statesman House,  
 Connaught Place, New Delhi - 110001

Dear Sir,

**Sub: Bid for selection of Bidder as Transmission Service Provider to establish Inter-State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" through tariff based competitive bidding process**

**1. To be used by Bidder using the development experience in infrastructure sector**

We certify that M/s. .... (Insert name of Technically Evaluated Entity (ies)) have experience of development of projects in the infrastructure sector in the last five (5) years whose aggregate capital expenditure is Rs. .... Crore or equivalent USD\*. We further certify that the capital expenditure of any single project considered for meeting the technical Qualification Requirement is not less than **Rs.230 Crore (Rupees Two Hundred Thirty Crore Only)** or equivalent USD\*. For this purpose, capital expenditure incurred on projects which have been either wholly completed / commissioned or partly completed projects put under commercial operation and for which operation has commenced till at least seven (7) days prior to the Bid Deadline has been considered.

The project(s) considered for the purpose of technical experience (as per table given below) have been executed and owned to the extent as indicated in the table below (to be at least twenty – six percent (26%)) by the Bidding Company / Lead Member of the Consortium / our Parent / our Affiliate(s) [strike off whichever is not applicable] on operation of the projects.

This technical requirement has been calculated as per the instructions provided in the RFP on the basis of following projects:

Name of Company (which has executed the project at (3)) whose technical capability has been used for Qualification Requirement	Relationship** with Bidding Company / Lead Member	Project name	Nature of Project (BOOT, BOT, BOOM, DBFOT etc.)	Relevant Infrastructure sector	Date of Financial Closure of the Project (in DD / MM / YYYY)	Date of Completion / Commissioning / Commercial Operation of partly completed projects	Project cost (Rs. Crore)	Percentage Equity Holding of Company at (1) in Completed project(s)
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
.....		..... (Project 1)						
.....		.....						
<b>Total (Rs. Crore)</b>								

\* Equivalent USD shall be calculated as per provisions of Clause \_\_\_\_

**PFC CONSULTING LIMITED**



177

\*\* The column for "Relationship with Bidding Company / Lead Member" is to be filled in only in case technical capability of Parent/Affiliate has been used for meeting Qualification Requirements.

We further certify that the Company(ies) as indicated in column (1) of the above table, whose technical capability has / have been used for meeting the qualification requirement, has / have held shareholding respectively of at least twenty – six percent (26%) from the date of financial closure till the date of commissioning / completion of the above project(s).

**2. To be used by Bidder using construction experience in infrastructure sector.**

We certify that M/s. .... (Insert name of Technically Evaluated Entity(ies)) have received aggregate payments not less than Rs. .... Crore or equivalent USD (calculated as per provisions in Clause 3.4.1) from its client(s) for construction works fully completed during the last 5(five) financial years. We further certify that the payment received from each project shall not be less than Rs. .... Crore or equivalent USD (calculated as per provisions in Clause 3.4.1). For this purpose, payments received on projects that have been commissioned/completed at least seven (7) days prior to the Bid Deadline shall be considered. Further only the payments (gross) actually received, during such 5 (five) financial years shall qualify for purposes of computing the technical capacity.

We also confirm that construction works does not include cost of land supply of goods or equipment except when such goods or equipment form part of a turn-key construction contract/ EPC contract for the project.

This technical requirement has been calculated as per the instructions provided in the RFP on the basis of following projects:

Name of Company (which has executed the project at (3)) whose technical capability has been used for Qualification Requirement	Relationship ** with Bidding Company / Lead Member	Project name	Nature of Project (EPC, Turnkey etc)	Relevant Infrastructure sector	Date of award of contract (in dd/mm/yy)	Date of Completion / Commissioning	Payment received (Rs. Crore)
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)
.....		..... Project 1					
.....		.....					
.....		.....					
Total (Rs. Crore)							

PFC CONSULTING LIMITED

178



Yours faithfully

.....  
**(Signature and name of the authorized signatory of the Company and stamp)**

Name: .....  
 Date: .....  
 Place: .....

.....  
**(Signature and Stamp of statutory Auditors of Bidding Company/ Lead Member of Consortium)**

Name: .....  
 Date: .....  
 Place: .....

Date: .....

**Notes:**

1. Along with the above format, in a separate sheet, please provide details of computation of capital expenditure of projects duly certified by Statutory Auditor of the project company. In addition, the Statutory Auditor of the project company should also certify that the capital expenditure of projects commissioned or completed 7 days prior to Bid Deadline has been capitalized in the books of accounts.

Additionally, in case construction experience is used, a certificate(s) from the statutory auditors stating the payments received and the concerned client(s) stating the works commissioned during the past 5 years in respect of the projects specified above. In case a particular job/ contract has been jointly executed by the Bidder (as part of a consortium), it should further support its claim for the share in work done for that particular job/ contract by producing a certificate from its statutory auditor or the client.

2. In case the accounts for the financial year in which the project claimed for meeting qualification requirement has been commissioned are not audited, the Bidder shall give declaration in this regard duly certified by its statutory auditor. In such a case, Bidder shall provide details of computation of capital expenditure of such project(s) duly certified by Statutory Auditor of the project company and the Statutory Auditor of the project company should also certify that the capital expenditure of projects commissioned or completed shall be capitalized in the books of accounts upon finalization.
3. The unconsolidated audited annual accounts of both the TEE and the Bidding Company / Lead Member for the respective financial years (financial years in which financial closure was achieved to the financial year in which the said project was completed / commissioned) should be submitted.

179



**ANNEXURE 7C - FORMAT FOR TECHNICAL & FINANCIAL REQUIREMENT – RELATIONSHIP & DETAILS  
OF EQUITY SHAREHOLDING**

**[To be filled by Bidding Company / each Member of the Bidding Consortium including Lead Member if credentials of Parent and / or Affiliates have been used by them]**

To  
PFC Consulting Limited  
9<sup>th</sup> Floor, Wing-A, Statesman House,  
Connaught Place, New Delhi - 110001

Dear Sir,

**Sub: Bid for selection of Bidder as Transmission Service Provider to establish Inter-State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" through tariff based competitive bidding process**

We certify that M/s. .... (insert name of the **Bidding Company / Consortium Members**) have considered the technical and financial capability of its Parent and / or Affiliates, for the purpose of meeting Qualification Requirements as per the instructions provided in the RFP. The name of Parent and / or Affiliate, nature of relationship(s) with such Parent and / or Affiliate and details of equity holding are as follows:

Name of Company whose credentials considered	Type of credentials considered (technical and / or financial)	Relationship with Bidding Company / Consortium Member (Parent / Affiliate)	Details of equity shareholding (refer notes below)
Company 1			
.....			
.....			
.....			
.....			

**NOTES:**

- i. In case of Parent, the equity holding of the Parent in the Bidding Company / Member of the Bidding Consortium, including the Lead Member of the Consortium, need to be specified.
- ii. In case of Affiliate under direct control of Bidder, the equity holding of the Bidding Company / Member of the Bidding Consortium, including the Lead Member of the Consortium in the Affiliate, needs to be specified.
- iii. In case of Affiliate under common control of Parent, the equity holding of the Parent in the Affiliate of the Bidding Company / Member of the Bidding Consortium, including the Lead Member of the Consortium, needs to be specified.
- iv. Relationship of Parent / Affiliate with Bidding Company / Member of Consortium to be at the most seven (7) days prior to the Bid Deadline (as per Clause 2.1.4 of RFP)

Yours faithfully

PFC CONSULTING LIMITED

180



.....  
**(Signature and name of the authorized signatory of the Company and stamp)**

Name: .....

Date: .....

Place: .....

.....  
**(Signature and Stamp of statutory Auditors of Bidding Company / each Member of Bidding Consortium)**

Name: .....

Date: .....

Place: .....

Date: .....

PFC CONSULTING LIMITED



181

**ANNEXURE 7D - ADDITIONAL INFORMATION FOR VERIFICATION OF FINANCIAL AND TECHNICAL CAPABILITIES OF BIDDERS.**

.....  
**(Name of Bidder (Bidding Company/ Bidding Consortium or Technically/Financially Evaluated Entity (ies))**

**(Note: In case of Consortium, details to be filled in by Lead Member for each Member of the Consortium including the Lead Member and in case of the qualification requirements of Technically / Financially Evaluated Entity (ies) being used, to be filled by each of such entity (ies)**

**i. Financial capability (Attachment 1):**

1. Bidders shall attach unconsolidated / consolidated audited annual accounts, statements, as the case may be, (refer Clause 2.1.3) for the last three (3) financial years as Attachment 1. Such unconsolidated audited annual accounts shall include a Balance Sheet, Profit and Loss Account, Auditors Report and profit appropriation account.

**ii. Technical capability (Attachment 2):**

- a. This attachment shall include details of projects completed/commissioned or partly completed projects for which commercial operation has commenced to be considered for the purpose of meeting Qualification Requirements.

1. To be used by Bidder using development experience in infrastructure sector

Particulars	Year 1	Year 2	Year 3	Year 4	Year 5
Name(s) of project(s) from Infrastructure sectors					
Location(s) including country(s) where project was set up					
Nature of Project					
Voltage level (if any)					
Capital cost of project(s) Rs. in Crore					
*Status of the project					
% of equity owned in the project(s)					

**\*Note 1:** Date of completion/commissioning/commercial operation to be mentioned

**Note 2:** For each project listed in the table, the Bidder shall furnish an executive summary including the following information:

- Project model, i.e., BOO, BOOT, BOOM;
- Debt financing and equity raised and provided by Bidder/Bidder's Parent/Bidder's Affiliate for the project, including names of lenders and investors;
- Size and type of installation;
- Technical data/information on major equipment installed

PFC CONSULTING LIMITED



1/22

- Description of role performed by the Bidder/Bidder's Parent/Bidder's Affiliate on the project
- Clearances taken by the Bidder/Bidder's Parent/Bidder's Affiliate including but limited to right-of-way (RoW), forest clearance and other statutory / Govt. clearances.
- Cost data (breakdown of major components)
- Name of EPC and/or other major contractor
- Construction time for the project
- Names, addresses and contact numbers of owners of the projects
- Operating reliability over the past five (5) years or since date of commercial operation
- Operating environmental compliance history
- Names of supervisory entities or consultant, if any
- Date of commercial operation
- Total duration of operation

2. To be used by Bidder using construction experience in infrastructure sector

Particulars	Year 1	Year 2	Year 3	Year 4	Year 5
Name(s) of project(s) from Infrastructure sectors					
Location(s) including country(s) where project was set up					
Nature of Project					
Voltage level (if any)					
Revenue received Rs. in Crore					
*Status of the project					
% of equity owned in the project(s)					

**\*Note 1:** Date of completion/commissioning/commercial operation to be mentioned

**Note 2:** For each project listed in the table, the Bidder shall furnish an executive summary including the following information:

- Project model, i.e., EPC, Turnkey;
- Size and type of installation;
- Technical data/information on major equipment installed
- Description of role performed by the Bidder/Bidder's Parent/Bidder's Affiliate on the project
- Cost data (breakdown of major components)
- Name of sub-contractor
- Construction time for the project
- Names, addresses and contact numbers of owners of the projects
- Operating reliability over the past five (5) years or since date of commercial operation
- Operating environmental compliance history
- Names of supervisory entities or consultant, if any
- Date of commercial operation
- Total duration of operation

iii. Attachment-3:

- a. For each project listed in Attachment 2 above, certificates of final acceptance and/or certificates of good operating performance duly issued by owners for the project and the same shall be certified as true by authorized signatory of the Bidding Company or the Lead



Member of Consortium). In case the project listed in Attachment 2 is under BOOT / DBFOT mechanism, the certificates of final acceptance and/or certificates of good operating performance must be issued by the authority / independent engineer of the project as defined in the respective project agreement.

For and on behalf of Bidding Company/Consortium

M/s.....

.....  
(Signature of authorized signatory)

Name: .....

Designation: .....

Date: .....

Place: .....

184



**ANNEXURE 8 -UNDERTAKING AND DETAILS OF EQUITY INVESTMENT**

**Format 1: Bidders' Undertakings**

**[On the Letter Head of the Bidding Company/Lead Member of Bidding Consortium]**

**Date:** .....

**To,**

**PFC Consulting Limited  
9thFloor, Wing-A, Statesman House,  
Connaught Place, New Delhi - 110001**

Dear Sir,

**Sub: Bidders' Undertakings in respect of Bid for selection of Bidder as TSP to establish Inter-State transmission system for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I"**

We hereby undertake on our own behalf and on behalf of the TSP, that if selected as the Successful Bidder for the Project:

1. The Project shall comply with all the relevant electricity laws, codes, regulations, standards and Prudent Utility Practices, environment laws and relevant technical, operational and safety standards, and we shall execute any agreements that may be required to be executed as per law in this regard.
2. We confirm that the Project shall also comply with the standards and codes as per Clause 1.6.1.2 of the RFP and the TSP shall comply with the provisions contained in the Central Electricity Regulatory Commission Grant of Connectivity, Long-term Access and Medium-term Open Access in inter-state Transmission and related matters Open Access) Regulations, 2009.
3. We give our unconditional acceptance to the RFP dated **September 14, 2024** issued by the BPC and the RFP Project Documents, as amended, and undertake to ensure that the TSP shall execute all the RFP Project Documents, as per the provisions of this RFP.
4. We have submitted the Bid on the terms and conditions contained in the RFP and the RFP Project Documents. Further, the Financial Bid submitted by us is strictly as per the format provided in Annexure 21 of the RFP, without mentioning any deviations, conditions, assumptions or notes in the said Annexure.
5. Our Bid is valid up to the period required under Clause 2.8 of the RFP.
6. Our Bid has been duly signed by authorized signatory and stamped in the manner and to the extent indicated in this RFP and the power of attorney / Board resolution in requisite format as per RFP has been enclosed with this undertaking.
7. We have assumed that if we are selected as the Successful Bidder, the provisions of the Consortium Agreement, to the extent and only in relation to equity lock in and our liability thereof shall get modified to give effect to the provisions of Clause 2.5.8 of this RFP and Article

PFC CONSULTING LIMITED

82



185

18.1 of the Transmission Service Agreement. **(Note: This is applicable only in case of a Bidding Consortium).**

8. We confirm that our Bid meets the Scheduled COD of each transmission Element and the Project as specified below:

Sl. No.	Name of the Transmission Element	Scheduled COD	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre-required for declaring the commercial operation (COD) of the respective Element
1.	Establishment 4x1500 MVA, 765/400 kV Substation near Raghanesda (GIS) with 2x330 MVar, 765 kV bus reactor and 2x125 MVar, 420 kV bus reactor	27 months from effective date	52.69%	All Elements are required to be commissioned simultaneously as their utilization is dependent on commissioning of each other.
2.	Raghanesda (GIS) – Banaskantha (PG) 765 kV D/C line		36.50%	
3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s		2.80%	
4.	Creation of 220 kV switchyard (Bus Sec-I) at Raghanesda PS (GIS) along with installation of 2x500 MVA, 400/220 kV ICTs	30.09.2027*	7.28%	Elements at Sl. No. 1, 2 and 3 are pre-required for declaring the commercial operation (COD)
5.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Azure Power Sixty-Three Pvt. Ltd. (2200001107) (300 MW)	30.09.2027*	0.36%	
6.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Sunsure Solarpark RJ One Pvt. Ltd. (2200001018) (350 MW)	31.03.2028	0.37%	Element at Sl. No. 6 can be commissioned separately subject to commissioning of elements at sl. No. 1 to 4.

\*Subject to minimum schedule of 27 months from effective date.

We agree that the payment of Transmission Charges for any Element irrespective of its successful commissioning on or before its Scheduled COD shall only be considered after the successful commissioning of Element(s) which are pre - required for declaring the commercial operation of such Element as mentioned in the above table.

PFC CONSULTING LIMITED



186

9. We confirm that our Financial Bid conforms to all the conditions mentioned in this RFP, and in particular, we confirm that:
  - a. Financial Bid in the prescribed format of Annexure 21 has been submitted duly signed by the authorized signatory.
  - b. Financial Bid is unconditional.
  - c. Only one Financial Bid has been submitted.
10. We have neither made any statement nor provided any information in this Bid, which to the best of our knowledge is materially inaccurate or misleading. Further, all the confirmations, declarations and representations made in our Bid are true and accurate. In case this is found to be incorrect after our acquisition of RAGHANESDA RE TRANSMISSION LIMITED, pursuant to our selection as Selected Bidder, we agree that the same would be treated as a TSP's Event of Default under Transmission Service Agreement, and relevant provisions of Transmission Service Agreement shall apply.
11. We confirm that there are no litigations or other disputes against us which materially affect our ability to fulfill our obligations with regard to the Project as per the terms of RFP Project Documents.
12. Power of attorney/ Board resolution as per Clause 2.5.2 is enclosed.

**Signature and name of the authorized signatory of the Company and stamp of Bidding Company or Lead member of Consortium**

**Note:**

1. In case of foreign Bidders, refer to clause 2.5.6 (p)

PFC CONSULTING LIMITED



187

**Format 2: Details of equity investment in Project**

- 1.1.a Name of the Bidding Company/ Bidding Consortium:
- 1.1.b Name of the Lead Member in the case of a Bidding Consortium:
- 1.2 Investment details of the Bidding Company/Member of the Bidding Consortium investing in **RAGHANESDA RE TRANSMISSION LIMITED** as per Clause 2.5.8.2.

S. No.	Name of the Bidding Company/ Member in case of a Bidding Consortium	Name of the Company investing in the equity of the ____ [Name of SPV]	Relationship with Bidding Company /Member of the Bidding Consortium	% of equity participation in the ____ [Name of SPV]
(1)	(2)	(3)	(4)	(5)
TOTAL				100%

\* In case the Bidder proposes to invest through its Affiliate(s) / Parent Company / Ultimate Parent Company, the Bidder shall declare shareholding pattern of such Affiliate(s) / Parent Company / Ultimate Parent Company and provide documentary evidence to demonstrate relationship between the Bidder and the Affiliate(s) / Parent Company / Ultimate Parent Company. These documentary evidences could be, but not limited to, demat account statement(s) / Registrar of Companies' (ROC) certification / share registry book, etc duly certified by Company Secretary.

Members of the Consortium or the Bidding Company making investment in the equity of the \_\_\_\_ [Name of SPV] themselves to fill in their own names in the column (3)

**Signature and Name of authorized signatory in whose name power of attorney has been issued**

Signature of authorized signatory

Name: .....

Designation: .....

Date.....

Company rubber stamp



188

**ANNEXURE 9 -AUTHORISATION FROM PARENT/ AFFILIATE OF BIDDING COMPANY/ MEMBER OF BIDDING CONSORTIUM WHOSE TECHNICAL/ FINANCIAL CAPABILITY HAS BEEN USED BY THE BIDDING COMPANY/ MEMBER OF BIDDING CONSORTIUM.**

**[On the Letter Head of the Parent /Affiliate]**

Name: .....  
Full Address: .....  
Telephone No.: .....  
E-mail address: .....  
Fax / No.: .....

To

**PFC Consulting Limited  
9<sup>th</sup> Floor, Wing-A, Statesman House,  
Connaught Place, New Delhi - 110001**

Dear Sir,

**Sub: Authorization for use of Technical / Financial Capability of M/s..... (Insert name of Parent / Affiliate) by M/s ..... (Insert name of Bidding Company / Member of Bidding Consortium).**

We refer to the RFP dated **September 14, 2024** ('RFP') issued by you for selection of Bidder as Transmission Service Provider for establishing the Inter-State Transmission System for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I".

We confirm that M/s. .... (Insert name of Bidding Company/ Consortium Member) has been authorized by us to use our technical and/or financial capability [strikeout whichever is not applicable] for meeting the Qualification Requirements for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I".

We have carefully read and examined in detail the RFP including in particular, Clause 2.1.4 of the RFP, and we are also submitting legally binding undertaking supported by a board resolution that all the equity investment obligations of M/s..... (Insert Name of Bidding Company / Consortium Member), shall be deemed to be our equity investment obligations and in the event of any default the same shall be met by us.

For and on behalf of M/s..... (Insert Name of Parent / Affiliate)

.....  
**(Signature and Name of the authorized signatory of the Company and stamp)**

Name: .....  
Date: .....  
Place: .....

**Notes:**

1. The above undertaking can be furnished by Ultimate Parent of Technically Evaluated Entity or Financially Evaluated Entity, as the case maybe, if legally binding undertaking is also furnished by the Ultimate Parent on behalf of such Financially Evaluated Entity/Technically Evaluated Entity.

189



**ANNEXURE 10- FORMAT OF UNDERTAKING BY TECHNICALLY / FINANCIALLY EVALUATED ENTITY /  
ULTIMATE PARENT COMPANY**

**[On the Letter Head of the Technically / Financially Evaluated Entity / Ultimate Parent Company]**

Name: .....  
Full Address: .....  
Telephone No.: .....  
E-mail address: .....  
Fax/No.: .....

**To:**  
**Chief Executive Officer**  
**PFC Consulting Limited**  
**9th Floor, Wing-A, Statesman House,**  
**Connaught Place, New Delhi - 110001**

**Sub: Undertaking for equity investment**

Dear Sir,

We refer to the Request for Proposal dated September 14, 2024 ('RFP') issued by you regarding setting up of Inter-State transmission system for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" Project on build, own, operate and transfer basis.

We have carefully read and examined in detail the RFP and the RFP Project Documents, including in particular, Clause 2.1.4 of the RFP and Clauses 2.5.2 and 2.5.8 of the RFP, regarding submission of an undertaking regarding the investment in the equity share capital of **RAGHANESDA RE TRANSMISSION LIMITED** and provisions for minimum equity holding and equity lock-in. We have also noted the amount of the equity investment required to be made in **RAGHANESDA RE TRANSMISSION LIMITED** by the ..... [Insert the name of the Bidder or the Consortium Member] for the Project.

In view of the above, we hereby undertake to you and confirm that in the event of failure of .....[Insert the name of the Bidder or the Consortium Member] to invest in full or in part, in the equity share capital of **RAGHANESDA RE TRANSMISSION LIMITED** as specified in the Bid, we shall invest the said amount not invested by.....[Insert the name of the Bidder or the Consortium Member] in **RAGHANESDA RE TRANSMISSION LIMITED** by purchase of existing shares or subscribing to the new shares of **RAGHANESDA RE TRANSMISSION LIMITED**, as stipulated by you.

We have attached hereto certified true copy of the Board resolution whereby the Board of Directors of our Company has approved issue of this Undertaking by the Company.

All the terms used herein but not defined, shall have the meaning as ascribed to the said terms under the RFP.

Certified as true.

.....  
(Signature and Name of the authorized signatory of the Company and stamp)

**Note:**

1. Wherever required, extract of the charter documents and documents such as a Board resolution should be submitted for verification.

PFC CONSULTING LIMITED



190

**ANNEXURE 11 - FORMATS FOR BOARD RESOLUTIONS****Format 1****Format of the Board resolution for the Bidding Company / each Member of the Consortium / investing Affiliate / Parent Company / Ultimate Parent Company, where applicable**

[Reference Clause 2.5.2 of the RFP and the illustrations in Annexure 11A]

[Note: The following resolution no.1 needs to be passed by the Boards of each of the entity/ (ies) making equity investment]

The Board, after discussion, at the duly convened Meeting on ..... [Insert date], with the consent of all the Directors present and in compliance of the provisions of the Companies Act, 1956/2013, passed the following Resolution:

1. **RESOLVED THAT** pursuant to the provisions of the Companies Act, 1956 / Companies Act 2013 (as the case may be) and compliance thereof and as permitted under the Memorandum and Articles of Association of the company, approval of the Board be and is hereby accorded for investment of.....% (.....per cent) of the total equity share capital of **RAGHANESDA RE TRANSMISSION LIMITED** representing the entire amount proposed to be invested by the company for the transmission system for "Transmission system for evacuation of RE power from Raghanesda Area of Gujarat-3GW under Phase-I", partly by acquisition of the existing equity shares from PFC Consulting Limited and / or partly by subscribing to the new equity shares, as per the terms of the RFP.

[Note: Equity investment obligations by the Bidding Company/each Member of the Bidding Consortium/investing Affiliate or Parent or Ultimate Parent should add up to 100%.]

[Note: In the event the Bidder is a Bidding Consortium, the following Board resolution no. 2 also needs to be passed by the Lead Member of the Bidding Consortium]

2. **RESOLVED THAT** approval of the Board be and is hereby accorded to contribute such further amount over and above the;..... percentage (\_\_\_%) limit to the extent becoming necessary towards the total equity share in the **RAGHANESDA RE TRANSMISSION LIMITED**, obligatory on the part of the company pursuant to the terms and conditions contained in the Consortium Agreement dated .....executed by the company as per the provisions of the RFP.

[Note: In the event, the investing entity is an Affiliate or Parent or Ultimate Parent of the Bidder, the following Board resolution no. 3 shall also be passed by the Bidder]

3. **FURTHER RESOLVED THAT** the Board hereby acknowledges the Board Resolution(s) passed by the..... [Name of the Affiliate(s)/ Parent / Ultimate Parent] regarding the investment of.....(.....%) of the equity share capital requirements of **RAGHANESDA RE TRANSMISSION LIMITED**, which is to be invested by the .....[Name of the Affiliate(s)/ Parent / Ultimate Parent] for the **RAGHANESDA RE TRANSMISSION LIMITED**, partly by acquisition of the existing equity shares from PFC Consulting Limited and partly by subscribing to the new equity shares, as per the terms of the RFP.

[Note: The following resolution no. 4 is to be provided by the Bidding Company / Lead Member of the Consortium only]

4. **FURTHER RESOLVED THAT** MR/MS .....be and is hereby authorized to take all the steps required to be taken by the Company for submission of the Bid, including in particular, signing of the Bid, making changes thereto and submitting amended Bid, all the documents related to the Bid, certified

PFC CONSULTING LIMITED



191

copy of this Board resolution or letter or undertakings etc, required to be submitted to BPC as part of the Bid or such other documents as may be necessary in this regard.

Certified True Copy

Company rubber stamp to be affixed

**[Notes:**

- 1) This certified true copy should be submitted on the letterhead of the Company, signed by the Company Secretary or any Whole Time Director/ Manager (supported by a specific board resolution) of the Bidding Company or the Lead Member of Consortium.
- 2) The contents of the format may be suitably re-worded indicating the identity of the entity passing the resolution, i.e., the Bidding Company, each Member of the Bidding Consortium.
- 3) This format may be modified only to the limited extent required to comply with the local regulations and laws applicable to a foreign entity submitting this resolution. For example, reference to Companies Act 1956 / Companies Act 2013 (as the case may be) may be suitably modified to refer to the law applicable to the entity submitting the resolution. However, in such case, the foreign entity shall submit an unqualified opinion issued by the legal counsel of such foreign entity, stating that the Board resolutions are in compliance with the applicable laws of the respective jurisdictions of the issuing company and the authorizations granted therein are true and valid.]



**Format 2****Format for the Board resolution of Technically / Financially Evaluated Entity / Ultimate Parent Company (in case credentials of such TEE/ FEE has been utilized by the Bidding Company or Bidding Consortium)**

The Board, after discussion, at the duly convened Meeting on ..... [Insert date], with the consent of all the Directors present and in compliance of the provisions of the Companies Act, 1956 / 2013, passed the following Resolution:

**RESOLVED THAT** pursuant to the provisions of the Companies Act, 1956 / Companies Act, 2013 (as the case may be) and compliance thereof and as permitted under the Memorandum and Articles of Association of the company, approval of the Board be and is hereby accorded for issuing an Undertaking to the BPC, in the format specified in the RFP issued by the BPC, draft of which is attached hereto and initialed by the Chairman whereby the company undertakes to invest .....percent (... %) of the total equity share capital of **RAGHANESDA RE TRANSMISSION LIMITED** representing the entire amount proposed to be invested by .....[insert the name of the Bidder or Member] for the said Project, in case of failure of .....[insert the name of the Bidder or Member] to make such investment".

**FURTHER RESOLVED THAT** .....be and is hereby authorized to take all the steps required to be taken by the Company, including in particular, signing the said Undertaking, submitting the same to the BPC through .....[Insert name of Bidding Company/Lead Member of the Consortium] of all the related documents, certified copy of this Board resolution or letter, undertakings etc, required to be submitted to BPC as part of the Bid or such other documents as may be necessary in this regard.

**Certified True Copy****Company rubber stamp to be affixed****Note:**

1. This certified true copy should be submitted on the letterhead of the Company, signed by the Company Secretary or any Whole-time Director/Manager (supported by a specific board resolution) of Bidding Company or Lead Member of the Consortium.
2. The contents of the format may be suitably re-worded indicating the identity of the entity passing the resolution.
2. This format may be modified only to the limited extent required to comply with the local regulations and laws applicable to a foreign entity submitting this resolution. For example, reference to Companies Act 1956 / Companies Act 2013 (as the case may be) may be suitably modified to refer to the law applicable to the entity submitting the resolution. However, in such case, the foreign entity shall submit an unqualified opinion issued by the legal counsel of such foreign entity, stating that the Board resolutions are in compliance with the applicable laws of the respective jurisdictions of the issuing company and the authorizations granted therein are true and valid.



**ANNEXURE 11A – ILLUSTRATION FOR APPLICABLE BOARD RESOLUTION REQUIREMENTS UNDER  
CLAUSE 2.5.2**

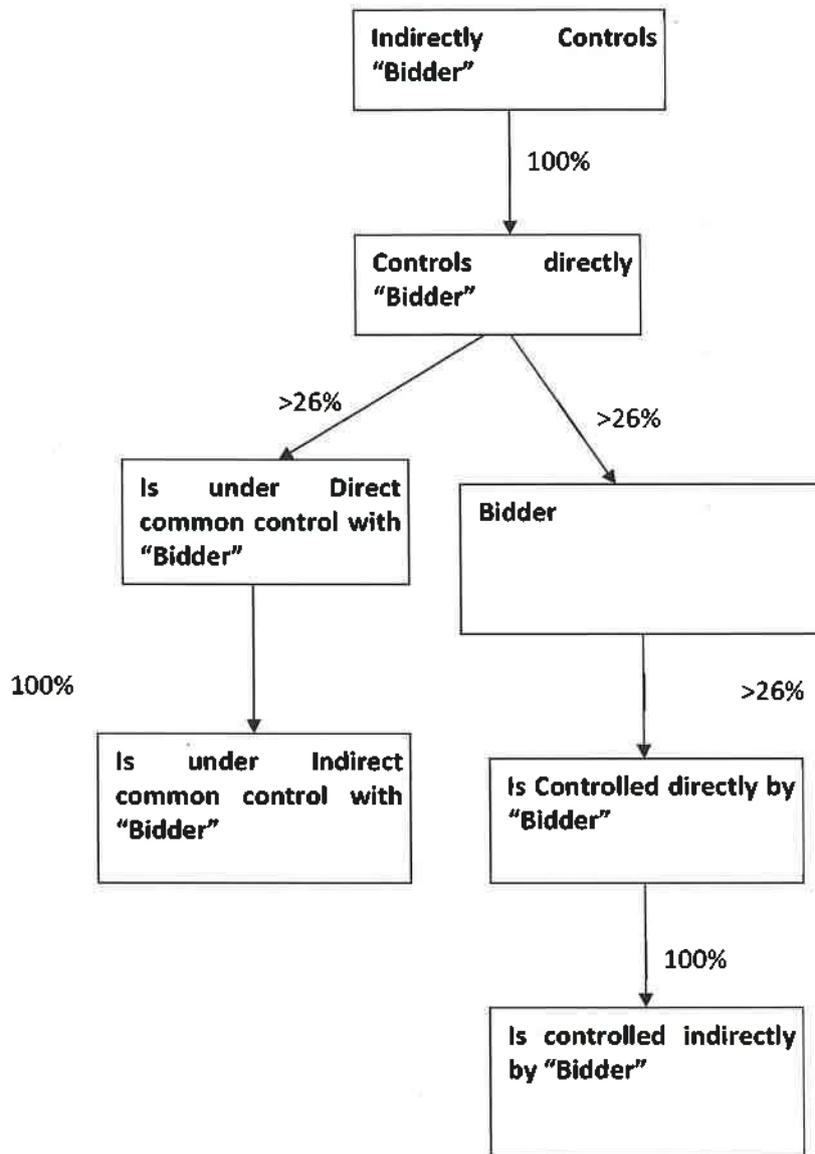
Investor in the TSP	Entities (other than Bidder) whose credentials (financial and/or technical) used by the Bidder for meeting RFP criteria	Applicable Board Resolutions	Requirement of Undertaking (Annexure 10)
Bidder himself for 100% equity	None	a) Format 1 of Annexure 11 - Resolution: 1, 2 and 4 from the Bidder	None
Bidder himself for 100% equity	Affiliate and/or Parent Company and/or Ultimate Parent	<p>a) Format 1 of Annexure 11 - Resolution: 1, 2, and 4 from the Bidder</p> <p>b) Format 2 of Annexure 11 by either Technically/ Financially Evaluated Entity(ies) whose credentials have been used, or Ultimate Parent.</p> <p>Provided, if the Bidder himself is the Ultimate Parent, then Format 2 need not be provided.</p>	<p>Yes, by either Technically / Financially Evaluated Entity(ies) Affiliate(s) whose credentials have been used, or Ultimate Parent.</p> <p>Provided, if the Bidder himself is the Ultimate Parent, then the undertaking need not be provided.</p>
Bidder himself + others (Affiliate and/or Parent Company and/or Ultimate Parent) in aggregate holding 100% equity	None	<p>a) Format 1 of Annexure 11 - Resolution: 1,2, 3 and 4 from the Bidder.</p> <p>b) Format 1 of Annexure 11 - Resolution: 1 from the Affiliate and /or Parent and /or Ultimate Parent investing in the equity</p>	None
Bidder himself + others (Affiliate and/or Parent Company and/or Ultimate Parent) in	Affiliate and/or Parent Company and/or Ultimate Parent	a) Format 1 of Annexure 11 - Resolution: 1,2, 3 and 4 from the Bidder.	Yes, by either Parent/ Affiliate(s) whose credentials have been used, or Ultimate Parent



Investor in the TSP	Entities (other than Bidder) whose credentials (financial and/or technical) used by the Bidder for meeting RFP criteria	Applicable Board Resolutions	Requirement of Undertaking (Annexure 10)
Aggregate holding 100% equity		b) Format 1 of Annexure 11 - Resolution: 1 from the Affiliate and/or Parent and/or Ultimate Parent investing in the equity  c) Format 2 of Annexure 11 by either Parent / Affiliate(s) whose credentials have been used and /or Ultimate Parent investing in the equity	



**ANNEXURE 12 - FORMAT FOR ILLUSTRATION OF AFFILIATES**



**NOTE:** Bidder to provide the illustration, as applicable in their case, duly certified by the Company Secretary and supported by documentary evidence in this regard.



**ANNEXURE 13 - FORMAT FOR DISCLOSURE****[On the letter head of Bidding Company / Each Member in a Bidding Consortium]**

Date: .....

**DISCLOSURE**

We hereby declare that the following companies with which we/ have direct or indirect relationship are also separately participating in this Bid process as per following details

S. No.	Name of the Company	Relationship
1.		
2.		
3.		

In case there is no such company please fill in the column "name of the company" as Nil.

Further we confirm that we don't have any Conflict of Interest with any other company participating in this bid process.

**Certified as True**

.....  
(Signature)

Name: .....

**Signature & Name of authorized signatory of the Company and Stamp**

The above disclosure should be signed and certified as true by the authorized signatory of the Bidding Company or of the Member, in case of a Consortium).



**ANNEXURE 14 - FORMAT OF THE BID BOND****FORMAT OF THE UNCONDITIONAL AND IRREVOCABLE BANK  
GUARANTEE FOR BID BOND**

(To be on non-judicial stamp paper of appropriate value as per Stamp Act relevant to place of execution.)

In consideration of the ..... [Insert name of the Bidder] submitting the Bid inter alia for establishing the Inter-State transmission system for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" on build, own, operate and transfer basis, in response to the RFP dated **September 14, 2024** issued by PFC Consulting Limited, and the Bid Process Coordinator (hereinafter referred to as BPC) agreeing to consider such Bid of ..... [Insert the name of the Bidder] as per the terms of the RFP, the [Insert name and address of the bank issuing the Bid Bond, and address of the Head Office] (hereinafter referred to as "Guarantor Bank") hereby agrees unequivocally, irrevocably and unconditionally to pay to PFC Consulting Limited or its authorized representative at \_\_\_\_ [Address of BPC] forthwith on demand in writing from PFC Consulting Limited or any representative authorized by it in this behalf, any amount up to and not exceeding Rupees \_\_\_\_\_ Only (Rs \_\_\_\_ Crore), on behalf of M/s..... [Insert name of the Bidder].

This guarantee shall be valid and binding on the Guarantor Bank up to and including ..... [Date to be inserted on the basis of Clause 2.11 of this RFP] and shall not be terminable by notice or any change in the constitution of the Guarantor Bank or by any other reasons whatsoever and our liability hereunder shall not be impaired or discharged by any extension of time or variations or alternations made, given, or agreed with or without our knowledge or consent, by or between concerned parties.

Our liability under this Guarantee is restricted to Rupees \_\_\_\_\_ Only (Rs \_\_\_\_ Crore). Our Guarantee shall remain in force until ..... [Date to be inserted on the basis of Clause 2.11 of this RFP]. PFC Consulting Limited or its authorized representative shall be entitled to invoke this Guarantee until ..... [Insert Date, which is three sixty-five days (365) days after the date in the preceding sentence]. The Guarantor Bank hereby expressly agrees that it shall not require any proof in addition to the written demand from PFC Consulting Limited or its authorized representative, made in any format, raised at the above-mentioned address of the Guarantor Bank, in order to make the said payment to PFC Consulting Limited or its authorized representative.

The Guarantor Bank shall make payment hereunder on first demand without restriction or conditions and notwithstanding any objection, disputes, or disparities raised by the Bidder or any other person. The Guarantor Bank shall not require PFC Consulting Limited or its authorized representative to justify the invocation of this BANK GUARANTEE, nor shall the Guarantor Bank have any recourse against PFC Consulting Limited or its authorized representative in respect of any payment made hereunder.

This BANK GUARANTEE shall be interpreted in accordance with the laws of India.

The Guarantor Bank represents that this BANK GUARANTEE has been established in such form and with such content that it is fully enforceable in accordance with its terms as against the Guarantor Bank in the manner provided herein.

This BANK GUARANTEE shall not be affected in any manner by reason of merger, amalgamation, restructuring or any other change in the constitution of the Guarantor Bank.

This BANK GUARANTEE shall be a primary obligation of the Guarantor Bank and accordingly PFC Consulting Limited or its authorized representative shall not be obliged before enforcing this BANK



GUARANTEE to take any action in any court or arbitral proceedings against the Bidder, to make any claim against or any demand on the Bidder or to give any notice to the Bidder to enforce any security held by PFC Consulting Limited or its authorized representative or to exercise, levy or enforce any distress, diligence or other process against the Bidder.

Notwithstanding anything contained hereinabove, our liability under this Guarantee is restricted to Rupees \_\_\_\_\_ Only (Rs \_\_\_\_ Crore) and it shall remain in force until ..... [Date to be inserted on the basis of Clause 2.11 of RFP], with an additional claim period of three hundred sixty-five (365) days thereafter. We are liable to pay the guaranteed amount or any part thereof under this BANK GUARANTEE only if PFC Consulting Limited or its authorized representative serves upon us a written claim or demand.

In witness whereof the Bank, through its authorized officer, has set its hand and stamp on this..... day of ..... at.....

**Witness:**

1.....  
Name and Address

Signature: .....  
Name: .....

2. ....  
Name and Address

Designation with Stamp:

Signature .....

Attorney as per power of attorney  
No.....

For:  
..... [Insert Name of the Bank]

**Banker's Stamp and Full Address:**

Dated this ..... day of ..... 20.....

**Notes:**

The Stamp Paper should be in the name of the Executing Bank.

PFC CONSULTING LIMITED



**ANNEXURE 15 - FORMAT FOR CONTRACT PERFORMANCE GUARANTEE**

**(To be on non-judicial stamp paper of appropriate value as per Stamp Act relevant to place of execution.  
Foreign entities submitting Bids are required to follow the applicable law in their country)**

In consideration of the ..... [Insert name of the SPV or Selected Bidder on behalf of SPV or Lead Member in case of the Consortium, with address] agreeing to undertake the obligations under the Transmission Service Agreement dated ..... and the other RFP Project Documents and the Nodal Agency and PFC Consulting Limited, agreeing to execute the RFP Project Documents with the Selected Bidder, regarding setting up the Project, the.....[Insert name and address of the bank issuing the guarantee and address of the head office] (hereinafter referred to as "Guarantor Bank") hereby agrees unequivocally, irrevocably and unconditionally to pay to the Nodal Agency at..... [Insert Place and Address of the Nodal Agency indicated in TSA] forthwith on demand in writing from the Nodal Agency or any Officer authorized by it in this behalf, any amount up to and not exceeding Rupees.....Crores (Rs.....) only [Insert the amount of the bank guarantee] on behalf of M/s..... [Insert name of the Selected Bidder / SPV].

This guarantee shall be valid and binding on the Guarantor Bank up to and including .....and shall not be terminable by notice or any change in the constitution of the Bank or the term of the Transmission Service Agreement or by any other reasons whatsoever and our liability hereunder shall not be impaired or discharged by any extension of time or variations or alternations made, given, or agreed with or without our knowledge or consent, by or between parties to the respective agreement.

Our liability under this Guarantee is restricted to Rupees ..... Crores (Rs.....) only. Our Guarantee shall remain in force until..... [Insert the date of validity of the Guarantee as per Clause 2.12.1 of the RFP]. The Nodal Agency shall be entitled to invoke this Guarantee up to three hundred sixty five (365) days of the last date of the validity of this Guarantee.

The Guarantor Bank hereby expressly agrees that it shall not require any proof in addition to the written demand from the Nodal Agency, made in any format, raised at the above mentioned address of the Guarantor Bank, in order to make the said payment to the Nodal Agency.

The Guarantor Bank shall make payment hereunder on first demand without restriction or conditions and notwithstanding any objection by **RAGHANESDA RE TRANSMISSION LIMITED**, ..... [Insert name of the Selected Bidder], ..... [Insert name of the TSP] and/or any other person. The Guarantor Bank shall not require the Nodal Agency to justify the invocation of this BANK GUARANTEE, nor shall the Guarantor Bank have any recourse against the Nodal Agency in respect of any payment made hereunder.

**This BANK GUARANTEE** shall be interpreted in accordance with the laws of India.

The Guarantor Bank represents that this BANK GUARANTEE has been established in such form and with such content that it is fully enforceable in accordance with its terms as against the Guarantor Bank in the manner provided herein.

**This BANK GUARANTEE** shall not be affected in any manner by reason of merger, amalgamation, restructuring, liquidation, winding up, dissolution or any other change in the constitution of the Guarantor Bank.

**This BANK GUARANTEE** shall be a primary obligation of the Guarantor Bank and accordingly the Nodal Agency shall not be obliged before enforcing this BANK GUARANTEE to take any action in any court or arbitral proceedings against **RAGHANESDA RE TRANSMISSION LIMITED** or the Selected Bidder, to make any claim against or any demand on **RAGHANESDA RE TRANSMISSION**



**LIMITED** or the Selected Bidder, as the case may be, or to give any notice to **RAGHANESDA RE TRANSMISSION LIMITED** or the Selected Bidder, as the case may be, or to enforce any security held by the Nodal Agency or to exercise, levy or enforce any distress, diligence or other process against **RAGHANESDA RE TRANSMISSION LIMITED** or the Selected Bidder, as the case may be.

The Guarantor Bank acknowledges that this BANK GUARANTEE is not personal to the Nodal Agency and may be assigned, in whole or in part, (whether absolutely or by way of security) by Nodal Agency to any entity to whom the Nodal Agency is entitled to assign its rights and obligations under the Transmission Service Agreement.

The Guarantor Bank hereby agrees and acknowledges that the Nodal Agency shall have a right to invoke this Bank Guarantee either in part or in full, as it may deem fit.

Notwithstanding anything contained hereinabove, our liability under this Guarantee is restricted to Rupees .....Crore (Rs .....) only and it shall remain in force until [Date to be inserted on the basis of Article 3.1.2 of TSA], with an additional claim period of three hundred sixty five (365) days thereafter. This BANK GUARANTEE shall be extended from time to time for such period, as may be desired by..... [Insert name of the Selected Bidder or Lead Member in case of the Consortium or SPV]. We are liable to pay the guaranteed amount or any part thereof under this Bank Guarantee only if the Nodal Agency serves upon us a written claim or demand.

**In witness where of:**

Signature.....

Name: .....

Power of attorney No.: .....

**For:**

..... [Insert Name of the Bank]

Banker's Seal and Full Address, including mailing address of the Head Office

**Notes:**

1. The Stamp Paper should be in the name of the Executing Bank.



**ANNEXURE 16 – FORMAT OF CHECKLIST FOR TECHNICAL BID SUBMISSION REQUIREMENTS**

**[This format needs to be duly filled in, signed by the authorized signatory of the Bidder (Bidding Company / Lead Member in case of a Bidding Consortium) and submitted along with the Bidder's Technical Bid]**

Technical Bid Submission Requirements	Response (Yes / No)
<p>1. Format for the Covering Letter on the letterhead of Bidding Company or Lead Member of the Consortium, as applicable;</p> <p>2. Format for Letter of Consent from each Consortium Member, including Lead Member, on their respective letterheads;</p> <p>3. Format for evidence of authorized signatory's authority;</p> <p>4. Board resolution from the Bidding Company / Lead Member of the Consortium in favour of the person executing the Power of Attorney as per Annexure 3;</p> <p>5. Power of Attorney from each Consortium Member in favour of Lead Member to be provided by each of the other Members of the Consortium as per Annexure 4;</p> <p>6. Board Resolution from each Member of the Consortium, other than the Lead Member, in favour of their respective authorized representatives for executing the POA, Consortium Agreement and signing of the requisite formats;</p> <p>7. Format for Bidder's composition and ownership structure, along with status of equity holding (owning ten percent or more of the total paid up equity) not earlier than thirty (30) days prior to the Bid Deadline as per Annexure 5;</p> <p>8. Consortium Agreement duly signed as per Annexure 6, along with Appendix-1, indicating the responsibilities and obligations of each Member of the Consortium;</p> <p>9. Format for Qualification Requirement:</p> <p>a. Calculation sheets, detailing computation of Networth considered for meeting Qualifying Requirements, duly signed and stamped by the Statutory Auditor of the Bidding Company / each Member in case of a Bidding Consortium / FEE in cases where credentials of FEE are taken;</p> <p>b. Calculation sheets, detailing computation of capital expenditure of projects and revenue received in construction projects considered for meeting Qualification Requirements, duly signed and stamped by the Statutory Auditor of the Bidding Company / Lead Member in case of Bidding Consortium / TEE in cases where credentials of TEE are taken;</p>	
<p>c. Last financial year unconsolidated / consolidated audited annual accounts / statements, as the case may be, of the Financially Evaluated Entity / Technical Evaluated Entity</p> <p>d. Unconsolidated audited annual accounts of both the TEE and the Bidding Company/Lead member, as applicable, from the financial</p>	



Technical Bid Submission Requirements	Response (Yes / No)
<p>years in which financial closure was achieved till the financial year in which the said project was completed / commissioned.</p> <p>10. Copy of the Memorandum and Articles of Association and certificate of incorporation or other organizational document (as applicable), including their amendments, certified by the Company Secretary of Bidding Company or each Member in case of a Consortium including Lead Member.</p> <p>11. Attachment of Annexure 7(D), detailing projects completed / commissioned and for which commercial operation has commenced including Executive Summary for each project.</p> <p>12. For each project listed in the attachment above, certified true copy of the certificates of final acceptance and / or certificates of good operating performance duly issued by owners or clients for the project, duly signed by authorized signatory in support of technical capability as defined in Clause 2.1.2 of RFP.</p> <p>13. Authority letter in favour of BPC from the Bidder/every Member of the Consortium authorizing the BPC to seek reference from their respective bankers &amp; others.</p> <p>14. Authorization from Parent / Affiliate of Bidding Company / Member of Bidding Consortium whose technical / financial capability has been used by the Bidding Company / Member of Bidding Consortium.</p> <p>15. Initialing of all pages of Technical Bid by the Authorized Signatory in whose favour the POA (Annexure 3) has been executed.</p> <p>16. Format for Illustration of Affiliates at the most seven (7) days prior to the Bid Deadline, duly certified by Company Secretary and supported by documentary evidence.</p> <p>17. Certified copy of the Register of Members / Demat Account Statement, Share Certificate, Annual Return filed with ROC etc. submitted as documentary evidence along with Annexure 12.</p> <p>18. Format for Disclosure by Bidding Company / each Member of the Consortium.</p> <p>19. Format for Affidavit by the Bidding Company / each Member of the Consortium</p>	
<p>20. Format for Authorization submitted in Non-Judicial stamp paper duly notarized.</p> <p>21. Bidders Undertaking and details of Equity Investment</p> <p>22. Proof of Payment of RFP Fees</p> <p>23. Bid Bond</p> <p>24. Board Resolution as per Annexure 11 (If required)</p>	

[Note: The checklist is not exhaustive. Bidders are required to submit all the information/documents as per requirement of RFP]



**For and on behalf of Bidder**

M/s. ....

.....  
**(Signature of authorized signatory)**

204



**ANNEXURE 17 – LIST OF BANKS**

The list of banks shall include all Scheduled Commercial Banks as per Second Schedule of RBI Act-1934 and any amendments thereof.

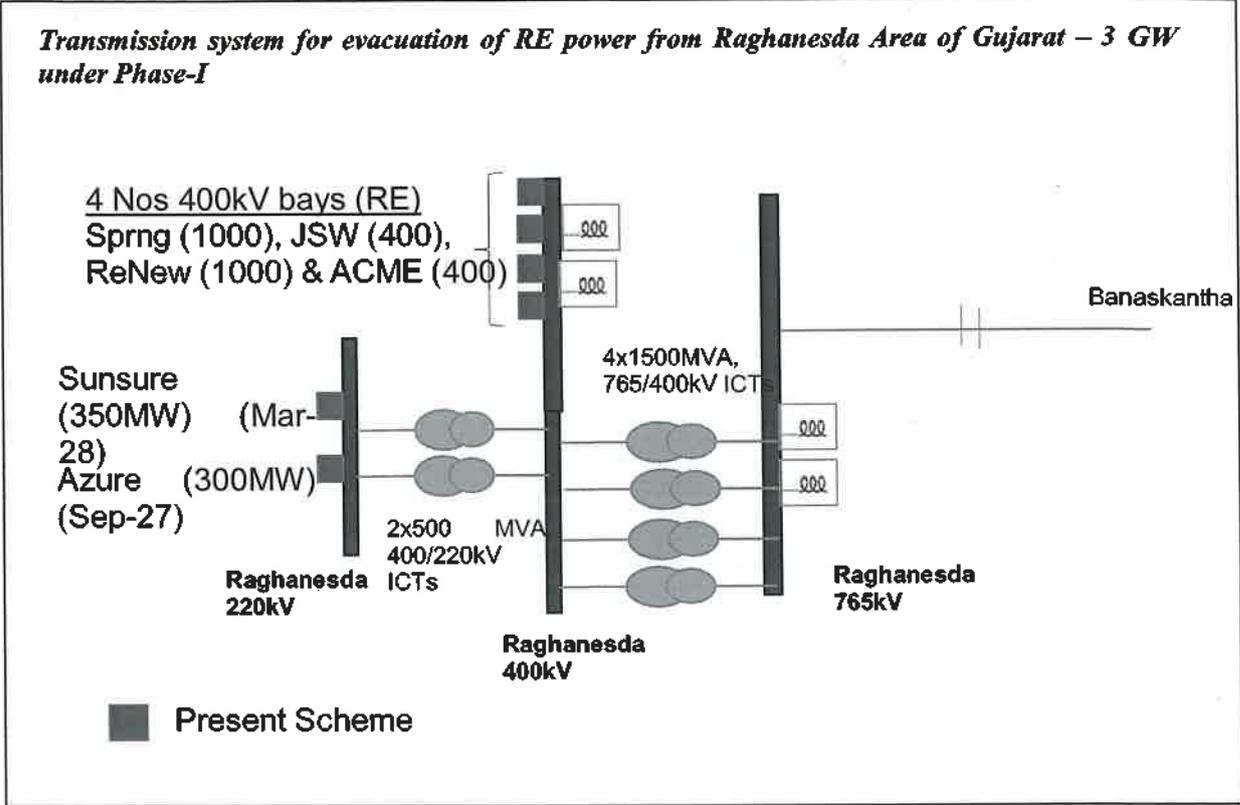
**Note:**

The above list of banks is indicative and can be modified by the BPC as required and any such change shall not be construed as a deviation from this document.



ANNEXURE 18 - GRID MAP OF THE PROJECT

Transmission Grid Map



**ANNEXURE 19 - FORMAT FOR CLARIFICATIONS / AMENDMENTS ON THE RFP / RFP PROJECT DOCUMENTS**

S. No.	Name of the Document	Clause No. and Existing provision	Clarification required	Suggested text for the amendment	Rationale for the Clarification or Amendment

Signature .....

Name.....

For

**Bidder's Rubber Stamp and Full Address.**

(Note: This format shall be used for submission of requests for clarifications/ amendments on the draft RFP Project Documents as per the provisions of Clause 2.3.1)

207



**ANNEXURE 20 - LIST FOR RFP PROJECT DOCUMENTS**

**ENCLOSURE 1: TRANSMISSION SERVICE AGREEMENT (Provided separately)**

**ENCLOSURE 2: SHARE PURCHASE AGREEMENT (Provided Separately)**

.....



208

**ANNEXURE 21 - FORMAT FOR FINANCIAL BID**

**[To be uploaded online]**

**Quoted Transmission Charges .....**

**Notes**

1. The Bidders are required to ensure compliance with the provisions of Clause 2.5.3 of this RFP.
2. Quotes to be in Rupees Millions and shall be up to two (2) decimal points.
3. The contents of this format shall be clearly typed.
4. The Financial Bid shall be digitally signed by the authorized signatory in whose name power of attorney as per Clause 2.5.2 is issued.
5. Ensure only one value for annual Transmission Charges is quoted. The same charge shall be payable every year to TSP for the term of TSA.



**ANNEXURE 22 – FORMAT FOR AFFIDAVIT**

**[On non-judicial stamp paper. Foreign companies submitting bids are required to follow the applicable law in their country]**

**AFFIDAVIT**

We [including any of our Affiliate and Consortium Member & any of its Affiliate], hereby declare that as on Bid Deadline:

- a. the Bidder & any of its Affiliate including any Consortium Member & any of its Affiliate, their directors or key personnel have not been barred or included in the blacklist by any government agency or authority in India, the government of the jurisdiction of the Bidder or Members where they are incorporated or the jurisdiction of their principal place of business, any international financial institution such as the World Bank Group, Asian Development Bank, African Development Bank, Inter-American Development Bank, Asian Infrastructure Investment Bank etc. or the United Nations or any of its agencies; or
- b. the Bidder & any of its Affiliate including any Consortium Member & any of its Affiliate or their directors have not been convicted of any offence in India or abroad.

We further declare that following investigations are pending / no investigation is pending [strike off whichever is not applicable] against us [including any of our Consortium Member or Affiliate or Parent or Ultimate Parent or Affiliate] or CEO or any of our directors/ manager/key managerial personnel of the Applicant /Consortium Member or their Affiliates.

We further undertake to inform the BPC of any such matter as mentioned above on its occurrence after the date of this affidavit till the Effective Date.

We undertake that, in case, any information provided in relation to this affidavit is found incorrect at any time hereafter, our BID / Letter of Intent / contract (if entered) would stand rejected / recalled / terminated, as the case may be.

.....  
Signature and Name of the authorized signatory of the Bidding Company / Lead Member of the Bidding Consortium

.....  
(Signature of Notary Public)

Place: .....  
Date: .....

Note: In case any investigation is pending against the Applicant, including any Consortium Member or Affiliate, or CEO or any of the directors/ manager/key managerial personnel of the Applicant /Consortium /Member or their Affiliates, full details of such investigation including the name of the



investigating agency, the charge/offence for which the investigation has been launched, name and designation of persons against whom the investigation has been launched and other relevant information should be disclosed under this affidavit.



**ANNEXURE A**

**Technical Details with respect to electronic bidding**

**Registration Methodology**

In order to submit online bids in the e-bidding process for selection of Transmission Service Provider, interested Bidders are required to register themselves with the e-procurement website of MSTC limited namely [www.mstcecommerce.com/eprchome/tsp/index.jsp](http://www.mstcecommerce.com/eprchome/tsp/index.jsp). To register with the website, the Bidder is required to fill up the online form available under the link Register as Vendor in the above website and fill up the same and click on Submit.

During this process, the Bidder shall create his user id and password and keep note of the same. The Bidder shall ensure that the secrecy of his user id and password is maintained at all time and he/she shall alone be responsible for any misuse of the user id and password.

The Bidder may check the details entered by it before final submission. On successful submission of the online registration Form, the Bidder shall receive a confirmation mail in the registered email address advising the Bidder to submit the following documents.

- i. Self-attested Income Tax PAN Card. In case of a registered Company or Firm, the Firm's PAN card and in case of a proprietorship firm, proprietor's personal PAN card is required. In case of partnership firm, PAN of the firm and that of the authorized partner are to be submitted.
- ii. Copy of the confirmation email Letter received from MSTC after successful completion of on-line registration.
- iii. A non-refundable registration fee of Rs.10,000/- plus GST as per applicable rate to be paid online. The account details will be available in the System generated email sent by MSTC post registration.

Please provide details of payment made like UTR No, remitting bank name, date of payment and amount in the covering letter.

The Bidder shall have to submit all the above documents to MSTC Limited for verification and activation of their login ids. The Bidders should send scanned copies of the above documents to the designated email id only which is given below.

[tsp@mstcindia.co.in](mailto:tsp@mstcindia.co.in)

It may be noted that Bidders need not visit any of the offices of MSTC Limited for submission of the documents.

Contact persons of MSTC Limited:

**Ms. Rupali**  
**9458704037**

**Mr. Setu Dutt Sharma**  
**7878055855**



Once the complete set of documents and requisite registration fee are received from a Bidder, MSTC shall activate the Bidder's login after verification / scrutiny of the documents. MSTC Limited reserves the right to call for additional documents from the Bidder if needed and the Bidder shall be obliged to submit the same.

On completion of the above stated registration process, a Bidder shall be able to login to MSTC's website.



**ANNEXURE B**

**Draft Pre-Award Integrity Pact**

**GENERAL**

This pre-bid contract Agreement (herein after called the Integrity Pact) is made on ..... day of the month of ..... 20....., between, on one hand, ..... [Insert name of BPC] through Shri ..... [Insert Name & designation of representative of BPC] (hereinafter called the "Bid Process Coordinator/ BPC", which expression shall mean and include, unless the context otherwise requires, his successors in the office and assigns) of the First Part and M/s ..... represented by Shri ..... [Insert Name & Designation of Authorized Signatory of the Bidder/ Lead Member of Consortium] (hereinafter called the "Bidder" which expression shall mean and include, unless the context otherwise requires, his successors and permitted assigns) of the Second Part.

WHEREAS the BPC is conducting the bidding process for selection of bidder as Transmission Service Provider (TSP) for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I", who will be responsible to set up the transmission project on build, own, operate and transfer (BOOT) basis and to provide Transmission Service.

WHEREAS the Bidder is a Private Company/Public Company/Government Undertaking/ Partnership, constituted in accordance with the relevant law in the matter and the BPC is a Public Sector Undertaking (PSU) performing its function on behalf of the Ministry of Power, Government of India.

NOW, THEREFORE,

To avoid all forms of corruption by following a system that is fair, transparent and free from any influence/prejudiced dealings during the complete bidding process with a view to: -

Enabling the BPC to select the bidder as TSP in conformity with the defined procedures by avoiding the high cost and the distortionary impact of corruption on public procurement, and

Enabling Bidder to abstain from bribing or indulging in any corrupt practice in order to emerge as selected bidder by providing assurance to them that their competitors will also abstain from bribing and other practices and the BPC will commit to prevent corruption, in any form, by its officials by following transparent procedures.

The parties hereto hereby agree to enter into this Integrity Pact and agree as follows:

**Commitments of BPC**

11 The BPC undertakes that no official of the BPC, connected directly or indirectly with the bidding process, will demand, take a promise for or accept, directly or through intermediaries, any bribe, consideration, gift, reward, favour or any material or immaterial



- benefit or any other advantage from the BIDDER, either for themselves or for any person, organization or third party related to the bidding process in exchange for an advantage in the bidding process, bid evaluation, contracting or implementation process related to the contract.
- 12 The BPC will, during the bidding stage, treat all bidders alike, and will provide to all bidders the same information and will not provide any such information to any particular bidder which could afford an advantage to that particular bidder in comparison to the other bidders.
  - 13 All the officials of the BPC will report the appropriate Government office any attempted or completed breaches of the above commitments as well as any substantial suspicion of such a breach.
  - 2 In case of any such preceding misconduct on the part of such official(s) is reported by the Bidder to the BPC with the full and verifiable facts and the same is *prima facie* found to be correct by the BPC, necessary disciplinary proceedings, or any other action as deemed fit, including criminal proceedings may be initiated by the BPC and such a person shall be debarred from further dealings related to the bidding process. In such a case while an enquiry is being conducted by the BPC the proceedings under the bidding process would not be stalled.

#### **Commitments of Bidder**

- 3 The Bidder commits itself to take all measures necessary to prevent corrupt practices, unfair means and illegal activities during any stage of its bid or during any pre award stage in order to emerge as Selected Bidder or in furtherance to secure it and in particular commits itself to the following: -
  - 31 The Bidder will not offer, directly or through intermediaries, any bribe, gift, consideration, reward, favour, any material or immaterial benefit or other advantage, commission, fees, brokerage or inducement to any official of the BPC, connected directly or indirectly with the bidding process, or to any person, organization or third party related to the bidding process in exchange for any advantage in the bidding, evaluation, contracting and implementation of the bidding process.
  - 32 The Bidder further undertakes that it has not given, offered or promised to give, directly or indirectly any bribe, gift, consideration, reward, favour, any material or immaterial benefit or other advantage, commission, fees, brokerage or inducement to any official of the BPC or otherwise in bidding process or for bearing to do or having done any act in relation to bidding process or any other contract with the Government for showing or forbearing to show favour or disfavour to any person in relation to the bidding process or any other contract with the Government.
  - 33 The Bidder shall disclose the name and address of agents and representatives and Indian Bidder shall disclose their foreign principals or associates.



- 34 The Bidder shall disclose the payments to be made by them to agents/brokers or any other intermediary, in connection with this bid.
- 35 The Bidder further confirms and declares to the BPC that the Bidder has not engaged any individual or firm or company whether Indian or foreign to intercede, facilitate or in any way to recommend to the BPC or any of its functionaries, whether officially or unofficially for selection of Bidder as TSP, nor has any amount been paid, promised or intended to be paid to any such individual, firm or company in respect of any such intercession, facilitation or recommendation.
- 36 The Bidder, either while presenting the bid or during pre-award negotiations or before signing the Share Purchase Agreement, shall disclose any payments he has made, is committed to or intends to make to officials of the BPC or their family members, agents, brokers or any other intermediaries in connection with the bidding process and the details of services agreed upon for such payments.
- 37 The Bidder will not collude with other parties interested in the bidding process to impair the transparency, fairness and progress of the bidding process.
- 38 The Bidder will not accept any advantage in exchange for any corrupt practice, unfair means and illegal activities.
- 39 The Bidder shall not use improperly, for purpose of competition or personal gain, or pass on to others, any information provided by the BPC as part of the business relationship, regarding plans, technical proposal and business details, including information contained in any electronic data carrier. The Bidder also undertakes to exercise due and adequate care lest any such information is divulged.
- 310 The Bidder commits to refrain from giving any complaint directly or through any other manner without supporting it with full and verifiable facts.
- 311 The Bidder shall not instigate or cause to instigate any third person to commit any of the actions mentioned above.
- 312 The Bidder shall not lend to or borrow any money from or enter into any monetary dealings or transactions, directly or indirectly, with any employee of the BPC.

#### 4 Previous Transgression

- 41 The Bidder declares that no previous transgression occurred in the last three years immediately before signing of this Integrity Pact, with any other company in any country in respect of any corrupt practices envisaged hereunder or with any Public Sector Enterprise in India or any Government Department in India that could justify Bidder's exclusion from the bidding process.



42 The Bidder agrees that if it makes incorrect statement on this subject, Bidder can be disqualified from the tender process or the contract, if already awarded, can be terminated for such reason.

5 **Bid Bond (Security Deposit)**

51 Along with the technical bid, the Bidder shall submit Bid Bond for an amount of **Rs. 17.60 Crore (Rupees Seventeen Crore Sixty Lakh Only)** issued by any Banks from the list provided in RFP Document] as Earnest Money/Security Deposit, with the BPC.

52 The Earnest Money/Security Deposit shall be valid & retained by the BPC for such period as specified in the RFP Document.

53 No interest shall be payable by the BPC to the Bidder on Earnest Money/Security Deposit for the period of its currency.

6 **Sanctions for Violations**

61 Any breach of the aforesaid provisions by the Bidder or any one employed by it or acting on its behalf (whether with or without the knowledge of the Bidder) shall entitle the BPC to take all or anyone of the following actions, wherever required:-

- (i) To immediately call off the pre-award negotiations without assigning any reason or giving any compensation to the Bidder. However, the proceedings with the other Bidder (s) would continue.
- (ii) The Bid Bond (in pre-award stage) shall stand forfeited either fully or partially, as decided by the BPC and the BPC shall not be required to assign any reason therefore.
- (iii) To immediately cancel the award, if already awarded, without giving any compensation to the Bidder.
- (iv) To cancel all or any other contracts with the Bidder. The Bidder shall be liable to pay compensation for any loss or damage to the BPC resulting from such cancellation/rescission.-
- (v) To debar the Bidder from participation in any tender or RFP issued by any BPC for an indefinite period.
- (vi) To recover all sums paid in violation of this Pact by Bidder to any middleman or agent or broker with a view to securing the award.

62 The BPC will be entitled to take all or any of the actions mentioned at para 6.1 (i) to (vi) of



this Pact also on the Commission by the Bidder or anyone employed by it or acting on its behalf (whether with or without the knowledge of the Bidder), of an offence as defined in Chapter IX of the Indian Penal code, 1860 or Prevention of Corruption Act, 1988 or any other statute enacted for prevention of corruption.

- 63 The decision of the BPC to the effect that a breach of the provisions of this Pact has been committed by the Bidder shall be final and conclusive on the Bidder. However, the Bidder can approach the Independent Monitor(s) appointed for the purposes of this Pact.

**7. Independent Monitors**

- 71 The BPC has appointed Independent Monitors (hereinafter referred to as Monitors) for this Pact in consultation with the Central Vigilance Commission.

**Shri Sanjiv Garg IRTS (Retd.)**

A-14/1, Vasant Vihar, New Delhi-110057

Mob No – 9818798390

Email ID- sanjivgarg.india@gmail.com

**Shri Jeyakodi Virusankulam Kumarasamy, IAS (Retd.)**

R/o 3F, Orchid Villa, 6" Avenue,

Harrington Road, Chetpet,

Chennai-600031.

Mob No – 9176699444

Email ID- jeyakodivk@gmail.com

- 72 The task of the Monitors shall be to review independently and objectively, whether and to what extent the parties comply with the obligations under this Pact.
- 73 The Monitors shall not be subject to instructions by the representatives of the parties and perform their functions neutrally and independently.
- 74 Both the parties accept that the Monitors have the right to access all the documents relating to the project/procurement, including minutes of meetings.
- 75 As soon as the Monitor notices, or has reason to believe, a violation of this Pact, he will so inform the Authority designated by the BPC.
- 76 The Bidder accepts that the Monitors has the right to access without restriction to all Project documentation of the BPC including that provided by the Bidder. The Monitor shall be under contractual obligation to treat the information and documents of the Bidder /Subcontractors(s) with confidentiality. [As all the bid documents are with BPC only]
- 77 The BPC will provide to the Monitors sufficient information about all meetings among the parties related to the Project provided such meetings could have an impact on the contractual relations between the parties. The parties will offer to the monitor the option to participate in such meetings.



78 The Monitor will submit a written report to the designated Authority of the BPC/Secretary in the Department within 8 to 10 weeks from the date of reference or intimation to him by the BPC / Bidder and, should the occasion arise, submit proposals for correcting problematic situations.

**8 Facilitation of Investigation**

In case of any allegation of violation of any provisions of this Pact or payment of commission, the BPC or its agencies shall be entitled to examine all the documents including the Books of Accounts of the Bidder and the Bidder shall provide necessary information and documents in English and shall extend all possible help for the purpose of such examination.

**9 Law and Place of Jurisdiction**

This Pact is subject to Indian Law. The place of performance and jurisdiction is the seat of the BPC.

**10 Other Legal Actions**

The actions stipulated in this Integrity Pact are without prejudice to any other legal action that may follow in accordance with the provisions of the any extent law in force relating to any civil or criminal proceedings.

**11 Validity**

111 The validity of this Integrity Pact shall be from date of its signing and up to 6 months from the date of transfer of project specific SPV i.e., signing of Share Purchase Agreement with BPC. In case Bidder is unsuccessful, this Integrity Pact shall expire after 15 days from the date of transfer of project specific SPV to successful bidder.

112 Should one or several provisions of this Pact turn out to be invalid, the remainder of this Pact shall remain valid. In this case, the parties will strive to come to an agreement to their original intentions.

12 The Parties hereby sign this Integrity Pact at \_\_\_\_\_ on



ANNEXURE-C

**LOCATION DETAILS OF EXISTING / PROPOSED SUBSTATIONS**

- a) **765/400 kV Raghnesda (GIS):** New substation which is to be implemented under present scheme.
- b) **765/400 kV Banaskantha S/s:** 24° 8'25.74"N, 71°59'54.58"E

*Note: The above coordinates/location of substation indicated is approximate in the substation area. Exact coordinates for the corresponding bays/gantry for termination of the respective line may be verified & finalized in coordination with actual site.*



**SPECIFIC TECHNICAL REQUIREMENTS FOR TRANSMISSION LINE**

The design, routing and construction of transmission lines shall be in accordance with Chapter V, Part A of CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022, as amended from time to time. Other CEA Regulations/ guidelines as amended up to date and Ministry of Power (MoP) guidelines, as applicable, shall also be followed.

- A.1.0 Selection of tower type shall be made as per CEA Regulations, however, in case lattice type towers are used, the following shall also be applicable:
- A.2.0 Steel section of grade E 250 and/or grade E 350 as per IS 2062, only are permitted for use in towers, extensions, gantry structures and stub setting templates. For towers in snowbound areas, steel sections shall conform to Grade-C of IS-2062.
- A.3.0 Towers shall be designed as per IS-802:2015, however the drag coefficient of the tower shall be as follows: -

Solidity Ratio	Drag Coefficient
Up to 0.05	3.6
0.1	3.4
0.2	2.9
0.3	2.5
0.4	2.2
0.5 and above	2.0

- A.4.0 Transmission Service Provider (TSP) shall adopt any additional loading/ design criteria for ensuring reliability of the line, if so desired and /or deemed necessary.
- A.5.0 Transmission line shall be designed considering wind zones as specified in wind map given in National Building Code 2016, Vol.1. The developer shall also make his own assessment of local wind conditions and frequent occurrences of High Intensity Winds (HIW) due to thunderstorms, dust storms, downburst etc. along the line route and wherever required, higher wind zone than that given in wind map shall be considered for tower design for ensuring reliability of line. Further, for transmission line sections passing within a distance of 50 km from the boundary of two wind zones, higher of the two wind zones shall be considered for design of towers located in such sections.
- A.6.0 Selection of reliability level for design of tower shall be as per CEA Regulation (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022, as amended from time to time.
- A.7.0 A) In case of construction of transmission line of Voltage level of 400 kV and above, under crossing of the existing transmission line shall not be allowed. In the case where it is inevitable to under-cross the existing transmission line then TSP shall seek prior approval from Chief Electrical Inspector, CEA with detailed study ensuring that all statutory electrical clearances and Electric Field limit of 10 kV/m at 1 m and 1.8 m from ground level is not violated.  
B) For power line crossing of 400 kV or above voltage level, large angle and dead end towers (i.e. D/DD/QD) shall be used on either side of power line crossing.



C) For power line crossing of 132 kV and 220 kV (or 230 kV) voltage level, angle towers (B/C/D/DB/DC/DD/ QB/QC/QD) shall be used on either side of power line crossing depending upon the merit of the prevailing site condition and line deviation requirement.

D) For power line crossing of 66 kV and below voltage level, suspension/tension towers shall be provided on either side of power line crossing depending upon the merit of the prevailing site condition and line deviation requirement.

E) For crossing of railways, national highways and state highways, the rules/ regulations of appropriate authorities shall be followed.

A.8.0 The relevant conductor configuration shall be as follows: -

i. Raghnesda (GIS) – Banaskantha (PG) 765 kV D/C line

Type of conductor: ACSR / AAAC / AL59

Basic Parameters:

Transmission line	ACSR Conductor specified	Equivalent AAAC conductor based on 53.5% conductivity of Al Alloy	Equivalent minimum size of AL59 conductor based on 59% conductivity of AL Alloy*	Sub-conductor Spacing
765 kV D/C (Hexa Bundle) Transmission Lines	<b>Zebra : Stranding</b> 54/3.18 mm-Al + 7/3.18 mm-Steel, 428 mm <sup>2</sup> , Aluminium area,  28.62 mm diameter  Maximum DC Resistance at 20°C (Ω/km): 0.06868 Minimum UTS: 130.32 kN	<b>Stranding details:</b> 61/3.19 mm,  487.5 mm <sup>2</sup> Aluminium alloy area 28.71 mm diameter  Maximum DC Resistance at 20°C (Ω/km): 0.06815 Minimum UTS: 135.6 kN	<b>Stranding details:</b> 61/3.08 mm,  454 mm <sup>2</sup> Aluminium alloy area 27.72 mm diameter  Maximum DC Resistance at 20°C (Ω/km): 0.0653 Minimum UTS: 108 kN	457 mm

Note:

- \*To select any size above the minimum, the sizes mentioned in the Indian standard IS-398 (part-6) shall be followed.
- The transmission lines shall have to be designed for a maximum operating conductor temperature of 85 OC.

A.9.0 The required phase to phase spacing and horizontal spacing for 765 kV line shall be governed by the tower design as well as minimum live metal clearances for 765 kV voltage level under different insulator swing angles. However, the phase to phase spacing for 765 kV line shall not be less than 15 m.



A.10.0 All electrical clearances including minimum live metal clearance, ground clearance and minimum mid span separation between earth wire and conductor as given below shall be considered:

I. Minimum live metal clearances for 765 kV line:

- a) (i) Under stationary conditions  
From tower body: For 765 kV D/C: 6.1 m  
For 765 kV S/C: 5.6 m

(ii) Under swing conditions

Wind Pressure Condition	Minimum Electrical Clearance
a) Swing angle (25°)	4.4 m
b) Swing angle (55°)	1.3 m

- b) Minimum ground clearance for 765 kV line: 18 m  
c) Minimum mid span separation between earth-wire and conductor for 765 kV line: 9.0 m

A.11.0 Shielding angle shall not exceed 10 deg for 765 kV D/C transmission line.

A.12.0 The Fault current for design of line shall be 50 kA for 1 sec for 765 kV.

A.13.0 In case of 400 kV and above voltage class lines, at least one out of two earth wires shall be OPGW and second earth wire, if not OPGW, shall be either of Galvanized Stranded Steel (GSS) or Aluminum Alloy Conductor Steel Reinforced (AACSR) conductor type or any other suitable conductor type depending upon span length and other technical consideration.

A.14.0 Each tower shall be earthed such that tower footing impedance does not exceed 10 ohms. Pipe type or Counterpoise type earthing shall be provided in accordance with relevant IS. Additional earthing shall be provided on every 7 to 8 km distance for direct earthing of both shield wires. If site condition demands, multiple earthing or use of earthing enhancement compound shall be used.

A.15.0 Pile type foundation shall be used for towers located in river or creek bed or on bank of river having scourable strata or in areas where river flow or change in river course is anticipated, based on detailed soil investigation and previous years' maximum flood discharge of the river, maximum velocity of water, highest flood level, scour depth and anticipated change in course of river based on river morphology data of at least past 20 years to ensure availability and reliability of the transmission line.

A.16.0 Transmission line route shall be finalized, in consultation with appropriate authorities so as to avoid the habitant zones of endangered species and other protected species. Bird diverters, wherever required, shall be provided on the transmission line. In order to optimize the route, use of GATISHAKTI platform shall also be made.

A.17.0 Wherever, the transmission lines are passing through cyclone prone areas i.e., areas up to 60 km from coast following shall also be applicable:

- a) Terrain category-I, with terrain roughness factor (K2) of 1.08 shall be considered for



tower design for exposed open terrain with few or no obstruction, which also includes open sea coasts, open stretch of water, desert and flat treeless plains.

- b) Importance factor for cyclonic region (K4) of 1.3 shall be considered for tower design.
- c) The number of consecutive spans between the section points/angle point shall not exceed 10 spans or 3 km instead of conventional practice of 15 spans or 5 km, in order to reduce the failure of such towers in coastal areas due to cascading effect. The section shall be terminated with tension tower/ angle tower and angle of deviation should be based on the site requirement.

A.18.0 Wherever, transmission lines are passing through cyclone prone areas (i.e. areas up to 60 km from coast)/ creek regions/ aggressive soil areas following shall also be applicable:

- a) The fabricated tower parts and stubs shall have a minimum overall zinc coating of 900 g/m<sup>2</sup> of surface area except for plates and sections below 5 mm which shall have a minimum overall zinc coating of 610 g/m<sup>2</sup> of surface area. The average zinc coating for all sections and plates 5 mm and above shall be maintained as 127 microns and that for plates and sections below 5 mm shall be maintained as 87 microns.
- b) Ready mix concrete of M30 Grade shall be used to avoid use of locally available saline water. However, design mix concrete of M30 Grade conforming to IS 456 with potable water can be used at locations where transportation of ready-mix concrete is not feasible. Minimum cement content in any case shall not be less than 330 kg/m<sup>3</sup>.
- c) The surface of the reinforced steel shall be treated with epoxy-based coating to enhance corrosion performance of foundation. Use of epoxy coated reinforcement in foundation shall be as per IS 13620. In addition, two (2) coats of bituminous painting of minimum 1.6 kg/m<sup>2</sup> per coat shall be applied on all exposed faces of foundation (i.e. pedestal and base slab).
- d) Double coat 20 mm thick cement plaster shall be provided on all exposed concrete surface as well up to 300 mm below ground level to give protection to concrete surface from environmental and saline effect.
- e) Before coping of chimney top portion, three coats of anti-corrosive paint of minimum 30-35 microns dry film thickness each shall be applied on the stub in the 50 mm coping portion as well as up to 350 mm above CL portion.

A.19.0 The raised chimney foundation is to be provided in areas prone to flooding/water stagnation like paddy field /agricultural field and undulated areas to avoid direct contact of water with steel part of tower. The top of the chimney of foundation should be at least above HFL (High Flood Level) or the historical water stagnation/ logging level (based on locally available data) or above High Tide Level or 500 mm above Natural Ground level (whichever is higher).

A.20.0 Routing of transmission line through protected areas of India shall be avoided to the extent possible. In case, it is not possible to avoid protected areas, the towers of the transmission line up to 400 kV level, which are installed in protected areas shall be designed for Multi-circuit (4 circuits) configuration of same voltage level considering reliability level of at least two (2). The top two circuits of these multi-circuit towers shall be used for stringing of the transmission line under present scope and the bottom two circuits shall be made available



for stringing of any future transmission line of any transmission service providers/ State transmission utilities/Central transmission utilities passing through the same protected area. Further, the configuration and coordinates of such transmission towers shall be submitted to CEA, CTU and BPC by the TSP.

- A.21.0 The TSP shall abide by the Guidelines of CEA w.r.t. shifting of transmission lines for NHAI projects and other projects.
- A.22.0 Safety precautions in regards to gas/oil pipelines in vicinity of Transmission lines shall be taken in coordination with gas/ petroleum authorities.
- A.23.0 The stringing of the transmission line in forest area shall be carried out through drone.
- A.24.0 The tower shall be designed considering the porcelain Insulators with creepage factor of 31 mm/ kV irrespective of type of insulator used.
- A.25.0 RoW width and Span in different terrain shall be as per Schedule VII of CEA (Technical Standards for Construction of Electrical plants and Electric Lines) Regulations 2022 and RoW guidelines issued vide CEA-PS-14-86/2/2019-PSETD Division dated 24.09.2024.



**SPECIFIC TECHNICAL REQUIREMENTS FOR SUBSTATION**

The proposed 765/400 kV Raghnesda S/s shall be Gas Insulated Switchgear (GIS) type conforming to the requirements of CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022, as amended from time to time.

The extension of 765/400 kV Banaskantha S/s shall be conventional Air Insulated Switchgear (AIS) type conforming to the requirements of CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations, 2022, as amended from time to time.

Other CEA Regulations/guidelines as amended up to date and MoP guidelines, as applicable, shall also be followed.

**B.1.0 Salient features of Substation Equipment and Facilities**

The design and specification of substation equipment are to be governed by the following factors:

**B.1.1 Insulation Coordination**

The system design parameters for substations/switchyards shall be as given below:

Sl. No.	Description of parameters	765/400 kV Raghnesda S/s (GIS)			765/400 kV Banaskantha S/s Extn.
		765 kV System	400 kV System	220 kV System	765 kV System
1.	System operating voltage	765 kV	400 kV	220 kV	765 kV
2.	Maximum voltage of the system (rms)	800 kV	420 kV	245 kV	800 kV
3.	Rated frequency	50 Hz	50 Hz	50 Hz	50 Hz
4.	No. of phases	3	3	3	3
5.	Rated Insulation levels				
i)	Lightning Impulse withstand voltage for (1.2/50 micro sec.)				
	- for Equipment other than Transformer and reactor	2100 kVp	1425 kVp	1050 kVp	2100 kVp
	- for Insulator String	2100 kVp	1550 kVp	1050 kVp	2100 kVp
ii)	Switching impulse withstand voltage (250/2500 micro sec.) dry and wet	1425 kVp (for GIS) 1550 kVp (for AIS)	1050 kVp	-	1550 kVp
iii)	One minute power frequency dry withstand voltage (rms)	960 kV (for GIS) 830 kV	650 kV (for GIS) 630 kV	-	830 kV



Sl. No.	Description of parameters	765/400 kV Raghnesda S/s (GIS)			765/400 kV Banaskantha S/s Extn.
		765 kV System (for AIS)	400 kV System (for AIS)	220 kV System	765 kV System
iv)	One minute power frequency dry and wet withstand voltage (rms)	-	-	460 kV	-
6.	Corona extinction voltage	508 kV	320 kV	-	508 kV
7.	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz	2500 micro-volt at 508 kV rms	1000 micro-volt at 266 kV rms	1000 micro-volts at 156 kV rms	2500 micro-volts at 508 kV rms
8.	Minimum creepage distance for insulator string/ longrod insulators/ outdoor bushings	24800 mm (31 mm/kV)	13020 mm (31 mm/kV)	7595 mm (31mm/kV)	24800 mm (31 mm/kV)
9.	Minimum creepage distance for switchyard equipment	24800 mm (31 mm/ kV)	13020 mm (31 mm/ kV)	7595 mm (31 mm/kV)	20000 mm (25 mm/kV)
10.	Max. fault current	50 kA	63 kA	50 kA	50 kA
11.	Duration of fault	1 sec	1 sec	1 Sec	1 sec

#### B.1.2 Switching Scheme

The switching schemes, as mentioned below, shall be adopted at various voltage levels of substation/switchyard:

Substation	765 kV side	400 kV side	220 kV side
765/400 kV Raghnesda S/s (GIS)	One and Half Breaker	One and Half Breaker	Double Main Scheme
765/400 kV Banaskantha S/s Extn.	One and Half Breaker	--	--

Notes: -

- i) For one and half breaker switching scheme, any double circuit line consisting of two numbers of feeders and originating from the same transmission or generating switchyard shall not be terminated in one diameter.
- ii) Two transformers of the same HV rating shall not be connected in the same diameter and similarly two bus reactors of same HV rating shall also not be connected in the same diameter.
- iii) A diameter in one and half breaker scheme is a set of 3 circuit breakers with associated isolators, earth switches, current transformers etc. for controlling two (2) numbers of feeders.
- iv) In case of GIS substation where the bus scheme is One and Half breaker scheme, the



diameters shall be complete with feeder/ line side isolator and GIS duct of the future bay shall be brought outside the GIS hall/building with extension/interface module suitably.

v) Connection arrangement of Switchable Line reactors shall be such that it can be used as Line reactor as well as Bus reactor with suitable NGR bypass arrangement. Further, Spare 1-phase Shunt Reactor unit shall be placed and connected in such a way that the spare unit can be utilized for all the bus and switchable line reactor banks (including future reactor banks) without its physical movement.

vi) Space provision for 765 kV and 400 kV future lines shall be kept considering switchable Line reactor for the lines.

vii) Space Provision for Future Bus sectionalizer:

One (1) set of future bus sectionalizer for 765 kV shall comprise two (2) Nos. of bus sectionalizer bays with associated Circuit Breakers, Isolators and Current Transformers for both buses.

One (1) set of future bus sectionalizer for 400 kV shall comprise two (2) Nos. of bus sectionalizer bays with associated Circuit Breakers, Isolators and Current Transformers for both buses.

One (1) set of future bus sectionalizer for 220 kV shall comprise two (2) Nos. of bus sectionalizer bays with associated Circuit Breakers, Isolators and Current Transformers for both buses.

viii) TSP shall plan distribution of line and transformer feeders to bus bar in such a way that all power can be evacuated successfully without crossing thermal limit at any point of bus-bar.

ix) 765/400 kV Raghnesda S/s (GIS)

In line with the above, four (4) Nos. full diameters for 765 kV and six (6) Nos. full diameters for 400 kV shall be provided. Further, 400 kV and 220 kV Line bays shall be complete along with line side equipment (such as LA, CVT, Wave Trap), gantry, protection panel etc. for termination of 400 kV and 220 kV lines for interconnection of RE Projects.

x) 765/400 kV Raghnesda S/s (GIS)

Provision of 765 kV Bus Sectionalization (Future) and space provision shall be with the following feeder distribution.

765 kV Bus Section-1	765 kV Bus Section-2 (Future)
a) 2 Nos. of present 765 kV Line	a) 4 Nos. of future 765 kV line along with switchable line reactor
b) 4 Nos. of present 765/400 kV ICT	b) 4 Nos. of future 765/400 kV ICT
c) 2 Nos. of present 765 kV Bus Reactor	c) 2 Nos. of future 765 kV Bus Reactor
d) 4 Nos. of future 765 kV line along with switchable line reactor	

Provision of 400 kV Bus Sectionalization (Future) and space provision shall be with the following feeder distribution.



400 kV Bus Section-1	400 kV Bus Section-2 (Future)
a) 4 Nos. of present 765/400 kV ICT b) 2 No. of present Bus Reactor c) 4 Nos. of present 400 kV Lines d) 2 Nos. of present 400/220 kV ICT e) 4 Nos. of future 400 kV Line along with switchable line reactor f) 2 Nos. of future 400/220 kV ICT g) 2 Nos. for future interconnection of (2x1500 MW) for 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC]	a) 4 Nos. of future 765/400 kV ICT b) 4 Nos. of future 400/220 kV ICT c) 8 Nos. of future 400 kV Line along with switchable line reactor d) 2 Nos. of future 400 kV Bus Reactor e) 2 Nos. for future interconnection of (2x1500 MW) for 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC]

Provision of 220 kV Bus Sectionalization (Future) and space provision shall be with the following feeder distribution.

220 kV Bus Section-1	220 kV Bus Section-2 (Future)
a) 2 Nos. of present 400/220 kV ICT b) 2 Nos. of present 220 kV Line c) 1 No. of present Bus coupler d) 2 Nos. of future 400/220 kV ICT e) 4 Nos. of future 220 kV Line	a) 4 Nos. of future 400/220 kV ICT b) 6 Nos. of future 220 kV Line c) 1 No. of future Bus coupler

xi) **765 kV Banaskantha Extn:**

Refer attached SLD (Drg. No. C/ENGG/WR-II/BANASKANTHA/SLD/1) and GA drawing (GNB-PGCIL-BNK-ELE-003) of Banaskantha S/s. One circuit of Radhanesda – Banaskantha (PG) 765 kV D/C line shall be terminated in new diameter for which Main and Tie bays shall be constructed under present scope. Other circuit of Radhanesda – Banaskantha (PG) 765 kV D/C line shall be terminated in existing diameter for which Main Bay shall be constructed (Tie bay is existing) under present scope. Further, all associated interconnection work shall also be in the present scope of TSP.

B.2.0 **Substation Equipment and facilities (Voltage level as applicable):**

The switchgear shall be designed and specified to withstand operating conditions and duty requirements. All equipment shall be designed considering the following capacity.

Sl. No	Description of bay	765/400 kV Raghnesda S/s (GIS)			765 kV Banaskantha S/s (AIS)
		765 kV	400 kV	220 kV	765 kV
1.	Bus Bar	4000 A	4000 A	3000 A	As per existing



Sl. No	Description of bay	765/400 kV Raghnesda S/s (GIS)			765 kV Banaskantha S/s (AIS)
		765 kV	400 kV	220 kV	765 kV
2.	Line bay	3150 A	3150 A	1600 A	3150 A
3.	ICT bay	3150 A	3150 A	1600 A	N/A
4.	Reactor bay	3150 A	3150 A	N/A	N/A
5.	Bus Coupler Bay	N/A	N/A	3000 A	N/A

### B.2.1 Power Transformers

#### B.2.1.1 (765/√3)/(400/√3)/33 kV Single Phase Autotransformer

500 MVA 765/√3)/(400/√3)/33 kV, 1-phase Autotransformer (including arrangement for 3-phase bank formation of 1500 MVA) shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA website.

Spare transformer (1-phase) unit shall be placed and connected in such a way that in case of fault in any unit of any of the transformer banks (including for future transformer banks) can be replaced by spare unit without physically moving it.

#### B.2.1.2 400/220/33 kV, 3-phase Autotransformer

500 MVA, 400/220/33 kV, 3-phase autotransformer shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA website.

### B.2.2 Shunt Reactors

#### B.2.2.1 (765/√3) kV Single Phase Shunt Reactor

110 MVA, 765/√3 kV, 1-Phase Reactor (including arrangement for 3-phase bank formation of 330 MVA) shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA website.

Spare 1-phase Shunt Reactor unit shall be placed and connected in such a way that the spare unit can be utilized for all the bus and switchable line reactor banks (including for future reactor banks) without its physical movement.

#### B.2.2.2 420 kV, 3-Phase, Shunt Reactor

125 MVA, 420 kV, 3-Phase Reactor shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA website.



### B.2.3 765 kV, 400 kV and 220 kV GIS Substation equipment

GIS (Gas Insulated Switchgear) shall be Indoor type in accordance to IEC: 62271-203. The switchgear shall be designed and specified to withstand operating conditions and duty requirements. All the switchgear such as Circuit Breaker, isolator, earth switch including CT, PT etc. shall be GIS type. The Surge Arrestor and Voltage Transformer shall be either GIS or outdoor AIS type.

The GIS assembly shall consist of separate modular compartments e.g. Circuit Breaker compartment, Bus bar compartment filled with SF6 Gas and separated by gas tight partitions so as to minimize risk to human life, allow ease of maintenance and limit the effects of gas leaks failures and internal arcs etc. These compartments shall be designed to minimize the risk of damage to adjacent sections and protection of personnel in the event of a failure occurring within the compartments. Rupture diaphragms with suitable deflectors shall be provided to prevent uncontrolled bursting pressures developing within the enclosures under worst operating conditions, thus providing controlled pressure relief in the affected compartment. The arrangement of gas sections or compartments shall be such as to facilitate future extension of any make without any drilling, cutting or welding on the existing equipment. To add equipment, it shall not be necessary to move or dislocate the existing switchgear bays. The layout of Gas Insulated Bus Ducts shall be properly planned to optimize the length of bus ducts and for easy accessibility for maintenance. The length of busbars, bus ducts, isolator sections shall be optimized considering effects of fast transient voltage due to isolator operations.

The bus bar modules including auxiliary bus modules (wherever applicable) shall be provided with suitable End Piece (Interface) module on both sides with the test link facility for future extension as per provisions of future requirements. The end piece module shall be designed in such a way so that future GIS modules may be tested without extending test voltage to existing bus and vice-versa by removing the test link.

TSP shall make available the complete details for the design of interface module such as cross section, enclosure material, enclosure dimensions (inner and outer), Flange diameter (inner and outer), conductor cross-section and connection arrangement, bolt spacing and dimension, rated gas pressure, Gasket detail etc. Further, adequate space for GIS busbar interface module shall be taken into account for future scope.

Each section shall have plug-in or easily removable connection pieces to allow for easy replacement of any component with the minimum disturbance to the remainder of the equipment. Inspection windows (View Ports) shall be provided for Disconnect Switches and both type of earth switches i.e. Maintenance and fast operating.

Local Control Cabinets (LCC) shall be provided as per requirement. The alarm and annunciation of GIS equipment shall be wired to the SCADA System.

The material and thickness of the enclosures shall be such as to withstand an internal flashover without burns through for a period of 300 ms at rated short time withstand current. The material shall be such that it has no effect of environment as well as from the by-products of SF6 breakdown under arcing conditions. This shall be validated with Type Test.

**Service continuity requirement for GIS:**



The GIS equipment with the given bus switching arrangement shall be divided into different gas compartments. During the work such as a fault repair or major maintenance, requiring the dismantling of a gas compartment for which more than one compartments may need to be de-gassed.

TSP shall meet following Service continuity conditions (to the extent possible) with ensuring equipment and operating personnel's safety:

- For One and half breaker bus switching scheme, during a fault in Circuit Breaker compartment, no bus bar and feeder is permitted out of service during maintenance and repair/replacement.
- During a fault in a GIS compartment other than the Circuit Breaker compartment, maximum of one bus bar and/or one feeder is permitted out of service during maintenance and repair/replacement.

**UHF sensors in GIS for PD (Partial Discharge) detection:**

The adequate number of Ultra High Frequency (UHF) sensors shall be provided in the offered GIS along with suitable portable type Partial Discharge (PD) measuring instrument for detection of Partial discharge (of 5 pC and above as per IEC 60270). The number and location of these sensors shall be based on laboratory tests on the typical design of GIS as per recommendations of CIGRE Document No. 654 (Application Guide for sensitivity verification for UHF Partial discharge detection system for GIS).

**B.2.3.1 Circuit Breakers (GIS)**

GIS Circuit breakers shall in general be of C2-M2 class and comply to IEC-62271-100. The rated break time shall not exceed 40 ms (milli second) for 765 kV and 400 kV. The rated break time shall not exceed 60 ms for 220 kV. Circuit breakers shall be suitable for single phase and three phase auto reclosing. Each breaker would have two sets of trip circuits which would be connected to separate DC supplies for greater reliability. The Circuit breakers controlling 765 kV lines shall be provided with pre-insertion closing resistor of about 450 ohms with 9 ms insertion time or Controlled Switching Device (CSD). The Circuit breakers controlling 400 kV lines wherever required shall be provided with pre-insertion closing resistor of about 400 ohms with 8 ms insertion time or Controlled Switching Device (CSD) for lines longer than 200 km. The short line fault capacity shall be the same as the rated capacity and this is proposed to be achieved without use of opening resistors. Controlled switching device shall be provided in the Circuit Breaker of the switchable line reactor bay and in Main and Tie bay circuit breakers of line with non-switchable line reactors, Bus reactors and Transformers for 400 kV and above voltage class.

**B.2.3.2 Isolators (GIS)**

The isolators shall comply to IEC 62271-102 in general. Earth switches shall be provided at various locations to facilitate maintenance. Main blades and earth blades shall be interlocked and interlock shall be fail safe type. All isolators and earth switches shall be motor operated type.

The isolator shall be of extended mechanical endurance class-M2 and suitable for Bus Transfer Current Switching duty as per IEC standards. High speed earthing switches shall be provided for grounding purposes at overhead line terminations and cable terminations and shall have fault



making capability as specified. Earth switch for line isolator shall be of earthing switch class E1 and shall be suitable for induced current switching duty as defined for Class-B as per relevant standard.

#### **B.2.3.3 Current Transformers (GIS)**

Current Transformers shall comply with IEC 61869 in general. All ratios shall be obtained by secondary taps only. Generally, Current Transformers (CT) shall have five cores (four for protection and one for metering) whereas; CT in Tie bays shall have six cores (four for protections and two for metering) suitably distributed on both sides of CB (for 400 kV and above voltage class). 220 kV Current Transformers shall have five cores (four for protection and one for metering). The burden and knee point voltage shall be in accordance with the requirements of the system including possible feeds for telemetry. The accuracy class for protection core shall be PX and for the metering core it shall be 0.2S. The rated burden of cores shall be closer to the maximum burden requirement of metering and protection system (not more than 20 VA for metering core) for better sensitivity and accuracy.

The instrument security factor shall be less than 5 for CTs up to 400 kV voltage class and less than 10 for CTs of 765 kV voltage class.

#### **B.2.3.4 Voltage Transformer (GIS)**

The voltage transformers shall conform to IEC-61869. Voltage transformers shall be of electromagnetic type with SF6 gas insulation. The earth end of the high voltage winding and the ends of the secondary winding shall be brought out in the terminal box. The voltage transformers shall be located as a separate bay module and will be connected phase to ground and shall be used for protection, metering and synchronization. The voltage transformers shall be of inductive type, nonresistant and shall be contained in their own-SF6 compartment, separated from other parts of installation. The voltage transformer shall be effectively shielded against high frequency electromagnetic transients. The voltage transformer shall have three secondary windings out of which two shall be used for protection and one for metering. The voltage transformer should be thermally and dielectrically safe when the secondary terminals are loaded with the guaranteed thermal burdens. The accuracy class for protection cores shall be 3P. The accuracy of 0.2 on metering core should be maintained throughout the entire burden range on all the three windings without any adjustments during operation. The rated burden of cores shall be closer to the maximum burden requirement of metering and protection system (not more than 50 VA for metering core) for better sensitivity and accuracy.

#### **B.2.3.5 Surge Arresters (GIS) (if applicable)**

624 kV Station High (SH) duty, 336 kV Station High (SH) and 216 kV Station Medium (SM) duty gapless type Surge arresters with thermal energy (Wth) of minimum 13 kJ/ kV , 12 kJ/ kV and 7 kJ/kV respectively shall be provided for 800 kV ,420 kV and 245 kV system respectively conforming to IEC 60099-4 in general. Other characteristics of Surge arrester shall be chosen in accordance with system requirements. Surge arresters shall be provided at line entrances, near transformers and reactors so as to achieve proper insulation coordination. A leakage current monitor with surge counter shall be provided with each surge arrester.



#### B.2.3.6 SF<sub>6</sub> to Air Bushing

Outdoor bushings, for the connection of conventional external conductors to the SF<sub>6</sub> metal enclosed switchgear, shall be provided. Bushings shall generally be in accordance with the requirements of IEC-60137. The creepage distance over the external surface of outdoor bushings shall not be less than 31 mm/ kV. SF<sub>6</sub> to air Bushing shall be of Polymer/ composite type and shall be robust and designed for adequate cantilever strength to meet the requirement of seismic conditions. The electrical and mechanical characteristics of bushings shall be in accordance with IEC-60137. Polymer/composite insulator shall be seamless sheath of silicon rubber compound. The housing and weather sheds should have silicon content of minimum 30% by weight. It should protect the bushing against environmental influences, external pollution and humidity. The hollow silicon composite insulators shall comply with the requirements of IEC 61462 and the relevant parts of IEC-62217.

#### B.2.4 765 kV, 400 kV and 220 kV AIS Substation equipment (as applicable)

##### B.2.4.1 Circuit Breakers (AIS)

The circuit breakers and accessories shall conform to IEC: 62271-100, IEC: 62271-1 and shall be of SF<sub>6</sub> Type. The circuit breakers shall be of class C2-M2 (as per IEC) with regard to restriking probability during capacitive current breaking and mechanical endurance. The rated break time shall not exceed 40 ms for 765 kV circuit breakers. The 765 kV circuit breakers shall be provided with single phase and three phase auto reclosing. Each breaker would have two sets of trip circuits, which would be connected to separate DC supplies for greater reliability. The circuit breakers controlling 765 kV lines shall be provided with pre-insertion closing resistor of about 450 ohm maximum with 9 ms insertion time or Controlled Switching Device. The short line fault capacity shall be same as the rated capacity and this is proposed to achieve without use of opening resistors. The controlled switching device shall be provided in circuit breakers of switchable line reactor bay and in Main and Tie bay circuit breakers of line with non-switchable line reactors, Bus Reactors and Transformers of voltage class 400 kV and above.

##### B.2.4.2 Isolators (AIS)

The isolators shall comply with IEC 62271-102 in general. 765 kV isolator design shall be double break or vertical break or knee-type. All isolators and earth switches shall be motor operated. Earth switches shall be provided at various locations to facilitate maintenance. Isolator shall be of extended mechanical endurance class – M2 as per IEC-62271-102. Main blades and earth blades shall be interlocked and interlock shall be fail safe type. The 765 kV earth switch for line isolator shall be suitable for induced current switching duty as defined for Class-B.

##### B.2.4.3 Current Transformers (AIS)

Current Transformers shall comply with IEC 61869 in general. All ratios shall be obtained by secondary taps only. Generally, Current Transformers (CT) for 765 kV shall have six cores (four for protection and two for metering). The burden and knee point voltage shall be in accordance with the requirements of the system including possible feeds for telemetry. The



accuracy class for the protection core shall be PX and for the metering core it shall be 0.2S. The rated burden of cores shall be closer to the maximum burden requirement of the metering and protection system (not more than 20 VA for metering core) for better sensitivity and accuracy. The instrument security factor shall be less than ten (10) for CTs of 765 kV voltage class.

#### **B.2.4.4 Capacitive Voltage Transformers (AIS)**

Capacitive Voltage transformers shall comply with IEC 61869 in general. These shall have three secondaries out of which two shall be used for protection and one for metering. The accuracy class for protection cores shall be 3P and for metering core it shall be 0.2. The Capacitive Voltage Transformers on lines shall be suitable for Carrier Coupling. The Capacitance of CVT for 765 kV shall be 8800 pF. The Capacitance of CVT for 400 kV and 220 kV shall be of 4400/ 8800 pF depending on PLCC requirements. The rated burden of cores shall be closer to the maximum burden requirement of metering and protection system (not more than 50 VA for metering core) for better sensitivity and accuracy.

#### **B.2.4.5 Surge Arresters (AIS)**

624 kV Station High (SH) duty, 336 kV Station High (SH) duty and 216 kV Station Medium (SM) duty gapless type Surge arresters with thermal energy (Wth) of minimum 13 kJ/kV , 12 kJ/kV and 7 kJ/kV respectively shall be provided for 800 kV , 420 kV and 220 kV system respectively conforming to IEC 60099-4 in general. Other characteristics of Surge arrester shall be chosen in accordance with system requirements. Surge arresters shall be provided at line entrances, near Transformers and Reactors so as to achieve proper insulation coordination. Surge Arresters shall be provided with porcelain/ polymer housing fitted with pressure relief devices. A leakage current monitor with surge counter shall be provided with each surge arrester.

#### **B.2.5 Protection Relaying and Control System**

The protective relaying system proposed to be provided for transmission lines, auto-transformers, reactors and bus bars to minimize the damage to the equipment in the events of faults and abnormal conditions, is dealt in this section. All main protective relays shall be numerical type with IEC 61850 communication interface and should have interoperability during integration of numerical relays to communicate over IEC61850 protocol with RTU/SAS/IEDs of different OEMs. All numerical relays shall have built in disturbance recording feature.

The protection circuits and relays of transformer and reactor shall be electrically and physically segregated into two groups each being independent and capable of providing uninterrupted protection even in the event of one of the protection groups failing, to obtain redundancy, and to take protection systems out for maintenance while the equipment remains in service.

##### **a) Transmission Lines Protection**

765 kV, 400 kV and 220 kV lines shall have Main-I numerical three zone distance protection scheme with carrier aided inter-tripping feature. 765 kV, 400 kV and 220 kV lines shall also have Main-II numerical distance protection scheme like Main-I but from different make that of Main-I. The Main-I and Main-II protection relays of same make may be provided only if they are of



different hardware and manufacturing platform or different principle of operation.

However, Line Current Differential relay (with back up distance protection feature) as Main-I and Main-II shall be considered at both ends for short lines (line length below 30 km) having Fibre Optic Communication Link. Differential relay at remote end shall be provided by the TSP. Associated power and control cabling and integration with SAS at remote end shall be provided by respective bay owners.

In case of 220 kV line bays for RE Generators, Line Current differential relay (with back up distance protection feature) as Main-I and Main-II shall be provided. Further, in such cases, the matching line current differential relay for remote end shall be provided by the TSP as loose supply.

In case of loop in loop out of transmission lines, the existing protection scheme shall be studied and suitable up-gradation (if required) shall be carried out.

Further, all 765 kV, 400 kV and 220 kV lines shall be provided with single and three phase auto-reclosing facility to allow reclosing of circuit breakers in case of transient faults. These lines shall also be provided with distance to fault locators to identify the location of fault on transmission lines.

All 765 kV, 400 kV and 220 kV lines shall also be provided with two stages over voltage protection. Over voltage protection and distance to fault locator may be provided as in-built feature of Main-I and Main-II protection relays. Auto reclose as built-in function of Bay Control Unit (BCU) is also acceptable.

The Main-I and Main-II protection relays shall be fed from separate DC sources and shall be mounted in separate panels.

For 765 kV, 400 kV and 220 kV transmission lines, directional IDMT earth fault relay should be provided as standalone unit or in-built feature of Main-I and Main -II feature.

#### **b) Auto Transformer Protection**

These shall have the following protections:

- i) Numerical Differential protection
- ii) Numerical Restricted earth fault protection
- iii) Numerical Back-up Over-current and earth fault protection on High Voltage (HV) and Intermediate Voltage (IV) side
- iv) Numerical Over fluxing protection on HV and IV side
- v) Numerical Overload alarm

Further, Numerical Back-up Over-current and earth fault protection on HV and IV side of autotransformer shall not be combined with other protective functions in the main relays and shall be independent relays. Besides these, power transformers shall also be provided with Buchholz relay, Magnetic oil Gauge (MOG) with low oil level alarm, protection against high oil and winding temperature and pressure relief device etc.

Suitable monitoring, control (operation of associated circuit breaker and isolator) and protection for LT auxiliary transformer connected to tertiary winding of auto-transformer for the purpose



of auxiliary supply shall be provided. The over current and other necessary protection shall be provided for the auxiliary transformer. These protection and control may be provided as built in feature either in the bay controller to be provided for the auxiliary system or in the control and protection IEDs to be provided for autotransformer.

**c) 765 kV and 400 kV Reactor Protection**

Reactor shall be provided with the following protections:

- i) Numerical Differential protection.
- ii) Numerical Restricted earth fault protection
- iii) Numerical Back-up impedance protection

Besides these, reactors shall also be provided with Buchholz relay, Magnetic Oil Gauge (MOG) with low oil level alarm, protection against oil and winding temperatures and pressure relief device, etc.

**d) Bus bar Protection**

The high speed low impedance type bus bar differential protection, which is essential to minimize the damage and maintain system stability at the time of bus bar faults, shall be provided for 765 kV, 400 kV and 220 kV. Duplicated bus bar protection is envisaged for 765 kV and 400 kV bus-bar protection. Bus bar protection scheme shall be such that it operates selectively for each bus and incorporate necessary features required for ensuring security. The scheme shall have complete bus bar protection for present as well as envisaged future bays i.e. input / output modules for future bays shall also be provided.

Bus Bar protection system for new substation shall be de-centralized (distributed) type.

The scheme shall have complete bus bar protection for present as well as envisaged future bays i.e. input / output modules for future bays for the bus sections under present scope and PUs shall be provided by the respective bay owners.

In case, the bus section is provided, then each side of bus section shall have separate set of bus bar protection schemes.

For existing substations, the existing bus bar protection shall be augmented as per requirement.

**e) Local Breaker Back up Protection**

This shall be provided for each 765 kV , 400 kV and 220 kV circuit breakers and will be connected to de-energize the affected stuck breaker from both sides.

Notes:

1. LBB and REF relays shall be provided separately from transformer differential relay.
2. LBB relay may also be provided as built-in protection function of distributed bus bar protection scheme; however in such case separate LBB relay shall be provided for tie bays (in case of One and Half breaker scheme).



3. Over fluxing and overload protection can be provided as built-in feature of differential relay.
4. In 765 kV and 400 kV switchyard, if spare bay of half diameter is identified as future, Tie CB relay panel shall be with Auto-reclosure feature.

#### B.2.6 Substation Automation System

- a) For all the new substations, state of art Substation Automation System (SAS) conforming to IEC-61850 shall be provided. The distributed architecture shall be used for Substation Automation system, where the controls shall be provided through Bay control units. The Bay control unit is to be provided bay wise for voltage level 220 kV and above. All bay control units as well as protection units are normally connected through an Optical fibre high speed network. The control and monitoring of circuit breaker, dis-connector, re-setting of relays etc. can be done from Human Machine Interface (HMI) from the Relay Control Room.

The functions of control, annunciation, disturbance recording, event logging and measurement of electrical parameters shall be integrated in Substation Automation System.

At new substations, the Substation Automation System (SAS) shall be suitable for operation and monitoring of the complete substation including proposed future bays/elements.

In existing substations with Substation automation system (SAS), augmentation of existing SAS shall be done for bays under present scope.

In existing Substations where Substation automation is not provided, control functions shall be done through control panels.

Necessary gateway and modems (as required) shall be provided to send data to RLDC/SLDC as per their requirement and shall be provisioned with 2+2 redundancy i.e. 2 channels for Main Control Centre and 2 channels for Backup Control Centre. In order to meet this requirement, suitable redundancy at port and card level need to be ensured by the TSP to avoid any single point of failure which may lead to interruption in real-time grid operation. Accordingly, all the hardware for communication services of station as stated above shall support dual redundancy for data transmission of station to respective main and backup RLDCs. Any augmentation work at RLDC/SLDC is excluded from TSP's scope. However, all the configuration work at substation end required to send data to RLDC/SLDC shall be in the scope of TSP.

- b) **Time synchronization equipment**

Time synchronization equipment complete in all respect including antenna, cable, processing equipment required to receive time signal through GPS or from National Physical Laboratory (NPL) through INSAT shall be provided at new substations. This equipment shall be used to synchronize SAS and IEDs etc.



### B.3.0 Substation Support facilities

Certain facilities required for operation and maintenance of substations as described below shall be provided at new substation. In existing substation, these facilities have already been provided and shall be extended/ augmented as per requirement.

### B.3.1 AC and DC power supplies

For catering the requirements of three phase and single phase AC supply and DC supply for various substation equipment (for present and future scope), the following arrangement is envisaged:-

- (i) For LT Supply at each new Substation, two (2) Nos. of LT Transformers (minimum 800 kVA for substations with highest voltage rating as 765 kV) shall be provided which shall be fed from two independent sources as per CEA (Technical Standards for Connectivity to the Grid) Regulations, 2007.

Metering arrangement with Special Energy Meters (SEMs) shall be provided by TSP at 33 kV tertiary of 765/400 kV Transformer for drawing auxiliary supply at new substation. Such SEMs shall be provided by CTU at the cost of the TSP. Accounting of such energy drawn by the TSP shall be done by RLDC/RPC as part of Regional Energy Accounting.

Additionally, Active Energy Meters may be provided at the same point in the 33 kV tertiary of 765/400/33 kV Transformer by local SEB/DISCOM for energy accounting.

- (ii) 2 sets of 220 V battery banks for control and protection and 2 sets of 48 V battery banks for PLCC/ communication equipment shall be provided at each new Substation. Each battery bank shall have a float-cum-boost charger.

At new substation, sizing of 220 V battery and battery charger shall be done based on the number of bays specified (including future bays) as per CEA Regulations and relevant IS. 2 sets of 48 V battery banks for PLCC and communication equipment for present and future scope shall be provided at each new Substation with at least 10-hour battery backup and extended backup, if required. 48 V DC can be achieved from 220 V DC battery bank using adapter, if so desired by TSP, without compromising backup time.

- (iii) Suitable AC and DC distribution boards and associated LT Switchgear shall be provided at new substation.

- (iv) For new substation, following switch boards shall be considered with duplicate supply with bus coupler/ sectionalizer and duplicate outgoing feeders except for Emergency lighting distribution board which shall have only one incoming feeder:

- (a) 415 V Main Switch board – 1 No.
- (b) AC distribution board – 1 No.
- (c) Main lighting distribution board – 1 No.



- (d) Emergency lighting distribution board – 1 No.
- (e) 220 Volt DC distribution board – 2 Nos.
- (f) 48 Volt DC distribution board – 2 Nos.

Sizing of LT Switchgear shall be suitable to cater the requirement for all present and future bays. AC and DC distribution boards shall have modules for all the feeders (including future as specified).

- (v) At new Substation, one No. of DG set (minimum 500 kVA for substations with highest voltage rating as 765 kV) shall be provided for emergency applications.
- (vi) At new substation, sizing of battery and battery chargers shall be done based on the number of bays specified (including future bays).
- (vii) For substation extensions, existing facilities shall be augmented as required.

#### B.3.2 Fire Fighting System

Fire-fighting system for substation including transformer and reactor shall conform to CEA (Measures Relating to Safety and Electric Supply) Regulations, 2023 as amendment time to time.

Further, adequate water hydrants and portable fire extinguishers shall be provided in the substations. The main header of firefighting system shall be suitable for extension to bays covered under the future scope; necessary piping interface in this regard shall be provided.

Optical Beam type heat detection for GIS hall fire protection system shall be provided for all the GIS halls.

At existing substations, the fire-fighting systems, as available, shall be augmented/ extended to meet the additional requirements.

#### B.3.3 Oil Evacuating, Filtering, Testing and Filling apparatus

To monitor the quality of oil for satisfactory performance of transformers, shunt reactors and for periodical maintenance necessary oil evacuating, filtering, testing and filling apparatus would be provided at new substations. Oil storage tanks of adequate capacities for storage of transformer oil would be provided.

Online Transformer Oil Drying Out System shall be provided in line with the provisions of Standard Specification and Technical Parameters for Transformers and Reactors (66 kV and above Voltage Class) as amended up to date available on CEA website.

#### B.3.4 Illumination

Normal and emergency AC and DC illumination shall be provided adequately in the control room and other buildings of the substation. The switchyard shall also be provided with adequate illumination.



Lighting of the entire control room building, fire-fighting pump house, other building (if any) and switchyard shall be done by LED based low power consumption luminaries.

#### B.3.5 Control Room

For new substation, substation control room shall be provided to house substation work stations for station level control (SAS) along with its peripheral and recording equipment, AC and DC distribution boards, DC batteries and associated battery chargers, Fire Protection panels, Telecommunication panels and other panels as per requirements. Air conditioning shall be provided in the building as functional requirements. Main cable trenches from the control room shall have adequate space provision for laying of cables from control room for all the future bays also. **As the GIS hall shall be extendable on both sides, Control Room building shall be separate from the GIS hall building.**

At existing substations, the adequacy of size of control room shall be ascertained and the same shall be augmented as per requirement.

#### B.3.6 GIS hall

The Gas Insulated Switchgear (GIS) of each voltage level along with other associated equipment shall be housed inside separate GIS building. The panels i.e. Bay level units, bay mimic, relay and protection panels, RTCC panels, PLCC panels, panels for tele-communication system etc. are to be placed in a separate room in the GIS building. The size of the room shall be such that all the panels for the bays under present scope shall be accommodated. The panel room shall be air-conditioned. Further, the temperature of the room shall be monitored through substation automation system by providing necessary temperature transducers. Ventilation system of suitable capacity shall be provided for each GIS hall.

One EOT Crane of suitable capacity for erection and maintenance of largest GIS component/assembly and all plant installed in the GIS switchgear room shall be provided in each GIS hall. The crane shall be capable of fulfilling all special requirements for erection and maintenance of GIS equipment. The capacity of the crane shall be sized to lift the heaviest GIS switchgear component.

For extension of existing GIS, existing facilities shall be suitably augmented/ extended for GIS equipment under present scope.

#### B.3.7 Control Concept

All the EHV circuit breakers in substation/switching stations shall be controlled and synchronized from the switchyard control room/remote control center. All the isolators shall have control from remote/local whereas the earth switches shall have local control only.

#### B.3.8 Visual Monitoring System (VMS) for watch and ward of substation premises:

Visual monitoring system for effective watch and ward of substation premises shall cover all the transformers and reactors, all other major AIS Equipment (such as CB, isolators, CT, CVT, SA etc. as applicable), GIS bays, panel room, all the gates of switchyard and all entry and exit points of control room building and accordingly the location of cameras shall be decided. In addition to



the gates of the switchyard, the cameras shall also be located around the boundaries at suitable locations. The camera shall be high-definition color CCD camera with night vision feature. The VMS data partly/completely shall be recorded (minimum for 15 days) at least @25fps (or better) and stored on network video recorder. The system shall use video signals from various cameras installed at different locations, process them for viewing on workstations/monitors in the control room and simultaneously record all the cameras. The VMS data should go only to the intended personnel/facility and not to the remote server of the Camera (VMS supplier).

Mouse/keyboard controllers shall be used for pan, tilt, zoom and other functions of the desired camera. The Visual Monitoring System shall have provision of WAN connectivity for remote monitoring.

All camera recordings shall have Camera ID and location/area of recording as well as date/time stamp. The equipment should generally conform to Electromagnetic compatibility requirement for outdoor equipment in EHV substation.

At existing substations, the Visual Monitoring System if available shall be augmented as per existing or better specification as required.

#### B.4 General Facilities

- a) Line Gantry/Towers are envisaged for bays under present scope only. However, for adjacent future line bay, tower shall be designed for extension (considering Hexa conductors for 765 kV and Quad conductors for 400 kV future lines and Twin conductor for 220 kV future lines) wherever applicable.
- b) Bay extension works at existing substation shall be executed by TSP in accordance with the requirement/provisions mentioned above. However, interface points shall be considered keeping in view the existing design/arrangement at the substation.
- c) TSP has to arrange for construction power and water on its own.
- d) All outdoor steel structures including anchor/foundation bolts shall be fully galvanized. The weight of the zinc coating shall be at least 610 g/m<sup>2</sup>. However, for coastal/creek regions it shall be at least 900 g/m<sup>2</sup>.
- e) In 765 kV and 400 kV switchyard, if spare bay of half diameter is identified as future, all the equipment for Tie and Future Bay shall be designed considering the current rating of line bay i.e. 3150 A.
- f) Boundary wall shall be brick masonry wall with RCC frame or Stone masonry wall or Precast RCC wall under present scope along the property line of complete substation area including future switchyard area to prevent encroachment and unauthorized access. Minimum height of the boundary wall shall be of 1.8 m from finished ground level (FGL).



- g) All electrical equipment shall be installed above Highest Flood Level (HFL) and where such equipment is not possible to be installed above Highest Flood Level, it shall be ensured that there is no seepage or leakage or logging of water.
- h) As per CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022/CEA Manual on Transmissions Planning criteria 2023, line approaching substation shall normally be perpendicular to the substation boundary for a stretch of 2-3 km. Accordingly, TSP shall ensure that line terminations at substations are arranged in a manner to avoid hindrance to future line terminations at the substations.

#### B.5 EXTENSION OF EXISTING SUBSTATION

The following drawings/details of existing substation is attached with the RFP documents for further engineering by the bidder.

Sl. No.	Drawing Title	Drawing No./Details	Rev. No.
<b>A.</b>	<b>765/400 kV Banaskantha S/s</b>		
1.0	Single Line Diagram	C/ENGG/WR-II/BANASKANTHA/SLD/1	-
2.0	General Arrangement	C/ENGG/WR-II/ BANASKANTHA/GA/1	-
3.0	Earthmat Layout	TR202135-1001587-SS1623-EMAT-LAYOUT	R2
4.0	Visual Monitoring System	TB-384-510-018	R1
5.0	Bus Bar Protection	Make: NR Model: PCS 915	-
6.0	Substation Automation System (SAS)	Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)	R2

Note: Bidder is advised to visit the substation sites and acquaint themselves with the topography, infrastructure such as requirement of roads, cable trench, drainage, space availability in control rooms and LT panel room etc. and also the design philosophy.



### SPECIFIC TECHNICAL REQUIREMENTS FOR COMMUNICATION

The communication requirement shall be in accordance to CEA (Technical Standards for Communication System in Power System Operations) Regulations, 2020, CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations, 2022, CERC (Communication System for inter-State transmission of electricity) Regulations, 2017, and CEA (Cyber Security in Power Sector) Guidelines, 2021, all above documents as amended from time to time.

The complete ISTS communication system commissioned by TSP under the RFP shall be the asset of ISTS and shall be available for usage of ISTS requirements as suggested by CTU from time to time.

The communication services viz. SCADA, VoIP, PMU, AGC and AMR (wherever applicable) have been identified as critical services and therefore shall be provisioned with 2+2 redundancy i.e. 2 channels for Main Control Centre and 2 channels for Backup Control Centre. In order to meet this requirement, suitable redundancy at port and card level need to be ensured by the TSP to avoid any single point of failure which may lead to interruption in real-time grid operation.

PMU to PDC communication (wherever required) shall be through 2 channels to the PDC (main) as there is no backup PDC at present.

Accordingly, all the hardware for communication services of station as stated above shall support dual redundancy for data transmission of station to respective main and backup RLDCs.

In order to meet the requirement for grid management and operation of substations, Transmission Service Provider (TSP) shall provide the following:

#### **C.1.0 Establishment 3x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVar, 765 kV bus reactor and 2x125 MVar, 420 kV bus reactor**

- (I) TSP shall supply, install and commission One or more Nos. of FODP (288F or higher) alongwith panel and required Approach Cables (48/24F) with all associated hardware fittings from gantry tower to Control Room for all the incoming lines envisaged under the present scope.
- (II) TSP shall supply, install and commission One or more STM-16 (FOTE) equipment alongwith panel/s supporting minimum Nine (9) directions with MSP (Multiplex Section Protection – 1+1). These directions shall exclude protected (1+1) local patching among equipment (if any). Communication Equipment shall be provided with necessary interfaces to meet the voice and data communication requirement among Banaskantha (PG), Raghnesda GIS, M/s Azure Power Sixty Three Pvt. Ltd., M/s Sunsure Solarpark RJ One Pvt. Ltd. and upcoming RE generation S/s. The suitable DC Power Supply and backup to be provided for communication equipment.



- (III) FODP and FOTE equipment with panels shall be provided in Control Room of Raghnesda GIS S/s. FOTE and FODP Eq can be accommodated in same panel to optimize space.
- (IV) The new communication equipment under the present scope shall be compatible for integration with existing regional level centralized NMS. The local configuration of the new communication equipment shall be the responsibility of TSP. The configuration work in the existing centralized NMS for integration of new Communication equipment shall be done by Regional ULDC Team, however all the necessary support in this regard shall be ensured by TSP.
- (V) TSP shall supply, install and commission Firewall in redundant mode (1+1) in line with the specification attached at Annexure F.1.
- (VI) The maintenance of all the communication equipment and software thereof including FOTE, FODP, approach cable, PMU, DCPS alongwith Battery Bank and Firewall shall be the responsibility of TSP.

**C.2.0 Raghnesda (GIS) – Banaskantha (PG) 765 kV D/C line**

- (I) On Raghnesda (GIS) – Banaskantha (PG) 765 kV D/C line, TSP shall supply, install and commission One (1) No. OPGW cable containing 48 Fibres (48F) on one E/W peak and conventional earth wire on other E/W peak.
- (II) The TSP shall install this OPGW from gantry of Raghnesda GIS up to the gantry of Banaskantha (PG) with all associated hardware including Vibration Dampers, mid-way and gantry Joint Boxes (called OPGW Hardware hereafter) and finally terminate in Joint Boxes at end Substations. The transmission line length is 95 kms (approx.) where repeater is not required to meet link budget requirement of Raghnesda (GIS) – Banaskantha (PG) link.
- (III) Maintenance of OPGW Cable, and OPGW Hardware shall be the responsibility of TSP.

**C.3.0 2 Nos. 765 kV line bays at Banaskantha (PG) S/s**

- (I) TSP shall supply, install and commission One or more Nos. of FODP (144F or higher) alongwith panel and required Approach Cables (48F) with all associated hardware fittings from gantry tower to Bay Kiosk and from the Bay Kiosk to Control room.
- (II) TSP shall supply, install and commission One STM-16 (FOTE) equipment alongwith panel/s supporting minimum three (3) directions with MSP (Multiplex Section Protection – 1+1) with necessary interfaces to meet the voice and data communication requirement between Raghnesda GIS and Banaskantha (PG) S/s. The suitable DC Power Supply and backup to be provided for communication equipment.
- (III) FOTE/FODP panel shall be installed in the new Bay Kiosk/ Switchyard Panel Room (SPR). The FOTE under present scope shall be integrated by TSP with the existing FOTE at control room of Banaskantha (PG) S/s which shall be communicating with respective



control center. TSP to provide necessary FODP sub rack / Splice trays/ Patch cords etc. and optical interfaces/equipment in the existing FOTE/FODP panels in control room for integration with the existing FOTE for onwards data transmission.

In case spare optical direction is not available in the existing FOTE at the control room, the TSP shall coordinate with station owner to reconfigure the directions in existing FOTE at control room. Alternatively, The TSP may integrate the FOTE under the present scope with existing FOTE in the nearby Kiosk connected to the control room FOTE (if available with spare direction). For this purpose, TSP shall provide necessary FODP sub rack / Splice trays/ Patch cords etc. and suitable optical interfaces/ equipment in the existing FOTE/FODP panels in another Kiosk (SPR).

FOTE and FODP can be accommodated in same panel to optimize space.

The new communication equipment under the present scope shall be compatible for integration with existing regional level centralized NMS. The local configuration of the new communication equipment shall be the responsibility of TSP. The configuration work in the existing centralized NMS for integration of new Communication equipment shall be done by Regional ULDC Team, however all the necessary support in this regard shall be ensured by TSP.

The maintenance of all the communication equipment and software thereof including FOTE, PMU, FODP, approach cable, DCPS along with Battery Bank shall be the responsibility of TSP.

#### **C.4.0 Specific Requirement for Phasor Measurement Units (PMUs)**

TSP shall supply, install and commission required No. of Phasor Measurement Units (PMUs) PMUs at all the locations under the scope of TSP under this RFP as per CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations, 2022 (alongwith all amendments if any), and all the applicable Regulations, Standards, Guidelines issued time to time. The signal list shall be as per the Annexure-I Part-B of CERC Guidelines on "Interface Requirements" 2024. These PMUs shall be provided with GPS clock and LAN switch and shall connect with LAN switch of control room of respective substations/ generating stations with Fibre Optic cable. These PMUs shall be connected with the FOTE at Substation/ generating stations for onwards data transmission to the PDC (Phasor Data Concentrator) located at respective RLDC. Configuration work in existing PDC at RLDC for new PMU integration shall be done by respective RLDC, however all the necessary support in this regard shall be ensured by TSP. The maintenance of all the PMUs and associated equipment shall be the responsibility of TSP.

Note: Existing Station owner/s to provide necessary support to integrate different equipment and applications of new extended bays with the existing substation e.g. Communication (through FOTE), Voice etc. for smooth operation and monitoring of new added grid elements.



Proposed Communication for Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I

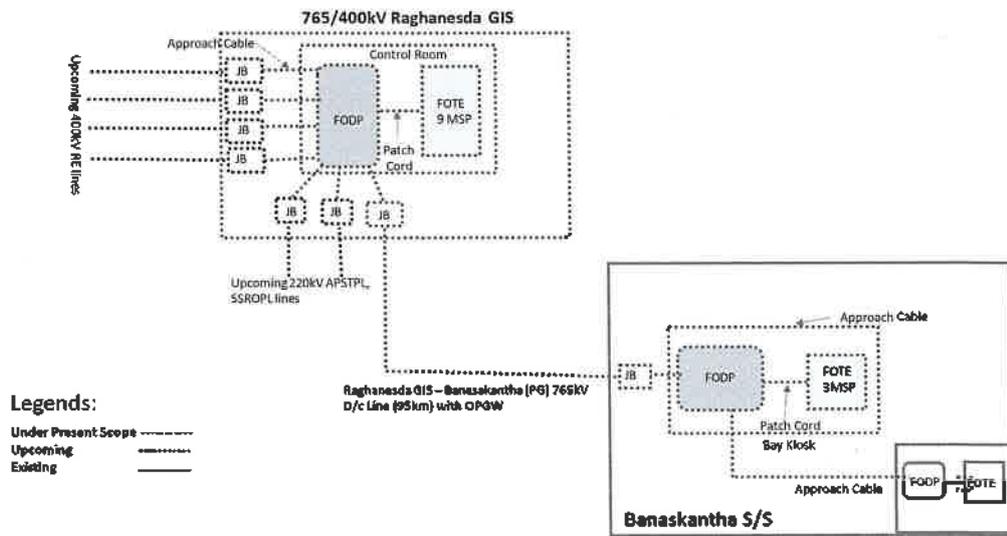


Figure F.1



247

**Next Generation Firewall (NGFW)**

TSP shall provide 2 NGFW one in Main and another in Standby mode having electrical ethernet interfaces/ports and placed between FOTE and SAS gateway/s at the substation. All ethernet based applications shall be terminated in the firewall ports directly (e.g. PMU, AMR, VOIP, SAS/SCADA etc.). Each port of firewall shall work as a separate zone. Firewall shall be hardware based with features of Block/Allow/drop and IPSec VPN (network encryption).

The number of ports/interfaces in each firewall (i.e. Main and Standby) shall be minimum 16 Nos. TSP shall provide either single firewall or multiple firewalls to meet this interfaces requirement, each for main as well as standby firewall. Minimum throughput of firewall shall be 300 Mbps.

The Firewall shall be managed/ configured as standalone at present and shall also have compatibility to manage/configure through Centralized Management Console (CMC) remotely in future.

Firewall shall be tested and certified for ISO15408 Common Criteria for least EAL4+.

Further, the OEM must certify that it conforms to Secure Product Development Life Cycle requirements as per IEC62443-4-1. The firewall shall generate reports for NERC-CIP Compliance.

The specifications for the firewalls are given at Annexure-F.2 and schematic diagram showing firewall placement given at Figure F.2.



**Specifications of Next Generation Firewall (NGFW)**

1. NGFW shall have following features including but not limited to:  
Encryption through IPSec VPN (Virtual Private Network), Deep Packet Inspection (DPI), Denial of service (DoS) and Distributed Denial of Service (DDoS) prevention, Port Block/ Allow, rules/policies for block/allow, IP (Internet Protocol) and Media Access Control (MAC) spoofing protection, threat detection, Intrusion Prevention System (IPS), Anti-Virus, Anti-Spyware, Man In The Middle (MITM) attack prevention.
2. The proposed firewall shall be able to handle (alert, block or allow) unknown /unidentified applications e.g. unknown TCP and UDP packets. It shall have the provision to define application control list based on application group and/or list.
3. Firewall shall have feature and also have capability to update the definition/ Signatures of Anti-Virus online as well as offline. Firewall shall also be compatible to update the definitions/signatures through CMC. There shall be a defined process for security patching and firmware up-gradation. There shall be a feature to field validate firmware checksum. The same shall also be validated before using the OEM provided file/binary in the process of firmware up-gradation and security patching
4. Firewall shall have Management Console port to configure remotely.
5. Firewall shall be EMI/EMC compliant in Substation environment as per IEC 61850-3.
6. Firewall shall be rack mounted in existing standard equipment cabinets.
7. Firewall shall have support of SCADA applications (IEC-60870-5-104), ICCP, PMU (IEEE C37.118), Sub-Station Automation System (IEC 61850), Ethernet and other substation environment protocols.
8. Client based Encryption/ VPN must support different Operating System platforms e.g. Windows, Linux and Mac.
9. The solution must have content and comprehensive file detection policies, blocking the files as function of their types, protocols and directions.
10. Firewall shall have logging facility as per standard logs/events format. Firewall shall have features to export the generated/stored logs/events in csv (Comma Separated Value) and also any other standard formats for offline usage, analysis and compliance. Firewall shall have suitable memory architecture and solution to store and be enable to export all logs/events for a period of last 90 days at any given time.



11. Firewall shall have features and be compatible with local as well as central authentication system (RADIUS, LDAP, or TACACS+) for user account and access right management. It shall also have Role Based User management feature.
12. Firewall shall have the capability to configure sufficient number of VLANs.
13. Firewall shall have the capability to support sufficient number of sessions.
14. Firewall shall have provision to configure multiple IP Sec VPNs, at least 100 Nos., (one-to-many or many-to-one). Shall support redundant operation with a similar router after creation of all the IP Sec VPN. IPsec VPN shall support encryption protocols as AES128, AES256 and hashing algorithms as MD5 and SHA1. IPsec VPN throughput shall support at least 300 Mbps
15. Firewall shall be capable of SNMP v3 for monitoring from Network Management system. It shall also have SNMPv3 encrypted authentication and access security
16. Firewall shall support in Active/Passive or Active-Active mode with High Availability features like load balancing, failover for firewall and IPsec VPN without losing the session connectivity.
17. Firewall should have integrated traffic shaping (bandwidth, allocation, prioritisation, etc.) functionality
18. Shall support simultaneous operation with both IPv4 and IPv6 traffic
19. Firewall shall be compatible with SNTP/NTP or any other standards for clock synchronization
20. Firewall shall have the features of port as well as MAC based security
21. Firewall shall support exporting of logs to a centralized log management system (e.g. syslog) for security event and information management.
22. Firewall time shall be kept synchronised to official Indian Timekeeping agency, [time.nplindia.org](http://time.nplindia.org).
23. Firewall product shall be provided with all applicable updates at least until 36 months since the applicable date of product shipping to the concerned utility.



### Firewall Placement Diagram

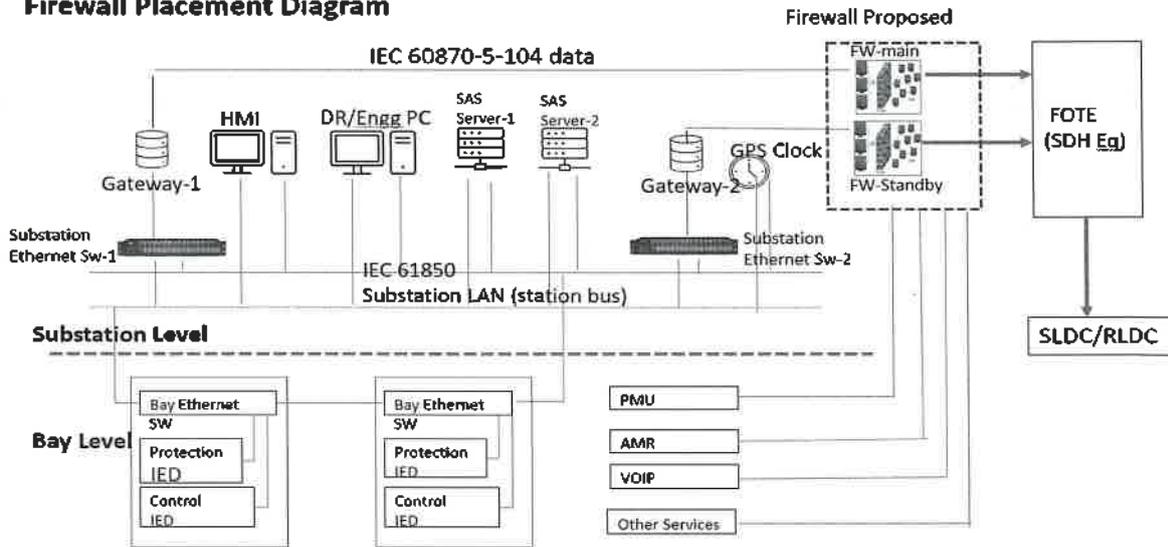


Figure F.2

251



**C.5.0 PLCC and PABX:**

Power line carrier communication (PLCC) equipment complete for speech, tele-protection commands and data channels shall be provided on each transmission line. The PLCC equipment shall in brief include the following: -

- (i) Coupling device, line traps, carrier terminals, protection couplers, HF cables, PABX (if applicable) and maintenance and testing instruments.
- (ii) At new substation, a telephone exchange (PABX) of 24 lines shall be provided as means of effective communication among various buildings of the substation, remote end substations and with control centers (RLDC/SLDC) etc.
- (iii) Coupling devices shall be suitable for phase to phase coupling for 400 kV Transmission lines. The pass band of coupling devices shall have sufficient margin for adding communication channel in future if required. Necessary protection devices for safety of personnel and low voltage part against power frequency voltages and transient over voltage shall also be provided.
- (iv) The line traps shall be broad band tuned suitable for blocking the complete range of carrier frequencies. Line Trap shall have necessary protective devices such as lightning arresters for the protection of tuning device. Decoupling network consisting of line traps and coupling capacitors may also be required at certain substation in case of extreme frequency congestion.
- (v) The carrier terminals shall be of single side-band (SSB) amplitude modulation (AM) type and shall have 4 kHz band width. PLCC Carrier terminals and Protection couplers shall be considered for both ends of the line.
- (vi) PLCC equipment for all the transmission lines covered under the scheme shall be provided by TSP. PLCC to be provided for following lines under present scope:

Sl. No	Line name	PLCC configuration
1	Raghnesda (GIS) – Banaskantha (PG) 765 kV D/C line	1 set Analog PLCC + 1 set Digital Protection Coupler for each circuit at both ends.

Further, CVT and Wave trap for all 765 kV and 400 kV line bays under present scope shall be provided by TSP.

- (vii) All other associated equipment like cabling, coupling device and HF cable shall also be provided by the TSP.
- (viii) 2 sets of 48 V battery banks for PLCC and communication equipment shall be provided at each new Substation with at least 10-hour battery backup and extended backup, if required.



**Annexure – E****SPECIFIC TECHNICAL REQUIREMENTS FOR INTEGRATION OF COMMUNICATION EQUIPMENT WITH REGIONAL LEVEL NMS / REGIONAL UNMS:**

The new communication equipment/ system for all the substations under the present scope shall be compatible for integration with existing regional level NMS system/ Centralized Supervision and Monitoring System (CSMS) i.e. Regional UNMS. The local configuration of the new communication equipment at the station end shall be the responsibility of TSP as per Annexure E.1. The configuration work in the existing centralized NMS/ CSMS at Control center end, for integration of new Communication equipment/ system shall be done by Regional ULDC Team/ NMT, however all the necessary support in this regard shall be ensured by TSP.

Annexure E.1

**Requirement for integration of Communication Equipment with Regional UNMS:**

1. TSP shall ensure that NMS/EMS/NE supplied by them is NBI compliant and all FCAPS functionality is supported in the NBI such as NE Inventory, Hardware Inventory – Shelf/Slot/Card/SFP/Port, Topology, Protections, Alarms, Performance- real time and periodic, Performance KPI parameters ( E-1, STM, Ethernet) , Remote Configuration, Cross Connects, Trails and Circuits, Services Provisioning (NE), E-1 , STM, Ethernet , TX and RS Trace, loop back and details are published in the NBI guide for the configuration parameters.
2. TSP shall be obliged to provide/share all necessary documentations such as NBI Guide/MIB/IDL/WSDL/API files/ etc. for onward integration of their NMS/EMS/NE with regional UNMS.
3. The following support shall be provided by TSP for integration of their supplied equipment with regional UNMS:
  - Enabling and activating NBI license in their EMS/NMS and providing NBI login access along with User credentials
  - Assist in verifying NBI Connectivity with UNMS vendor for the successful communication and retrieval of data.
  - Assist in troubleshooting (if required) for NBI connectivity along with UNMS vendor for the communication and retrieval of data.
4. For standalone NE which is not integrated with any EMS/NMS, TSP shall provide modality of complete FCAPS data acquisition as above through industry standard programmatic methods and provide the CLI command manual.



**Annexure-F****Frequently Asked Queries:****1.0 Transmission Line:**

- 1.1 Please clarify that whether shutdowns for crossing of existing transmission lines of POWERGRID/STUs/ Power Evacuation Lines from Generation Plants/ Any other Transmission Licensee will be given to TSP on chargeable basis or free of cost

**Reply:** Shutdowns for crossing of existing transmission lines of POWERGRID/ STUs/ Power Evacuation Lines from Generation Plants/ Any other Transmission Licensee will be given to TSP by the concerned owner of the lines as per their own terms and conditions. As far as shutdown of ISTS lines are concerned the same can be availed by approaching respective Regional Power Committee.

- 1.2 We understand that the suggested swing angle criteria are applicable for Suspension Insulator in Suspension Tower. Further, you are requested to provide similar swing angle and clearance criteria for Pilot Insulator with Jumper and Jumper.

**Reply:** It is clarified that the swing angle criteria (as mentioned in RFP) for transmission lines is applicable for Suspension Insulator in Suspension Tower. Further, as per Clause 3.0 of Specific Technical Requirements for transmission lines, Transmission service Provider (TSP) shall adopt any additional loading/design criteria for ensuring reliability of the line, if so desired and /or deemed necessary.

- 1.3 We request you to kindly allow that use of diamond configuration at Power line crossings and the existing owner of the lines may be directed to allow the same for the successful bidders.

**Reply:** Power line crossing including Diamond configuration is responsibility of the TSP. TSP shall formally submit the profile of the crossing section to the owner of the existing line suggesting proposed crossing alternatives. The crossing will have to be carried out as per approval of owner of the existing line.

- 1.4 It is requested you to kindly provide present status of Forest Clearances if any transmission line corridor area falling in wildlife forest / reserve forest/ mangroves

**Reply:** Based on the preliminary route survey, the process of initiation of forest clearance for the forest stretches, if any, enroute the proposed line alignment will be initiated by way of writing letters to the concerned authority (ies). However, it may be noted that it will be the responsibility of TSP for obtaining forest clearance for the forest stretches as provided in the survey report and also for any forest area encountered during detailed survey.

- 1.5 For transmission line, no special requirement is specified for type of Insulator and creepage in RFP document. Hence it is understood that bidder can decide the type of insulator along with creepage requirement based on general CEA regulations and relevant standards. Kindly confirm.



**Reply:** The minimum specific creepage distances shall be decided for the pollution condition in the area of installation. It shall be as per CEA regulations and relevant standards.

**2.0 Substation**

2.1 We understand that space for storage of O&M spare shall be provided by existing owner within the station boundary without any cost. Kindly confirm.

**Reply:** Space for storage of O&M spares shall be arranged by TSP on its own.

2.2 We presume that the O&M for the end Termination bays will be in the scope of the TSP and TSP shall not be liable for any payment towards O&M to the existing owner of the substation. Kindly confirm.

**Reply:** Operation and maintenance of the bays is solely responsibility of the TSP.

Further, TSP shall follow CEA's "Operation and Maintenance (O&M) guidelines and Standard Format for Memorandum of Understanding between New TSP and Existing TSP" issued by CEA vide its letter No. I/28514/2023 dated 22.06.2023. Copy of the guideline is available on CEA website at following link:

[https://cea.nic.in/wpcontent/uploads/pse\\_\\_\\_td/2023/06/om\\_guidelines.pdf](https://cea.nic.in/wpcontent/uploads/pse___td/2023/06/om_guidelines.pdf)

2.3 With reference to subject scheme of existing sub-station, we assumed following scope of work:

- (a) We assumed internal road is available and need not to consider in the present scope of work.
- (b) Drainage is available and need not to consider in the present scope of work.
- (c) Cable trench extension in adjacent to Main cable trench only under present scope of work.
- (d) Levelled area being provided by developer for bay extension.

**Reply:** Regarding requirement of internal road, drainage, cable trench, leveling of the bay extension area, bidder is advised to visit site and acquaint themselves with the provisions/facilities available at substation.

2.4 Kindly provide the soil investigation report of soil parameters of existing substation.

**Reply:** Bidder is advised to visit the substation site and ascertain the requisite parameters.

2.5 Kindly confirm, energy accounting of aux. power consumption. Whether it will be on chargeable basis or part of transmission loss.

**Reply:** It will be on chargeable basis.

2.6 We understand that VMS requirement is for unmanned stations only. For Manned



stations VMS is not compulsory.

**Reply:** VMS shall be provided in line with requirements of RfP document.

- 2.7 It is understood that Construction water and power shall be provided free of cost to TSP by respective substation owner for construction of new bays.

**Reply:** Arrangement of construction power and water is in the scope of TSP.

- 2.8 It is understood that existing fire hydrant system shall be extended by the TSP for bay extension.

**Reply:** Existing fire hydrant system shall be extended from existing system (if required)

- 2.9 Please clarify that Status of land acquisition for Substations. Whether the lands have been acquired by BPC and will be transferred to TSP.

**Reply:** The acquisition of land for substation is in the scope of TSP.

- 2.10 We understood that no any dedicated metering CT and CVT required for Line/feeders. Further, we understood that requisite Energy meters for various 765 kV, 400 kV and 220 kV Feeders shall be provided and installed by CTU free of cost to TSP.

**Reply:** Dedicated metering CT and CVT are not required for line/feeders. Metering core of existing CT/CVT can be used provided accuracy class is matching with metering requirement. Requisite Special Energy Meters shall be provided and installed by CTU at the cost of TSP in C&P panel subject to space availability, else, in separate metering panel (to be provided by TSP at its cost).


- 2.11 A draft copy of the Connection Agreement may be furnished. A draft copy of the Connection Agreement may be furnished.

**Reply:** Web page link [https://www.ctuil.in/formats\\_gna\\_transition](https://www.ctuil.in/formats_gna_transition)

- 2.12 Please clarify whether the spare 765 kV single phase Reactor unit for Bus reactor shall be provided with 1ph 765 kV CB.

**Reply:** As per RfP, the spare 1-Ph reactor unit shall be utilized for all the bus and switchable line reactor banks (including for future reactor banks). Hence, 1ph 765 kV CB shall also be provided with spare 1-Ph reactor for utilizing with bus reactor as well as switchable line reactor.

- 2.13 It is understood that existing busbar protection have provision for future bays and also PUs are available for future bays. BPC to confirm availability of CU and PU for bays under present scope of work at existing substations. BPC may kindly confirm availability of communication



ports for integrating new PUs with the existing CUs at existing substations.

**Reply:** Bus Bar Protection with Central Unit (CU) is required for new bus section as specified in RfP. Peripheral Units (PUs) shall be provided by the respective bay owner. Further, augmentation/replacement of existing CU, if required, to meet the system requirement shall also be provided for proper functioning of bus bar protection.

- 2.14 For SCADA, it is understood that necessary process I/O shall be available for future bays and accordingly license for same. BPC to confirm.

**Reply:** Necessary process I/O along with license shall be in the scope of the successful bidder.

- 2.15 No separate FF system is envisaged under the present scope of work for existing substation. BPC to confirm.

**Reply:** Existing fire-fighting systems shall be extended to meet the additional requirements under present scope.

- 2.16 PLCC for 220 kV Lines are not under the scope of TSP. BPC to Confirm. It is requested to provide Type of Coupling for 220 kV Transmission Lines under present scope.

**Reply:** PLCC for 220 kV line is in the scope of developer of the line. Inter circuit coupling for 220 kV D/C and phase to phase coupling for 220 kV S/C shall be applicable for PLCC.

- 2.17 BPC is requested to confirm the availability of space in the existing control rooms at existing substation for execution of extension work under current project.

**Reply:** Switchyard Panel Rooms are generally required for AIS type substation and relay room are required for GIS type substation. Further, if needed, control room shall be augmented as per requirement.

### 3.0 Communication

- 3.1 What are the usage of OPGW, FOTE, PMU etc. under communication requirement of RFP?

**Reply:** User shall be responsible for providing compatible equipment along with appropriate interface for uninterrupted communication with the concerned control center and shall be responsible for successful integration with the communication system provided by CTU.

Communication systems e.g. OPGW, FOTE etc. and PMU are required for grid operation through RLDC/SLDC, speech communication, tele-protection and tele-metering.

- 3.2 Is space for installation of communication panels are provided to TSP in existing Substations incase new bays are in the scope of TSP?



**Reply:** The space related issues are deliberated in the RfP itself. TSP to install FOTE/FODP panels in the new Bay Kiosk (Switchyard Panel Room (SPR)) / Bay Kiosk/ Relay Panel Room (in case of GIS S/s). Further, TSP to connect and integrate the proposed FOTE with the existing FOTE in the control room to complete communication path upto RLDC. In Case 132 kV Substation TSP shall accommodate the said panels either by extension of existing control room or other arrangements.

3.3 How is the OPGW laying done in case of LILO lines?

**Reply:** In case LILO lines are on same towers (e.g. both Line in and Line Out portion are on same towers, generally done LILO of S/C lines). Then 2x24F OPGW shall be required to install by TSP on both earthwire peak on 400 kV and 765 kV lines where two E/W peaks are available. On 220 and 132 kV lines where only one E/W peak is available TSP to install one no. 48F OPGW.

In case LILO lines are on different towers (e.g. both Line In and Line Out portion are on different towers, generally done LILO of D/C lines). Then 1x24F OPGW shall be required to install by TSP on one earthwire peak and conventional earthwire on second earthwire peak, on both Line In and Line Out portion towers of 400 kV and 765 kV lines. On 220 kV and 132 kV lines where only one E/W peak is available TSP to install one No. 24F OPGW in place of conventional earthwire.

3.4 How is the OPGW laying done in case Multi circuit Towers?

**Reply:** In case two different lines are using common multi circuit portion for some distance (originating from different stations, may be terminating on same or on different stations). Two No. 24F OPGW to be installed on both E/W peaks for common M/C portion of 765 kV and 400 kV lines.

In case 220/132 kV lines using multi circuit portion where single E/W peak is available one No. 48F may be installed for common multi circuit portion.

3.5 How PMUs are integrated for new bays at existing Substations?

**Reply:** PMU data of new bays to be provided in the ethernet port of switch at control room and thereafter to be connected with existing FOTE of existing substation to send data to PDC of RLDC by TSP. These PMUs shall be provided with GPS clock and LAN switch and shall connect with LAN switch of control room of respective substations with Fibre Optic cable.

3.6 Is Spare direction available in existing FOTE for integration with new bay kiosk FOTE

**Reply:** The FOTE under present scope shall be integrated by TSP with the existing FOTE at control room of substation for onwards data transmission.

In case spare optical direction is not available in the existing FOTE at the control room, the TSP shall coordinate with station owner to reconfigure the directions in existing FOTE at control room.

3.7 What is the distance from LILO point to proposed substation for feasibility of repeater station?

**Reply:** Tentative Location of LILO point shall be as per survey report of BPC however exact location to be ascertained after detailed survey by TSP.



- 3.8 What is the make and model of existing OPGW in case LILO of main line at new substation?  
**Reply:** All OPGW (along with optical fibers) meet Central Electricity Authority (Technical Standards for Communication System in Power System Operations) Regulations, 2020 and bidder shall install OPGW accordingly.
- 3.9 In case of LILO of existing line at new substation who shall provide PMUs at existing substation bays?  
**Reply:** TSP to provide PMUs for all bays under their scope of RFP.
- 4.0 **Planning :**
- 4.1 Whether the Project/ Elements are eligible for early commissioning incentive as per MoP, Gol order dated 15.07.2015.?  
**Reply:** Commissioning is to be done as per the timeline mentioned in RfP. However, early commissioning shall be treated as per applicable CERC Regulations/orders.



Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-1"

S. N.	Clause No. and Existing provision	Clarification required	Clarifications
1.	<p><b>RFP</b>                      "Final Offer" shall mean the Quoted Transmission Charges, required to be submitted as part of the Financial Bid on the electronic bidding platform during the reverse bidding stage. In case, no Final Offer is received during the e-reverse bidding stage then the lowest "Initial Offer" shall be deemed to be the Final Offer;</p>	<p>Presently, details of L-1 bidder are not displayed on conclusion of e-RA if there is no receipt of counterbids.                      In case, two bidders have quoted the same L1, they would be under false impression of having L1 tariff of their own and may not offer further competitive offer. In such scenario, e-RA shall end resulting in premature conclusion of e-RA process.                      It is requested to update the e-RA platform accordingly to reflect the status of L1 bidder under the above scenario.</p>	<p>The e-RA will be conducted as per SBDs and the details of the successful bidder will be intimated only after conclusion of e-Reverse Auction (e-RA) process. In e-RA, two bidders cannot have same price bid as every bid has to be necessarily less than the previous bid. In case of Initial Offer as bids are encrypted, two bidders may quote the same initial price offer. But in e-RA even if a single bid is received, two bidders cannot be at the same price offer. If the Initial Offer for two or more bidders is same and no bids are quoted in e-RA, the instant case seems to be hypothetical however in such case the decision of the competent authority shall prevail.</p>
2.	<p><b>RFP Document and TSA</b>  <b>Clause 1.5 of RFP</b>                      .... The TSP shall ensure transfer of all project assets along with substation land, right of way and clearances to CTU or its successors or an</p>	<p>Query-1                      Treatment of tax application at the end of the life of assets.                      As per section 50C of Income tax act, in case sale consideration received or</p>	<p>Definition of Project Assets is amply clear. The insurance proceeds will also be transferred by TSP.                      The TSP shall ensure transfer of all project assets along with substation land, right of way and clearances to CTUJIL or its successors or an</p>



260

**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>agency as decided by the Central Government after 35 years from COD of project at zero cost and free from any encumbrance and liability. The transfer shall be completed within 90 days after 35 years from COD of project failing which CTU shall be entitled to take over the project assets Suo moto.</p>	<p>claimed to be received by seller on sale of land or building or both is less than value adopted by stamp valuation authority (SVA), such value adopted by SVA would become actual sale consideration received or accruing to the seller. Therefore, capital gain would be Valuation as per stamp valuation authority reduced by cost/indexed cost of acquisition.</p>	<p>agency as decided by the Central Government after 35 years from COD of project at zero cost and free from any encumbrance and liability. All the expenditure till the transfer of all project assets along with substation land, right of way and clearances shall be borne by TSP. Any taxes, stamp duties and liabilities, as may be applicable, has to be borne by the TSP.</p>
<p><b>Provisions of TSA</b></p> <p>Definitions:</p>	<p>Treatment of Capital tax and applicable TDS to be clarified.</p>	
<p>"Project Assets" shall mean all physical and other assets relating to and forming part of the Project including: (a) rights over the Site for substations, ROW for transmission lines; (b) tangible &amp; intangible assets such as civil works and equipment including, foundations, embankments, pavements, electrical systems, communication systems, relief centres, administrative offices, Substations, software, tower and sub-stations designs etc; (c) project facilities situated on the Site;</p>	<p>Query-2 Modality of transfer of assets to be defined. In case only assets to be transferred then application of stamp duty &amp; other taxes and its treatment to be clarified.</p>	
	<p>Query-3</p>	

261



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>(d) all rights of the TSP under the project agreements;</p> <p>(e) financial assets, such as receivables, security deposits etc;</p> <p>(f) insurance proceeds; and</p> <p>(g) Applicable Permits and authorisations relating to or in respect of the Transmission System;"</p> <p>2.2.2 Post the Expiry Date of this Agreement, the TSP shall ensure transfer of Project Assets to CTU or its successors or an agency as decided by the State Government at zero cost and free from any encumbrance and liability. The transfer shall be completed within 90 days of expiry of this Agreement failing which CTU shall be entitled to take over the Project Assets</p> <p>Suo moto</p>	<p>Modalities for O&amp;M, other expenditure etc. for the transition period of 90 days may be confirmed.</p> <p>Availability calculation for the said period?</p> <p>Query-4</p> <p>There could be delay in receipt of payment against receivables. Further, the TSP might have some pending claims against insurance company.</p> <p>How shall TSP receive these legitimate pending claim or charges after transfer of asset to CTU?</p> <p>Query-5</p> <p>Please confirm that any taxes or charges or cost to be borne by the TSP at the transfer time including sale at value lower than fair value shall be reimbursed to the TSP.</p>
--	---	--

202



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>These costs are not known at this point of time and might be significant in amount. TSP cannot be exposed such charges.</p> <p>Query-6</p> <p>Modalities for O&amp;M, other expenditure etc. for the transition period of 90 days may be confirmed.</p>	
<p>3. <b>Clause 2.7.2 of RFP</b></p>	<p>The important timelines are mentioned in the table including shortlisting and announcement of Qualified bidder, proposed date of issuance of LoL, transfer of SPV etc.</p> <p>It is observed in the past that in case, there is extension in bid submission date, the revised timelines are not being provided regarding issuance of LoL, transfer of SPV etc.</p> <p>Further, in case of delay in shortlisting of qualified bidders, it is requested to provide the updated dates of financial bid opening and date of conduction of</p>	<p>The timelines for shortlisting of qualified bidders and subsequent conduction of e-RA shall be done as per timelines stipulated in the RFP.</p>

263



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghanesda area of Gujarat – 3 GW under Phase-I"**

	<p>e-RA etc., atleast 1 week prior to financial bid opening, to enable bidders to take appropriate action for participation in e-RA</p> <p>It is requested to kindly provide the updated table in case of extension in bid submission date/ delay in shortlisting of qualified bidders.</p>	
<p><b>4.</b></p> <p><b>Clause 2.15.3 of RFP</b></p> <p>After the date of acquisition of the equity shareholding of SPV [which is under incorporation], along with all its related assets and liabilities, by the Selected Bidder,</p> <p>i. the authority of the BPC in respect of this Bid Process shall forthwith cease to be taken thereafter will be undertaken by the Nodal Agency,</p>	<p>Role of BPC has to be complete.</p> <p>i. the authority of the BPC in respect of this Bid Process shall forthwith cease and any actions to be taken thereafter will be undertaken by the Nodal Agency, save for those which are related to and consequent to the bidding process adopted by the BPC.</p> <p>The BPC shall not relinquish its role after the acquisition but shall have to undertake all activities including providing the certification from the Bid Evaluation Committee etc., and other requirements to enable the Bidder to obtain Transmission license</p>	<p>The role of BPC ends with the transfer of SPV to the successful bidder.</p> <p>However, it may be noted that the BPC shall fulfil its responsibility of providing the certification from the Bid Evaluation Committee to enable the TSP to obtain Transmission license and adoption of Transmission charges.</p>

264



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		and adoption of Transmission charges. Furthermore, any activity which has an origin traced to the BPC activity/process has to be owned by BPC and the TSP / LTTC is neither aware nor can be made responsible.	
5.	<b>Clause 2.15.3 of RFP</b> iv. contractual obligations undertaken by the BPC shall continue to be fulfilled by the TSP.	What are the obligations that the BPC has undertaken which needs to be fulfilled by the TSP?  2.15.3 iv. Contractual obligations undertaken by the BPC shall continue to be fulfilled by the TSP if only such contractual obligations have been made available to the bidders 15 days prior to the bid deadline.  Nature of contractual obligations cannot be left open as the same is to be fulfilled by the TSP.	The details of the contractual obligations (if any) of BPC to be fulfilled by the TSP shall be intimated as per the provisions of RFP.
6.	<b>Clause 2.15.4 of RFP</b> Within five (5) working days of the issue of the acquisition of the SPV by the Successful Bidder, the TSP shall apply to the Commission for grant of Transmission License and make an application to the Commission for the adoption	Query-1  We request you to consider at least 30 days' time for completion of these activities.  Query-2	This is as per the Standard Bidding Documents. No change is envisaged.

265



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>of Transmission Charges, as required under Section – 63 of The Electricity Act 2003</p> <p>Provision of TSA</p> <p>3.1.1.....The TSP shall, within five (5) working days from the date of acquisition of SPV by the Selected Bidder, undertake to apply to the Commission for the grant of Transmission License and for the adoption of tariff as required under section-63 of the Electricity Act .....</p>	<p>Definition of working day is not defined in the TSA. Therefore, it is requested to define working day to avoid ambiguity and litigation later on</p> <p>Within thirty (30) working days of the issue of the acquisition of the SPV by the Successful Bidder, the TSP shall apply to the Commission for grant of Transmission License and make an application to the Commission for the adoption of Transmission Charges, as required under Section – 63 of The Electricity Act 2003</p>	
<p>7.</p>	<p><b>Clause 2.15.6 of RFP</b></p> <p>If the TSP fails to obtain the Transmission License from the Commission, it will constitute sufficient grounds for-annulment of award of the Project</p>	<p>In case TSP fails to obtain the Transmission License the reasons for the same have to be examined.</p> <p>2.15.6 If the TSP fails to obtain the Transmission License from the Appropriate Commission, the treatment shall be as per provisions 3.3 of the TSA.</p> <p>Provisions of 3.3 of TSA provides for consequences for non-fulfilment of conditions subsequent. The provisions</p>	<p>This is as per the Standard Bidding Documents. The provisions of RFP documents shall prevail.</p>

266



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		of RFP as such have to be reflective of TSA.	
8.	<b>General</b>	<p>Kindly confirm:</p> <p>i) whether the Project / Elements are covered under "Generation linked Project" or "System Strengthening Project"</p>	<p>The subject transmission scheme has been planned for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I.</p>
9.	<b>General</b>	<p>Kindly confirm:</p> <p>i) Whether the Project/ Elements are eligible for early commissioning incentive as per MoP, GoI order dated 15.07.2015.</p>	<p>The provisions in TSA pertaining to commissioning shall prevail which interalia covers the matter of preponing of CoD. The TSP may approach the Committee constituted by MoP vide its OM No. 15/1/2013-Trans dated 14.12.2021 to ensure smooth operationalization of the Policy for early commissioning.</p>
10.	<b>General</b>	<p>BPC is requested to confirm, whether the project/Elements of the project are a part of Associated Transmission System (ATS) as per definition of Connectivity and General Network Access to the inter-State Transmission System, Regulations, 2022.</p> <p>Bidder needs information for proper estimation.</p>	<p>Elements of the transmission scheme are covered under Common Transmission System (CTS) as the scheme has been evolved for evacuation of 3 GW capacity from Raghnesda region in Banaskantha district of Gujarat in line with the potential identified by MNRE.</p>

267



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p><b>11. General</b></p>	<p>BPC is requested to provide the details of transmission element(s) of subject project, for which any delay in construction of transmission elements by TSP resulting in mismatch of these elements viz-a-viz. generation station(s) or Unit(s), TSP shall be liable to make payments viz., transmission charges to generation station(s) or unit(s) under clause 13.8, Sharing of Inter-State Transmission Charges and Losses, Regulations, 2020.</p>	<p>All elements covered under the subject transmission scheme are required to be implemented simultaneously as per time-frame specified in the RFP. Treatment of transmission charges in case of delay/mismatch in transmission scheme shall be governed as per applicable provisions of TSA and CERC Sharing Regulations, 2020.</p>
<p><b>12. The definition of Contract Year in RFP is as under:</b></p>	<p>"Contract Year" shall mean the period beginning on the Scheduled COD, and ending on the immediately succeeding March 31 and thereafter each period of 12 ...:</p> <p>And the definition of Contract Year in TSA is as under:</p> <p>"Contract Year", for the purpose of payment of</p>	<p>The provisions of RFP and TSA are amply clear in this regard.</p> <p>As per RFP, the Contract Year shall start from the Scheduled CoD whereas as per TSA, the Contract Year shall start the CoD. As such, both the definitions are contradictory in nature.</p> <p>It is requested to clarify the correct definition of Contract Year.</p>

268



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>Transmission Charges, shall mean the period beginning on the COD, and ending on the immediately ..."</p>		
<p><b>13. Clause no 2.3 of TSA</b>                  Conditions prior to the expiry of the Transmission License                  2.3.1 In order to continue the Project beyond the expiry of the Transmission License, the TSP shall be obligated to make an application to the Commission at least two (2) years before the date of expiry of the Transmission License, seeking the Commission's approval for the extension of the term of the Transmission License up to the Expiry Date.                  2.3.2 The TSP shall timely comply with all the requirements that may be laid down by the Commission for extension of the term of the Transmission License beyond the initial term of twenty-five (25) years &amp; upto the Expiry Date and the TSP shall keep the Nodal Agency fully informed about the progress on its application for extension of the term of the Transmission License.</p>	<p>There should be a provision in the TSA to cover the revenue loss that may be incurred by the TSP, in the case of the Appropriate Commission not granting extension of the Transmission License beyond the period of 25 years.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>

269



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>14. <b>Clause 3.1.3 of TSA</b></p> <p>The TSP agrees and undertakes to duly perform and complete the following activities <b>within six (6) months</b> from the Effective Date (except for c) below),</p> <p>.....</p> <p>c) To submit to the Nodal Agency, CEA &amp; Independent Engineer, the Project Execution Plan, immediately after award of contract(s) and maximum within one hundred and twenty (120) days from the Effective Date. ....</p> <p>h) <b>To award the Engineering, Procurement and Construction contract ("EPC contract") for the design and construction of the Project and shall have given to such Contractor an irrevocable notice to proceed;</b></p>	<p>As per clause 3.1.3 h, the EPC contracts to be awarded in 6 months. Whereas as per clause 3.1.3 c, TSP is required to submit Project Execution Plan after awards of Contracts within 120 days. TSP shall not be in a position to submit project plan within 120 days from effective date if the award of EPC contract is awarded after 120 days, but before 6 months period.</p> <p>As such, the timelines mentioned in above clauses are contradictory and the same may be reviewed.</p>	<p>Section 3.1.3 clearly states that period of 6 months is not applicable to clause (c).</p>
<p>15. <b>Clause 3.3.1 of TSA</b></p> <p>If any of the conditions specified in Article 3.1.3 is not duly fulfilled by the TSP even within three (3) Months..... in accordance with the provisions of this Agreement</p>	<p>Suggested text to be added at the end of this Article:</p> <p>" ..... The additional Contract Performance Guarantee, if any provided by the TSP for delay in fulfillment of condition subsequent, shall be returned by the CTUIL on</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>

270



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>fulfilment of conditions subsequent by the TSP"</p> <p>The additional CPG is for specific default(s) and once such default(s) cease to exist, this additional amount of CPG should be returned.</p> <p>Additional CPG cannot be held back by the CTUIL till COD of the Project.</p>	
<p><b>16. Clause no 3.3.4 of TSA</b></p> <p>In case of inability of the TSP to fulfil the conditions specified in Article 3.1.3 due to any Force Majeure Event, the time period for fulfilment of the condition subsequent as mentioned in Article 3.1.3, may be extended for a period of such Force Majeure Event. Alternatively, if deemed necessary, this Agreement may be terminated by the Nodal Agency by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement and the Contract Performance Guarantee shall be returned as per the provisions of Article 6.5.1.</p> <p>.....</p>	<p>The terms and conditions for termination of the TSA under this Article, including the termination payment and status of the SPV, need to be provided in the TSA.</p> <p>In case the Force majeure event continues, the TSA will be terminated and the CPG will be returned.</p> <p>Other expenses that would have been incurred till the date of termination of the TSA including the Acquisition Price paid for Acquiring the SPV and other incurred costs shall also be explicitly stated. There should be an explicit provision for refund of the Acquisition Price, along with the other expenses incurred by the TSP /</p>	<p>In such cases, provisions of Article 3.3.5 and Article 13.6.1 of TSA shall apply.</p>

271



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

		Selected Bidder till such date of termination.	
17.	<p><b>Clause 3.3.4 of TSA</b> ..... Provided, that due to the provisions of this Article 3.3.4, ..... If the Scheduled COD is extended beyond a period of one hundred eighty (180) days due to the provisions of this Article 3.3.4, the TSP will be allowed to recover the interest cost during construction corresponding to the period exceeding one hundred eighty (180) days by adjustment in the Transmission Charges in accordance with Schedule 9</p> <p><b>11.7 (e) Available Relief for a Force Majeure Event</b> For avoidance of doubt, the TSP acknowledges that for extension of Scheduled COD a period up to one hundred eighty (180) days due to Force Majeure event, no compensation on the grounds such as interest cost,.....</p>	<p>In case project suffers from Force Majeure event for a period less than 6 months, interest cost during construction may be considered.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>
18.	<p><b>Clause 4.6 of TSA</b>  Interconnection Facilities:</p>	<p>It is understood that if interconnection facilities at the interconnection point is not available, whereas TSP has completed rest of the scope of the</p>	<p>The provisions of TSA are amply clear and shall prevail.</p>

272



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>4.6.1 Subject to the terms and conditions of this Agreement, the TSP shall be responsible for connecting the Project with the interconnection point(s) specified in Schedule 1 of this Agreement. The Interconnection Facilities shall be developed as per the scope of work and responsibilities assigned in Schedule 1 of this Agreement. The Nodal Agency shall be responsible for coordinating to make available the Interconnection Facilities.</p> <p>4.6.2 In order to remove any doubts, it is made clear that the obligation of the TSP within the scope of the project is to construct the Project as per Schedule-1 of this Agreement and in particular to connect it to the Interconnection Facilities as specified in this Agreement.</p>	<p>project, the project shall be considered as deemed COD and TSP shall be entitled to all the benefits envisaged under the TSA.</p>	
19.	<p><b>Section-I of RFP</b></p> <p><b>6.1 Connection with the Inter-connection Facilities:</b></p> <p>6.1.1 The TSP shall give the RLDC(s), CTU, / STU, as the case may be, and any other agencies as required, at least sixty (60) days advance written notice of the date on which it intends to connect an Element of the Project, which date</p>	<p>Reference is drawn to the Order of CERC 4/ADP/2016 dated 23.03.2016. Relevant extract of the Order is reproduced hereunder:</p> <p>"In the event the inter-connection facilities are not ready by SCOD or by revised SCOD (as may be revised by the petitioner and the LTTCs for the</p>	<p>The provisions of Article 6 of TSA are in line with the existing CERC Regulations and shall prevail.</p>

273



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>shall not be earlier than its Scheduled COD or Schedule COD extended as per Article 4.4.1 &amp; 4.4.2 of this Agreement, unless mutually agreed to by Parties. Further, any preponing of COD of any element prior to Scheduled COD must be approved by the Nodal Agency.</p>	<p>purpose of availing incentive as per MOP Policy) on account of non-readiness of the upstream or downstream transmission assets while the petitioner's transmission system is ready for commissioning, the COD of the transmission assets of the petitioner may be declared in accordance with the provisions of Article 6.2 of the TSA (to be known as "deemed COD") and the LTTCs/developers of the upstream and downstream assets shall be liable to pay the transmission charges from the deemed COD till the transmission assets are put into actual use."</p>
<p>6.2.1 An Element of the Project shall be declared to have achieved COD twenty four (24) hours following the connection of the Element with the Interconnection Facilities pursuant to Article 6.1 or seven (7) days after the date on which it is declared by the TSP to be ready for charging but is not able to be charged for reasons not attributable to the TSP subject to Article 6.1.2.</p>	<p>From above, it is seen that even in case of SCOD when the systems are declared deemed COD as per Article 6.2 of TSA, till the transmission assets are put into actual use, the transmission charges are liable to be paid by DICs/developers of the upstream and downstream assets. In such situations, it shall be construed that BPC has obtained consent of the DICs/ Upstream / Downstream /</p>
<p>Provided that an Element shall be declared to have achieved COD only after all the Element(s), if any, which are pre-required to have achieved COD as defined in Schedule 2 of this Agreement, have been declared to have achieved their respective COD.</p>	<p></p>
<p>6.2.2 Once any Element of the Project has been declared to have achieved deemed COD as per Article 6.2.1 above, such Element of the Project</p>	<p></p>

274



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>shall be deemed to have Availability equal to the Target Availability till the actual charging of the Element and to this extent, TSP shall be eligible for the Monthly Transmission Charges applicable for such Element.</p>	<p>Generators (as applicable) for payment of transmission charges.  Further, as per CERC order no. 104/MP/2018 dated 18<sup>th</sup> September 2018, downstream was directed to pay transmission charges to TSP.</p>	
<p>20.</p>	<p><b>Clause 6.3.1 (b) of TSA</b> In case of delay due to Indirect Non-Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency, TSP is entitled for payment for debt service which is due under the Financing Agreements, subject to a maximum of Transmission Charges calculated on Target Availability, for the period of such events in excess of three (3) continuous or non-continuous Months in the manner provided in (c) below.</p>	<p>Clause 6.3.1 (b) covers the loss on debt amount which includes, due to Indirect Non-Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency, TSP is entitled for payment for debt service which is due under the Financing Agreements. However, any loss on the equity is not covered in the above clause.  In order to compensate for the loss due to Indirect Non-Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency, compensation to both equity as well as debt to be covered as per clause 6.3.1 (a).</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>

275



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>21. <b>Clause 10 of TSA</b> Billing and Payment of Transmission Charges 10.3 Rebate &amp; Late Payment Surcharge</p>	<p>Any changes in CERC regulations, which have an implication on Billing cycle and/or cost implication to the TSP due to change in rebate and late payment surcharge, the same shall be allowed to be recovered under Change in law.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>
<p>22. <b>Clause no. 10.1 of TSA</b> Subject to provisions of this Article 10, the Monthly Transmission Charges shall be paid to the TSP, in Indian Rupees, on monthly basis as per the provisions of this agreement, from the date on which an Element(s) has achieved COD until the Expiry Date of this Agreement, unless terminated earlier and in line with the provisions of Schedule 4 of this Agreement.</p>	<p>Subject to provisions of this Article 10, the Monthly Transmission Charges shall be paid to the TSP, in Indian Rupees, on monthly basis as per the provisions of the Sharing Regulations, from the date on which an Element(s) has achieved COD or deemed to have <u>achieved COD</u> until the Expiry Date of this Agreement, unless terminated earlier and in line with the provisions of Schedule 4 of this Agreement</p> <p>As per clause 6.2 of the TSA, the TSP is eligible for payment of Transmission charges from the date of deemed COD.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>
<p>23. <b>Clause no. 11.4 of TSA</b> 11.4 Force Majeure Exclusions</p>	<p>The survey report furnished by BPC has to be accurate and any error or omission has to be owned by the BPC.</p>	<p>BPC appoints designated survey agencies to conduct survey, prepares the Survey Report and</p>

276



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

<p>11.4.1 (g) Any error or omission in the survey report provided by BPC during the bidding process.</p>	<p>Professional fees including fees for survey report is also claimed by BPC.</p>	<p>furnish the same to bidders. Bidders may refer clause 2.5.7.3 of RFP.</p>
<p>24. <b>Clause 12.1.1 of TSA</b> Change in Law means the occurrence of any of the following after the Bid Deadline resulting into any additional recurring / non-recurring expenditure by the TSP or any savings of the TSP....</p>	<p>It is mentioned that in case any change in law event occurs on bid submission date or just prior to bid submission date, the bidders shall not have adequate time to understand the cost implication of such change in law event. Bidders cannot be exposed to such uncertainties and thereafter it is requested to consider any event after 7 days prior to bid deadline as Change in Law event.</p> <p>Furthermore, the bid submission is fixed at 12 noon. Whereas change in event could happen during the day even after 12 noon. Such clause can have serious implications on the viability of the project.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>
<p>25. <b>Clause 12.1.2 of TSA</b> Notwithstanding anything contained in this Agreement, Change in Law shall not cover any change:</p>	<p>Any tax applied on the income or profits of the TSP need to be covered under change in law.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail. Further, please refer Clause 2.5.7 of RFP.</p>

272



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>a. Taxes on corporate income; and; and</p> <p>b. Withholding tax on income or dividends distributed to the shareholders of the TSP.</p>	<p>Tax is an element beyond the control of the TSP.</p> <p>Change in tax or introduction of any tax is covered under change in law.</p> <p>Tax rate applicable on the income or profits of the TSP is beyond the control of the TSP and to assume the same for 35 years shall be a risk which is best assumed by the LTTCs accordingly this is to be reviewed.</p>	
<p>26.</p>	<p><b>Clause 13.7 of TSA</b></p> <p>If Agreement is terminated on account of Force Majeure Events, non -requirement of any Element or Project during Construction, Nodal Agency's non-fulfilment of Role &amp; TSP's Event of Default, the TSP shall be entitled for Termination Payment equivalent to valuation of Project Assets. Upon payment, the Nodal Agency shall take over the Project Assets</p>	<p>Kindly furnish the methodology of calculation of valuation of project asset.</p>	<p>Valuation of project assets shall be done as per the prevailing industry practices.</p> <p>Further, please refer Clause 18.2.e. of TSA</p>
<p>27.</p>	<p><b>Clause 10.1.2.1 of TSA</b></p>	<p>Timelines for payment of transmission charges is linked to "due date".</p>	<p>The provisions of TSA shall prevail.</p>

278



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p><b>10.1.2.1</b> 1 Any amount payable under an Invoice shall be paid in immediately available and freely transferable clear funds, for value on or before the Due Date, to such account of the TSP or Long Term Transmission Customer as shall have been previously notified to Long Term Transmission Customer or the TSP, as the case may be</p> <p><b>10.3 Rebate &amp; Late Payment Surcharge:</b></p> <p><b>10.3.1 Rebate:</b> In case the Long Term Transmission Customer pays to the TSP through any mode of payment in respect of a Monthly Transmission Charge Invoice or Supplementary Bill, the following shall apply:</p> <p>a. For payment of Invoices through any mode of payment, a Rebate of 2% shall be allowed on the Monthly Transmission Charge Invoice or Supplementary Bill for payments made in full within two Business Day of the receipt of the Invoice; or</p> <p>b. For payment of Invoices subsequently, but within the Due Date, a Rebate of 1% shall be allowed on the payments made in full.</p> <p>and</p>	<p>However, the "due date" is not defined in the TSA.</p> <p>It is requested to provide the definition of "due date" to avoid confusion and litigation.</p>	
---	---	--

279



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

28.	<p><b>others</b></p> <p><b>Clause 2.1.2 of RFP</b></p> <p>" Experience of development of projects in the Infrastructure Sector in the last five (5) years with aggregate capital expenditure of not less than Rs..... Crore or equivalent USD (calculated as per provisions in Clause 3.4.1). However, the capital expenditure of each project shall not be less than Rs..... Crore or equivalent USD (calculated as per provisions in Clause 3.4.1</p> <p>For this purpose, capital expenditure incurred on projects that have been commissioned/ completed at least seven (7) days prior to Bid Deadline shall be considered. The capital expenditure discussed above shall be as capitalized and reflected in the audited books of accounts of the Technically Evaluated Entity.....".</p>	<p>As per QR, the capital expenditure under reference shall be as capitalised and reflected in the audited books of accounts of Technically Evaluated Entity.</p> <p>In above regard, please clarify the following:</p> <p>Whether entire capital expenditure of various Project(s), meeting the value-wise threshold requirements of QR, as capitalised in last five years in the audited books of accounts of Technically Evaluated Entity, shall be considered;</p> <p>OR</p> <p>Whether only the capital expenditure incurred in the last five years of such Project(s), capitalised in last five years in the audited books of accounts of Technically Evaluated Entity, shall be considered.</p>	<p>This is as per the Standard Bidding Documents. No change is envisaged.</p>
-----	---	--	---

280



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p><b>29.</b> <b>Clause 2.11 of RFP</b> Each Bidder shall submit the Bid accompanied by Bid Bond issued by any of the Banks listed in Annexure-17. The Bid Bond shall be valid for a period of thirty (30) days beyond the validity of the Bid.</p>	<p>Verification of issued bid bond is done by the beneficiary bank of the BPC through SFMS platform from the issuing bank of the bidder. In above regard, BPC is requested to provide following details.</p> <ul style="list-style-type: none"> <li>- Bank account detail of beneficiary along with IFSC code and Branch address</li> <li>- Unique Identifier of the beneficiary (if applicable) (The unique identifier needs to be incorporated by the issuing bank in Field 7037 of the IFIN 760 COV/FIN COV while transmitting verification messages to the Beneficiary Bank through SFMS).</li> </ul>	<p>The requisite information shall be provided before bid submission.</p>
<p><b>30.</b> <b>Annexure 14 of RFP</b> (Format of the Bid Bond) Addressee details are not mentioned in the beginning of the format</p>	<p>Addressee details to whom Bid Bond is to be addressed are not mentioned in the Bid Bond Format. It is requested to mention the followings at starting of the format:</p>	<p>Bid Bond is to be addressed to PFC Consulting Limited.</p>

281



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>Annexure 14 (Format of the Bid Bond)</p> <p>" To, Designation of officer Name of BPC Address of BPC</p> <p>In consideration of the.....</p>	
<p>31.</p> <p><b>Clause 1.6.2.2 of RFP</b></p> <p>The details and documents as may be obtained by the BPC/ project specific SPV in relation to the Project shall be handed over to the TSP on an as-is-where-is basis, so that it may take further actions to obtain <b>Consents, Clearances and Permits</b></p>	<p>BPC to get the <b>GST registration and GST TAN</b> registration in the name of SPV in the State of Project execution where supply of Goods and Services shall take place.</p>	<p>Presently, the GST registration of the SPV is not taken by the BPC as there is no income of SPV and the same is in compliance to GST Act.</p>
<p>32.</p> <p><b>Clause 1.2 (i) of SPA</b></p> <p>"Acquisition Price" shall mean INR _____ (Rupees _____ only) [Insert the value of the Acquisition Price, both in figures and in words respectively], which is the aggregate consideration payable by the Selected Bidder towards purchase of the Sale Shares at par along with assets and liabilities of the Company as on the Closing Date subject to</p>	<p>As per clause 1.2 (i) of the Share Purchase agreement, BPC is required to provide audited financial statement, as on the closing date for adjustment, if any, in regard to aggregate consideration for acquisition of the SPV.</p>	<p>Audited Financial Statements shall be furnished post completion of audit.</p>

281



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

	<p>adjustment as per the audited accounts of the Company as on the Closing Date;</p>	<p>It is requested to BPC to furnish audited financial statement within 15 days of the closing date.</p>	<p>This is as per the Standard Bidding Documents. The provisions of RFP shall prevail.</p>						
<p>33. ...Know all men by these presents, We .....(name) and address of the registered office of the Bidder...</p>	<p>As per the format of Power of Attorney, the bidder is required to mention the name and registered office of the bidder.</p> <p>In case corporate office of the bidder is in different state than that of its registered office, can the bidder execute the Power of Attorney in the state of its corporate office?</p>	<p>Kindly provide the element wise break up for determining the transmission charges based on availability</p>	<p>As per RFP, all elements of the subject transmission scheme are to be commissioned simultaneously. Approved cost may be considered for this purpose.</p>						
<p>34. ... We confirm that our Bid meets the Scheduled COD of each transmission Element and the Project as specified below:</p>	<table border="1"> <thead> <tr> <th data-bbox="367 1332 555 1769">Name of the Transmission Element</th> <th data-bbox="555 1332 758 1769">Scheduled COD</th> <th data-bbox="758 1332 1260 1769">Percentage of Quoted Transmission Charges recoverable on Scheduled COD of</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>	Name of the Transmission Element	Scheduled COD	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of					
Name of the Transmission Element	Scheduled COD	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of							

283



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	the Element of the Project		
Establishment 3x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor	30 months from SPV transfer	100%	
Raghnesda (GIS) - Banaskantha (PG) 765 kV D/c line 2 Nos. 765 kV line bays at Banaskantha (PG) S/s			
35. 2.5 The Bidding Process .....	2.5 The Bidding Process .....		The provisions of RFP and TSA are amply clear in this regard.

284



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>The initial period for conducting the e-reverse bidding should be 2 hours which will be extended by 30 minutes from the last received bid time, if the bid is received during the last 30 minutes of the scheduled or extended bid time. Subsequently, it will be extended again by 30 minutes from the latest received bid time.</p> <p>.....</p>	<p>The initial period for conducting the e-reverse bidding should be 2 hours which will be extended by 15 minutes from the last received bid time, if the bid is received during the last 15 minutes of the scheduled or extended bid time. Subsequently, it will be extended again by 15 minutes from the latest received bid time.</p> <p>In case e-Reverse Bidding is not completed by 20:00 Hrs (IST), then the e-Reverse Bidding shall be paused and will resume on the next working day at 10:00 Hrs (IST). The prevailing L1 bidder at the time of pause on the previous day shall continue to be the L1 bidder at resumption of e-Reverse Auction. On resuming, the e-Reverse Bidding shall be conducted for 60 minutes, which will be extended by 15 minutes from the last received bid time, if the bid is received during the last 15 minutes. Subsequently, it will be extended</p>
---	---

285



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>again by 15 minutes from the latest received bid time.</p> <p>The above shall continue till the e-Reverse Bidding gets concluded.</p> <p>As per revised Standard Bidding Documents, the bidders are required to quote single annual Transmission Charge from the date of SCOD of the project till expiry date in initial bid and in the e-RA. During e-RA, the initial time period for e-RA is 2 hours with extension of 30 minutes from last bid.</p> <p>In this regard, it is submitted that the bidder is required to quote single number as annual transmission charges. Further, there is option for automatic reduction in e-RA portal. Therefore, the extension of 30 minutes from last bid submission may be reduced to 15 minutes.</p> <p>Further, in case the bidding extends beyond office hours, the e-RA may be</p>	
--	---	--

286



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>paused and resumed on the next working day as being followed by major service providers.</p> <p>RfP bid submission shall be scheduled accordingly.</p>	<p>Noted.</p>
<p><b>36.</b></p> <p><b>Clause 1.5 of RFP</b></p> <p>The objective of the bidding process is to select a Successful Bidder pursuant to this RFP, who shall acquire one hundred percent (100%) of the equity shares of SPV [which is under incorporation] along with all its related assets and liabilities as per the provisions of the Share Purchase Agreement, at the Acquisition Price to be intimated by the BPC, twenty (20) days prior to the Bid Deadline.</p>		
<p><b>37.</b></p> <p><b>a. Clarifications and Pre-Bid Meeting</b></p> <p><b>2.3.1</b> The Bidders may seek clarifications or suggest amendments to the RFP by sending an email to the BPC at the email id indicated in Clause 2.14 within the date and time RFP for Selection of Bidder as Transmission Service Provider mentioned in Clause 2.7.2. For any such clarifications or amendments, the Bidders should adhere to the format as per Annexure -</p>	<p>The response for clarifications sought by prospective bidders shall be provided at least 2 weeks prior to bid deadline, so that price implications, if any, can be accounted for in the RFP bid.</p>	<p>Noted.</p>

207



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

<p>38. <b>2.5 The Bidding Process</b> The entire bidding process shall be conducted on electronic bidding platform created by MSTC Limited.</p>	<p>The event of Bid Submission shall be kept live on the MSTC portal atleast 1 week prior to bid deadline.</p>	<p>Noted.</p>		
<p>39. <b>Section 1</b> <b>Clause 1.2 (1)</b></p>	<p>Future scope (Space for): 220kV BC : 1 No.  We understand that considering two section of 220kV Buses at Raghnesda S/S, space for 2 nos. of Bus Coupler bays shall be provided.  Kindly confirm.</p>	<p>Space provision for future 2 nos. bus couplers shall be kept for future 2 nos. 220 kV bus sections.  Further please refer to Amendment-I dated 05.11.2024.</p>		
<p>40. <b>Annexure-C</b> <b>Clause No. B.1.2(x)</b></p>	<p>Provision of 220 kV Bus Sectionalization (Future) and space provision shall be with the following feeder distribution.</p> <table border="1" data-bbox="1085 784 1244 1456"> <tr> <td>220 kV Bus Section-1 (Future)</td> <td>220 kV Bus Section-2 (Future)</td> </tr> </table>	220 kV Bus Section-1 (Future)	220 kV Bus Section-2 (Future)	<p>Bidder's understanding is generally in order.  Further please refer to Amendment-I dated 05.11.2024.</p>
220 kV Bus Section-1 (Future)	220 kV Bus Section-2 (Future)			

286



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghanesda area of Gujarat – 3 GW under Phase-I"**

	<p>a) 4 Nos. of future 400/220 kV ICT</p> <p>b) 6 Nos. of future 220 kV Line</p>	<p>a) 4 Nos. of future 400/220 kV ICT</p> <p>b) 6 Nos. of future 220 kV Line</p>	<p>Refer Sl. no. 1 of Amendment-I dated 05.11.2024</p>
<p><b>41. Annexure-C</b></p> <p><b>Clause No. B.1.2(xi)</b></p>	<p><b>765kV Banaskantha Extn:</b></p> <p>Refer attached SLD and GA drawing of Banaskantha S/s. Raghanesda – Banaskantha (PG) 765 kV D/C line shall be terminated in existing diameters for which Main Bays shall be constructed (Tie bays are existing) under present scope as marked in GA drawing. Further, all associated interconnection work shall also be in the present scope of TSP.</p>	<p><b>Transmission Lines Protection</b></p> <p>765 kV and 400 kV lines shall have Main-I numerical three zone distance protection scheme with carrier aided inter-tripping feature. 765 kV and 400</p>	<p>Bidder shall meet the requirements of RFP.</p> <p>Further, as on date, details of RE generators proposed to be connected at Raghanesda PS which have been allocated 4 Nos. 400kV line bays along with their co-ordinates are given below:</p>
<p><b>42. Annexure-C</b></p> <p><b>Clause No. B.2.5(a)</b></p>			

209



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>kV lines shall also have Main-II numerical distance protection scheme like Main-I but from different make that of Main-I. The Main-I and Main-II protection relays of same make may be provided only if they are of different hardware and manufacturing platform or different principle of operation.</p> <p>However, Line Current Differential relay (with back up distance protection feature) as Main-I and Main-II shall be considered at both ends for short lines (line length below 30 km) having Fibre Optic Communication Link. Differential relay at remote end shall be provided by the TSP. Associated power and control cabling and integration with SAS at remote end shall be provided by respective bay owner.</p>	<p>1.Spring Wind Energy Private Limited (SWEPL): 200MW (220000612) – 1 line bay Coordinates: 24.213, 71.309 (as per application)</p> <p>2.JSW Neo Energy Ltd. (JSWNEL): 200MW (2200001014) – 1 line bay Coordinates: 24.329103, 71.376031 (as per application)</p> <p>3.Renew Solar Power Pvt. Ltd. (RSPPL): 300MW (2200000993) – 1 line bay Coordinates: 24.454944, 71.403583 (as per application)</p> <p>4.ACME Solar Holdings Ltd. (ASHL) 400MW (2200001064) – 1 line bay Coordinates: 24.428143, 71.436474 (as per application)</p>
--	--	---

062



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		<p>We understand 4 nos. of 400kV Line Bays under present scope shall Numerical distance protection for both Main-I and Main-II protection.</p> <p>In case, Line Current Differential relay (with back up distance protection feature) as Main-I and Main-II is envisaged for 400kV Line Bays, please inform line length for the proposed 4 Nos. of 400kV transmission lines.</p>	
<p><b>43. RFP &amp; TSA General</b></p>		<p>We request you to clarify whether there are any deviations/addition in the RFP/TSA documents from the Standard Bidding documents (SBD) and if any, whether approval for the same has been taken or not.</p> <p>Please provide the list of the same, if any.</p>	<p>The RFP/ TSA Documents are as per the Standard Bidding Documents (SBDs) and subsequent amendments issued by the Ministry of Power, GoI.</p>
<p><b>44. RFP General</b></p>		<p>Please let us know the status of Regulatory Approvals for the project.</p>	<p>Transmission system is approved as per MoP Electricity (Transmission System Planning, Development and Recovery of Inter-State Transmission Charges) Rules, 2021. Regulatory</p>

291



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

		SPV Acquisition is linked to regulatory approval and it is very important to get the clearance before RFP Submission as this will impact the initiation of projects.	approval would not be required for implementation of any ISTS project after approval by MoP.
<b>45.</b>	<b>RFP</b> <b>General</b>	We request you to let us know the status of TSA signing. SPV Acquisition is linked to TSA Signing and it is very important to get the clearance before RFP Submission as this will impact the initiation of projects	As per revised TBCB Guidelines and SBDs issued by MOP, TSP on the date of acquisition of SPV from the BPC will enter into a Transmission Service Agreement (TSA) with the Nodal Agency i.e., CTUIL
<b>46.</b>	<b>Clause 1.6.2.1 (2) of RFP</b> To obtain approval for laying of overhead transmission lines under Section 68 of Electricity Act, from the Government at least twenty (20) days prior to Bid Deadline.	It is requested you to kindly provide present status of process initiated by BPC with regard to section 68 approval.	Application to be filed to get approval for laying of Overhead Transmission Lines under Section 68. The same shall be shared with the successful bidder.
<b>47.</b>	<b>Clause 1.6.2.1 (4) of RFP</b>	It is requested you to kindly provide present status of Forest Clearances if	Bidders may refer the issued Survey report in this regard. Further, necessary



292

**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

	To initiate process of seeking forest clearance, if required.	any transmission line corridor area falling in wildlife forest / reserve forest/ mangroves.	applications/letters for forest clearances have been shared with the appropriate authorities to get necessary approval.
48.	<b>Clause 1.6.2.1 (2) of RFP</b>  The details and documents as may be obtained by the EPC/ project specific SPV in relation to the Project shall be handed over to the TSP on an as-is-where-is basis, so that it may take further actions to obtain Consents, Clearances and Permits.	Please provide copy of all such document available with you from the State Government and/or Ministry of Power and/or kindly facilitate for State Support Agreement.	The necessary support shall be provided on case to case basis.
49.	<b>Clause 1.10 of RFP</b>  The Ministry of Power and the appropriate state government(s) shall provide their support to the TSP, on best endeavor basis, in enabling the TSP to develop the Project.	We request you to share all such documents or correspondence happened with MOP and State Government, this will help the TSP is taking further approvals for the project.	The necessary documents shall be provided on case to case basis.

293



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p><b>50. Clause 1.12 of RFP</b></p> <p>Once the Successful Bidder is selected, the details and documents as may be obtained by the BPC/ project specific SPV in relation to the Project, shall be handed over to the Successful Bidder on as is where basis, so that it may take further actions to obtain all necessary Consents, Clearances and Permits and the TSP shall not be entitled for any extensions in the Scheduled COD of the Project except as provided for in the TSA.</p>	<p>BPC is requested to provide the list of details &amp; documents to be handed over to the Successful Bidder.</p>	<p>BPC will provide all the requisite documents/certifications under the Guidelines and the Standard Bidding Documents to the Successful Bidder at the time of transfer of SPV.</p>
<p><b>51. Clause 2.15.2 of RFP</b></p> <p>Within ten (10) days of the issue of the Letter of Intent, the Selected Bidder shall:</p> <p>a) provide the Contract Performance Guarantee in favour of the Nodal Agency as per the provisions of Clause 2.12</p>	<p>BPC will appreciate that the completion of said activities by the Selected Bidder within ten (10) days after issuance of LoI is very stringent.</p> <p>Also, execution of SPV / signing of share purchase agreement is not within the control of TSP as it is dependent on certain regulatory</p>	<p>This is as per the Standard Bidding Documents. The provisions of RFP shall prevail.</p>

294



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for 'Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I'**

	<p>b) execute the Share Purchase Agreement and the Transmission Service Agreement</p> <p>c) acquire, for the Acquisition Price, one hundred percent (100%) equity shareholding of [Insert the name of the SPV] from PFC Consulting Limited, who shall sell to the Selected Bidder, the equity shareholding of [Insert the name of the SPV], along with all its related assets and liabilities;</p>	<p>approvals as well. We therefore request to consider at least 30 days' time for completion of these activities as well as provide a carve out for consequences if the delay is not on account of TSP.</p>	
<p>52.</p>	<p><b>Clause 2.15.2 of RFP</b></p> <p>Stamp duties payable on purchase of one hundred percent (100%) of the equity shareholding of [Insert the name of the SPV], along with all its related assets and liabilities, shall also be borne by the Selected Bidder.</p>	<p>We request you to provide Applicable Stamp Duty Charges and Amount of Stamp Paper for the following agreements:</p> <ul style="list-style-type: none"> <li>i. Transmission Service Agreement</li> <li>ii. Share Purchase Agreement</li> <li>iii. Power of Attorney</li> <li>iv. Share Transfer Form</li> </ul>	<p>As per the Delhi Stamp duty Schedule 1A, stamp duty payable on Share Purchase Agreements and Transmission Service Agreement respectively is Rs. 1,000/- and Rs.50; however, all such agreements also include separate agreements in respect of Arbitration, Indemnity, guarantee, etc. and stamp duty on these separate items are also considered for the total stamp duty payable. Therefore, based on these identified stamp duties and taking some extra ones, the stamp duty of Rs. 1200 and 500 has been considered for Share Purchase Agreements and Transmission Service</p>

295



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

	<p>It will be helpful if you can specify the name of 1st party and 2nd party for purchase of stamp papers.</p>	<p>Agreement, respectively. This is a customary practice and we are fine with the same. Three agreements will be signed in original, therefore separate stamp duty is payable on each of the agreement</p>
<p>53.</p>	<p><b>Clause 2.15.4 of RFP</b></p> <p>Within five (5) working days of the issue of the acquisition of the SPV by the Successful Bidder, the TSP shall apply to the Commission for grant of Transmission License and make an application to the Commission for the adoption of Transmission Charges, as required under Section - 63 of The Electricity Act 2003.</p>	<p>Clause 2.15.4 may be reworded as below -</p> <p>Within ten (10) working days of the issue of the acquisition of the SPV by the Successful Bidder, the TSP shall apply to the Commission for grant of Transmission License and make an application to the Commission for the adoption of Transmission Charges, as required under Section - 63 of The Electricity Act 2003.</p> <p>The condition to apply for grant of transmission license and make application for adoption of transmission charges within 5 days is onerous. Request to please change the</p>

968



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

	<p><b>54. Clause 2.15.5 of RFP</b></p> <p>If the Selected Bidder / TSP fails or refuses to comply with any of its obligations under</p> <p>Clauses 2.15.2, 2.15.3 and 2.15.4, and provided that the other parties are willing to execute the Share Purchase Agreement and PFC Consulting Limited is willing to sell the entire equity shareholding of [Insert the name of the SPV], along with all its related assets and liabilities, to the Selected Bidder, such failure or refusal on the part of the Selected Bidder shall constitute sufficient grounds for cancellation of the Letter of Intent. In such cases, the BPC / its authorized representative(s) shall be entitled to invoke the Bid Bond of the Selected Bidder.</p>	<p>relevant provisions as per the suggested text in RFP and TSA</p> <p>It is requested to kindly clarify as to what will be the consequences if the Selected Bidders fails to comply with any of its obligations under 2.15.2, 2.15.3 and 2.15.3 due to reasons beyond the control of or not attributable to Selected Bidder / TSP.</p> <p>As the consequences for failure to comply the obligations under 2.15.2, 2.15.3 and 2.15.3 is the cancellation of Letter of Intent (LOI). We request you to reconsider the same as it would be unfair if LOI of selected bidder is cancelled due to reasons beyond its control.</p>	<p>This is as per the Standard Bidding Documents. The provisions of RFP shall prevail.</p> <p>Further, the provision for extension provided in Clause 2.15.2 of RFP document shall be applicable.</p>
--	--	---	---

197



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

55.	<p><b>Clause 2.4.3 of RFP</b></p> <p>The amendment to the RFP shall be notified to all the Bidders through the electronic bidding platform and shall be binding on them.</p>	<p>We understand that the BPC will also continue to share amendments / corrigendum through emails as per the current practice.</p>	<p>Amendments/Corrigendum are available on BPC website and same is also shared separately through email with the bidders.</p>
56.	<p><b>Clause 3.6.1 of RFP</b></p> <p>However, if no bid is received during the e-reverse bidding stage then the Bidder with lowest quoted initial transmission charges ("Initial Offer") during e-bidding stage shall be declared as the Successful Bidder, .....</p>	<p>We request you to clarify, if two or more bidders quote the same initial offer which turns out to be prevailing lowest levelized tariff and no further discount is offered by any bidder during e-reverse auction.</p> <p>In such case what will be the modality BPC will follow for award of project.</p> <p>BPC to confirm</p>	<p>If the Initial Offer for two or more bidders is same and no bids are quoted in e-RA, the instant case seems to be hypothetical however in such case the decision of the competent authority shall prevail.</p>
57.	<p><b>RFP General</b></p>	<p>We request you to kindly accept the Board resolutions passed by Management Committees formed by the Board of Directors of Bidding Company and TEE / affiliate respectively and duly authorized by</p>	<p>The Board Resolutions passed by the Management Committee with duly authorized from the Board of Directors may be considered as per the provisions of RFP.</p>

292



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

		<p>the Board of Directors for participation in various tenders issued by Govt. authorities in response to the RFP submission.</p> <p>The board meeting of Bidding Company / TEE may not be scheduled till RFP submission.</p> <p>Thus, we request you to kindly consider the board resolution passed by the management committee formed by the board of directors' w.r.t. Authorization from Bidding Company and TEE.</p>	
<p><b>58.</b></p> <p><b>RFP</b></p> <p><b>Annexure 22 – Format for Affidavit</b></p>		<p>We understand that the declaration and details with respect to conviction and investigation is to be provided for Affiliate / Parent company of the Bidding company only if such an Affiliate / Parent company is being used for meeting financial / technical qualification requirements.</p>	<p>The declaration and details with respect to Clause 2.1.9 of RFP is to be provided by the bidding company including Affiliate / Parent company of the Bidding company being used for meeting financial/technical qualification requirements as per Annexure 22 of the RFP document.</p>

299



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

<p>59.</p>	<p><b>Clause 1.6.1.5 of RFP</b></p> <p>The TSP shall seek approval under Section 164 of Electricity Act, from CEA after acquisition of [Insert the name of the SPV], The approval shall be granted by CEA generally within 30 days but in no case later than 45 days from the date of receipt of application (complete in all aspects).</p>	<p>It is requested you to kindly clarify whether process of obtaining authorization U/s 164 of Electricity Act, 2003 would be initiated by BPC.</p> <p>It is suggested that BPC may initiate the process for obtaining approval U/s 164 based on the survey undertaken by BPC.</p> <p>It may be appreciated that obtaining approval U/s 164 takes considerable time. In the interest of timely completion of project, it is suggested that BPC may initiate the process U/s 164.</p>	<p>This is as per the Standard Bidding Documents. The provisions of RFP shall prevail. Further, as per the provisions of RFP, TSP shall initiate the process for obtaining approval U/s 164.</p>
<p>60.</p>	<p><b>ANNEXURE B - Draft Pre-Award Integrity Pact of RFP</b></p>	<p>As per the draft of integrity pact ANNEXURE B in 2nd Paragraph the project name is missing "WHEREAS the BPC is conducting the bidding process for selection of bidder as Transmission Service Provider (TSP), who will be responsible to set up the transmission project on build, own,</p>	<p>Transmission scheme name is mentioned in Annexure B - Draft Pre-Award Integrity Pact. Kindly refer the same.</p>



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		<p>operate and transfer (BOOT) basis and to provide Transmission Service".</p> <p>Clarify to bidder if the project name should be added or bidder should submit as it is.</p>	
<p><b>61.</b></p>	<p><b>Article 3.3.1 of TSA</b></p> <p>If any of the conditions specified in Article 3.1.3 is not duly fulfilled by the TSP even within three (3) Months after the time specified therein, then on and from the expiry of such period and until the TSP has satisfied all the conditions specified in Article 3.1.3, the TSP shall, on a monthly basis, be liable to furnish to Central Transmission Utility of India Limited (being the Nodal Agency) additional Contract Performance Guarantee of Rs. 1.10 Crore (Rupees One Crore Ten Lakh Only) within two (2) Business Days of expiry of every such Month. Such additional Contract Performance Guarantee shall be provided to Central Transmission Utility of India Limited (being the Nodal Agency) in the manner provided in Article 3.1.1 and shall become part of the Contract Performance Guarantee and all the</p>	<p>In view of the rationale provided here, it is requested to amend the provision regarding refund of additional CPG on fulfillment of Conditions Subsequent.</p> <p>Additional CPG shall be recovered for the non-fulfilment of Conditions Subsequent. However, this additional CPG is then forming part of CPG and is being retained by Nodal Agency.</p> <p>Considering the fact that additional CPG is consequential guarantee for performance related to condition subsequent, it is requested to review the provision and amend the provision to refund the additional CPG on fulfillment of Conditions Subsequent.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>

201



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>provisions of this Agreement shall be construed accordingly. Central Transmission Utility of India Limited (being the Nodal Agency) shall be entitled to hold and / or invoke the Contract Performance Guarantee, including such additional Contract Performance Guarantee, in accordance with the provisions of this Agreement.</p>		
<p><b>62.</b></p>	<p><b>Article 4.4 Extension of Time of TSA</b></p> <p>TSP is required to obtain certain clearances/ approval such as authorization u/s 164, Forest clearance, Grant of Transmission License and approval for adoption of tariff etc. In case if there is any delay in these approvals beyond stipulated time, such delay shall be considered for extension of SCOD of the project and any consequential increase in cost shall be allowed through appropriate adjustment in the tariff.</p>	<p>Clearances/ approval such as authorization u/s 164, Forest clearance, Grant of Transmission License and approval for adoption of tariff are not within the control of TSP once it has been applied after fulfilling all the necessary compliance, any consequential delay is required to be allowed.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>
<p><b>63.</b></p>	<p><b>Article 5.12 Extension of Time of TSA</b></p> <p>The TSP acknowledges and agrees that it shall not be relieved from any of its obligations under this Agreement or be entitled to any extension of time or any compensation whatsoever by reason of the unsuitability of the Site or Transmission Line route(s).</p>	<p>TSP cannot be burdened with impact of unsuitability of the site or transmission line route due to reasons beyond control. Therefore, suitable revision may be carried out in clause 5.1.2.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>

502



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		<p>There may be number of reasons for unsuitability of the site or transmission line route which are beyond control of the TSP.</p> <p>For such instances, suitable extension of time and appropriate adjustment in tariff shall be provided.</p> <p>Inspection of Construction drawings and other documents related to construction may be deleted from clause no. 5.6.</p> <p>Construction drawings and few specific documents may be proprietary/ confidential and is against commercial interest of the TSP.</p>	
64.	<p><b>Article 5.6 Site regulations and Construction Documents</b></p> <p>The TSP shall abide by the Safety Rules and Procedures as mentioned in Schedule 3 of this Agreement</p> <p>The TSP shall retain at the Site and make available for inspection at all reasonable times copies of the Consents, Clearances and Permits, construction drawings and other documents related to construction.</p>		<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>
65.	<p><b>Article 6.4.1 of TSA</b></p> <p>Liquidated Damages for Delay in achieving COD of Project by TSP.</p>	<p>If the TSP fails to achieve COD for any Element of the Project or for the Project by SCOD, then the TSP is required to pay liquidated damages. It is noted that, Clause 6.4.1 of the TSA does not</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>

202



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

	<p>exclude delays caused due to a Force Majeure or Nodal Agency's default. This may well be a drafting oversight and may be clarified.</p> <p>The TSP should also not be liable to pay liquidated damages in the event the delay is not attributable to the TSP. Accordingly, it may be clarified that no damages will be payable in the event the delay is on account of Force Majeure or Nodal Agency's default.</p>	
<p><b>66. Article 11.3 Force Majeure</b></p> <p>A 'Force Majeure' means any event or circumstance or combination of events and circumstances including those stated below that wholly or partly prevents or unavoidably delays an Affected Party in the performance of its obligations/ roles under this Agreement, but only if and to the extent that such events or circumstances are not within the reasonable control, directly or indirectly, of the Affected Party and could not have been avoided if the</p>	<p>Underlined text may be added under Article 11.3:</p> <p>A 'Force Majeure' means any event or circumstance or combination of events and circumstances including those stated below that wholly or partly prevents or unavoidably delays an Affected Party or makes performance of obligation commercially unviable for the Affected Party in the performance of its obligations/ roles</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>Affected Party had taken reasonable care or complied with Prudent Utility Practices:</p>	<p>under this Agreement, but only if and to the extent that such events or circumstances are not within the reasonable control, directly or indirectly, of the Affected Party and could not have been avoided if the Affected Party had taken reasonable care or complied with Prudent Utility Practices:</p>	
<p>67.</p>	<p><b>Provisions in TSA</b> (Provision related to non-fulfilment of condition subsequent) 3.3.6 The Nodal agency, on the failure of the TSP to fulfil its obligations, if it considers that there are sufficient grounds for so doing, apart from invoking the Contract Performance Guarantee under para 3.3.3 may also initiate proceedings for blacklisting the TSP as per provisions of Article 13.2 of TSA.</p>	<p>The blacklisting of TSP for a period of 5 years for default, failure to complete conditions subsequent &amp; annulment of award, and for indefinite period for error in online and physical submission is onerous and harsh on TSP. TSP's event of default covers a lot of activities, and if TSP fails to comply with even one activity, TSP is at risk of getting blacklisted.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>

507



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>(Termination procedure for TSP event of default)</p> <p>13.2</p> <p>Further, the Nodal Agency may also initiate proceedings to blacklist the TSP &amp; its Affiliates from participation in any RFP issued by BPCs for a period of 5 years.</p> <p>Provisions in RFP</p> <p>(Non fulfilment of Obligations by TSP post issuance of Lol and post acquisition of SPV)</p> <p>2.15.8</p> <p>The annulment of the award, under Clause 2.15.5 or 2.15.6 of this RFP, shall be sufficient grounds for blacklisting the bidder, whose award has been annulled, for a period of five years or more, as decided by the National Committee on Transmission, provided that the blacklisting shall be done only after giving the bidder an opportunity for showing cause.</p> <p>(Discrepancy in online and physical submission of selected bidder)</p>	<p>Further, TSA provides discretionary right to Nodal agency to decide whether TSP would be blacklisted.</p> <p>In case of discrepancy in submission, it is requested that BPC shall seek clarification from bidder and upon failure to provide clarification and complete investigation only, should construe such activity as fraudulent practice.</p> <p>Hence it is requested to include blacklisting only in extreme cases and provide definite guidelines on Nodal Agency's right to blacklist bidders. Also in RFP, blacklisting for annulment of project award would be done by government, while in other cases it would be done by Nodal Agency. It is requested that blacklisting rights shall only reside with government.</p>
--	--

206



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>3.6.1</p> <p>In case, there is a discrepancy between the online submission and physical documents, the bid would be out rightly rejected and the bidder shall be construed to have engaged in the fraudulent practice as defined in Clause 2.19.3 with consequences as mentioned in Clause 2.19.2. Further, in such a case, the provisions of Clause 2.5.6</p>			
<p>68.</p> <p><b>Clause 13.3 of TSA</b></p> <p><b>Procedure for Nodal Agency's non-fulfilment of Role</b></p> <p>a. Upon the Nodal Agency not being able to fulfil its role under Article 4.2. the TSP may serve notice on the Nodal Agency, with a copy to CEA and the Lenders' Representative (a "TSP's Preliminary Notice"), which notice shall specify in reasonable detail the circumstances giving rise to such non-fulfilment of role by the Nodal Agency.</p>		<p>13.3 Procedure for Nodal Agency's non-fulfilment of Role</p> <p>a. Upon the Nodal Agency not being able to fulfil its role under Article 4.2. the TSP may serve TERMINATION notice on the Nodal Agency, with a copy to CEA and the Lenders' Representative (a "TSP's Preliminary Termination Notice").</p> <p>The contract clauses as per TSA favors the Nodal Agency. All the termination rights are provided to Nodal Agency and the agreement does not provide</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>

207



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		<p>the other party (TSP) right to terminate in case of default of Nodal Agency.</p> <p>In absence of termination right, TSP is at risk commercially, if Nodal agency fails to fulfill its assigned responsibilities, for example failure of Nodal Agency to pay the quoted transmission charges.</p> <p>Also, the methodology for computation of compensation to TSP, in case of mutual agreement to terminate, should be defined upfront.</p>	
<p><b>69.</b></p>	<p><b>Clause 3.3.4 of TSA</b></p> <p>In case of inability of the TSP to fulfil the conditions specified in Article 3.1.3 due to any Force Majeure Event, the time period for fulfilment of the condition subsequent as mentioned in Article 3.1.3, may be extended for a period of such Force Majeure Event. Alternatively, if deemed necessary, this</p>	<p>3.3.4 In case of inability of the TSP to fulfil the conditions specified in Article 3.1.3 due to any Force Majeure Event, the time period for fulfilment of the condition subsequent as mentioned in Article 3.1.3, may be extended for a period of such Force Majeure Event.</p>	<p>In such cases, provisions of Article 3.3.5 and Article 13.6.1 of TSA shall apply.</p>

208



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

<p>Agreement may be terminated by the Nodal Agency by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement and the Contract Performance Guarantee shall be returned as per the provisions of Article 6.5.1.</p>	<p>In case the Force Majeure Event continues even after a period of one hundred and eighty (180) days if deemed necessary, the Nodal Agency or TSP, upon mutual agreement may terminate the Agreement as per the provisions of Article 13.4 by giving a Termination Notice to the other party, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement and the Contract Performance Guarantee shall be returned as per the provisions of Article 6.5.1.</p>
<p>4.4.2 In the event that an Element or the Project cannot be commissioned by its Scheduled COD on account of any Force Majeure Event as per Article 11, the Scheduled COD shall be extended, by a 'day to day' basis for a period of such Force Majeure Event. Alternatively, if deemed necessary, the Nodal Agency may terminate the Agreement as per the provisions of Article 13.4 by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to</p>	<p>4.4.2 In the event that an Element or the Project cannot be commissioned by its Scheduled COD on account of any</p>

209



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>exercise right of substitution in accordance with Article 15.3 of this Agreement.</p> <p>13.4 Termination due to Force Majeure</p> <p>13.4.1 In case the Parties could not reach an agreement pursuant to Articles 3.3.4 and 4.4.2 of this Agreement and the Force Majeure Event or its effects continue to be present, the Nodal Agency shall have the right to cause termination of the Agreement. In case of such termination, the Contract Performance Guarantee shall be returned to the TSP as per the provisions of Article 6.5.1.</p>	<p>Force Majeure Event as per Article 11, the Scheduled COD shall be extended, by a 'day to day' basis for a period of such Force Majeure Event.</p> <p>In case the Force Majeure Event continues even after a period of one hundred and eighty (180) days if deemed necessary, the Nodal Agency or TSP, upon mutual agreement may terminate the Agreement as per the provisions of Article 13.4 by giving a Termination Notice to the other party, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement.</p> <p>In case of delay in SCOD due to FM event, the provision gives discretionary right to Nodal Agency to terminate TSA after occurrence of FM</p>
--	---



3/10

**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		<p>event. There should be gestation period of at least 6 months after start of FM event. Post completion of 6 months, both parties may decide to terminate the contract on mutual agreement. In case of FM, there should not be any unilateral right to terminate. Also, the methodology for computation of compensation to TSP, in case of mutual agreement to terminate, should be defined upfront.</p>	
<p>70. Clause 5.8 of TSA "Remedial Measures: The TSP shall take all necessary actions for remedying the shortfall in achievement of timely progress in execution of the Project, if any, as intimated by the Independent Engineer and/ or CEA and/ or the Nodal Agency. However, such intimation by the Independent Engineer and/ or CEA and/ or the Nodal Agency and the subsequent effect of such remedial measures carried out by the TSP shall</p>	<p>This is very stringent clause and provides for agreement termination at the subjective discretion of Nodal Agency. Request to modify the clause as:  ..... If the shortfalls as intimated to the TSP are not remedied to the satisfaction of the CEA and/ or the Nodal Agency, it may refer the same to the Appropriate Commission for appropriate action.</p>	<p>This is as per the Standard Bidding Documents. No change is envisaged.</p>	

311



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

	<p>not relieve the TSP of its obligations in the Agreement. Independent Engineer and/or CEA and/ or the Nodal Agency may carry out random inspections during the Project execution, as and when deemed necessary by it. If the shortfalls as intimated to the TSP are not remedied to the satisfaction of the CEA and/ or the Nodal Agency, this Agreement may be terminated by the Nodal Agency by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement."</p>		
71.	<p><b>Clause 13.7.1 of TSA</b> If Agreement is terminated on account of Force Majeure Events, no requirement of any Element or Project during Construction, Nodal Agency's non-fulfilment of Role &amp; TSP's Event of Default, the TSP shall be entitled for Termination Payment equivalent to valuation of Project</p>	<p>Guidelines on valuation of project assets conducted should be provided to ensure there is no ambiguity. Further if TSA is terminated during operating period of project, guidelines on valuation of assets in such event to be provided.</p>	<p>This is as per the Standard Bidding Documents. The provisions of clause 18.2.e. of TSA shall prevail.</p>

2/1



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>Assets. Upon payment, the Nodal Agency shall take over the Project Assets.</p>		<p>Valuation of project assets shall be done as per the prevailing industry practices. Please refer Clause No. 18.2.e. of TSA</p>
<p><b>72. Clause 13.5 of TSA</b></p> <p>13.5 Termination or amendment due to non-requirement of any Element or Project during construction</p> <p>13.5.1 In case any Element or Project, which is under construction, is no longer required due to any reason whatsoever, the Nodal Agency may issue a notice to this effect to the TSP.</p> <p>13.5.2 Nodal agency may also issue notice to the TSP seeking their response to the proposed termination/ amendment (as the case may be) of the Agreement. The Nodal Agency shall issue copy of such notice to Lenders. In the notice, Nodal Agency shall also include an assessment of the physical progress made by TSP in the Element/ Project (as the case may be) that is no longer required.</p>	<p>Guidelines on amendment of TSA in case of non-requirement of any element during construction should be clearly specified, especially the treatment of Quoted Transmission Charges and capital cost of element no longer required.</p> <p>For example, if 50% construction of an element is completed and that element is not required, how the TSP would be compensated for the capital cost of the element.</p>	

2/8



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>13.5.3 The TSP shall neither carry out further Investment nor carry out any work on the Element/ Project (as the case may be) that is no longer required after delivery of the notice.</p> <p>13.5.4 After taking into account the comments of the TSP, the Nodal Agency may terminate the Agreement or amend it if both parties agree to the amendment.</p>		
<p><b>73.</b></p>	<p>Change in Law of TSA Inclusion of change in acquisition price in Change in Law</p>	<p>As SPV acquisition price is part of capital cost of project, any change in Acquisition price after bidding would directly affect the bidder commercially and it is totally beyond the control of TSP. Hence, it is requested to kindly allow change in acquisition price under CIL event.</p>	<p>The change in acquisition price to the extent as per Provisions under Clause No. 3.5 of Tariff Based Competitive Bidding Guidelines for Transmission Service issued on 10.08.2021 shall prevail.</p>
<p><b>74.</b></p>	<p><b>Provisions of TSA</b> D)The TSP has agreed to make an application for a Transmission License to the</p>	<p>D)The TSP has agreed to make an application for a Transmission License to the Appropriate Commission for</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>

314



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>Commission for setting up the Project on build, own, operate and transfer basis.</p>	<p>setting up the Project on build, own, operate and maintain basis.</p> <p>As per revised TSA, asset to be transferred to Nodal agency post 35 years (BOOT). The assets created would be Financial assets instead of Fixed assets. Under IndAS accounting rules, depreciation of financial assets is not allowed.</p> <p>Further, TSP would be at risk of authorities levying 18% GST upfront on construction revenue recognized on COD. Higher taxation would impact the project economics eventually leading to higher tariff for the Consumers.</p> <p>Under BOOT model, asset condition may degrade towards end of concession period due to lack of incentive for developer to maintain the asset by incurring some capex.</p>	
--	---	---	--

215



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	Hence it is requested to continue with the BOOM model.	
75. <b>Clause 5.5.6 of TSA</b>	5.5.6 For any delay in commissioning any critical Element(s), as identified in Schedule 1 & Schedule 2 of this Agreement, beyond a period of 6 months (as per clause 13.1.b) unless extended by Nodal Agency due to FM/CIL as per provisions of this agreement, shall lead to a sequestration of 10% of the Contract Performance Guarantee.	This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.
	6.4.5 For avoidance of doubt, it is clarified that amount payable by TSP under this Article is over and above the penalty payable by TSP under Article 5.5.6 of this Agreement.	
	Clause 13.1.b of TSA allows upto 6 months' delay in commissioning of element after SCOD.	
	10% sequestration clause does not cover any delay due FM or CIL event.	
	If in case all the elements of projects are declared as "critical elements", TSP is liable for 10% CPG sequestration. It is requested to kindly extend period	

216



Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

		<p>beyond which CPG sequestration shall occur to 6 months.</p> <p>Further, TSP should not be made liable for LD payments on account of delay in project / element commissioning more than as identified under clauses 6.4.1 and 6.4.2</p>	
<p><b>76. Provisions of TSA</b>  AA- Actual Availability ; MTC- Monthly transmission charges; Tmn = transmission charges for month "m" in contract year "n"  For incentive  If 98% &lt; AA &lt; 98.5%; MTC= Tmn*1;  If 98.5% &lt; AA &lt; 99.75% ;  MTC= Tmn* (AA / 98.5 %);  If AA &gt; 99.75%;</p>	<p>Incentive = 0.02 x Annual Transmission Charges x (Actual Annual Availability – Target Availability)</p> <p>Target Availability: AC -98% &amp; HVDC -95% Incentive = 0.02 x Annual Transmission Charges x (Actual Annual Availability – Target Availability)</p> <p>Target Availability: AC -98% &amp; HVDC -95%</p> <p>The tariff for projects under TBCB has seen a reduction of 30%-50% as compared to RTM projects. The</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>	



217

**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

<p>MTC = Tmn* (99.75 % /98.5 %);</p> <p><b>For Penalty</b></p> <p>If 95 % &lt; AA &lt; 98 %</p> <p>MTC = Tmn* (AA / 98 %);</p> <p>If AA &lt; 95 %</p> <p>MTC = Tmn* (AA/98 %) - 0.02* (Tmn* (AA/98%))</p>	<p>incentive for maintaining availability above target availability aids in increasing reliability of the transmission system. As the incentive is reduced as per revised provisions, developers may increase the Quoted tariffs to compensate which may result in increased cost of electricity to end consumer. Further there is no incentive for maintaining actual availability between 98% and 98.5%.</p> <p>Hence it is requested to continue with existing provisions for penalty and incentive calculation.</p>	
<p><b>77. Clause 3.3.4 of TSA</b></p> <p>Provided, that due to the provisions of Article 3.3.4, any increase in the time period for completion of conditions subsequent mentioned under Article 3.1 .3, shall lead to an equal increase in the time period for the Scheduled COD. If the Scheduled COD is extended beyond a period of one hundred</p>	<p>3.3.4 Provided, that due to the provisions of Article 3.3.4, any increase in the time period for completion of conditions subsequent mentioned under Article 3.1 .3, shall lead to an equal increase in the time period for the Scheduled COD. The TSP will be allowed to recover the interest cost</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>

31A



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

<p>eighty (180) days due to the provisions of this Article 3.3.4, the TSP will be allowed to recover the interest cost during construction corresponding to the period exceeding one hundred eighty (180) days by adjustment in the Transmission Charges in accordance with Schedule 9.</p>	<p>during construction corresponding for the period of FM/CIL event by adjustment in the Transmission Charges in accordance with Schedule 9.</p> <p>In event of FM/CIL event, provisions under revised TSA do not provide for any adjustment in transmission charges for a period of 180 days. TSP is allowed to recover interest cost during construction for period exceeding 180 days.</p> <p>As large portion (70%) of project cost is funded through debt, repayment of which does not start till COD, any delay in SCOD leads to higher interest built up. This severely affects the project economics of developer. Hence it is requested to allow for recovery of interest cost during construction for entire period of FM/CIL event.</p>
---	--



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>78. <b>Clause 18. 1 of TSA</b> The Nodal Agency shall appoint an agency/company as Independent Engineer (IE).....  Responsibilities of IE include progress monitoring, ensuring quality, determine costs of works/services, determine valuation of project assets, assist parties in dispute resolution.</p>	<p>It is requested to not appoint an external agency (Independent Engineer-IE) and the Nodal Agency to execute the functions such as progress monitoring, quality assurance, determination of works/services, valuation of projects assets.  Any delay in appointment of IE would delay the project execution.  Further addition of an external agency would also be an additional expense which would eventually result in tariff increase.</p>	<p>Nodal Agency shall appoint the Independent Engineer as per the provisions of TSA.</p>
<p>79. 3.1 Satisfaction of Conditions Subsequent by the TSP  c. Execute this Agreement;</p>	<p>Since the execution of TSA will require coordination with the CTU, it is requested that the TSA be executed before project acquisition by the project SPV in the interest of saving time. This will also facilitate early completion of the project critical activities</p>	<p>As per revised TBCB Guidelines and SBDs issued by MOP, GoI, TSP on the date of acquisition of SPV from the BPC will enter into a Transmission Service Agreement (TSA) with the Nodal Agency.</p>

226



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

80.	<p><b>Clause 3.1.3 of TSA</b></p> <p>The TSP agrees and undertakes to duly perform and complete the following activities within six (6) months from the Effective Date</p> <p>.....</p> <p>To obtain the Transmission License for the Project from the Commission;</p>	<p>While the TSP will apply to the respective commission for grant of license, time required for the issuance is beyond the control of TSP once the application is made. We request to modify the clause suitably to incorporate the above.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>
81.	<p><b>Clause 3.5 of SPA</b></p> <p>The Selected Bidder hereby acknowledges and agrees that after the date of acquisition of one hundred percent (100%) of the Shares of the Company by the Selected Bidder as per Clause 3.3, (a) the authority of the BPC in respect of the Bid Process shall forthwith cease and any actions to be taken thereafter regarding the Bid Process will be undertaken by the Central Transmission Utility of India Limited themselves, (b) all rights and obligations of the BPC shall cease forthwith, (c) all other rights</p>	<p>We understand that acquisition price towards acquisition of one hundred percent (100%) of the equity shareholding of the Company, communicated to bidder would include all liabilities pertaining to SPV prior to closing date. Please confirm</p>	<p>The Acquisition Price includes all the assets and liabilities pertaining to SPV and details of the same will be intimated by the BPC as per the provisions of RFP.</p>

23



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>and obligations of the Company shall be of the TSP and (d) any decisions taken by the BPC on behalf of the Company prior to the date of acquisition, shall continue to be binding on the Company and/or Central Transmission Utility of India Limited as the case may be.</p>		
<p>82.</p>	<p><b>765kV Line Bays at Banaskantha.</b>  <b>General Scope of Work</b></p>	<p>As per Scope no line reactor is envisaged for both ends. However, as per Shared GA space provision is there.  It is understood that as NO Line reactor scope is there, TSP need not develop space for the space and direct terminate the line to respective location as shown.  BPC to confirm the understanding</p>	<p>Refer GA drawing provided with the RFP.</p>
<p>83.</p>	<p><b>765kV Line Bays at Banaskantha</b>  <b>Clause B.2.5. d) of RFP</b></p>	<p>It is understood that existing busbar protection have provision for future bays and also PUs are available for future bays. BPC to confirm.</p>	<p>Banaskantha substation extension:  Existing busbar protection at Banaskantha S/S has provision for bays under the present scope. PUs shall be provided by the respective bay owner.</p>

322



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-1"**

<p>84. 765kV Line Bays at Banaskantha Clause B.2.6 a) of RFP</p>	<p>For SCADA, it is understood that necessary process I/O shall be available for future bays and accordingly license for same. BPC to confirm.</p>	<p>Banaskantha substation extension: Necessary process I/O for bays under present scope including license for same is in present scope.</p>
<p>85. 765kV Line Bays at Banaskantha Clause B.3.1 of RFP</p>	<p>BPC to confirm the availability of AC &amp; DC feeders in existing ACDB/DCDB for future bays.</p>	<p>Banaskantha substation extension: AC &amp; DC feeders and modules are to be provided under present scope.</p>
<p>86. 765kV Line Bays at Banaskantha Clause B.3.1 of RFP</p>	<p>We understand that existing equipment such as DG Set, LT Transformer, Battery &amp; Battery charger have sufficient capacity to cater the requirements of bay under present scope of work, hence no need to consider new DG Set, LT Transformer, Battery &amp; Battery charger in the existing substations. BPC to confirm the same.</p>	<p>New DG Set, LT Transformer, Battery &amp; Battery charger are not envisaged at existing Banaskantha substation.</p>
<p>87. 765kV Line Bays at Banaskantha Clause B.3.2 of RFP</p>	<p>No separate FF system is envisaged under the present scope of work.</p>	<p>The fire-fighting systems, as available, shall be augmented/ extended to meet the additional requirements at Banaskantha S/S.</p>

323



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

		BPC to confirm	
88.	<p><b>Clause 1.6.1.1 of RFP</b></p> <p>The actual location of substations, switching stations or HVDC terminal or inverter stations shall not be beyond 3 Km radius of the location proposed by the BPC in the survey report. The actual location of Greenfield substations for a generation pooling substation and for load serving substations shall not be beyond 3 Km radius of the location proposed by the BPC in the survey report. However, actual location of any Greenfield intermediate Substations in the scope of TSP shall not be beyond 10 Km radius of the location proposed by the BPC in the survey report.</p>	<p>BPC is requested to clarify that in case no land is available for substations, switching stations or HVDC terminal or inverter stations within 3 KM/10KM radius of the location proposed by the BPC in the survey report, whether the selected bidder can opt for the land beyond 3KM/10KM?</p> <p>Bidder needs the information for proper estimation.</p>	<p>The Substation (Greenfield generation pooling sub-station) shall not be beyond 3 km radius of the proposed location.</p>
89.	<p><b>RFP General</b></p> <p><b>Soil Test Report of Banasakatha S/s</b></p>	<p>BPC is requested to provide Soil Test report of Banasakatha S/s for proper design and estimation of Bays.</p>	<p>Soil investigation is in present scope.</p>
90.	<p><b>As per the scope of RFP</b></p> <p><b>400KV line bays - 4 Nos. at Raghnesda (GIS)</b></p>	<p>BPC is requested to clarify that in the present scope of Raghnesda (GIS) S/s 4 Nos. of 400KV line bays are there for (interconnection of RE Projects). BPC may provide the coordinates/location</p>	<p>Confirmed.</p> <p>Refer to clarification at Sl. No. 42 for coordinates of RE developers which have been allocated 4 Nos. 400kV line bays.</p>



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

		of generation station and other relevant details.	
91.	<b>Clause 1.5 of RFP</b>	The TSP shall ensure transfer of all project assets along with substation land, right of way and clearances to CTU or its successors or an agency as decided by the Central Government after 35 years from COD of project at zero cost and free from any encumbrance and liability.  The legal, statutory charges & taxes if applicable for transfer of all project assets is to be borne by CTU or successors. Kindly confirm	The provisions of RFP and TSA are amply clear in this regard.
92.	<b>SECTION 1: Clause no 1.6.1.1 of RFP</b>	We understand that BPC has already acquired land for proposed substation site and encumbrance free land will be provided to successful Bidder, Please confirm.	Land is to be acquired by the TSP for proposed substation. BPC have provided the coordinates of the proposed Substation which can be accessed from survey report which is already shared with the bidders.
93.	<b>Survey Report</b>	Kindly confirm the land area allotted for Raghnesda SS & provide us the	

225



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		boundary co-ordinates for our better designing purpose. Kindly provide the survey report of transmission line.	
94.	<b>RFP - NOTIFICATION Clause no 6</b>	Kindly provide the SPV name	SPV Incorporation is under process and SPV name would be shared separately.
95.	<b>RFP Section 2, clause no 2.15.4 &amp; TSA clause no 3.1.1</b>	Within five (5) working days of the issue of the acquisition of the SPV by the Successful Bidder, the TSP shall apply to the Commission for grant of Transmission License and make an application to the Commission for the adoption of Transmission Charges, as required under Section – 63 of The Electricity Act 2003.  We request you to consider at least 30 days' time for completion of these activities.	The provisions of RFP and TSA shall prevail.
96.	<b>General Query</b>	As per RFP, the space for extension of 2 nos of 765KV bay at Banaskantha is	No cost is envisaged for the space in existing substation for extension of 2 nos. of 765 kV bay at Banaskantha.



Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

		provided at free of cost. Kindly confirm.	
97.	<b>RFP - GA (doc no GNB-PGCIL-BNK-ELE-003)</b>	The allocation of 765KV bay at banaskantha SS is not clear. As both the circuits for Raghnesda is shown on extreme opposite side to each other as per given layout. Please confirm	Refer Sl. no. 1 of Amendment-I dated 05.11.2024.
98.	<b>RFP - SLD (doc no GNB-PGCIL-BNK-ELE-002)</b>	The scope is limited to 765KV line bay at Banaskantha SS. No line reactors are required for both line bays. Please confirm	Refer clause 1.2 of RFP for scope of work.
99.	<b>RFP - SLD (doc no GNB-PGCIL-BNK-ELE-002)</b>	In SLD of Banaskantha for Circuit II, it is shown as Aux Bus for ICT. We understand that same would be converted to line bay. Kindly confirm.	Refer Sl. no. 1 of Amendment-I dated 05.11.2024.
100.	<b>RFP - B.5 (EXTENSION OF EXISTING SUBSTATION)</b>	Addition to SLD & Layout, other drawings such as Earthmat layout, VMS Layout, BUS bar Type (Centralized/decentralized), PLCC make for 765kV Banaskantha are also	Refer Sl. no. 2 of Amendment-I dated 05.11.2024 for Earthmat layout, VMS and Bus bar protection details. Bidder may visit the site for other existing details.

827



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		required for proper estimation of quantities.	
101.	<b>B.2.3.1 Circuit Breakers (GIS)</b>	<p>The Circuit breakers controlling 400 kV lines wherever required shall be provided with pre-insertion closing resistor of about 400 ohms with 8 Ms insertion time or Controlled Switching Device (CSD) for lines longer than 200 km.</p> <p>Kindly clarify whether both PIR &amp; CSD needs to be considered for 4 nos of 400KV line bay (Present scope), as distance of the connecting lines at 400KV Level is not mentioned.</p>	Requirement of RfP shall be followed.
102.	<b>General Query</b>	<p>Further, We understand that spare feeder in ACDB/DCDB &amp; Bus bar bay units are already present at site and same shall be utilized for present extension work at 765KV Banaskantha SS.</p>	Refer GA drawing provided with the RfP.



220

**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		<p>We assume that LT System viz. LT transformer, battery banks/Charger, DG set etc are sufficient to accommodate the present bays load requirement. Kindly confirm our understanding.</p>	
<p>103. <b>General Query</b></p>		<p>BPC is requested to confirm the following for the extension work at Banaskantha SS:</p> <ol style="list-style-type: none"> <li>1. Availability of space in existing Control room for extension work</li> <li>2. Availability of CU and PU for bays under present scope of work</li> <li>3. Sufficiency of existing fire hydrant system for extension</li> <li>4. Availability of Feeders in existing ACDB and DCDB panels</li> <li>5. Sufficiency of existing battery and battery charger for extension work</li> </ol>	<p>Banaskantha S/S: 1. Bidder may visit the site to ascertain the space as per their requirement. 2. Existing busbar protection at Banaskantha S/S have provision for bays under present scope. PUs shall be provided by respective bay owner. 3. The fire-fighting systems, as available, shall be augmented/ extended to meet the additional requirements at Banaskantha S/S. 4 &amp; 6. AC &amp; DC feeders and modules are to be provided under present scope. 5. New Battery and Battery charger are not envisaged at existing Banaskantha substation.</p>

329



**Set 1 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghanesda area of Gujarat – 3 GW under Phase-I"**

	<p>6. Availability of AC &amp; DC Feeders in LT boards. 7. SAS and Bus bar protection make and model 8. Make and model of VMS</p>	<p>7&amp;8. Refer Sl. no. 2 of Amendment-I dated 05.11.2024. <b>Bidder is also advised to visit the site to ascertain the above existing details.</b></p>
--	---	---

930



**Amendment-1 (dated: 05.11.2024) to RFP Documents for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phas" through tariff based competitive bidding process.**

Sl. No.	Clause No.	Existing Clause	New/Revised Clause																																																
1	RFP Specific Technical Requirements for Substation Clause no. B.1.2	xi) 765 kV Banaskantha Extn: Refer attached SLD & GA drawing of Banaskantha S/S. Raghnesda – Banaskantha (PG) 765 kV D/c line shall be terminated in existing diameters for which Main Bays shall be constructed (Tie bays are existing) under present scope as marked in GA drawing. Further, all associated interconnection work shall also be in the present scope of TSP.	xi) 765 kV Banaskantha Extn: Refer attached SLD (Drg. No. C/ENGG/WR-II/BANASKANTHA/SLD/1) & GA drawing (GNB-PGCIL-BNK-ELE-003) of Banaskantha S/S. One circuit of Radhanesda – Banaskantha (PG) 765 kV D/c line shall be terminated in new diameter for which Main and Tie bays shall be constructed under present scope. Other circuit of Radhanesda – Banaskantha (PG) 765 kV D/c line shall be terminated in existing diameter for which Main Bay shall be constructed (Tie bay is existing) under present scope. Further, all associated interconnection work shall also be in the present scope of TSP.																																																
2	RFP Specific Technical Requirements for Substation Clause no. B.5	<p><b>B.5 EXTENSION OF EXISTING SUBSTATION</b></p> <p>The following drawings/details of existing substation is attached with the RFP documents for further engineering by the bidder.</p> <table border="1"> <thead> <tr> <th>Sl. No.</th> <th>Drawing Title</th> <th>Drawing No./Details</th> <th>Rev. No.</th> </tr> </thead> <tbody> <tr> <td>A.</td> <td colspan="3">765/400 kV Banaskantha S/s</td> </tr> <tr> <td>1.0</td> <td>Single Line Diagram</td> <td>C/ENGG/WR-II/BANASKANTHA A/SLD/1</td> <td>-</td> </tr> <tr> <td>2.0</td> <td>General Arrangement</td> <td>GNB-PGCIL-BNK-ELE-003</td> <td>5</td> </tr> <tr> <td>3.0</td> <td>Earthmat Layout</td> <td>TR202135-1001587-SS1623-EMAT-LAYOUT</td> <td>R2</td> </tr> <tr> <td>4.0</td> <td>Visual Monitoring System</td> <td>TB-384-510-018</td> <td>R1</td> </tr> </tbody> </table>	Sl. No.	Drawing Title	Drawing No./Details	Rev. No.	A.	765/400 kV Banaskantha S/s			1.0	Single Line Diagram	C/ENGG/WR-II/BANASKANTHA A/SLD/1	-	2.0	General Arrangement	GNB-PGCIL-BNK-ELE-003	5	3.0	Earthmat Layout	TR202135-1001587-SS1623-EMAT-LAYOUT	R2	4.0	Visual Monitoring System	TB-384-510-018	R1	<p><b>B.5 EXTENSION OF EXISTING SUBSTATION</b></p> <p>The following drawings/details of existing substation is attached with the RFP documents for further engineering by the bidder.</p> <table border="1"> <thead> <tr> <th>Sl. No.</th> <th>Drawing Title</th> <th>Drawing No./Details</th> <th>Rev. No.</th> </tr> </thead> <tbody> <tr> <td>A.</td> <td colspan="3">765/400 kV Banaskantha S/s</td> </tr> <tr> <td>1.0</td> <td>Single Line Diagram</td> <td>C/ENGG/WR-II/BANASKANTHA A/SLD/1</td> <td>-</td> </tr> <tr> <td>2.0</td> <td>General Arrangement</td> <td>GNB-PGCIL-BNK-ELE-003</td> <td>5</td> </tr> <tr> <td>3.0</td> <td>Earthmat Layout</td> <td>TR202135-1001587-SS1623-EMAT-LAYOUT</td> <td>R2</td> </tr> <tr> <td>4.0</td> <td>Visual Monitoring System</td> <td>TB-384-510-018</td> <td>R1</td> </tr> </tbody> </table>	Sl. No.	Drawing Title	Drawing No./Details	Rev. No.	A.	765/400 kV Banaskantha S/s			1.0	Single Line Diagram	C/ENGG/WR-II/BANASKANTHA A/SLD/1	-	2.0	General Arrangement	GNB-PGCIL-BNK-ELE-003	5	3.0	Earthmat Layout	TR202135-1001587-SS1623-EMAT-LAYOUT	R2	4.0	Visual Monitoring System	TB-384-510-018	R1
Sl. No.	Drawing Title	Drawing No./Details	Rev. No.																																																
A.	765/400 kV Banaskantha S/s																																																		
1.0	Single Line Diagram	C/ENGG/WR-II/BANASKANTHA A/SLD/1	-																																																
2.0	General Arrangement	GNB-PGCIL-BNK-ELE-003	5																																																
3.0	Earthmat Layout	TR202135-1001587-SS1623-EMAT-LAYOUT	R2																																																
4.0	Visual Monitoring System	TB-384-510-018	R1																																																
Sl. No.	Drawing Title	Drawing No./Details	Rev. No.																																																
A.	765/400 kV Banaskantha S/s																																																		
1.0	Single Line Diagram	C/ENGG/WR-II/BANASKANTHA A/SLD/1	-																																																
2.0	General Arrangement	GNB-PGCIL-BNK-ELE-003	5																																																
3.0	Earthmat Layout	TR202135-1001587-SS1623-EMAT-LAYOUT	R2																																																
4.0	Visual Monitoring System	TB-384-510-018	R1																																																

2



**Amendment-1 (dated: 05.11.2024) to RFP Documents for "Transmission system for evacuation of RE power from Raghanesda area of Gujarat - 3 GW under Phase-I" through tariff based competitive bidding process.**

Sl. No.	Clause No.	Existing Clause	New/Revised Clause																		
		(SAS)	<table border="1"> <tr> <td>5.0</td> <td>Bus Bar Protection</td> <td>Make: NR Model: PCS 915</td> <td>-</td> </tr> <tr> <td>6.0</td> <td>Substation Automation System (SAS)</td> <td>Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)</td> <td>R2</td> </tr> </table>	5.0	Bus Bar Protection	Make: NR Model: PCS 915	-	6.0	Substation Automation System (SAS)	Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)	R2										
5.0	Bus Bar Protection	Make: NR Model: PCS 915	-																		
6.0	Substation Automation System (SAS)	Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)	R2																		
3	RFP Clause no. 1.2	<p>1.2 The TSP will be required to establish the following Inter State Transmission System for "Transmission system for evacuation of RE power from Raghanesda Area of Gujarat-3GW under Phase-I" (hereinafter referred to as 'Project') on build, own, operate and transfer basis, and to provide transmission service.</p>	<p>1.2 The TSP will be required to establish the following Inter State Transmission System for "Transmission system for evacuation of RE power from Raghanesda Area of Gujarat-3GW under Phase-I" (hereinafter referred to as 'Project') on build, own, operate and transfer basis, and to provide transmission service.</p>																		
		<p>Transmission system for evacuation of RE power from Raghanesda Area of Gujarat-3GW under Phase-I</p> <table border="1"> <thead> <tr> <th>S No.</th> <th>Name of Transmission Element</th> <th>Scheduled COD from Effective Date</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Establishment 3x1500 MVA, 765/400 kV Substation near Raghanesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor</td> <td>.....</td> </tr> <tr> <td>...</td> <td>...</td> <td>...</td> </tr> </tbody> </table>	S No.	Name of Transmission Element	Scheduled COD from Effective Date	1	Establishment 3x1500 MVA, 765/400 kV Substation near Raghanesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor	.....	...	...	...	<p>Transmission system for evacuation of RE power from Raghanesda Area of Gujarat-3GW under Phase-I</p> <table border="1"> <thead> <tr> <th>S No.</th> <th>Name of Transmission Element</th> <th>Scheduled COD from Effective Date</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Establishment 3x1500 MVA, 765/400 kV Substation near Raghanesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor</td> <td>.....</td> </tr> <tr> <td>...</td> <td>...</td> <td>.....</td> </tr> </tbody> </table>	S No.	Name of Transmission Element	Scheduled COD from Effective Date	1	Establishment 3x1500 MVA, 765/400 kV Substation near Raghanesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor	.....	...	...	.....
S No.	Name of Transmission Element	Scheduled COD from Effective Date																			
1	Establishment 3x1500 MVA, 765/400 kV Substation near Raghanesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor	.....																			
...	...	...																			
S No.	Name of Transmission Element	Scheduled COD from Effective Date																			
1	Establishment 3x1500 MVA, 765/400 kV Substation near Raghanesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor	.....																			
...	...	.....																			

222



Amendment-1 (dated: 05.11.2024) to RFP Documents for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phas ' through tariff based competitive bidding process.

Sl. No.	Clause No.	Existing Clause	New/Revised Clause
		<p>Future Scope (Space for):</p> <p>.....</p> <p>.....</p> <ul style="list-style-type: none"> <li>• 220 kV BC : 1 No.</li> </ul> <p>.....</p>	<p>Future Scope (Space for):</p> <p>.....</p> <p>.....</p> <ul style="list-style-type: none"> <li>• 220 kV BC : 2 Nos.</li> </ul> <p>.....</p>
4.	Clause B.1.2(x) of RFP	<p>Provision of 220 kV Bus Sectionalization (Future) and space provision shall be with the following feeder distribution.</p> <p>220 kV Bus Section-1 (Future)</p> <p>a) 4 Nos. of future 400/220 kV ICT</p> <p>b) 6 Nos. of future 220 kV Line</p> <p>220 kV Bus Section-2 (Future)</p> <p>a) 4 Nos. of future 400/220 kV ICT</p> <p>b) 6 Nos. of future 220 kV Line</p> <p>c) 1 No. future Bus coupler</p>	<p>Provision of 220 kV Bus Sectionalization (Future) and space provision shall be with the following feeder distribution.</p> <p>220 kV Bus Section-1 (Future)</p> <p>a) 4 Nos. of future 400/220 kV ICT</p> <p>b) 6 Nos. of future 220 kV Line</p> <p>c) 1 No. future Bus coupler</p>
5.	Clause A.7.0 of RFP	<p>A) For power line crossing of 400 kV or above voltage level, large angle and dead end towers (i.e. D/DD/QD) shall be used on either side of power line crossing.</p> <p>B) For power line crossing of 132 kV and 220 kV (or 230 kV) voltage level, angle towers (B/C/D/DB/DC/DD/ QB/QC/QD) shall be used on either side of power line crossing depending upon the merit of the prevailing site condition and line deviation requirement.</p> <p>C) For power line crossing of 66 kV and below voltage level, suspension/tension towers shall be provided on either side of power line crossing depending upon the merit of the</p>	<p>A) Under crossing of the existing transmission line of same Voltage shall not be allowed. In the case where it is inevitable to under-cross the existing transmission line then TSP shall seek prior approval from Chief Electrical Inspector, CEA with detailed study ensuring that all statutory electrical clearances and Electric Field limit of 10 kV/m at 1 m and 1.8 m from ground level is not violated.</p> <p>B) For power line crossing of 400 kV or above voltage level, large angle and dead end towers (i.e. D/DD/QD) shall be used on either side of power line crossing.</p> <p>C) For power line crossing of 132 kV and 220 kV (or 230 kV) voltage level, angle towers (B/C/D/DB/DC/DD/ QB/QC/QD)</p>

222

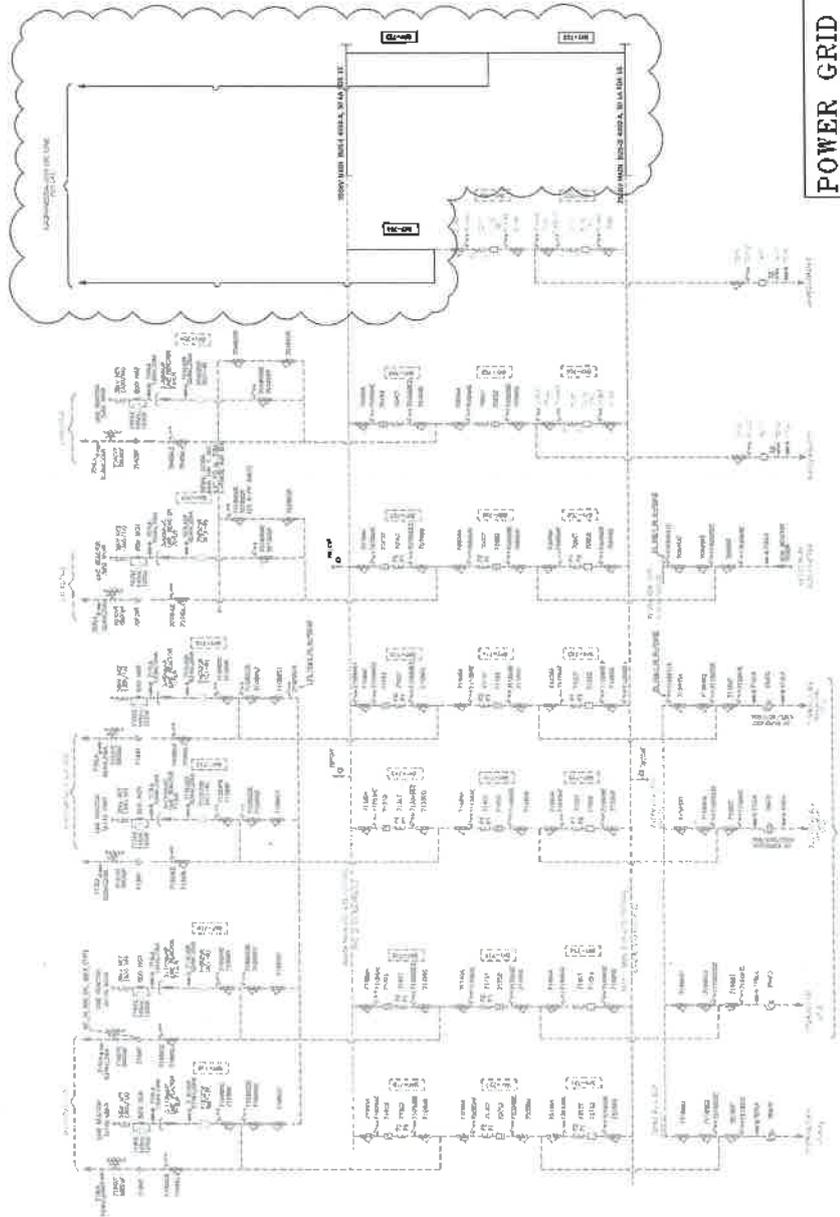


**Amendment-1 (dated: 05.11.2024) to RFP Documents for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase 1" through tariff based competitive bidding process.**

Sl. No.	Clause No.	Existing Clause	New/Revised Clause
		<p>prevailing site condition and line deviation requirement.</p> <p>D) For crossing of railways, national highways and state highways, the rules/ regulations of appropriate authorities shall be followed.</p>	<p>shall be used on either side of power line crossing depending upon the merit of the prevailing site condition and line deviation requirement.</p> <p>D) For power line crossing of 66 kV and below voltage level, suspension/tension towers shall be provided on either side of power line crossing depending upon the merit of the prevailing site condition and line deviation requirement.</p> <p>E) For crossing of railways, national highways and state highways, the rules/ regulations of appropriate authorities shall be followed.</p>
6.	Clause A.23.0 of RFP	New Clause	The stringing of the transmission line in forest area shall be carried out through drone.
7.	Clause A.24.0 of RFP	New Clause	The tower shall be designed considering the porcelain Insulators with creepage factor of 31 mm/ kV irrespective of type of insulator used.
8.	Clause A.11.0 of RFP	Shielding angle shall not exceed for 765 kV D/C transmission line.	Shielding angle shall not exceed 10 deg for 765 kV D/C transmission line.

834





**POWER GRID CORPORATION OF INDIA LIMITED**  
(A Government of India Enterprise)

**PROJECT:**

**SUBSTATION** 765/400KV BANASKANTHA S/S (PG)

**TITLE:** SINGLE LINE DIAGRAM

**DRAWING NO.** C/ENGG/WR-II/BANASKANTHA/SLD/1

**NOTE:** NEW DIAMETER WITH TWO CB SCHEME TO BE CONSIDERED FOR TERMINATION OF ONE OF THE CIRCUIT OF 765KV BANASKANTHA - RAGHANESDA(GIS) D/C TRANSMISSION LINE.

**LEGENDS:**

EXISTING/FUTURE  
UNDER PRESENT SCOPE





Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

S. N.	Clause No. and Existing provision	Clarification required	Clarifications
1.	RFP for Selection of Bidder as Transmission Service Provider  Special Technical requirement for Transmission Line  Clause A.11.0  It is noted that valued of Shielding angle is not specified in Clause A.11.0.  "Shielding angle shall not exceed for 765kV D/C transmission line".  Kindly confirm the value.	It is noted that valued of Shielding angle is not specified in Clause A.11.0.  "Shielding angle shall not exceed for 765kV D/C transmission line".  Kindly confirm the value.	Please refer Amendment No. 01 issued dated 05.11.2024.
2.	RFP for Selection of Bidder as Transmission Service Provider  Clause 1.2  2 Nos. 765 kV line bays at Banaskantha (PG) S/s	BPC is requested to provide the following documents for the extension work at Banaskantha (PG):  1. Soil investigation report 2. Cable trench layout 3. Earthmat Layout	Soil investigation is in present scope.  Earthmat layout is provided with Amendment-1 dated 05.11.2024.  For other details, bidder is advised to visit the site.



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

3.	RFP for Selection of Bidder as Transmission Service Provider  Clause 1.2 Scope of Work	We understand TSP has to follow RFP requirements only. Existing station (at Banaskantha PG) owner practice and requirement is not binding on TSP.	Bidder shall meet the requirements of RfP.
4.	RFP for Selection of Bidder as Transmission Service Provider  Clause 1.2 2 Nos. 765 kV line bays at Banaskantha (FG) S/s 765 kV line bays – 2 Nos	BPC is requested to share the following details for extension work at Banaskantha S/s:  1. Availability of space in existing Control room for extension work 2. Availability of CU and PU for bays under present scope of work 3. Availability of Feeders in existing ACDB and DCDB panels 4. Sufficiency of existing battery and battery charger for extension work 5. Availability of AC & DC Feeders in LT boards. 6. SAS and Bus bar protection make and model 7. Make and model of VMS	Kindly refer reply no. 103 of Set-1 issued to bidders dated 05.11.2024.
5.	RFP for Selection of Bidder as Transmission Service Provider  Clause B.1.2 Note:	As the make and model of future GIS equipment is unknown, we understand that the bays provided for completion of dia (to be utilized in future) are to be	Refer clause B.1.2 (iv) and (ix) of RFP regarding requirements of diameter completion including the requirement of line side equipments.



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghanesda area of Gujarat - 3 GW under Phase-I"**

<p>(iv) In case of GIS substation where the bus scheme is One and Half breaker scheme, the diameters shall be complete with feeder/line side isolator to be used for any future line with switchable line reactor bay and GIS duct of the future bay shall be brought outside the GIS hall/building with extension/interface module suitably.</p>	<p>terminated immediately outside the GIS Hall with extension module. Please confirm.</p>	
<p>6. RFP for Selection of Bidder as Transmission Service Provider Clause B.1.2 Switching Scheme 400kV feeder distribution at Raghanesda ix) 765/400 kV Raghanesda S/s (GIS) 400kV bay configuration Bus Reactor - Tie- Future Line x) 765/400 kV Raghanesda S/s (GIS) 400 kV Bus Section-1</p>	<p>As per sl no (ix) the future bay to be provided by TSP for dia completion of 400kV diameter shall be 1 no of 400kV line bay. However, as per sl no (x) in 400kV Bus Section-1, 4 nos of future line along with switchable line reactor are envisaged. We understand that based on SI No (ix) of clause B.1.2, TSP needs to provide 1 no of 400kV line bay for dia completion with provision for Line reactor bay addition only. The associated line reactor bay for the future 400kV line bay is not in present scope of work of TSP. Please confirm.</p>	<p>400 kV Future line bay mentioned in Clause B.1.2 (ix) is to be executed under present scope as part of diameter completion. It is clarified that Line Reactor module for the future Line bay for diameter completion is under present scope as per RFP.</p>

329



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

7.	<p>e) 4 Nos. of future 400 kV Line along with switchable line reactor</p> <p>TSA</p> <p>Schedule 1</p> <p>Scope of the Project provides that:</p> <p>TSP of Banaskantha S/s (POWERGRID) shall provide space for scope of work.</p>	<p>The construction of scope of work by the selected bidder would depend on provision of space to be provided by POWERGRID and would be out of control of the selected bidder. BPC to clarify the following:</p> <p>a. We understand at Banaskantha (PG), encumbrance free &amp; levelled land as per required FGL as per existing station, shall be provided to TSP for present scope of Bay extension work. Please clarify.</p> <p>b. Whether the space provided by POWERGRID will be compatible for the selected bidder for the scope of work?</p> <p>c. Whether the space will be provided by POWERGRID as free of cost?</p>	<p>For point no (c) No cost is envisaged for the space in existing substation for extension of 2 nos. of 765 kV bay at Banaskantha.</p> <p>For points (a) to (f) except poin no. (c) Bidder is advised to visit the site to ascertain the existing details.</p> <p>For point no (g) the provisions of TSA shall prevail.</p>
----	--	--	--

240



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		<p>d. Under which documents or transactions POWERGRID shall be obligated to provide spaces to the selected bidder? BPC to please clarify under what binding arrangement or agreement is in place with PGCIL who is obligated to provide space for works to successful bidder.</p> <p>e. BPC to share a copy of the binding document or agreement, mentioning timeline of providing bays and space for works agreed by PGCIL, if any under which POWERGRID is obligated to provide spaces to the selected bidder.</p> <p>f. In case of any delay on the part of POWERGRID in providing spaces to the Selected Bidder, whether the extension of SCOD and reimbursement of the cost will be provided to the selected bidder?</p> <p>g. Whether the delays on the part of POWERGRID in providing the space will cover under force majeure?</p>	
--	--	--	--

341



Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

		Whether there is any timeline within which POWERGRID need to provide space to Selected Bidder?	
8.	<p>TSA</p> <p>Clause 5.1.2</p> <p>The TSP acknowledges and agrees that it shall not be relieved from any of its obligations under this Agreement or be entitled to any extension of time or any compensation whatsoever by reason of the unsuitability of the Site or Transmission Line route(s).</p>	<p>BPC to clarify that as the spaces for the completion of the scope of work shall be provided POWERGRID, who shall be responsible in case of the unsuitability of the land provided by POWERGRID?</p>	<p>The relevant provisions of TSA shall prevail.</p>
9.	<p>TSA</p> <p>Clause 5.5.6</p> <p>Any delay in commissioning any critical Element(s), as identified in Schedule 1 &amp; Schedule 2 of this Agreement, beyond a period of 45 days shall lead to a sequestration of 10% of the Contract Performance Guarantee</p>	<p>As a general practice, the CERC considers any request for an extension of time post-COD of the Project. BPC to clarify whether the 10% of CPBG will be invoked even when such delay is caused due to FM events and without adjudication on the validity of such claims.</p>	<p>The relevant provisions of TSA shall prevail.</p>
10.	<p>TSA</p>	<p>BPC to clarify the following:</p>	<p>The relevant provisions of TSA shall prevail.</p>

342



Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

	<p>Clause 2.2.2 It is required that post the Expiry Date, the TSP to transfer the Project to CTU within a period of 90 days</p>	<p>a. Who will be responsible for O&amp;M of the Project post Expiry Date till the Project is transferred as the Agreement will automatically terminate on Expiry Date?  Whether the TSP will be paid for the O&amp;M for the period post Expiry Date till the Project is transferred if the TSP manages the O&amp;M post Expiry Date?</p>	
11.	<p>TSA  Clauses 4.1(f) and 4.2.1(e)  These clauses provide assistance by the Nodal Agency or TSP to the Arbitrators as required for the performance of their duties and responsibilities.</p>	<p>BPC to define Arbitrators as there are no provisions of arbitrators in the TSA.</p>	<p>The provisions of TSA shall prevail.</p>
12.	<p>TSA  5.1.4.(a)  The actual location of Greenfield substations (Switching Stations or HVDC Terminal or Inverter Stations) for a generation pooling substation and for load serving substations in the scope of TSP shall not be beyond 3 Km radius of the location proposed by the BPC in the</p>	<p>BPC to clarify that in case no land is available for Greenfield Substations (switching stations, or HVDC terminal or inverter stations), load serving substation, Greenfield Intermediate Substation within a 3 KM/ 10 KM radius respectively of the location proposed by the BPC in the survey report, whether the selected bidder can opt for the land beyond 3 KM / 10 KM, as applicable?</p>	<p>The provisions of RFP and TSA shall prevail.</p>

293



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>survey report. However, actual location of any Greenfield Intermediate Substations in the scope of TSP shall not be beyond 10 Km radius of the location proposed by the BPC in the Survey Report.</p>									
<p>13. TSA and SPA Execution of the TSA and SPA</p>	<p>As per the provisions of the Indian Stamp Act, the execution of the Share Purchase Agreement ('SPA') and the Transmission Service Agreement ('TSA') should be made on the stamp papers of INR 1200 and INR 500 respectively. The relevant provisions of the Indian Stamp Act are provided below:</p> <table border="1" data-bbox="778 689 1284 1368"> <thead> <tr> <th>SN.</th> <th>Document</th> <th>Stamp Paper for Execution (in INR)</th> <th>Indian Stamp Act, 1899 ('Act') read with Delhi Schedule 1A ('Schedule')</th> </tr> </thead> <tbody> <tr> <td>1.</td> <td>Share Purchase Agreement</td> <td>1200</td> <td>Section 5 of Act read with (i) Item no. 5(b) of Schedule- sale of shares in an incorporated company: Rs.</td> </tr> </tbody> </table> <p>Please refer reply no 52 provided in Set-1 dated 05.11.2024.</p>	SN.	Document	Stamp Paper for Execution (in INR)	Indian Stamp Act, 1899 ('Act') read with Delhi Schedule 1A ('Schedule')	1.	Share Purchase Agreement	1200	Section 5 of Act read with (i) Item no. 5(b) of Schedule- sale of shares in an incorporated company: Rs.
SN.	Document	Stamp Paper for Execution (in INR)	Indian Stamp Act, 1899 ('Act') read with Delhi Schedule 1A ('Schedule')						
1.	Share Purchase Agreement	1200	Section 5 of Act read with (i) Item no. 5(b) of Schedule- sale of shares in an incorporated company: Rs.						

344



Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"

	1000/-, (ii) Item 5(c) Arbitration: Rs. 50/-, (iii) Item No. 34 Indemnity: Rs. 100/-.		Section 5 of Act read with (i) Item 5(c), agreement (other): Rs. 50/-, (ii) Item No. 37, guarantee: Rs. 50/-, (iii) Item No. 34, indemnity: Rs. 100/-, and others.	
2.	Transmission Service Agreement	500		BPC to confirm the amount of stamp papers on which the execution of the SPA and TSA will be executed
14. RFP				We request BPC to confirm that in case of delay in grant of section 164 approval beyond 45 days by CEA, The provisions of RFP shall prevail.

345



Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

<p>RFP, Clause 1.6. Clause no. 1.6.1.5 – Scope of Transmission Service Provider The TSP shall seek approval under Section 164 of Electricity Act, from CEA after acquisition of SPV [which is under incorporation]. The approval shall be granted by CEA generally within 30 days but in no case later than 45 days from the date of receipt of application (complete in all aspects).</p>	<p>will this qualify as Force Majeure (FM) event under TSA, and we can get relief as per TSA.</p>	<p>Applications for Connectivity for 3050 MW were granted / agreed for grant at Raghnesda PS. Further, applications for Connectivity for 1400 MW (beyond 3050 MW) were also received.</p>
<p>15. RFP &amp; TSA</p>	<p><b>Schedule 1, Project Description and Scope of Project</b> For evacuation of this 3GW capacity from Raghnesda region in Banaskantha district of Gujarat, establishment of 765/400 kV Raghnesda (GIS) S/s is proposed with 3x1500 MVA 765/400 kV ICTs &amp; Raghnesda (GIS) – Banaskantha (PG) 765 kV D/c line. The scheme will facilitate integration of 3GW RE injection into the ISTS network.  Please provide status as on September 2024 of GNA application for Raghnesda PS.</p>	<p>All the elements mentioned at clause 2.6 of RfP are critically important. There is no such additional critical element other.</p>
<p>16. TSA ARTICLE: 5 Clause no. 5.5.6 -</p>	<p>We understand that of List of Element(s) along with the critical Element(s) are defined and provided in</p>	<p>All the elements mentioned at clause 2.6 of RfP are critically important. There is no such additional critical element other.</p>



346

**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

	<p>For any delay in commissioning any critical Element(s), as identified in Schedule 1 &amp; Schedule 2 of this Agreement, beyond a period of 45 days shall lead to a sequestration of 10% of the Contract Performance Guarantee.</p>	<p>TSA and there will no separate list of Elements(s) to be provided by CEA.</p>	<p>than the elements mentioned in the clause 2.6.</p>
17.	<p>TSA Schedule 1 &amp; 2</p>	<p>In Schedule 1, the Scheduled COD of the Project is 30 Months (defined term, i.e., 30 days per month) from Effective Date.  Whereas in Schedule 2, the Scheduled COD for the Project is 30 months (undefined term, i.e., actual days in each month) from SPV acquisition</p>	<p>The provisions of TSA shall prevail.</p>
18.	<p>Definitions: "Bid Bond" shall mean the unconditional and irrevocable bank guarantee for Rs. 17.6 Crore (Rupees Seventeen Crore Sixty Lakh Only), to be submitted along with the Technical Bid by the Bidder under Clause 2.11 of this RFP, as per the format prescribed in Annexure 14</p>	<p>BPC to clarify what is the actual Scheduled COD.  We would like to bring to your kind attention the Government's progressive decision to allow Insurance Surety bonds as a security mechanism. This was announced by the Hon'ble finance minister during the Union budget for FY-23.  The Hon'ble Ministry of Road Transport &amp; Highways has already taken a significant step by amending the bidding documents for EPC, HAM, and BOT (ToT) projects, incorporating provisions for accepting</p>	<p>The provisions of RFP and TSA shall prevail.</p>
<p>19. RFP</p>			<p>The provisions of RFP shall prevail.</p>



242

**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

	<p>Within ten (10) days from the date of issue of the Letter of Intent, the Selected Bidder, on behalf of the TSP, will provide to the Nodal Agency the Contract Performance Guarantee for an amount of Rs. 44 Crore (Forty-Four Crore Only)).</p>	<p>insurance surety bonds as 'Bid Security' and 'Performance Security'.</p> <p>Considering the capital-intensive nature of transmission projects, we request BPC to also allow submission of Insurance Surety Bonds as an alternative to Bank Guarantees as a security mechanism.</p>	
<p>20. RFP</p> <p><b>Technical Bid comprising of</b></p> <p>19. For each project listed in Annexure 7(D), certified true copy of the certificates of final acceptance</p>	<p>As per RFP clause 2.1.2 (ii), "Experience in construction of project in infrastructure sector" is allowed for meeting the technical requirement by the bidders.</p> <p>In reference to the same, bidders need to provide the details of above experience as per "Annexure 7D - Additional Information for verification of financial &amp; technical capabilities of the bidders"</p> <p>The Part iii, attachment 3, (a) states</p> <p><i>"For each project listed in Attachment 2 above, certificates of final acceptance and/or certificates of good operating performance duly issued by owners for the project and the same shall be certified as true by</i></p>	<p>The provisions of RFP shall prevail.</p>	

298



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p><i>authorized signatory of the Bidding Company or the Lead Member of Consortium). In case the project listed in Attachment 2 is under BOOT / DBFOT mechanism, the certificates of final acceptance and/or certificates of good operating performance must be issued by the authority / independent engineer of the project as defined in the respective project agreement"</i></p> <p>Further, as per the RFP Clause 2.5.2 (19)</p> <p><i>"For each project listed in Annexure 7(D), certified true copy of the certificates of final acceptance and / or certificates of good operating performance duly issued by owners or clients for the project, duly signed by authorized signatory".</i></p> <p>The experience in construction of infrastructure sector is obtained through Engineering, Procurement &amp; Construction contracts (EPC Contracts) having a construction timeline and a pre-defined defect liability period. The industry wide norm for issuing the experience certificates to the EPC contractors is through issuance of completion certificates or final acceptance certificates by the contracting authorities.</p> <p>In reference to the above, we presume that in case of use of experience of construction (2.1.2 (ii)), we</p>
--	--

249



Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"

<p>21. RFP Section-2, clause no. 2.6. Project Schedule Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project &amp; TSA: Schedule-4 Computation of Transmission Charges</p>	<p>presume that submission of completion certificates or final acceptance certificates duly issued by owners of the project will sufficient and acceptable to the BPC. Please note that there are 3 nos. of Transmission elements in the subject project. We understand that all elements of the scheme are required to be commissioned simultaneously as their utilization is dependent on each other and hence considering the same percentage of quoted transmission charges are clubbed and mentioned as single percentage (100%) for all these elements. BPC will appreciate that during Operation of the of the asset, if any outages happen to any element/elements of said asset or any scenarios occurs which are illustrated in schedule-4 of TSA then it will be difficult to compute payment of Transmission Charges under various scenarios based on the availability of each element. Please note that as per clause 10 of TSA, Monthly Transmission Charges shall be paid to the TSP, in Indian Rupees, on monthly basis as per the provisions of TSA, from the date on which an <i>Element(s) has achieved COD until the Expiry Date of this Agreement</i>, unless terminated earlier and in line with the provisions of Schedule 4 of this Agreement.</p>	<p>All elements of scheme are required to be commissioned simultaneously as their utilization is dependent on each other. Further, the recovery of transmission charges shall be as per relevant regulations of CERC.</p>
---	--	---

55



Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

	<p>In view of the above, BPC is requested to provide break-up of each element.</p> <p>1) Please note that there is no clarity about the liability of the TSP post Transfer of asset. We request BPC to define the process of Transfer.</p> <p>2) As the project is BOOT basis, we request BPC to provide Transfer Agreement for bidder's review and assessment.</p> <p>3) As the project is BOOT basis, what will be the Liability of TSP in case of any Default post Transfer to CTU.</p> <p>4) As per the RFP, the transfer shall be completed within 90 days after 35 years from COD of project failing which CTU shall be entitled to take over the project assets Suo moto. We request BPC to confirm whether the Project is required to be given on as is where is basis or if CTU can ask for certain refurbishments to be done?</p> <p>It is requested to BPC to confirm will there be an obligation of the TSP to obtain re obtain the clearance at the time of Transfer, in case of NHAL, Road, Highways etc.</p>	
<p>22. RFP RFP, section-1, Clause 1.5, Para 3 "The TSP shall ensure transfer of all project assets along with substation land, right of way and clearances to CTU or its successors or an agency as decided by the Central Government after 35 years from COD of project at zero cost and free from any encumbrance and liability. The transfer shall be completed within 90 days after 35 years from COD of project failing which CTU shall be entitled to take over the project assets Suo moto".</p>		<p>The provisions of RFP shall prevail.</p>

29



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

23.	<p><b>REQUEST FOR PROPOSAL NOTIFICATION</b></p> <p>Point no.- 6: The objective of the bidding process is to select a Successful Bidder pursuant to this RFP, who shall acquire one hundred percent (100%) of the equity shares of SPV [which is under incorporation].</p>	<p>We would like to inform you that without the name of the SPV, the bidders are not able to obtain the approvals from their respective Boards for issuance of Board resolution/ POA, which delays the finalization of documents required for bid participation/submission from the bidder's end. You shall appreciate that the Board meetings for large conglomerates generally happens once a quarter. In view of the above, we request the BPC to provide the name of the SPV along with RFP issuance or maximum 7 days from RFP issuance.</p>	<p>Please refer Amendment No-02 dated 13.11.2024.</p>
24.	<p>Request for Proposal Notification, Disclaimer This RFP may be withdrawn or cancelled by the BPC at any time without assigning any reasons thereof. BPC further reserves the right, at its complete discretion to reject any or all of the Bids without assigning any reasons whatsoever."</p>	<p>We would like to mention that it will be unreasonable on the part of BPC to reject a bid without assigning any reason. Since the BPC can be construed as 'state' under the Constitution, conduct of BPC ought to have transparent and as such BPC cannot take any decision without assigning proper reason/ justification.</p>	<p>The provisions of RFP shall prevail.</p>
25.	<p>Definition: Conflict of Interest" A Bidder shall be considered to be in a Conflict of Interest with one or more Bidders in the same bidding process if they have a relationship with each other,</p>	<p>It needs to be noted that this definition is vague and wide in as much as it only requires that an entity is able to have access; it is immaterial whether information was accessed or not, just the fact that a party is in a position to access the information or</p>	<p>The provisions of RFP and TSA shall prevail.</p>

352



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	directly or through a common company, that puts them in a position to have access to information about or influence the Bid of another Bidder.	influence bid of another party is enough. As far as this aspect is concerned, this definition should be amended. This should further cover any conflict-of-interest situation between the BPC and any of the bidder.	
26.	RFP Annexure-B, Clause 3.3 provides that "the Bidder shall disclose the name and address of agents and representatives, and Indian Bidder shall disclose their foreign principals or associates". Clause 3.4 states that "the Bidder shall disclose the payments to be made by them to agents/brokers or any other intermediary, in connection with this bid"	BPC is requested to clarify the rationale for having this clause? We understand that The Bidder is free to engage any consultant as long as it is under the purview of applicable law.	The provisions of RFP shall prevail.
27.	TSA: Clause F The TSP has agreed to execute the agreement(s) required, if any, under Sharing Regulations within fifteen (15) days from the date of grant of	Please note that the Sharing Regulations only provides for Supplementary TSA and Revenue Sharing Agreement with CTU. Kindly confirm if there any other Agreement which is also required to be signed.	The provisions of TSA shall prevail.

252



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I"**

	Transmission License from the Commission.		
28.	<p>TSA: Clause H</p> <p>The billing, collection, and disbursement of the Transmission Charges by the CTU to the ISTS Licensee shall be governed as per Sharing Regulations</p>	<p>In case of default in the payment by the DIC, BPC is requested to clarify the following.</p> <p>a) How will the Transmission charges be recovered?</p> <p>b) what is the assurance for recovery of Transmission charges in view of the repeal of the Regulation of the power supply 2010 by the CERC.</p>	<p>The provisions of TSA shall prevail.</p>
29.	<p>TSA ARTICLE: 1</p> <p>Definitions and Interpretations</p> <p>Independent Engineer" shall mean an agency/company, appointed by Nodal Agency in accordance with the Guidelines for Encouraging Competition in Development of Transmission Projects.</p> <p>TSA ARTICLE: 18</p> <p>18.3 Remuneration of Independent Engineer</p>	<p>We understand that as the Independent Engineer to be appointed by Nodal Agency (CTU), the fee and charges of the Independent Engineer shall be paid by CTU and TSP does not have to consider any fee and charges of the Independent Engineer in its bid.</p>	<p>Bidder understanding is correct in this regard.</p>
30.	<p>TSA ARTICLE: 1</p> <p>Definitions and Interpretations</p>	<p>The proviso to the definition states that while taking major decisions, CTU shall consult CEA on technical matters and any other matter if it feels necessary.</p>	<p>The provisions of TSA shall prevail.</p>

354



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>BPC is requested to provide clarity on what would constitute 'major decisions'; further, what would be the nature of consultation is not clear, whether such consultation would be binding or just advisory in nature? Further, there is an element of discretion as well on the part of CTU, which should be done away with.</p>	
<p>31. As per TSA, 1. Scheduled COD of each transmission Element: 30 months from the date of SPV Transfer 2. The Definition of Month: "Month" shall mean a period of thirty (30) days from (and excluding) the date of the event;</p>	<p>BPC to confirm the following: a. The Schedule COD for the Project is 30 Months from SPV Transfer and since the Month is used as defined term, therefore, the 30 Month for the Project will be calculated on the basis of 30 days in each month? For example: If the SPV Transfer Date is 01-04-2024 then SCOD will be 22-03-2026. b. The Schedule COD for each transmission Element is 24 months from SPV transfer and month has not been used as defined term, therefore 24 months will be calculated on the month to month basis? For example: If the SPV transfer date is 01-04-2024 then SCOD will be 01-10-2026. c. BPC to clarify that the SCOD for each transmission Element is different from SCOD of the Project?</p>	<p>The provisions of TSA shall prevail.</p>
<p>32. TSA ARTICLE: 13 Clause no.13.7 Termination Payment -</p>	<p>As there is no mechanism for termination payment. We request BPC to provide the mechanism for compensating the cost incurred by the TSP for</p>	<p>The provisions of TSA are amply clear in this regard and shall prevail.</p>

355



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>construction of asset, in case of non-requirement of any element during construction stage.</p>	
<p>33.</p>	<p>If Agreement is terminated on account of Force Majeure Events, non-requirement of any Element or Project during Construction, Long Term Transmission Customers non-fulfilment of Role &amp; TSP's Event of Default, the TSP shall be entitled for Termination Payment equivalent to valuation of Project Assets. Upon payment, the Long Term Transmission Customers shall take over the Project Assets</p> <p><b>TSA ARTICLE: 12</b>  <b>Relief for change in law 12.2.3 -</b>          12.2.3 For any claims made under Articles 12.2.1 and 12.2.2 above, the TSP shall provide to the Long Term Transmission Customers documentary proof of such increase / decrease in cost of the Project / revenue for establishing the impact of such Change in Law.</p>	<p>Please note that No timelines defined for response by LTTC in case of CIL event. We request BPC to define timeline in which LTTC will respond to the TSP.</p> <p>The provisions of TSA shall prevail.</p>
<p>34.</p>	<p><b>TSA ARTICLE: 11</b>          Clause no. 11.4.1          .....</p>	<p>We request BPC to remove the point no g form the Force Majeure Exclusions</p> <p>The provisions of TSA shall prevail.</p>

256



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>(g) Any error or omission in the survey report provided by BPC during the bidding process</p>		
<p>35. TSA ARTICLE: 3          Clause No. 3.3.4          Provided that due to the provisions of this Article 3.3.4, any increase in the time period for completion of conditions subsequent mentioned under Article 3.1.3, shall lead to an equal increase in the time period for the Scheduled COD.          If the Scheduled COD is extended beyond a period of one hundred eighty (180) days due to the provisions of this Article 3.3.4, the TSP will be allowed to recover the interest cost during construction corresponding to the period exceeding one hundred eighty (180) days by adjustment in the Transmission Charges in accordance with Schedule 9.</p>	<p>What is the rationale for only IDC recovery and no other expenditure like project cost overrun (such as overheads &amp; price variation etc.)</p>	<p>The provisions of TSA shall prevail.</p>

357



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

36.	<p>TSA ARTICLE: 8 8.2 Target availability The Target Availability of each Element and the Project shall be 98%</p>	<p>As per previous TSA, target availability was at project level not for each element. We request BPC to maintain target availability at Project level only.</p>	<p>This is as per the Standard Bidding Documents. The provisions of TSA shall prevail.</p>
37.	<p>TSA ARTICLE: 12 Payment on account of Change in Law 12.4.1 The payment for Change in Law shall be through a separate Bill. However, in case of any change in Monthly Transmission Charges by reason of Change in Law, as determined in accordance with this Agreement, the Bills to be raised by the Nodal Agency after such change in Transmission Charges shall appropriately reflect the changed Monthly Transmission Charges.</p>	<p>BPC is requested to provide the format and timeline for submission of separate bill for settlement of CIL events?</p>	<p>The provisions of TSA shall prevail.</p>
38.	<p>Schedule 2 The payment of Transmission Charges for any Element, irrespective of its successful commissioning on or before its Scheduled COD, shall only be</p>	<p>BPC is requested to clarify that in case an element is successfully commissioned and is put to use/power flows, but the pre-required element is not successfully commissioned. Will TSP be eligible for getting Tariff?</p>	<p>The provisions of Schedule 2 shall prevail.</p>

258



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>considered after successful commissioning of the Element(s), which are prerequisites for declaring the commercial operation of such Element as mentioned in the above table.</p>		
39.	<p>Schedule 9 of TSA Methodology for determining the Relief Under Force Majeure Event &amp; Change in Law during Construction Period. The relief in the form of revision in tariff due to Force Majeure Event leading to extension of Scheduled COD for a period beyond one hundred eighty (180) days and/ or Change in Law during the construction period shall be as under: <math>\Delta T = [(P \times d)] + [1 - (1 + d)^{-n}]</math></p>	<p>What is the rationale for the increase in Transmission Charges as stated above shall be applicable only if the value of increase in Transmission Charges as calculated above exceeds 0.30% (zero-point three percent) of the quoted Transmission Charges of the TSP.</p>	<p>The provisions of TSA shall prevail.</p>
40.	<p>ANNEXURE 22 - FORMAT FOR AFFIDAVIT</p>	<p>We would like to mention that with reference to the RFP Clause 2.1.9 Bidders shall confirm a notarized affidavit as per Annexure 22.  Please note for large conglomerates signing on behalf of all the affiliates can run into hundreds of numbers and different geographies, is practically impossible.</p>	<p>The provisions of RFP shall prevail.</p>

259



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>We request you to allow Annexure-22 to be signed by the Authorized signatory of the Bidding company on behalf of Bidding entity only.</p>	
<p>41. Definitions: Transmission Service Agreement" or "TSA" shall mean the agreement entered into between Nodal Agency and the TSP, pursuant to which the TSP shall build, own, operate and transfer the Project and make available the assets of the Project on a commercial basis.</p>	<p>As per the bidding documents TSA shall be signed between Nodal agency and TSP only. We request BPC to clarify role of Designated ISTS Customers and linkage of Designated ISTS Customers to TSA.</p>	<p>The provisions of TSA shall prevail.</p>
<p>42. Annexure no. 15- format for Contract Performance Guarantee/ Last Para Notwithstanding anything ..... (365) days thereafter. This BANK GUARANTEE shall be extended from time to time for such period, as may be desired by..... [Insert name of the Selected Bidder or Lead Member in case of the Consortium or SPV].</p>	<p>Kindly note that the Government banks are not issuing the contract Performance Guarantee. We request BPC to modify the last Para of the Performance Guarantee format as highlighted in red font below: Notwithstanding anything ..... (365) days thereafter. This BANK GUARANTEE shall be extended from time to time for such period, as may be desired by..... [Insert name of the Selected Bidder or Lead Member in case of the Consortium or SPV and ..... [Insert name of the Bank].</p>	<p>The provisions of RFP shall prevail.</p>

360



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghanesda area of Gujarat – 3 GW under Phase-I"**

<p>43. Schedule: 9 Methodology for determining the Relief Under Force Majeure Event &amp; Change in Law during Construction Period.</p>	<p>CERC notified 'Discount rate for computation of levelized transmission charges' is 9.25% on 2<sup>nd</sup> April 2024, please confirm if this Discount rate for computation of levelized transmission charges is to be considered for this calculation under schedule-9</p>	<p>Bidder may refer the recent rate available on CERC website in this regard.</p>
<p>44. Clause 5.5.6: For any delay in commissioning any critical Element(s), as identified in Schedule 1 &amp; Schedule 2 of this Agreement, beyond a period of 45 days shall lead to a sequestration of 10% of CPG.  There are no Elements identified in Schedule 1 &amp; 2 as 'critical' – Kindly confirm as Bidder needs the information for proper estimation</p>	<p>Clause 5.5.6 of the TSA provides that for any delay in commissioning any critical Element(s), as identified in Schedule 1 &amp; Schedule 2 of this Agreement, beyond a period of 45 days shall lead to a sequestration of 10% of CPG.  There are no Elements identified in Schedule 1 &amp; 2 as 'critical' – Kindly confirm as Bidder needs the information for proper estimation</p>	<p>The provisions of TSA shall prevail.</p>
<p>45. Clause no. 1.2 of Section 1 on Page # 17 of RFP,  Scope of the Transmission Scheme:  Establishment 3x1500 MVA, 765/400 kV Substation near Raghanesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor</p>	<p>Ministry of Power has issued the Amendment in SBD for Inter-state Transmission Service through TBCB process dated 16th June, 2023 and as per the same BPC has modified the clause 1.6.1.1 of the RFP as follows:  Establishment, operation and maintenance of the Project on build, own, operate and transfer basis and completion of all the activities for the Project, including survey, detailed project report formulation, arranging finance, project management, necessary Consents, Clearances and Permits (way leave,</p>	<p>This is as per the Standard Bidding Document. The provisions of RFP shall prevail.</p>



261

**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	environment & forest, civil aviation, railway/road/river/canal/power crossing/PTCC, etc.), land compensation, design, engineering, equipment, material, construction, erection, testing & commissioning. Further, the actual location of Greenfield substations (switching stations or HVDC terminal or inverter stations) for a generation substation and for load serving substation in the scope of TSP shall not be beyond 3 Km radius of the location proposed by the BPC in the survey report. However, actual location of the any greenfield intermediate Substations in the scope of TSP shall not be beyond 10 km radius of the location proposed by the BPC in the survey report.	
46. RFP Scope of the Transmission Scheme	<p>i) BPC is requested to kindly provide the definitions for generation pooling substation, load serving substation and Greenfield intermediate Substation.</p> <p>BPC is requested to provide following data/documents for extension work at Banaskantha:</p> <ol style="list-style-type: none"> <li>1) Cable trench Layout</li> <li>2) Earthmat Layout</li> <li>3) Substation Automation System.</li> <li>4) Visual Monitoring System.</li> </ol>	<p>1. Bidder is advised to visit the site.</p> <p>2,3,4. Drawings/details are provided in Amendment-1 dated 05.11.2024.</p>
47. RFP Scope of the Transmission Scheme	BPC is requested to confirm the busbar extension scope in existing Busbar protection scheme for 765kV Banaskantha.	<p>1,2. Existing busbar protection at Banaskantha S/s have provision for bays</p>



Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

		<p>1) As we understand main busbar relay future bay is available with future augmentation.</p> <p>2) As we understand Bay Unit relay is in TSP scope.</p> <p>3) BPC is requested to provide Make and Model Number of existing CRP relays &amp; Busbar scheme.</p> <p>4) BPC is requested to provide Make of the SCADA.</p>	<p>under present scope. PUs shall be provided by respective bay owner.</p> <p>3,4. Details are provided in Amendment-1 dated 05.11.2024.</p>
48.	RFP Scope of the Transmission Scheme	<p>BPC is requested to confirm the civil, structure and equipments in existing 765kV Banaskantha.</p> <p>1) As we understand tie breaker (half dia) is available. scope of the TSP shall be after tie breaker isolators. All associated interconnection work shall also be in the present scope of TSP.</p> <p>2) As we understand there is sufficient space available in SPR room to accommodate present scope CRP and other communication panels. There are No requirement to construct new SPR room. TSP consider the Minor modification in SPR room during the installation of CRP.</p>	<p>1. Refer Amendment-1 for scope at 765 kV Banaskantha S/s dated 05.11.2024.</p> <p>2.SPR along CRP and other communication panels etc. shall be provided as per requirement under present scope. Bidder is advised to visit the site to get acquainted himself.</p>
49.	RFP Scope of the Transmission Scheme	<p>We understand that at existing Banaskantha SS, AC &amp; DC Feeders are available for present &amp; future scope of work in existing LT boards.</p>	<p>AC and DC feeders are in present scope.</p>
50.	RFP Scope of the Transmission Scheme	<p>BPC Is requested to confirm that existing battery and battery chargers at Banaskantha have sufficient capacity to cater extension work under the present scope of work.</p>	<p>New Battery and Battery charger are not envisaged at existing Banaskantha substation.</p>
	RFP	<p>BPC is requested to provide make and model of existing VMS at Banaskantha SS.</p>	<p>Details are provided in Amendment-1 dated 05.11.2024.</p>



Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

52.	RFP Scope of the Transmission Scheme	BPC to confirm the timeline for handing over the space by existing TSP at Banaskantha substation.	Bidder is advised to visit the site to get acquainted himself.
53.	RFP Clause No. A.11.0 Specific Technical Requirements for Transmission Line "Shielding angle shall not exceed for 765 kV D/C transmission line."	Shielding angle is not mentioned. Please clarify.	Kindly refer Reply No S.No.01.
54.	RFP Clause No. A.17.0 Specific Technical Requirements for Transmission Line	Kindly confirm applicability of importance factor for cyclonic region (K4) of 1.3 for this 765kV line.	Refer Clause A.17.0 of RfP for specific technical requirements of transmission lines.
55.	RFP Clause No. A.18.0 Specific Technical Requirements for Transmission Line	Kindly confirm the applicability of criteria mentioned for cyclone prone areas (i.e. areas up to 60 km from coast)/ creek regions/ aggressive soil areas for this 765kV line.	Refer Clause A.17.0 and A.18.0 of RfP for specific technical requirements of transmission lines.

264



Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

56. RFP General	<p>There is discrepancy in termination of proposed 765kV D/C Transmission Line at Banaskantha Substation.</p> <p>In electrical layout plan &amp; section drawing of Banaskantha substation, both circuits are terminating in opposite direction and hence bifurcation of D/C into S/C is envisaged at substation end. However, in the survey report, both circuits are terminated at single location.</p> <p>Please provide correct location and co-ordinates of bay for termination of line at Banaskantha substation.</p> <p>In the survey report for the Banaskantha end line, both circuits are terminated at a single point (42 R 804561.95 m E 2673327.25 m N). However, in the SLD provided for Banaskantha, both circuits are terminated at two different locations. Kindly clarify.</p> <p>Please provide the termination Gantry-coordinate at Banaskantha PGCIL end for both Circuit.</p>	Please refer the Amendment No-01 issued dated 05.11.2024 in this regard.
57. Scope of Work SI 2.0 Raghnesda (GIS) – Banaskantha (PG) 765 kV D/c line	BPC is requested to confirm the line length for present scope of 400 kV line, 4 nos bays (for interconnection of RE Projects) at Raghnesda.	As per Scope of Work SI 2.0 Raghnesda (GIS) – Banaskantha (PG) 765 kV D/c line, there is no scope of Construction of 400 kV line.
58. Survey Report Page No 28	There is discrepancy in BPC survey report page No 28 SNO 18 Airport/Air strip: Deesa Airport SNO 19 Upcoming Airport/Aviation Zone/Airforce Station: Nil	It is understood that location of Dessa Airport is being changed to a new location which is approximately 17 Km away from the proposed route of

265



Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

		<p>transmission line. Bidder is requested to carry out due diligence and take requisite permission along with following all applicable regulations.</p>
59.	<p>Survey Report</p> <p>Information of proposed 765/400 KV Substation near Raghnesda (GIS) Page No 10</p> <p>Proposed Substation: Land Co-ordinates</p> <p>Corner 1 24°27'12.10"N 71°24'21.09"E</p> <p>Corner 2 24°27'18.73"N 71°24'37.76"E</p> <p>Corner 3 24°26'54.75"N 71°24'47.85"E</p> <p>Corner 4 24°26'48.32"N 71°24'31.00"E</p>	<p>Kindly confirm if there are any plans for a Deesa defense airport in Village Jhakol, Gujarat (near PGCIL Banaskantha Substation, Gujarat) within 11 Km radius of proposed TL.</p> <p>Will restrictions on transmission line tower height be allowed?</p> <p>(The location coordinates are 42R 801874.73m E, 2694026.18m N)</p> <p>As per the survey report, the proposed location of the 765/400kV GIS Raghnesda Substation (center point coordinates: 744312.00 m E, 2706266.00 m N) falls within a 3 km radius based on the coordinates provided.</p> <p>The 3 km radius of the proposed substation falls inside the 7 km and 10 km buffer zones of the Kutch Wildlife Sanctuary.</p> <p>Kindly confirm.</p>
60.	<p>Survey Report</p> <p>Section 3</p>	<p>Proposed Substation location lies outside the area of 3 Km from the Wildlife Sanctuary.</p> <p>Bidder understanding is correct in this regard i.e. Area mentioned under Survey Report includes area for HVDC (Future Scope).</p>



**Set 2 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	Approach & Methodology	BPC is requested to clarify, whether the area mentioned in the survey report also includes area for HVDC (Future scope)?	
61.	<p>Survey Report</p> <p>Route details and BPC route KMZ for Raghnesda (GIS) – Banaskantha (PG) 765 kV D/c line.</p>	<p>As per our internal assessment of the route for the subject transmission line, it is visible that the construction of Airbase (Jhakol Airforce Station) is undergoing, and approximate ~32 KM BPC route is passing through 20 KM circle from the under-construction Airstrip. This is a quite large sized Airbase which is under development and the further details of the Airforce station are not yet available in the public domain. This shall impact the route finalization of the bidders and pose a risk of route variation during execution. This has not been included in the BPC survey report issued to the bidders.</p> <p>BPC is requested to clarify the same and provide required amendment to its survey report.</p>	<p>Please refer Reply No. 58 of Set-2 in this regard.</p>

367



Amendment No. 2 dated 13.11.2024

to

RFP documents for selection of Transmission Service Provider to establish transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I" through tariff based competitive bidding process

S.No.	Existing Provisions	Revised Provisions
1.	All the relevant clauses of RFP, TSA and SPA "SPV [which is under incorporation]"	All the relevant clauses of RFP, TSA and SPA "SPV [which is under incorporation]" in the subject RFP, TSA and SPA may be read as "RAGHANESDA RE TRANSMISSION LIMITED"



218

Set 3 & 4 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

S. N.	Clause No. and Existing provision	Clarification required	Clarifications
1.	<p>Appendix-II GA BANASKANTHA shared vide mail dated 05.11.2024 As per Scope of work: 2 Nos. 765 kV line bays at Banaskantha (PG) S/s. <b>Note:</b> TSP of Banaskantha S/s (POWERGRID) shall provide space for scope at Sl. 3 above.</p>	<p>1. As per shared GA drawing, it seems Bay marking crosses over the Boundary line of the existing Banaskantha (PG) substation. 2. As per GA drawing, scope of TSP shall include Dismantling of Existing Fencing, Roads, Other Site Infrastructure, etc. as required for development of new diameter in 765kV Switchyard. 3. As per GA drawing, required Land Development works in the current vacant area i.e. CDUVWXBC (Contouring, Levelling, etc.) as required shall be in the scope of TSP. BPC to confirm the following: a. The land availability for 2 Nos. 765 kV line bays under present scope and confirm the understanding as per point no 2 &amp; 3. b. Encumbrance free land for 2 Nos. 765 kV line bays shall be provided by the existing S/s owner to the successful bidder.</p>	<p>Tender GA drawing showing the gantries has been provided with RfP. Successful bidder shall finalise the layout as per tender GA and to suit the site condition. All associated civil works including dismantling (if any) to execute the bays under present scope shall be done by the successful bidder in coordination with existing owner of the substation. Further, bidders are also advised to visit the Banaskantha (PG) substation to acquaint themselves about the site conditions.</p>

369



Set 3 & 4 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

<p>2. Appendix-II GA BANASKANTHA shared vide mail dated 05.11.2024 765kV Line Bays at Banaskantha</p>	<p>Line side gantry position also not in line with adjacent Gantry position. BPC to provide proper GA with no. of Gantry to be developed under present scope of work.</p>	<p>Gantries shown in GA drawing are indicative and for tender purpose. TSP to finalise the location of gantries as per design requirement.</p>
<p>3. RFP for selection of bidder as Transmission service provider Clause 1.2 Future Scope (Space for): Establishment of 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC] terminal station (4x1500 MW) along with associate interconnections with 400 kV HVAC Switchyard and all associated equipment (incl. filters)/bus extension, etc.</p>	<p>BPC is requested to mention if the Filter connections and switching arrangement for the AC filters are envisaged to be GIS type or AIS type in future, as this will be critical in determining the space requirement. Bidder needs the information for proper estimation</p>	<p>Space provision for future HVDC shall be kept considering Filter connections and switching arrangement such that main bay shall be considered as GIS type whereas Circuit breaker along with bay for sub-banks of AC filters shall be considered as AIS type.</p>
<p>4. Amendment-1 (dated 05<sup>th</sup> Nov'24) to RFP documents Amendment-1 Sl No. – 1 Clause no. B.1.2 765 kV Banaskantha Extn: Refer attached SLD &amp; GA drawing of Banaskantha S/S. Raghnesda – Banaskantha (PG) 765 kV D/c line shall be terminated in existing</p>	<p>765 kV Banaskantha Extn: As per attached commented GA drawing (GNB-PGCIL-BNK-ELE-003) of Banaskantha S/S, one circuit of Raghnesda – Banaskantha (PG) 765 kV D/c line shall be terminated in new diameter for which Main and Tie bays shall be constructed under present scope.</p>	<p>1) Bus bar extension for Main bus-I can also be done through BPI to suit the available space. No additional space beyond substation boundary shall be provided by existing TSP.</p>

370



Set 3 & 4 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

<p>diameters for which Main Bays shall be constructed (Tie bays are existing) under present scope as marked in GA drawing. Further, all associated interconnection work shall also be in the present scope of TSP.</p>	<p>BPC is requested to confirm the following Points:</p> <p>1) One of the circuit 765 kV for which diameter consisting of Main and Tie is considered in TSP scope, Main Bus-1&amp;2 needs to be extended. As per the attached GA only Main Bus -2 extension gantry is shown and for Main Bus -1 no extended gantry is shown. The extension of Main Bus 1 gantry is falling beyond SS boundary. BPC to confirm that land for extension of main bus -1 gantry shall be provided by existing TSP (PGCIL).</p> <p>2) We understand that the diameter of new bay and tie for one of the circuit at Banaskantha will not be having future bay.</p> <p>We understand that both 765 kV line entry at Banaskantha will be at same point (Not from the Ahmedabad 765 KV side). BPC to confirm.</p> <p>For proper cost estimation.</p>	<p>2) As per SLD provided with RFP, future bay is not required.</p>
<p>5. Amendment-1 (dated 05<sup>th</sup> Nov'24) to RFP documents Amendment-1 Sl No. – 1</p>	<p>765 kV Banaskantha Extn: As per the SLD drawing (Drg. No. C/ENGG/WR-II/BANASKANTHA/SLD/1), BPC is requested to confirm the location of main and</p>	<p>Bidders may refer the survey report and are advised to visit the Banaskantha (PG) substation to acquaint themselves</p>

175



Set 3 & 4 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"

<p>Clause no. B.1.2</p> <p>765 kV Banaskantha Extn: Refer attached SLD &amp; GA drawing of Banaskantha S/S. Raghnesda – Banaskantha (PG) 765 kV D/c line shall be terminated in existing diameters for which Main Bays shall be constructed (Tie bays are existing) under present scope as marked in GA drawing. Further, all associated interconnection work shall also be in the present scope of TSP.</p>	<p>tie bays for new circuit for clarification of line entry point.</p> <p>For proper cost estimation.</p>	<p>about the exact location of main and tie bays.</p>								
<p>6. Amendment-1 (dated 05.11.2024)</p> <p>RFP Specific Technical Requirements for Substation Clause no. B.5</p>	<p><b>B.5 EXTENSION OF EXISTING SUBSTATION</b></p> <p>The following drawings/details of existing substation is attached with the RFP documents for further engineering by the bidder.</p> <table border="1" data-bbox="1069 705 1294 1366"> <thead> <tr> <th>S.No.</th> <th>Drawing Title</th> <th>Drawing No./Details</th> <th>Rev. No.</th> </tr> </thead> <tbody> <tr> <td>2.0</td> <td>General Arrangement</td> <td>GNB- PGCIL-</td> <td>5</td> </tr> </tbody> </table>	S.No.	Drawing Title	Drawing No./Details	Rev. No.	2.0	General Arrangement	GNB- PGCIL-	5	<p>Refer Amendment No 03 issued dated 12.12.2024.</p>
S.No.	Drawing Title	Drawing No./Details	Rev. No.							
2.0	General Arrangement	GNB- PGCIL-	5							

372



**Set 3 & 4 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		<p>BNK-ELE- 003</p>	<p>Drawing No. of GA drawing for Extn of Banaskantha S/S attached with the Amendment-1 (Drawing No: C/ENGG/WR-II/BANASKANTHA/GA/1) is different than drawing no. of GA drawing mentioned in the Amendment-1.</p> <p>We understand that drawing attached with the Amendment-1 (Drawing No: C/ENGG/WR-II/BANASKANTHA/GA/1) is correct drawing and same shall be followed by TSP.</p> <p>Kindly confirm.</p>	
<p>7. Annexure-C</p> <p>Clause No. B.2.5(a)</p>		<p><u>Transmission Lines Protection</u></p> <p>765 kV and 400 kV lines shall have Main-I numerical three zone distance protection scheme with carrier aided inter-tripping feature. 765 kV and 400 kV lines shall also have Main-II numerical distance protection scheme like Main-I but from different make that of Main-I. The Main-I and Main-II protection relays of same make may be provided only if they are of</p>	<p>Bidder to follow the requirement of RfP and CEA Regulations which are amply clear.</p>	

273



**Set 3 & 4 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>different hardware and manufacturing platform or different principle of operation.</p> <p>However, Line Current Differential relay (with back up distance protection feature) as Main-I and Main-II shall be considered at both ends for short lines (line length below 30 km) having Fibre Optic Communication Link. Differential relay at remote end shall be provided by the TSP. Associated power and control cabling and integration with SAS at remote end shall be provided by respective bay owner.</p> <p>We understand that for 400kV transmission line (line length below 30 km) wherein Line Current Differential relay is considered as both Main-I and Main-II Transmission Line Protection, there shall be no requirement of Wave Trap for PLCC/Communication.</p> <p>Kindly confirm.</p>
--	---

374



**Amendment-3 (dated: 12.12.2024) to RFP Documents for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I" through tariff based competitive bidding process.**

Sl. No.	Clause No.	Existing Clause	New/Revised Clause																																																																
1	Amendment 1, Sl. No. 2	<p><b>B.5 EXTENSION OF EXISTING SUBSTATION</b></p> <p>The following drawings/details of existing substation is attached with the RFP documents for further engineering by the bidder.</p> <table border="1"> <thead> <tr> <th>Sl. No.</th> <th>Drawing Title</th> <th>Drawing No./Details</th> <th>Rev. No.</th> </tr> </thead> <tbody> <tr> <td>A.</td> <td colspan="3">765/400 kV Banaskantha S/s</td> </tr> <tr> <td>1.0</td> <td>Single Line Diagram</td> <td>C/ENGG/WR-II/BANASKANTHA/SLD/1</td> <td>-</td> </tr> <tr> <td>2.0</td> <td>General Arrangement</td> <td>C/ENGG/WR-II/BANASKANTHA/GA/1</td> <td>-</td> </tr> <tr> <td>3.0</td> <td>Earthmat Layout</td> <td>TR202135-1001587-SS1623-EMAT-LAYOUT</td> <td>R2</td> </tr> <tr> <td>4.0</td> <td>Visual Monitoring System</td> <td>TB-384-510-018</td> <td>R1</td> </tr> <tr> <td>5.0</td> <td>Bus Bar Protection</td> <td>Make: NR Model: PCS 915</td> <td>-</td> </tr> <tr> <td>6.0</td> <td>Substation Automation System (SAS)</td> <td>Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)</td> <td>R2</td> </tr> </tbody> </table>	Sl. No.	Drawing Title	Drawing No./Details	Rev. No.	A.	765/400 kV Banaskantha S/s			1.0	Single Line Diagram	C/ENGG/WR-II/BANASKANTHA/SLD/1	-	2.0	General Arrangement	C/ENGG/WR-II/BANASKANTHA/GA/1	-	3.0	Earthmat Layout	TR202135-1001587-SS1623-EMAT-LAYOUT	R2	4.0	Visual Monitoring System	TB-384-510-018	R1	5.0	Bus Bar Protection	Make: NR Model: PCS 915	-	6.0	Substation Automation System (SAS)	Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)	R2	<p><b>B.5 EXTENSION OF EXISTING SUBSTATION</b></p> <p>The following drawings/details of existing substation is attached with the RFP documents for further engineering by the bidder.</p> <table border="1"> <thead> <tr> <th>Sl. No.</th> <th>Drawing Title</th> <th>Drawing No./Details</th> <th>Rev. No.</th> </tr> </thead> <tbody> <tr> <td>A.</td> <td colspan="3">765/400 kV Banaskantha S/s</td> </tr> <tr> <td>1.0</td> <td>Single Line Diagram</td> <td>C/ENGG/WR-II/BANASKANTHA/SLD/1</td> <td>-</td> </tr> <tr> <td>2.0</td> <td>General Arrangement</td> <td>GNB-PGCIL-BNK-ELE-003</td> <td>5</td> </tr> <tr> <td>3.0</td> <td>Earthmat Layout</td> <td>TR202135-1001587-SS1623-EMAT-LAYOUT</td> <td>R2</td> </tr> <tr> <td>4.0</td> <td>Visual Monitoring System</td> <td>TB-384-510-018</td> <td>R1</td> </tr> <tr> <td>5.0</td> <td>Bus Bar Protection</td> <td>Make: NR Model: PCS 915</td> <td>-</td> </tr> <tr> <td>6.0</td> <td>Substation Automation System (SAS)</td> <td>Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)</td> <td>R2</td> </tr> </tbody> </table>	Sl. No.	Drawing Title	Drawing No./Details	Rev. No.	A.	765/400 kV Banaskantha S/s			1.0	Single Line Diagram	C/ENGG/WR-II/BANASKANTHA/SLD/1	-	2.0	General Arrangement	GNB-PGCIL-BNK-ELE-003	5	3.0	Earthmat Layout	TR202135-1001587-SS1623-EMAT-LAYOUT	R2	4.0	Visual Monitoring System	TB-384-510-018	R1	5.0	Bus Bar Protection	Make: NR Model: PCS 915	-	6.0	Substation Automation System (SAS)	Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)	R2
Sl. No.	Drawing Title	Drawing No./Details	Rev. No.																																																																
A.	765/400 kV Banaskantha S/s																																																																		
1.0	Single Line Diagram	C/ENGG/WR-II/BANASKANTHA/SLD/1	-																																																																
2.0	General Arrangement	C/ENGG/WR-II/BANASKANTHA/GA/1	-																																																																
3.0	Earthmat Layout	TR202135-1001587-SS1623-EMAT-LAYOUT	R2																																																																
4.0	Visual Monitoring System	TB-384-510-018	R1																																																																
5.0	Bus Bar Protection	Make: NR Model: PCS 915	-																																																																
6.0	Substation Automation System (SAS)	Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)	R2																																																																
Sl. No.	Drawing Title	Drawing No./Details	Rev. No.																																																																
A.	765/400 kV Banaskantha S/s																																																																		
1.0	Single Line Diagram	C/ENGG/WR-II/BANASKANTHA/SLD/1	-																																																																
2.0	General Arrangement	GNB-PGCIL-BNK-ELE-003	5																																																																
3.0	Earthmat Layout	TR202135-1001587-SS1623-EMAT-LAYOUT	R2																																																																
4.0	Visual Monitoring System	TB-384-510-018	R1																																																																
5.0	Bus Bar Protection	Make: NR Model: PCS 915	-																																																																
6.0	Substation Automation System (SAS)	Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)	R2																																																																

523



Sl. No.	Clause No.	Existing Clause	New/Revised Clause
2.	A.23.0	New Clause	The stringing of the transmission line in forest area shall be carried out through drone.
3.	A.24.0	New Clause	The tower shall be designed considering the porcelain Insulators with creepage factor of 31 mm/ kV irrespective of type of insulator used.
4.	A.25.0	New Clause	RoW width and Span in different terrain shall be as per Schedule VII of CEA (Technical Standards for Construction of Electrical plants and Electric Lines) Regulations 2022 and RoW guidelines issued vide CEA-PS-14-86/2/2019-PSETD Division dated 24.09.2024.

376



**Set 5 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

S. N.	Clause No. and Existing provision	Clarification required	Clarifications
1.	<p>RFP for selection of bidder as Transmission service provider                      Clause 1.2                      Future Scope (Space for):                      Establishment of 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC] terminal station (4x1500 MW) along with associated interconnections with 400 kV HVAC Switchyard and all associated equipment (incl. filters)/bus extension, etc.</p>	<p>As the total requirement for HVDC (LCC) is dependent on the number of filters required and the technology provider (OEM), it is difficult estimate proper area requirement for the same. Also, the number of filters required can only be ascertained from detailed network study which is not possible at this time.</p> <p>Hence, BPC is requested to mention a fixed size and shape of area to be provided by TSP for future HVDC requirement at Raghnesda.</p> <p>Bidder needs the information for proper estimation.</p>	<p>The area indicated in the survey report for the substation in the survey report is tentative. Bidders are advised to assess the area required for the present and future scope of work and may carry out their own due diligence to finalize the area and shape of land required.</p>
2.	<p>RFP                      New Clause A.25.0                      RoW width and Span in different terrain shall be as per Schedule VII of CEA (Technical Standards for Construction of Electrical plants and Electric Lines)</p>	<p>With reference to the referred clause, it is understood that the Spans mentioned in the regulation &amp; guidelines are provided with intention to reduce the Transmission line</p>	<p>In general Design span in the forest/urban/populated area shall be followed. However at some particular locations if there is obstruction, the individual span</p>



272

**Set 5 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>Regulations 2022 and RoW guidelines issued vide CEA-PS- 14-86/2/2019-PSETD Division dated 24.09.2024</p>	<p>impact on environment &amp; also lower the ROW compensation. It is also understood that in terrain such as forest/Urban/Populated areas, TSP is free to evaluate the options available and finalize the best scenario from compliance as well as techno commercial point of view. Restriction of span in forest may lead to increased tree cutting as number of locations shall increase in forest. This may lead to rejection/revision of forest approval eventually delaying the completion of project. Also, unless the ROW width &amp; spans are updated in MOEF guidelines, reduction in ROW width as specified in CEA regulations &amp; guidelines may not be applicable.</p>	<p>may be changed provided RoW specified for the forest/urban/populated area as per CEA (Technical Standards for Construction of Electrical plants and Electric Lines) Regulations 2022 and RoW guidelines issued vide CEA-PS-14-86/2/2019-PSETD Division dated 24.09.2024 is not violated.</p>
<p>3. CEA letter dated 22-Nov-24: Facilitating Broadband expansion by allowing leasing of OPGW</p>	<p>In reference to CEA letter dated 22-Nov-2024; wherein, on request of DoT (Ministry of Communications) to Secretary -MoP for laying of atleast 48F (48 Fibers) OPGW in future transmission projects making</p>	<p>Kindly refer Amendment No. 05 issued dated 01.01.2025.</p>



276

**Set 5 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		<p>provisions for leasing of additional fibers for the use of telecom licensee, CEA has requested CTU, STU &amp; TSPs to incorporate 48F instead of 24 F in their future transmission schemes.</p> <p>Further, CEA has advised BPCs to modify the schemes which are currently under bidding, wherever applicable.</p> <p>BPC is requested to confirm if the bidders shall consider 24F or 48F OPGW in the subject bid.</p>	
4.	<p>Appendix-I_SLD Banaskantha Extn (Drawing No. C/ENGG/WR-II/BANASKANTHA/SLD/1)</p> <p>and</p> <p>Appendix-II_GA Banaskantha Extn (Drawing No. C/ENGG/WR-II/BANASKANTHA/GA/1)</p>	<p>As per SLD Raghnesda (GIS) D/C Line: Both line bays will enter adjacent to the existing Lakadia-I at Banaskantha PGCIL SS end.</p> <p>BPC is requested to confirm.</p>	<p>Please refer to amendment issued dated 12.12.2024.</p>
5.	<p>SI No. 60 of Set 2 clarifications</p> <p>Survey Report Section 3</p>	<p>The land considered by BPC as per survey report i.e. 100 acres for establishment of Raghnesda SS including Establishment of 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC] terminal station (4x1500 MW) along</p>	<p>Kindly refer above reply provided at S.No. 01.</p>

379



**Set 5 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

	<p>Approach &amp; Methodology</p> <p>Bidder understanding is correct in this regard i.e. Area mentioned under Survey Report includes area for HVDC (Future Scope).</p>	<p>with associated interconnections with 400 kV HVAC Switchyard and all associated equipment (incl. filters)/bus extension, etc. is not sufficient, as establishment of HVDC itself will require approximately 85 acres. As per our estimation, the total minimum land required will be significantly higher than as mentioned in the Survey Report.</p> <p>BPC is requested to confirm.</p>	
6.	<p>RFP Survey Report</p>	<p>As per available information M/s GETCO has planned a 400kV line from Raghnesda to Zerda which has been approved as part of their intra-state transmission system. The same has not been shown in survey report issued by BPC.</p> <p>Accordingly, it is requested to revise the survey report considering the above so that the impact of the same may be considered by all the bidders.</p> <p>The bidder can provide the realistic tariff bid.</p>	<p>Bidder may carry out their own due diligence in this regard.</p>

380



**Set 5 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

Scope of Transmission scheme, RFP		Scheduled COD in months from Effective Date	The substation (greenfield generation pooling sub-station) shall not be beyond 3 km radius of the proposed location as sufficient space is available within 3 kms vicinity of the proposed substation location.
Sl. No.	Name of Transmission Element		
1	<p>Establishment 3x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor....</p> <p><b>Future Scope (Space for):</b> ..... Establishment of 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC] terminal station (4x1500 MW) along with associated interconnections with 400 kV HVAC Switchyard and all associated equipment (incl. filters)/bus extension, etc.</p>	24 months	<p>Subsequent to receipt of your clarifications dated 05/11/2024, we have carried out our survey for selection of suitable land for establishment of proposed 765/400 kV Raghnesda (GIS) Substation within 3 km radius of the location proposed in the survey report with following findings:</p> <p>There is no suitable contiguous land parcel(s) (other than provided by BPC) with requisite suitable area for proposed 765/400 kV Raghnesda (GIS) inter-alia including 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC] terminal station (4x1500 MW) along with associated interconnections with 400 kV HVAC Switchyard found available within 3 km radius of coordinates given by BPC. The non-availability of suitable land parcel within 3 km of given coordinates may lead to uncertainty in implementation of the project.</p> <p>Considering non availability of required land area within 3 km radius, following is proposed-</p>
2			<p>Considering large number of connectivity applications being received at Raghnesda PS, space for HVDC as provided in the scope of subject transmission scheme is required to be kept by the successful bidder.</p> <p>Accordingly, requirement of RfP shall be followed.</p>



281

**Set 5 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

		<p>The radius may please be increased from 03 km to 10 km from proposed BPC coordinates given in Survey Report so as to get more alternative land parcel of required size.</p> <p>Alternatively, Land requirement for future scope of "Establishment of 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC] terminal station (4x1500 MW) along with associated interconnections with 400 kV HVAC Switchyard and all associated equipment (incl. filters)/bus extension, etc." may be omitted from present scope.</p>	
<p>8. SI No. 42 of Set 1 clarifications Annexure-C Clause No. B.2.5(a)</p> <p>Bidder shall meet the requirements of RfP.</p> <p>Further, as on date, details of RE generators proposed to be connected at Raghnesda PS which have been allocated 4 Nos. 400kV line bays along with their co-ordinates are given below:</p>		<p>BPC is requested to confirm the following Points:</p> <p>The locations mentioned in SI No. 3 is falling within 3 km radius &amp; location at SI No. 4 is falling near the proposed 3 km radius of Proposed Raghnesda SS coordinates as provided by BPC.</p>	<p>Bidders may coordinate with the Solar power developers to obtain the boundary coordinates.</p> <p>The Substation is to be set up within 3 Km radius of the proposed Substation location as per the RfP.</p>

282



**Set 5 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

<p>1. Spring Wind Energy Private Limited (SWEPL): 200MW (2200000612) – 1-line bay Coordinates: 24.213, 71.309 (as per application)</p> <p>2. JSW Neo Energy Ltd. (JSWNEEL): 200MW (2200001014) – 1-line bay Coordinates: 24.329103, 71.376031 (as per application)</p> <p>3. Renew Solar Power Pvt. Ltd. (RSPPL): 300MW (2200000993) – 1-line bay Coordinates: 24.454944, 71.403583 (as per application)</p> <p>ACME Solar Holdings Ltd. (ASHL) 400MW (2200001064) – 1-line bay Coordinates: 24.428143, 71.436474 (as per application)</p>	<p>We request BPC to confirm the exact boundary locations of Land for the proposed solar installations by Renew Solar Power Pvt. Ltd. (300 MW) and ACME Solar Holdings Ltd. (400 MW). Additionally, to ensure the transmission line route is planned without encroaching on their premises or any other proposed solar projects near the Raghnesda substation, kindly provide the land coordinates for such projects.</p> <p>We assume that both projects are solar hence approx. 1000 acres land for Renew power solar plant will be occupied within 3 km radius of proposed SS location as per BPC survey report, hence availability of area will get reduced for bidders. <b>It is requested to increase the radius from 3 km to 6 km for selecting suitable land for proposed Raghnesda SS.</b></p>
--	---



**Amendment-5 (Dated: 01.01.2025) to RFP Documents for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I" through tariff based competitive bidding process**

Sl. No.	Clause No.	Existing Clause	New/Revised Clause
1	C.1.0 (I) of RFP	TSP shall supply, install and commission One or more Nos. of FODP (168F or higher) along with panel and required Approach Cable (24F) with all associated hardware fittings from gantry tower to Control Room for all the incoming lines envisaged under the present scope.	TSP shall supply, install and commission One or more Nos. of FODP (336F or higher) along with panel and required Approach Cable (48F) with all associated hardware fittings from gantry tower to Bay Kiosk and from the Bay Kiosk to Control Room for all the incoming lines envisaged under the present scope.
2	C.2.0 (I) of RFP	On Raghnesda (GIS) - Banaskantha (PG) 765 kV D/C line, TSP shall supply, install and commission One (1) No. OPGW cable containing 24 Fibres (24F) on one E/W peak and conventional earth wire on other E/W peak.	On Raghnesda (GIS) - Banaskantha (PG) 765 kV D/C line, TSP shall supply, install and commission One (1) No. OPGW cable containing 48 Fibres (48F) on one E/W peak and conventional earth wire on other E/W peak. Proposed OPGW Hardware, Joint Box and other accessories shall be as per 48 Fiber OPGW.
3	C.3.0 (I) of RFP	TSP shall supply, install and commission 1 No. FODP (72F or higher) along with panel and required Approach Cable (24F) with all associated hardware fittings from gantry tower to Bay Kiosk and from the Bay Kiosk to Control room.	TSP shall supply, install and commission 1 No. FODP (144F or higher) along with panel and required Approach Cable (48F) with all associated hardware fittings from gantry tower to Bay Kiosk and from the Bay Kiosk to Control room.
4	C.5.0 of RFP	New Clause The tower shall be designed considering the porcelain Insulators with creepage factor of 31 mm/kV irrespective of type of insulator used.	<b>For the extension / By pass portion of existing line with OPGW:</b> OPGW requirement on extended line / By pass portion shall be of same OPGW fiber capacity of existing line. Deleted



Sl. No.	Clause No.	Existing Clause	New/Revised Clause
6.	Annexure F Clause 3.3 of RFP	<p>In case LILO lines are on same towers (e.g. both Line In and Line Out portion are on same towers, generally done LILO of S/C lines) and Line Out portion are on same towers, generally done LILO of S/C lines). Then 2x24F OPGW shall be required to install by TSP on both earthwire peak on 400 kV and 765 kV lines where two E/W peaks are available. On 220 and 132 kV lines where two E/W peaks are available and 132 kV lines where only one E/W peak is available TSP to install one no. 48F OPGW.</p> <p>Incase LILO lines are on different towers (e.g. both Line In and Line Out portion are on different towers, generally done LILO of D/C lines) Then 1x24F OPGW shall be required to install by TSP on one earthwire peak and conventional earthwire on second earthwire peak, on both Line In and Line Out portion towers of 400 kV and 765 kV lines. On 220 kV and 132 kV lines where only one E/W peak is available TSP to install one No. 24F OPGW in place of conventional earthwire</p>	<p>In case LILO lines are on same towers (e.g. both Line In and Line Out portion are on same towers, generally done LILO of S/C lines). Then 2x48F OPGW shall be required to install by TSP on both earthwire peak on 400 kV and 765 kV lines where two E/W peaks are available. On 220 and 132 kV lines where only one E/W peak is available TSP to install one no. 96F OPGW.</p> <p>Incase LILO lines are on different towers (e.g. both Line In and Line Out portion are on different towers, generally done LILO of D/C lines) Then 1x48F OPGW shall be required to install by TSP on one earthwire peak and conventional earthwire on second earthwire peak, on both Line In and Line Out portion towers of 400 kV and 765 kV lines. On 220 kV and 132 kV lines where only one E/W peak is available TSP to install one No. 48F OPGW in place of conventional earthwire.</p>
7.	Annexure F Clause 3.4 of RFP	<p>In case two different lines are using common multi circuit portion for some distance (originating from different stations, may be terminating on same or on different stations). Two No. 24F OPGW to be installed on both E/W peaks for common M/C portion of 765 kV and 400 kV lines. In case 220/132 kV lines using multi circuit portion where single E/W peak is available one No. 48F may be installed for common multi circuit portion.</p>	<p>In case two different lines are using common multi circuit portion for some distance (originating from different stations, may be terminating on same or on different stations). Two No. 48F OPGW to be installed on both E/W peaks for common M/C portion of 765 kV and 400 kV lines. In case 220/132 kV lines using multi circuit portion where single E/W peak is available one No. 96F may be installed for common multi circuit portion.</p>

22



**Set 6 of Clarifications to RFP Documents for Selection of Bidder as Transmission Service Provider to establish Inter-State Transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I"**

S. N.	Clause No. and Existing provision	Clarification required	Clarifications
1.	<p><b>Technical Requirement of Substation as per RFP</b> As per RFP, TSP has to consider the Auxiliary loads for Present and Future Scope. Also, Fire Fighting design to be made for Present and Future Scope and keep provision to suitably extend by TSA of future Scope.</p> <p>Raghnesda Project is having Future Bays of 765kV / 400kV and 220kV bays and associated Transformers and Reactors. Apart from the above, 6000 MW ± 800 kV HVDC is also provided in the Future Scope as per RFP Conditions.</p>	<p>We understand that Auxiliary feeders, Control &amp; Power Supply arrangements, Fire Fighting system for Future HVDC Scope is not to be considered in present scope.</p> <p>We understand that HVDC is a standalone project and TSP who would be winning that in future would be taking care of all the above requirements.</p> <p>Present scope as per RFP conditions specified in the Technical Requirements of Substation to be considered only for AC Substation.</p> <p>Please Clarify our understanding is correct.</p>	<p>The bidder's understanding in this regard is correct. A separate arrangement will be made for the 6000 MW ±800 kV HVDC system.</p> <p>Furthermore, the provisions of the RFP shall prevail in this matter.</p>

288



**ANNEXURE V : CERTIFICATE OF BID EVALUATION COMMITTEE**





May 28, 2025

**CERTIFICATE BY THE BID EVALUATION COMMITTEE**

**Sub.: Selection of Successful Bidder as Transmission Service Provider to establish "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I".**

It is hereby certified that:

1. The entire bid process has been carried out in accordance with the "Tariff based Competitive Bidding Guidelines for Transmission Service" and "Guidelines for encouraging competition in development of the Transmission Projects" issued by Ministry of Power, Govt. of India under Section 63 of the Electricity Act, 2003 and as amended from time to time.
2. 'Dineshchandra R. Agrawal Infracon Private Limited' emerged as the Successful Bidder after the conclusion of e-reverse bidding process with the lowest Quoted Transmission Charges of Rs2,328.71 million per annum.
3. The quoted tariff is lower than the Levelised Tariff calculated based on CERC norms considering the capital cost for the Project "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" as assessed by Cost Committee. The quoted tariff discovered through e-reverse bidding process is acceptable.

Name of Committee Member	Signature
Shri. Rajesh Kumar Singh, General Manager, SBI Commercial Client Group Regional Office - II New Delhi - Chairman	
Shri. Deepak N. Gawali, SE (Operations), WRPC- Member	
Shri. Sunil Kumar M. Soni, SE (GETCO) - Member	
Shri. Bhanwar Singh Meena, Director (PSE&TD), Central Electricity Authority- Member	
Shri. Ganeswara Rao Jada, Director, PSPA-I Division, Central Electricity Authority - Member	
Shri. Rakesh Mohan, Chairman, RAGHANESDA RE TRANSMISSION LIMITED, New Delhi - Convener Member	



**ANNEXURE VI : COPY OF DULY ACCEPTED LETTER OF INTENT (LOI)**



389

ISO 9001:2008 COMPANY



**Dineshchandra R. Agrawal**  
**Infracon Pvt. Ltd.**

Infrastructure Builder

Phone : 91-79-2630 9789, 9687617789

Website : www.draipl.com

Email : [drainfra89@gmail.com](mailto:drainfra89@gmail.com) / [ps.cmd@draipl.com](mailto:ps.cmd@draipl.com)

401, The Grand Mall, S.M. Road, Ambawadi,  
Ahmedabad - 380015. Gujarat, INDIA

No. DRAIPL/PFC/LOI/ 345

Date: 09.06.2025

To,  
**The General Manager**  
PFC Consulting Limited  
9<sup>th</sup> Floor (A Wing),  
Statesman House, Connaught Place,  
New Delhi-110001

Email: [pfcl.itp@pfcindia.com](mailto:pfcl.itp@pfcindia.com)

**Kind Attn: Mr. Naveen Kumar-General Manager**

**Sub: Independent Transmission Project (ITP) "Transmission system for evacuation of RT Power from Raghnesda Area of Gujarat-3GW under Phase-I" Letter of Intent Reg:-**

**Ref: Your office letter No. 04/24-25/ITP-90/RFP dt. 03.06.2025**

Sir,

Referring to above we hereby acknowledge the receipt of LOI dt. 03.06.2025 for the work stated above. Copy of LOI duly signed is attached herewith for your reference and record.

Thanking You

Yours faithfully,  
For Dineshchandra R. Agrawal Infracon Pvt Ltd.

Authorised Signatory

Encl: Copy of LOI duly signed.



Ref. No. 04/24-25/ITP-90/RFP

June 03, 2025

To

E-mail: [dra.tender@draipl.com](mailto:dra.tender@draipl.com)

Mr. Sameer Modh, Manager (BD)

Dineshchandra R. Agrawal Infracon Private Limited,

401, The Grand Mall, S.M. Road, Ambawadi

Ahmedabad – 380015, Gujarat

**Sub.: Independent Transmission Project (ITP) "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I" - Letter of Intent**

Dear Sir,

We refer to:

1. The Request for Proposal document dated September 14, 2024 issued to 'Dineshchandra R. Agrawal Infracon Private Limited' as regards participation in the international competitive bidding process for Transmission Scheme for "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I", and as amended till the Bid Deadline including all correspondence/ clarifications / amendments exchanged between 'Dineshchandra R. Agrawal Infracon Private Limited' and PFC Consulting Limited in regard thereto (hereinafter collectively referred to as the "Final RFP");
2. The offer of 'Dineshchandra R. Agrawal Infracon Private Limited' by way of a Technical Bid pursuant to (1) above submitted on April 28, 2025 in response to the Final RFP.
3. The offer of 'Dineshchandra R. Agrawal Infracon Private Limited' by way of Financial Bid-Initial Offer submitted on April 28, 2025 in response to the Final RFP.
4. The offer of 'Dineshchandra R. Agrawal Infracon Private Limited' by way of a Financial Bid-Final Offer Submitted during e-Reverse Auction process concluded on May 23, 2025 in response to the Final RFP.
5. The Technical Bid as at Sl.No. (2) above and the Financial Bid as in Sl.Nos. (3) & (4) above, hereinafter collectively referred to as the "Bid".

This is to inform you that the process of evaluating bids received pursuant to the Final RFP, including the Bid, has been concluded. We are pleased to inform you that your proposal and offer received by way of the "Bid" has been accepted and 'Dineshchandra R. Agrawal Infracon Private Limited' is hereby declared as the Successful Bidder as per Clause 3.6.1 of the Final RFP for the above project and consequently this Letter of Intent (hereinafter referred to as the "LoI") is being issued.

पंजीकृत कार्यालय : प्रथम तल, "उमानिधि", 1 बाराखम्बा लेन, कर्नाट प्लेस, नई दिल्ली-110001

Regd. Office : First Floor, "Umanidhi", 1, Barakhamba Lane, Connaught Place, New Delhi-110001

कंपनी मुख्यालय : नौवौं तल (ए विंग), स्टेट्समैन हाउस, कर्नाट प्लेस, नई दिल्ली-110001 दूरभाष : 011-23443900 फैक्स : 011-23443990

Corporate Office : 9<sup>th</sup> Floor (A Wing), Statesman House, Connaught Place, New Delhi - 110001 Phone : 011 - 23443900 Fax : 011 - 23443990

वेबसाइट / Website : [www.pfcindia.com](http://www.pfcindia.com) CIN : U74140DL2008GO1175858



This LoI is based on the Final RFP and you are requested to please comply with the following:

- a) Acknowledging its issuance and unconditionally accepting its contents and recording "Accepted unconditionally" under the signature of your authorized signatory on each page of the duplicate copy of this letter attached herewith and returning the same to PFC Consulting Limited within seven (07) days of the date of issuance of LoI. This LoI is issued to you in duplicate.
- b) Completion of various activities as stipulated in the Final RFP including in particular Clause 2.15.2, Clause 2.15.3 and Clause 2.15.4 of the Final RFP, within the timelines as prescribed therein.

It may be noted that PFC Consulting Limited has the rights available to them under the Final RFP, including rights under Clause 2.15.5 and Clause 3.6.3 thereof, upon your failure to comply with the aforementioned conditions.

As you are aware, the issuance and contents of this LoI are based on the Bid submitted by you as per the Final RFP including the Transmission charges and other details regarding the Scheduled COD as contained therein. The Quoted Transmission Charges as submitted by you and the Scheduled COD of each transmission Element and the Project as agreed by you in your Bid, as per Annexure 21 and Format-1 of Annexure 8 respectively of the Final RFP is annexed herewith as **Schedule A** and incorporated herein by way of reference.



Yours sincerely,  
For PFC Consulting Limited



(Naveen Kumar)  
15

*Unconditional Acceptance of LoI* General Manager

Enclosures:

- **Schedule A** - Quoted Transmission Charges and the Scheduled COD of each Transmission Element and the Project submitted in your Bid, as per Annexure 21 and Format-1 of Annexure 8 respectively of the Final RFP

Copy to:

1. Chairperson and Managing Director, Power Finance Corporation Limited, "Urjanidhi", 1, Barakhamba Lane, Connaught Lane, New Delhi - 110 001
2. Director (Transmission), Ministry of Power, Shram Shakti Bhawan, Rafi Marg, New Delhi- 110001
3. Chief Engineer (PSPA-I) and Member Secretary (NCT), Central Electricity Authority, 3<sup>rd</sup> Floor, Sewa Bhawan, R.K. Puram, New Delhi - 110066.
4. Chief Operating Officer (COO), Central Transmission Utility of India Limited (CTUIL), 5<sup>th</sup>-10<sup>th</sup> Floor, Icon International Tower-1, Sector -32, Gurgaon, Haryana - 122001.
5. Secretary, Central Electricity Regulatory Commission, 6<sup>th</sup>, 7<sup>th</sup> & 8<sup>th</sup> Floors, Tower B, World Trade Centre, Nauroji Nagar, New Delhi - 110 029.



**SCHEDULE - A**

(Page 1 of 2)

**1. Quoted Transmission Charges as per Annexure-21-Format For Financial Bid**

**Quoted Transmission Charges: Rs. 2,328.71 Million per annum**



*Signature*



**SCHEDULE-A**

(Page 2 of 2)

**2. Scheduled COD of each transmission Element and the Project as per Format 1 of Annexure-8 of RFP**

Sl. No.	Name of the Transmission Element	Scheduled COD	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre-required for declaring the commercial operation (COD) of the respective Element
1.	Establishment 4x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVAr, 765 kV bus reactor and 2x125 MVAr, 420 kV bus reactor	27 months from effective date	52.69%	All Elements are required to be commissioned simultaneously as their utilization is dependent on commissioning of each other.
2.	Raghnesda (GIS) - Banaskantha (PG) 765 kV D/C line		36.50%	
3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s		2.80%	
4.	Creation of 220 kV switchyard (Bus Sec-I) at Raghnesda PS (GIS) along with installation of 2x500 MVA, 400/220 kV ICTs	30.09.2027*	7.28%	Elements at Sl. No. 1, 2 and 3 are pre-required for declaring the commercial operation (COD)
5.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Azure Power Sixty-Three Pvt. Ltd. (2200001107) (300 MW)	30.09.2027*	0.36%	
6.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Sunsure Solarpark RJ One Pvt. Ltd. (2200001018) (350 MW)	31.03.2028	0.37%	Element at Sl. No. 6 can be commissioned separately subject to commissioning of elements at sl. No. 1 to 4.

\*Subject to minimum schedule of 27 months from effective date.



**ANNEXURE VII : COPY OF LETTER ISSUED BY BPC EXTENSION IN FOR COMPLETION OF THE OBLIGATIONS AS PER CLAUSE 2.15.2, 2.15.3 AND 2.15.4 OF RFP.**



Ref. 04/24-25/ITP-90/RfP

July 23, 2025

To

Mr. Sameer Modh, Manager (BD)  
Dineshchandra R. Agrawal Infracon Private Limited,  
401, The Grand Mall, S.M. Road, Ambawadi  
Ahmedabad - 380015, Gujarat

Email: [dra.tender@draipl.com](mailto:dra.tender@draipl.com)

Sub: Independent Transmission Project "Transmission system for evacuation of RE power from Raghnesda area of Gujarat-3 under Phase-I" - Regarding Extension of LoI.

Dear Sir,

This is with reference to Letter of Intent (LoI) issued on June 03, 2025 for establishment of subject transmission scheme. The Clause No. 2.15.2 of the RFP document stipulates that within ten (10) days of the issue of the LoI the selected bidder shall complete all the activities including the acquisition of SPV.

As the SPV is being transferred on July 23, 2025, the last date for completion of various activities under Clause No. 2.15.2 of the RFP document is extended from June 13, 2025 (10 days from LoI) to July 23, 2025.

Thanking you,

Yours faithfully,

  
(Naveen Phougat)  
General Manager

पंजीकृत कार्यालय : प्रथम तल, 'उर्जानिधि', 1 बाराखम्बा लेन, कनॉट प्लेस, नई दिल्ली-110001

Regd. Office : First Floor, "Urjanidhi", 1, Barakhamba Lane, Connaught Place, New Delhi-110001

कंपनी मुख्यालय : नौथी तल (ए विंग), स्टेट्समैन हाउस, कनॉट प्लेस, नई दिल्ली - 110001 दूरभाष : 011 - 23443900 फैक्स : 011 - 23443990

Corporate Office : 9<sup>th</sup> Floor (A Wing), Statesman House, Connaught Place, New Delhi - 110001 Phone : 011 - 23443900 Fax : 011 - 23443990

वेबसाइट / Website : [www.pfccindia.com](http://www.pfccindia.com) CIN : U74140DL2008GO1175856



**ANNEXURE VIII : COPY OF CONTRACT PERFORMANCE GUARANTEE**





LCB Ahmedabad, Shivalik Shilp 2<sup>nd</sup> Floor, Iskcon Cross Roads,  
S.G. Highway, Ahmedabad-380015

Dated: 22-07-2025

To,  
Central Transmission Utility Limited  
5<sup>th</sup> to 10<sup>th</sup> Floor,  
Ircan International Tower No 1,  
Plot No 16,  
Gurugram,  
Haryana-122003

**Subject:** Revalidation of bank Guarantee No 44410ILG032425 dated 21/07/2025 issued on behalf of Dineshchandra R Agrawal Infracon Pvt. Ltd.

Dear Sir,

With reference to Bank Guarantee No. 44410ILG032425 dated 21/07/2025, issued by our branch on behalf of Dineshchandra R Agrawal Infracon Pvt Ltd in your favour for an amount of Rs 57,50,00,000/- (Fifty Seven Crore Fifty lakh Only)

We certify that stamp paper certificate No IN-GJ15478338243321X dated 14/05/2025 is to be replaced with stamp paper certificate No. IN-GJ66949739479438X dated 22/07/2025. Consider stamp paper No. IN-GJ66949739479438X dated 22/07/2025 as integral part of Bank Guarantee No 44410ILG032425.

All other terms and conditions remain unchanged.

Kindly acknowledge the revalidation.

Thanking You,

Yours faithfully,

Ravi Ranjan Kumar  
Sr. Manager  
PF No. 5168252  
Punjab National Bank  
LCB Ahmedabad

Abhishek Birmaan  
Chief Manager  
PF No. 5174144  
Punjab National Bank  
LCB Ahmedabad

Received on 25/07/2025  
  
Deepak Krishnan  
Chief manager, CRUCL.





IN-GJ66949739479438X



सत्यमेव जयते

# INDIA NON JUDICIAL Government of Gujarat Certificate of Stamp Duty

<b>Certificate No.</b>	IN-GJ66949739479438X
<b>Certificate Issued Date</b>	22-Jul-2025 01:43 PM
<b>Account Reference</b>	IMPACC (AC)/ gj13023611/ GULBAI TEKRA/ GJ-AH
<b>Unique Doc. Reference</b>	SUBIN-GJGJ1302361140666682669836X
<b>Purchased by</b>	PUNJAB NATIONAL BANK
<b>Description of Document</b>	Article 32 Letter of Guarantee
<b>Description</b>	BANK GUARANTEE
<b>Consideration Price (Rs.)</b>	0 (Zero)
<b>First Party</b>	PUNJAB NATIONAL BANK
<b>Second Party</b>	CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED
<b>Stamp Duty Paid By</b>	PUNJAB NATIONAL BANK
<b>Stamp Duty Amount(Rs.)</b>	300 (Three Hundred only)

THIS STAMP PAPER FORMS AN INTEGRAL PART OF


BG No. 444101L6032425

AMOUNT 57,50,00,000/-

DATED 21/07/2025 ISSUED ON

BEHALF OF M/S Dineshchandra R. Agrawal

FAVOURING Central Transmission Utility of India



GG 0016672701



**Step-by-Step Alert**

1. The authenticity of this Stamp certificate should be verified at [www.shilolestamp.com](http://www.shilolestamp.com) or using a Stamp Reader App of StockHolders. Any discrepancy in the details on this Certificate and as available on the website / Mobile App renders it invalid.
2. The duty of checking the legitimacy is on the users of the certificate.
3. In case of any discrepancy please advise the Competent Authority.



IN-GJ15478338243321X



सत्यमेव जयते

# INDIA NON JUDICIAL Government of Gujarat Certificate of Stamp Duty

**Certificate No.** : IN-GJ15478338243321X

**Certificate Issued Date** : 14-May-2025 01:32 PM

**Account Reference** : IMPACC (AC)/ gj13023611/ GULBAI TEKRA/ GJ-AH

**Unique Doc. Reference** : SUBIN-GJGJ1302361139880610995542X

**Purchased by** : DINESHCHANDRA R AGRAWAL INFRACON PVT LTD

**Description of Document** : Article 32 Letter of Guarantee

**Description** : BANK GUARANTEE

**Consideration Price (Rs.)** : 0  
(Zero)

**First Party** : DINESHCHANDRA R AGRAWAL INFRACON PVT LTD


**Second Party** : PUNJAB NATIONAL BANK

**Stamp Duty Paid By** : DINESHCHANDRA R AGRAWAL INFRACON PVT LTD

**Stamp Duty Amount(Rs.)** : 300  
(Three Hundred only)

THIS STAMP PAPER FORMS AN INTEGRAL PART OF

BG No. 44410816082425  
 AMOUNT 53,50,00,000/-  
 DATED 21/09/25 ISSUED ON  
 BEHALF OF M/c Dineshchandra R. Agrawal Infracon Pvt Ltd  
 FAVOURING Central Transmission Utility of India Ltd.



GG 0006913574

VOID VOID VOID

1. This Stamp certificate should be verified at [www.shcinstamp.com](http://www.shcinstamp.com) or using a Stamp Mobile App of Stock Holding Corporation of India Limited.

2. Any alteration in the details on this Certificate and as available on the website / Mobile App renders it invalid.

3. The Stamp certificate is valid only if it is used in the form of the certificate.

4. The Stamp certificate is issued under the supervision of the Controller of Stamps, Government of India.



400

**गारंटी पत्र के लिए मानक आवरण पत्र**  
**STANDARD COVERING LETTER FOR LETTER OF GUARANTEE**



शाखा : **LCB Ahmedabad**  
Branch :  
टेलीफोन नंबर : **079-27541682**  
Telephone No. :  
ईमेल पता :  
Email Address : **Bo4441@Pnb.co.in**  
मुद्रित क्रमांक :  
Printed Serial No. : **TYX 457445**

To: **Central Transmission Utility Limited (being the Nodal Agency) at 5th to 10th Floor, Icon International Tower, Tower No-1**  
माननीय महोदय, **Plot No-16 Gurgaon, Haryana - 122003**  
Dear Sir,

कृपया हमारा संलग्नक गारंटी पत्र संख्या ..... दिनांक ..... को रुपये ..... (₹ ..... Confirmation of this LG can be obtained by the ..... ) के लिए दिनांक ..... तक वेध प्राप्त करें, जो ..... Beneficiary through Bank's Corporate Website ..... के अनुरोध पर इस कार्यालय द्वारा (1) श्री/सुश्री ..... (https://www.pnbIndia.in/)>>Home Screen>> ..... पदनाम ..... और (2) श्री/सुश्री ..... Online Services (Right Side of Screen)>>Online ..... पदनाम ..... के संयुक्त हस्ताक्षर से जारी की गई।  
BG Verification Portal

Please find enclosed our letter of guarantee no. **44410216032425** dated **21/07/25** for an amount of **₹ 57,50,00,000/-** Rupees **Fifty Seven Crore Fifty lakh only** valid till **27/12/27** and issued at the request of **M/S Dineshchandra B. Agrawal** by this office under the joint signatures of (1) Sh./Ms. **Abhishek Birmann** Designation **Chief Manager** (2) Sh./Ms. **Ravi Ranjan Kumar** Designation **Sr. Manager**

उक्त गारंटी पत्र का संदेश आपके बैंक को एस एफ एम एस गेटवे के माध्यम से प्रेषित कर दिया गया है। यह परामर्श है कि आप अपने हित में, अपने बैंक/शाखा से गारंटी के उपरोक्त पत्र की वास्तविकता को सत्यापित कर सकते हैं। साथ ही, गारंटी फॉर्म की वास्तविकता हमारे नियंत्रण कार्यालय से सत्यापित की जा सकती है, जो (पता, ईमेल आईडी, नियंत्रण कार्यालय का संपर्क नंबर) है, जिसे इस पत्र की एक प्रति पृष्ठांकित की जा रही है।

The message of the said letter of guarantee has been transmitted through SFMS gateway to your bank. It is advised that in your own interest, you may verify the genuineness of above letter of guarantee from your Bank/Branch. Also, the genuineness of guarantee form be verified from our Controlling Office, which is **Zonal Office Ahmedabad** **4th Floor Channarya Building Ashram Road Ahmedabad** (Address, Email ID, Contact No. of the Controlling Office), to whom a copy of this letter is being endorsed. **Zoahm Sarda & Pnb.co.in -380009**

आपका भवदीय Yours faithfully,

हस्ताक्षर Signature .....  
नाम Name **Ravi Ranjan K.R**  
पदनाम Designation **Sr. Manager**

दिनांक Date : **21/7/25**

प्रतिलिपि: मंडल प्रमुख ..... (पता) हमारे कार्यालय द्वारा उपर्युक्त गारंटी की प्रति सूचना तथा रिकॉर्ड हेतु प्रस्तुत

CC : The Circle Head **Zonal office Ahmedabad** (address) along with a copy of the above said guarantee issued by us for his information and record.



**ANNEXURE 15 - FORMAT FOR CONTRACT PERFORMANCE GUARANTEE**

**(To be on non-judicial stamp paper of appropriate value as per Stamp Act relevant to place of execution.  
Foreign entities submitting Bids are required to follow the applicable law in their country)**

In consideration of the M/s. Dineshchandra R. Agrawal Infracon Private Limited having its registered address at 401, The Grand Mall, S.M Road, Ambawadi, Ahmedabad-380015, Gujarat, India agreeing to undertake the obligations under the Transmission Service Agreement dated 23<sup>rd</sup> July 2025 and the other RFP Project Documents and the Nodal Agency and PFC Consulting Limited, agreeing to execute the RFP Project Documents with the Selected Bidder, regarding setting up the Project, the Punjab National Bank, having its Head Office at Plot No.4, Sector-10, Dwarka, New Delhi- 110 075 and branch office at Second Floor, Shivalik Ship, Iscon Cross Road, S.G. Highway, Ahmedabad- 380059 (hereinafter referred to as "Guarantor Bank") hereby agrees unequivocally, irrevocably and unconditionally to pay to the Central Transmission Utility of India Limited (being the Nodal Agency) having address at 5th to 10th Floor, Ircon International Tower, Tower no-1, Plot no -16 , Sector-32, Gurugram, Haryana-122003 forthwith on demand in writing from the Nodal Agency or any Officer authorized by it in this behalf, any amount up to and not exceeding Rs. 57.50 Crore (Rupees Fifty Seven Crore and Fifty Lakhs) on behalf of M/s. Dineshchandra R. Agrawal Infracon Private Limited.

This guarantee shall be valid and binding on the Guarantor Bank up to and including 27<sup>th</sup> December 2027 and shall not be terminable by notice or any change in the constitution of the Bank or the term of the Transmission Service Agreement or by any other reasons whatsoever and our liability hereunder shall not be impaired or discharged by any extension of time or variations or alternations made, given, or agreed with or without our knowledge or consent, by or between parties to the respective agreement.

Our liability under this Guarantee is restricted to Rs. 57.50 Crore (Rupees Fifty Seven Crore and Fifty Lakhs only). Our Guarantee shall remain in force until 27<sup>th</sup> December 2027. The Nodal Agency shall be entitled to invoke this Guarantee up to three hundred sixty five (365) days of the last date of the validity of this Guarantee.

The Guarantor Bank hereby expressly agrees that it shall not require any proof in addition to the written demand from the Central Transmission Utility of India Limited (in its role as the Nodal Agency), made in any format, raised at the above mentioned address of the Guarantor Bank, in order to make the said payment to the Nodal Agency.

The Guarantor Bank shall make payment hereunder on first demand without restriction or conditions and notwithstanding any objection by M/s. Dineshchandra R. Agrawal Infracon Private Limited, RAGHANESDA RE TRANSMISSION LIMITED, and/or any other person. The Guarantor Bank shall not require the Nodal Agency to justify the invocation of this BANK GUARANTEE, nor shall the Guarantor Bank have any recourse against the Nodal Agency in respect of any payment made hereunder.

**This BANK GUARANTEE shall be interpreted in accordance with the laws of India.**

The Guarantor Bank represents that this BANK GUARANTEE has been established in such form and with such content that it is fully enforceable in accordance with its terms as against the Guarantor Bank in the manner provided herein.

**This BANK GUARANTEE shall not be affected in any manner by reason of merger, amalgamation, restructuring, liquidation, winding up, dissolution or any other change in the constitution of the Guarantor Bank.**

**This BANK GUARANTEE shall be a primary obligation of the Guarantor Bank and accordingly the Nodal Agency shall not be obliged before enforcing this BANK GUARANTEE to take any action in any court or arbitral proceedings against RAGHANESDA RE TRANSMISSION LIMITED or M/s.**

For Punjab national bank  
Large Corporate Branch,  
Ahmedabad

  
Sr. Manager

For Punjab national bank  
Large Corporate Branch,  
Ahmedabad

  
Chief Manager



Dineshchandra R. Agrawal Infracon Private Limited, to make any claim against or any demand on **RAGHANESDA RE TRANSMISSION LIMITED** or M/s. Dineshchandra R. Agrawal Infracon Private Limited, as the case may be, or to give any notice to **RAGHANESDA RE TRANSMISSION LIMITED** or M/s. Dineshchandra R. Agrawal Infracon Private Limited, as the case may be, or to enforce any security held by the Nodal Agency or to exercise, levy or enforce any distress, diligence or other process against **RAGHANESDA RE TRANSMISSION LIMITED** or M/s. Dineshchandra R. Agrawal Infracon Private Limited, as the case may be.

The Guarantor Bank acknowledges that this BANK GUARANTEE is not personal to the Nodal Agency and may be assigned, in whole or in part, (whether absolutely or by way of security) by Nodal Agency to any entity to whom the Nodal Agency is entitled to assign its rights and obligations under the Transmission Service Agreement.

The Guarantor Bank hereby agrees and acknowledges that the Nodal Agency shall have a right to invoke this Bank Guarantee either in part or in full, as it may deem fit.


Notwithstanding anything contained hereinabove, our liability under this Guarantee is restricted to Rs. 57.50 Crore (Rupees Fifty Seven Crore and Fifty Lakhs) and it shall remain in force until 27<sup>th</sup> December 2027, with an additional claim period of three hundred sixty five (365) days thereafter. This BANK GUARANTEE shall be extended from time to time for such period, as may be desired M/s. Dineshchandra R. Agrawal Infracon Private Limited. We are liable to pay the guaranteed amount or any part thereof under this Bank Guarantee only if the Nodal Agency serves upon us a written claim or demand.

For Punjab national bank  
Large Corporate Branch,  
Ahmedabad



Sr. Manager

For Punjab national bank  
Large Corporate Branch,  
Ahmedabad



Chief Manager





IN-GJ66951261180869X



सत्यमेव जयते

# INDIA NON JUDICIAL Government of Gujarat Certificate of Stamp Duty

<b>Certificate No.</b>	: IN-GJ66951261180869X
<b>Certificate Issued Date</b>	: 22-Jul-2025 01:44 PM
<b>Account Reference</b>	: IMPACC (AG)/ gj13023611/ GULBAI TEKRA/ GJ-AH
<b>Unique Doc. Reference</b>	: SUBIN-GJGJ1302361140668910666170X
<b>Purchased by</b>	: PUNJAB NATIONAL BANK
<b>Description of Document</b>	: Article 32 Letter of Guarantee
<b>Description</b>	: BANK GUARANTEE
<b>Consideration Price (Rs.)</b>	: 0 (Zero)
<b>First Party</b>	: PUNJAB NATIONAL BANK
<b>Second Party</b>	: CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED
<b>Stamp Duty Paid By</b>	: PUNJAB NATIONAL BANK
<b>Stamp Duty Amount(Rs.)</b>	: 300 (Three Hundred only)



THIS STAMP PAPER FORMS ON INTEGRAL PART OF


BG No. 444101LG 032425

AMOUNT 57,50,00,000/-

DATED 21/07/2025 ISSUED ON

BEHALF OF M/S Dineshchandra R Agrawal Infraction Pvt Ltd.

FAVOURING Central Transmission Utility of India Ltd.



GG 0016672762



**Stipulatory Aids:**

1. The authenticity of this Stamp certificate should be verified at [www.shelbestamp.com](http://www.shelbestamp.com) or using e-Stamp Mobile App of State Bank of India. Any discrepancy in the details on this Certificate and as available on the website / Mobile App renders it invalid.
2. The onus of checking the authenticity is on the users of the certificate.
3. In case of any discrepancy please inform the Competent Authority.

404

**गारंटी पत्र के लिए मानक आवरण पत्र**  
**STANDARD COVERING LETTER FOR LETTER OF GUARANTEE**



शाखा : **LCB Ahmedabad**  
Branch :

टेलीफोन नंबर : **079-22541622**  
Telephone No. :

ईमेल पता : **Bo4441@Pnb.co.in**  
Email Address :

मुद्रित क्रमांक : **TYX 457451**  
Printed Serial No. :

To, **Central Transmission Unit  
of India Limited, (Being the Nodal  
Agency) at 5th to 10th Floor, Icon  
International Tower, Power House-1  
माननीय महोदय, Plot No-16, Gurugram Haryana -  
122 003.**

Dear Sir,

कृपया हमारा संलग्न गारंटी पत्र संख्या ..... दिनांक ..... को  
रुपये (₹ ..... Confirmation of this BG. can be obtained by the ..... ) के लिए दिनांक ..... तक  
वैध प्राप्त करें, जो ..... Beneficiary through Bank's Corporate Website  
(<https://www.pnbIndia.in/>) >> Home Screen >> ..... के अनुरोध  
पर इस कार्यालय द्वारा (1) श्री/सुश्री ..... पदनाम ..... और  
(2) श्री/सुश्री ..... Online Services (Right Side of Screen) >> Online ..... पदनाम .....  
BG Verification Portal ..... पदनाम .....  
के संयुक्त हस्ताक्षर से जारी की गई।

Please find enclosed our letter of guarantee no. **44410267032425** dated **21/7/25**  
for an amount of **₹ 57,50,00,000** Rupees **Fifty Seven Crore Fifty Lakh only** ..... )  
valid till **30-06-28** ..... and issued at the request of **M/S Dineshchandra R. Agrawal** by this  
office under the joint signatures of (1) Sh./Ms. **Abhishek Birman Infracon Pvt. Ltd.**  
Designation **Chief Manager** (2) Sh./Ms. **Ravi Ranjan Kumar**  
Designation **Sr. Manager** .....

उक्त गारंटी पत्र का संदेश आपके बैंक को एस एफ एम एस गेटवे के माध्यम से प्रेषित कर दिया गया है। यह परामर्श है कि आप अपने हित में, अपने बैंक / शाखा से गारंटी के उपरोक्त पत्र की वास्तविकता को सत्यापित कर सकते हैं। साथ ही, गारंटी फॉर्म की वास्तविकता हमारे नियंत्रण कार्यालय से सत्यापित की जा सकती है, जो .....  
(पता, ईमेल आईडी, नियंत्रण कार्यालय का संपर्क नंबर) है, जिसे इस पत्र की एक प्रति पृष्ठांकित की जा रही है।

The message of the said letter of guarantee has been transmitted through SFMS gateway to your bank. It is advised that in your own interest, you may verify the genuineness of above letter of guarantee from your Bank/Branch. Also, the genuineness of guarantee form be verified from our Controlling Office, which is **Zonal office Ahmedabad**  
**4th Floor, Chanakya Building Ashraya** Address, Email ID, Contact No. of the Controlling  
**Road Ahmedabad** Office), to whom a copy of this letter is being endorsed. **580009**

**Zoakm Sand @ Pnb.co.in**

आपका भवदीय Yours faithfully,  
हस्ताक्षर Signature .....  
नाम Name **Ravi Ranjan Kumar**  
पदनाम Designation **Sr. Manager**

दिनांक Date : **22/7/25**

प्रतिलिपि: मंडल प्रमुख ..... (पता) हमारे  
कार्यालय द्वारा उपर्युक्त गारंटी की प्रति सूचना तथा रिकॉर्ड हेतु प्रस्तुत  
CC : The Circle Head **Zonal office Ahmedabad**  
along with a copy of the above said guarantee issued by us for his information and record.



## EXTENSION /RENEWAL OF BANK GUARANTEE

Date: 22-07-2025

To,  
Central Transmission Utility Of India Limited  
( Being the Nodal Agency) at 5<sup>th</sup> to 10<sup>th</sup> floor,  
Ircon International Tower, Tower NO-1, Plot No-16  
Gurugram, Haryana-122003

Subject: Extension of Validity period of Bank Guarantee No.: 44410ILG032425 Dt. 21-07-2025

We Punjab National Bank, a body corporate constituted under the Banking Companies (Acquisition and Transfer of Undertaking) Act 1970 having its Head Office at Plot No.4, Sector 10, Dwarka, New Delhi 110075 and an inter-alia branch office at Office No 213-215, 1<sup>st</sup> Floor, Shivalik Shilp Building, Iskon Cross Road, SG Highway, Ahmedabad, Gujarat, Pin 380015 refer to the **Bank Guarantee Number: 44410ILG032425 Dt. 21-07-2025** (hereinafter referred to as "Said Guarantee") on account of **M/s. Dineshchandra R. Agrawal Infracon pvt. Ltd.** having his/her/ its/registered office at **AHMEDABAD, GUJARAT** (hereinafter referred to as an "Applicant") for a sum of **₹ 57,50,00,000/- (Rupees Fifty Seven crore Fifty lakh only)** in your favor. The validity of the said Guarantee was upto **27-12-2027**.

With reference to the same we state as hereunder:

1. We now at the request of the applicant of **M/s. Dineshchandra R. Agrawal Infracon pvt. Ltd.** further extend the period of validity of the said Bank Guarantee upto **30-06-2028** on the same terms & conditions mentioned in our original Bank Guarantee No. **44410ILG032425 Dt. 21-07-2025**.
2. This letter has to be read as part and parcel of our above referred Bank guarantee.

Notwithstanding anything contained herein:


"Notwithstanding anything to the contrary contained herein:-

- Our liability under this Guarantee shall not exceed **₹57,50,00,000/- (Rupees Fifty Seven crore Fifty lakh only)**
- This Bank Guarantee shall be valid up to **30-06-2028** (being the date of expiry of the Guarantee);
- Further, a claim period of upto **30-06-2029** after validity period (claim period) is available to you to make a demand under the Bank Guarantee.
- We are liable to pay up to the guarantee amount if and only if, we receive from you a written claim or demand within the validity period of the guarantee as above or within claim period, if any.

For Punjab national bank  
Large Corporate Branch,  
Ahmedabad

  
Sr. Manager

For Punjab national bank  
Large Corporate Branch,  
Ahmedabad

  
Chief Manager  


406

**ANNEXURE IX : COPY OF BPC LETTERS FOR ACQUISITION PRICE**

409



Ref. No. 04/24-25/ITP-90/RFP

June 13, 2025

To

e-mail: [dra.tender@draipl.com](mailto:dra.tender@draipl.com)

Mr. Sameer Modh, Manager (BD)

Dineshchandra R. Agrawal Infracon Private Limited,  
401, The Grand Mall, S.M. Road, Ambawadi  
Ahmedabad – 380015, Gujarat**Subject: Independent Transmission Project (ITP) "Transmission system for evacuation of RE power from Raghnesda Area of Gujarat - 3GW under Phase-I" – Regarding submission of CPG and Due Diligence for transfer of SPV.**

Ref: Letter of Intent (LoI) dated 03.06.2025.

Dear Sir,

In line with the provisions of Clause 2.15.2 (a), (b) & (c) of the RfP Document, Contract Performance Guarantee in favour of Nodal Agency i.e. Central Transmission Utility of India Limited (CTUIL) has to be provided, the Share Purchase Agreement has to be executed and the SPV namely, "RAGHANESDA RE TRANSMISSION LIMITED" has to be acquired by the selected bidder i.e. Dineshchandra R. Agrawal Infracon Private Limited along with all its related assets and liabilities for an Acquisition Price.

It may be noted that the SPV is tentatively scheduled to be transferred on 27.06.2025. You are therefore requested to arrange for due diligence process accordingly.

It is intimated that the Acquisition Price of the SPV "RAGHANESDA RE TRANSMISSION LIMITED" is Rs.19,13,95,265/- (Rupees Nineteen Crore Thirteen Lakh Sixty Nine Five Thousand Two Hundred Sixty Five Only). The break-up for this amount is given below:

Sl. No.	Description	Amount (in INR)
1.	PFCCL Management Fees	15,00,00,000
2.	Goods and Service Tax on PFCCL Management Fees	2,70,00,000
3.	Other Administrative Expenses	1,42,95,265
4.	Share Capital	1,00,000
	<b>Total</b>	<b>19,13,95,265</b>

The payment of the Acquisition Price may be made as detailed hereunder:

Name : **PFC Consulting Limited**  
PFCCL Goods and Service Tax No. : **07AAECP6182F1ZC**  
PFCCL PAN No. : **AAECP6182F**  
Mode of Payment : **RTGS**

पंजीकृत कार्यालय : प्रथम तल "ऊर्जाविधि", 1, बाराखम्बा लेन, कनॉट प्लेस, नई दिल्ली-110001

Regd. Office : First Floor, "Urjanidhi", 1, Barakhamba Lane, Connaught Place, New Delhi-110001

कंपनी मुख्यालय : नौवीं तल (ए विंग) स्टेट्समैन हाउस, कनॉट प्लेस, नई दिल्ली-110001 दूरभाष : 011-23443990 फैक्स : 011-23443990

Corporate Office : 9th Floor (A Wing) Statesman House, Connaught Place, New Delhi-110001 Phone : 011-23443990 Fax : 011-23443990

ई-मेल/ E-mail : [pfcconsulting@pfcindia.com](mailto:pfcconsulting@pfcindia.com) वेबसाइट/Website : [www.pfcclindia.com](http://www.pfcclindia.com)

408



**Bank Details:**

<b>Bank Name</b>	<b>ICICI Bank, 9A, Phelps, Connaught Place, New Delhi</b>
<b>Name of Account</b>	<b>PFC CONSULTING LIMITED</b>
<b>A/C No.</b>	<b>000705036117</b>
<b>IFSC Code</b>	<b>ICIC0000007</b>

It is requested that TDS may be deducted against the above payment as per I.T. rules. Copy of PAN Card and Cheque of the above bank are enclosed herewith.

You are requested to make the above payment as per the details provided above through RTGS at the earliest.

Further, it is requested to provide the Contract Performance Guarantee (CPG) in favour of Nodal Agency i.e. Central Transmission Utility of India Limited (CTUIL) as per the details provided at Annexure -A at the earliest.

With kind regards,

Yours sincerely,



(Naveen Phougat)  
General Manager

Encl: As enclosed



Annexure -A

**Contract Performance Guarantee (CPG)**

**Transmission system for evacuation of RE power from Raghnesda Area of Gujarat - 3GW  
under Phase-I**

S No.	Name of Nodal Agency	Address	Amount of CPG
1	Central Transmission Utility of India Limited	"5 <sup>th</sup> to 10 <sup>th</sup> Floor, Ircon International Tower-1, Sector-32, Gurugram-122001	Rs.57.50 Crore (Rupees Fifty Seven Crore Fifty Lakh Only)





पीएफसी कंसल्टिंग लिमिटेड  
(पावर फाइनेंस कॉर्पोरेशन लि० की पूर्णतः स्वामित्वाधीन सहायक कम्पनी)  
**PFC CONSULTING LIMITED**  
(A wholly owned Subsidiary of Power Finance Corporation Ltd.)

Ref. No.: 04/24-25/ITP-90/RFP

March 20, 2025

To,

Manish Aggarwal

E-mail: [manish.aggarwal@draipl.com](mailto:manish.aggarwal@draipl.com)

Power Division

DRA Infracon Pvt Ltd.

01, The Grand Mall, S. M. Road, Ambawadi,

Ahmedabad, Gujarat - 380015

**Subject: Independent Transmission Project "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I" - Regarding Estimated Acquisition Price.**

Dear Sir,


In line with the requirement of the RFP document specified in Clause 1.6.2.1 (5), the following may be noted with respect to the Acquisition Price:

"The estimated revised Acquisition Price payable by the selected Bidder to the PFC Consulting Limited for the acquisition of one hundred percent (100%) of the equity shareholding of "RAGHANESDA RE TRANSMISSION LIMITED", along with all its related assets and liabilities is Rs. 18,98,00,581/- (Rupees Eighteen Crore Ninety Eight Lakh Five Eighty One Rupees Only)."

This is for your information and further action, please.

Thanking you,

Yours faithfully

  
(Naveen Phouगत)  
General Manager



**ANNEXURE X : COPY OF SHARE PURCHASE AGREEMENT**



Dated 23<sup>rd</sup> July, 2025

**SHARE PURCHASE AGREEMENT**

**BETWEEN**

**PFC CONSULTING LIMITED**

**AND**

**RAGHANESDA RE TRANSMISSION LIMITED**

**AND**

**DINESHCHANDRA R. AGRAWAL INFRACON PRIVATE LIMITED**



413



सत्यमेव जयते

INDIA NON JUDICIAL

Government of National Capital Territory of Delhi

₹200

e-Stamp

Certificate No.	: IN-DL22631617265503X
Certificate Issued Date	: 22-Jul-2025 05:22 PM
Account Reference	: IMPACC (IV) d1716803/ DELHI/ DL-WSD
Unique Doc. Reference	: SUBIN-DL DL71680380175780108659X
Purchased by	: PFC CONSULTING LIMITED
Description of Document	: Article 5 General Agreement
Property Description	: Not Applicable
Consideration Price (Rs.)	: 0 (Zero)
First Party	: PFC CONSULTING LIMITED
Second Party	: Not Applicable
Stamp Duty Paid By	: PFC CONSULTING LIMITED
Stamp Duty Amount(Rs.)	: 200 (Two Hundred only)

₹200 ₹200 ₹200 ₹200

सत्यमेव जयते



₹200

Please write or type below this line

IN-DL22631617265503X

This Stamp Paper Forms Part of enclosed Share Purchase Agreement executed between PFC CONSULTING LIMITED, RAGHANESDA RE TRANSMISSION LIMITED and DINESHCHANDRA R. AGRAWAL INFRACON PRIVATE LIMITED



Statutory Alert: \*

1. The authenticity of this Stamp certificate should be verified at 'www.shcilestamp.com' or using e-Stamp Mobile App of Stock Holding. Any discrepancy in the details on this Certificate and as available on the website / Mobile App renders it invalid.
2. The onus of checking the legitimacy is on the users of the certificate.
3. In case of any discrepancy please inform the Competent Authority.

414



सत्यमेव जयते

INDIA NON JUDICIAL

Government of National Capital Territory of Delhi


₹500

e-Stamp

Certificate No.	: IN-DL22636280654871X
Certificate Issued Date	: 22-Jul-2025 05:27 PM
Account Reference	: IMPACC (IV) /dl736803/ DELHI/ DL-WSD
Unique Doc. Reference	: SUBIN-DL22636280654871X
Purchased by	: PFC CONSULTING LIMITED
Description of Document	: Article 5 General Agreement
Property Description	: Not Applicable
Consideration Price (Rs.)	: 0 (Zero)
First Party	: PFC CONSULTING LIMITED
Second Party	: Not Applicable
Stamp Duty Paid By	: PFC CONSULTING LIMITED
Stamp Duty Amount (Rs.)	: 500 (Five Hundred only)

₹500 ₹500 ₹500 ₹500

सत्यमेव जयते



₹500

Please write or type below this line

IN-DL22636280654871X

This Stamp Paper Forms Part of enclosed Share Purchase Agreement executed between **PFC CONSULTING LIMITED, RAGHANESDA RE TRANSMISSION LIMITED** and **DINESHCHANDRA R. AGRAWAL INFRACON PRIVATE LIMITED**



Statutory Alert:

1. The authenticity of this Stamp certificate should be verified at 'www.sholestamp.com' or using e-Stamp Mobile App of Stock Holding. Any discrepancy in the details on this Certificate and as available on the website / Mobile App renders it invalid.
2. The onus of checking the legitimacy is on the users of the certificate.
3. In case of any discrepancy please inform the Competent Authority.

415



सत्यमेव जयते

INDIA NON JUDICIAL

Government of National Capital Territory of Delhi

₹500

e-Stamp

Certificate No.	: IN-DL22636022871070X
Certificate Issued Date	: 22-Jul-2025 05:26 PM
Account Reference	: IMPACC (IV) / dl716803/ DELHI/ DL-WSD
Unique Doc. Reference	: SUBIN-DL71680380183394100310X
Purchased by	: PFC CONSULTING LIMITED
Description of Document	: Article 5 General Agreement
Property Description	: Not Applicable
Consideration Price (Rs.)	: 0 (Zero)
First Party	: PFC CONSULTING LIMITED
Second Party	: Not Applicable
Stamp Duty Paid By	: PFC CONSULTING LIMITED
Stamp Duty Amount(Rs.)	: 500 (Five Hundred only)

₹500₹500₹500₹500



₹500



Please write or type below this line

IN-DL22636022871070X

This Stamp Paper Forms Part of enclosed Share Purchase Agreement executed between PFC CONSULTING LIMITED, RAGHANESDA RE TRANSMISSION LIMITED and DINESHCHANDRA R. AGRAWAL INFRACON PRIVATE LIMITED



Statutory Alert:

- The authenticity of this Stamp certificate should be verified at 'www.shclstamp.com' or using e-Stamp Mobile App of Stock Holding. Any discrepancy in the details on this Certificate and as available on the website / Mobile App renders it Invalid.
- The onus of checking the legitimacy is on the users of the certificate.
- In case of any discrepancy please inform the Competent Authority.

418

**SHARE PURCHASE AGREEMENT**

This **SHARE PURCHASE AGREEMENT** ('Agreement') made on 23<sup>rd</sup> day of July, 2025 at New Delhi by and between:

**PFC CONSULTING LIMITED** (a wholly owned subsidiary of Power Finance Corporation Ltd.), a company incorporated under the Companies Act, 1956, with CIN No. U74140DL2008GOI175858, having its registered office at First Floor, "Urjanidhi", 1 Barakhamba Lane, Connaught Place, New Delhi - 110001, India (hereinafter referred to as "PFCCL", which expression shall, unless it be repugnant to the context or meaning thereof, be deemed to mean and include its successors and permitted assigns) of the **FIRST PART**;

**AND**

**RAGHANESDA RE TRANSMISSION LIMITED**, a company incorporated under the Companies Act, 2013, with CIN no. U42201DL2024GOI439548 having its registered office at First Floor, "Urjanidhi", 1 Barakhamba Lane, Connaught Place, New Delhi - 110001, India (hereinafter referred to as "Company" which expression shall, unless repugnant to the context or meaning thereof, be deemed to mean and include its successors and permitted assigns) of the **SECOND PART**;

**AND**

**DINESHCHANDRA R. AGRAWAL INFRACON PRIVATE LIMITED**, a company incorporated under the Companies Act, 1956 with CIN No. U45202GJ2003PTC043160 having its registered office 401, The Grand Mall, S. M. Road, Ambawadi, Polytechnic, Ahmedabad -380015, Gujarat, India (hereinafter referred to as "Selected Bidder" which expression shall, unless repugnant to the context or meaning thereof, be deemed to mean and include its successors and permitted assigns) of the **THIRD PART**.

**WHEREAS:**

- A. Ministry of Power (MoP) vide Gazette Notification No. **CG-DL-E-22082024-256561** dated **21.08.2024** has notified PFC Consulting Limited (Hereinafter referred to as the "PFCCL") to be the Bid Process Coordinator (BPC) for the purpose of selection of Bidder as Transmission Service Provider (TSP) to establish Inter-State transmission system for "Transmission system for evacuation of RE power from Raghnesda area of Gujarat – 3 GW under Phase-I" through tariff based competitive bidding process (hereinafter referred to as the "Project").
- B. In accordance with the Bidding Guidelines, PFCCL had initiated a Bid Process through issuance of RFP documents for selecting a Successful Bidder to build, own, operate and transfer the Project in accordance with and on the terms and conditions mentioned in the RFP Project Documents (as defined hereinafter).



- C. PFCCL has incorporated the Company and PFCCL along with the Nominees hold One hundred per cent (100 %) of total issued and paid up equity share capital of the Company.
- D. PFCCL has initiated the development of the Project and has obtained survey report, certain clearances, consents and permits as specified in the RFP regarding the Project.
- E. Pursuant to the said Bid Process, Dineshchandra R. Agrawal Infracon Private Limited (Hereinafter referred to as the "DRAIPL") has been identified as the Selected Bidder vide Letter of Intent dated 03.06.2025 issued by the PFCCL in favor of the Selected Bidder.
- F. As envisaged in the RFP, the Shares Seller (as defined hereinafter) has agreed to sell the Sale Shares (as defined hereinafter) to the Selected Bidder and the Selected Bidder has agreed to purchase the Sale Shares from the Shares Seller, subject to and on the terms and conditions set forth in this Agreement.


**NOW THEREFORE, IN CONSIDERATION OF THE MUTUAL COVENANTS AND AGREEMENTS SET FORTH IN THIS AGREEMENT AND FOR OTHER GOOD AND VALUABLE CONSIDERATION, THE PARTIES HEREBY AGREE AS FOLLOWS:**

**1. DEFINITIONS**

- 1.1 Capitalised terms in this Agreement, unless defined in this Agreement shall, in so far as the context admits, have the same meaning in this Agreement as has been ascribed to them in the Transmission Service Agreement.
- 1.2 Additionally, the following terms shall have the meaning hereinafter respectively assigned to them herein below:
- (i) "Acquisition Price" shall mean Rs. 19,13,95,265/- (Rupees Nineteen Crore Thirteen Lakh Ninety Five Thousand Two Hundred and Sixty Five only), which is the aggregate consideration payable by the Selected Bidder towards purchase of the Sale Shares at par along with assets and liabilities of the Company as on the Closing Date subject to adjustment as per the audited accounts of the Company as on the Closing Date;
- (ii) "Agreement" or "the Agreement" or "this Agreement" shall mean this Share Purchase Agreement and shall include the recitals and/or annexures attached hereto, and the contracts, certificates, disclosures and other documents to be executed and delivered pursuant hereto, if any, and any amendments made to this Agreement by Parties in writing;
- (iii) "Bid Process" shall mean the competitive bidding process initiated by the BPC, by issuance of RFP Documents for selecting a Successful Bidder to build, own, operate and transfer the Project in accordance with and on the terms and conditions mentioned in the RFP Project Documents;



- (iv) **"Board"** shall mean the board of directors of the Company;
- (v) **"Closing Date"** shall mean a mutually agreed date between the Parties falling within the period as mentioned in Clause 2.15.2 of RFP or on failure of such mutual agreement between the Parties shall be the date falling on the last date of such period;
- (vi) **"CTU"** or **"Central Transmission Utility of India Limited"** shall have same meaning as defined in the Electricity Act, 2003;
- (vii) **"Encumbrance"** shall mean any mortgage, pledge, lien, charge, security assignment, hypothecation, trust, encumbrance or any other agreement having the effect of creating security interest;
- (viii) **"Letter of Intent"** shall have the meaning ascribed thereto under the RFP;
- (ix) **"Nominees"** shall mean the Persons, who are named in Annexure A, holding the Sale Shares as nominees of PFCCL.
- (x) **"Party"** shall mean PFCCL, Company and the Selected Bidder, referred to individually, and **"Parties"** shall mean PFCCL, Company and the Selected Bidder collectively referred to, as relevant;
- (xi) **"Person"** shall include an individual, an association, a company, a corporation, a partnership, a joint venture, a trust, an unincorporated organisation, a joint stock company or other entity or organisation, including a government or political subdivision, or an agency or instrumentality thereof, and/or any other legal entity;
- (xii) **"RFP Project Documents"** shall mean the following documents, referred to collectively:
- a) Transmission Services Agreement;
  - b) this Agreement; and
  - c) Any other agreement(s) as may be required.
- (xiii) **"Representations and Warranties"** shall mean the representations and warranties mentioned in Clause 4 hereto;
- (xiv) **"Sale Shares"** shall mean 10,000 (Ten Thousand) Equity Shares, representing 100 percent of the total issued, subscribed and fully paid-up equity share capital of the Company held by the Shares Seller and Nominees as more particularly described in Annexure A attached hereto;
- (xv) **"Shares"** shall mean the fully paid-up equity shares of Company, of face value Rs. 10 each;



Provided that prior to the handing over of the Sale Share Certificates to the Selected Bidder as mentioned above, the Selected Bidder shall provide satisfactory evidence to PFCCCL that on or before the Closing Date, the Selected Bidder has furnished the Performance Bank Guarantee to Central Transmission Utility of India Limited and is in a position to comply with all other requirements of Clause 2.15.2 of the RFP.

3.3 The Selected Bidder shall immediately upon receiving the Sale Share Certificates and the Share Transfer Forms, duly execute the Share Transfer Forms and duly lodge the Share Transfer Forms and the Sale Share Certificates with the Company. The Selected Bidder may also propose the names of its nominees to be appointed on the Board of the Company and the address within the jurisdiction of the Registrar of Companies NCT of Delhi and Haryana, which would be the new registered office of the Company. The Company shall, upon receipt of the said documents from the Selected Bidder, do the following:

- (i) on the Closing Date convene a meeting of the Board, wherein the Board shall pass the following necessary resolutions:
  - (a) approving the transfer of the Shares constituting the Sale Shares from the Shares Seller and the Nominees to the name of the **Dineshchandra R. Agrawal Infracon Private Limited** and its nominees and transfer of all assets and liabilities of the Company as on Closing Date;
  - (b) approving **Dineshchandra R. Agrawal Infracon Private Limited** and its nominees as a member of the Company and entering the name of the **Dineshchandra R. Agrawal Infracon Private Limited** and its nominees in the register of members.
  - (c) changing the address of the registered office of the Company to the new address, within the jurisdiction of the Registrar of Companies NCT of Delhi and Haryana, as may be provided by the Selected Bidder.
  - (d) appointing the Directors of the Selected Bidder on the Board and accepting the resignations of the other existing Directors on the Board and the Chair of the meeting which was taken by one of the existing Directors shall be vacated and appointment of a new Chairman who shall be one of the newly appointed Director, for the rest of the meeting.

Pursuant to the acceptance of resignation of the existing Directors and appointment of new Chairman, the newly constituted Board of Directors shall hold the meeting and pass the following resolution:



- (e) terminating all the authorizations granted regarding the business and/or operations of the Company or the operations of the bank accounts of the Company, with prospective effect; and
  - (f) acknowledging and accepting the terms and conditions as contained in the executed copies of the RFP Project Documents and to abide by the provisions contained therein.
- (ii) Enter the name of the Dineshchandra R. Agrawal Infracon Private Limited and its nominees as the legal and beneficial owner of the Sale Shares, free of all Encumbrances, in the register of members of the Company;
  - (iii) Make the necessary endorsements on the Sale Share Certificates, indicating the name of the Dineshchandra R. Agrawal Infracon Private Limited and its nominees as the legal and beneficial owner of the Sale Shares evidenced there under;
  - (iv) Return the original Sale Share Certificates, duly endorsed in the name of the Dineshchandra R. Agrawal Infracon Private Limited and its nominees, to Dineshchandra R. Agrawal Infracon Private Limited and its nominees, as the case may be or its authorised representative;
  - (v) Handover all the statutory registers and records, if any, of the Company to Dineshchandra R. Agrawal Infracon Private Limited, the Selected Bidder.
  - (vi) Handover certified true copies of the Board resolution passed by the Company as per (i)(a) to (i)(f) of Clause 3.3 (i) to Central Transmission Utility of India Limited.
- 3.4 The Parties to this Agreement agree to take all measures that may be required to ensure that all the events contemplated in the Clauses 3.1 to 3.3 above on the Closing Date are completed on the same day.

Notwithstanding the provisions of Clause 3.3 hereto, all proceedings to be taken and all documents to be executed and delivered by the Parties at the Closing Date shall be deemed to have been taken and executed simultaneously and no proceedings shall be deemed to have been taken nor documents executed or delivered until all have been taken, executed and delivered.

- 3.5 The Selected Bidder hereby acknowledges and agrees that after the date of acquisition of one hundred percent (100%) of the equity shareholding of the Company, by the Selected Bidder as per Clause 3.3, (a) the authority, rights and obligations of the PFCCCL in respect of the Bid Process shall forthwith cease and any actions to be taken thereafter regarding the Bid Process will be undertaken by Central Transmission Utility of India Limited themselves or through their any authorized representative(s), (b) all rights and obligations of the PFCCCL shall be of the Selected Bidder and (c) any decisions taken by the



PFCCCL prior to the date of its acquisition by the Selected Bidder shall continue to be binding on the Selected Bidder. The Parties hereby agree that this provision shall survive the termination of this Agreement.

3.6 This agreement shall be effective from the date of its signing by the Parties and shall remain in force until all the obligations of the respective Parties under Clause 3.3 hereto are fulfilled.

#### 4. REPRESENTATIONS AND WARRANTIES

4.1 The Selected Bidder hereby represents and warrants to the Shares Seller that:

4.1.1 The Selected Bidder has full legal right, power and authority to enter into, execute and deliver this Agreement and to perform the obligations, undertakings and transactions set forth herein, and this Agreement has been duly and validly executed and delivered by the Selected Bidder and constitutes its legal, valid and binding obligations, enforceable against it in accordance with its terms;

4.1.2 The execution, delivery and performance of this Agreement by the Selected Bidder (i) will not violate or contravene any provision of the Memorandum of Association or Articles of Association of the Selected Bidder, (ii) will not violate or contravene any law, statute, rule, regulation, licensing requirement, order, writ, Injunction or decree of any court, governmental instrumentality or other regulatory, governmental or public body, agency or authority by which the Selected Bidder are bound or by which any of its and/or their properties or assets are bound, and (iii) except to the extent that the same have been duly and properly completed or obtained, will not require any filing with, or permit, consent or approval of or license from, or the giving of any notice to, any court, governmental instrumentality or other regulatory, governmental or public body, agency or authority, joint venture party, or any other entity or person whatsoever; and

4.1.3 The Selected Bidder is not restricted in any manner whatsoever, including without limitation, on account of any judicial or governmental order, action or proceeding, or any contractual obligation assumed by the Selected Bidder, from purchasing the Sale Shares from the Shares Seller in the manner provided for in this Agreement.

4.2 The Shares Seller hereby represents and warrants to the Selected Bidder that:

4.2.1 The Shares Seller and the Nominees are the legal and beneficial owners of the Sale Shares, free and clear of any Encumbrance and the delivery to the Selected Bidder of the Sale Shares pursuant to the provisions of this Agreement will transfer to the Selected Bidder a good title to the Sale Shares.



- 4.2.2 The Shares Seller has full legal right, power and authority to enter into, execute and deliver this Agreement and to perform the obligations, undertakings and transactions set forth herein. The execution, delivery and performance of this Agreement will not violate the Memorandum of Association and Articles of Association of the Shares Seller or contravene any contract by which it is bound.
- 4.2.3 The Shares Seller has obtained requisite authorizations to sell and transfer the Sale Shares to the Selected Bidder. The Shares Seller also represent that it is not prevented from transferring and selling the Sale Shares. Also, to the best of its knowledge, the Sale Shares are not the subject matter of any claim or pending proceeding or threatened by any legal proceeding made by any third party.
- 4.3 Except as specified in Clause 4.2, above the Shares Seller shall not be deemed to have, made any representation or warranty whatsoever, whether express or implied, in relation to the Sale Shares or Company, including but not limited to any implied warranty or representation as to the business or affairs of the Company.
- 4.4 The Representations and Warranties are given as at the date of this Agreement except that where a Representation and Warranty is expressed to be made as at another date, the Representation and Warranty is given with respect to that date only.
- 4.5 Each Representation and Warranty is to be construed independently of the others and is not limited by reference to any other Warranty. The Representations, Warranties and undertakings contained in this Clause 4 hereto or in any document delivered pursuant to or in connection with this Agreement are continuing in nature and shall survive the Closing Date for one (1) year.
- 4.6 The Parties represent to each other that all Representations and Warranties provided herein by the respective Party shall be true as of Closing Date.

**5. OBLIGATIONS OF THE SELECTED BIDDER**

The Selected Bidder agrees that the Shares Seller shall not be liable in any manner, nor shall it assume any responsibility or liability whatsoever, in respect of the business of the Company and its operations or activities, arising after Closing Date, to any Person or any authority, central, state, local or municipal or otherwise and the same shall be the sole responsibility of the Selected Bidder.

**6. MISCELLANEOUS**

**6.1 NOTICES**

- a) All notices to be given under this Agreement shall be in writing and in the English language.



- b) All notices must be delivered personally or by registered or speed post or by recognised courier to the addresses below:

<b>Selected Bidder (Lead Member in case of Consortium)</b>	<b>Dineshchandra R. Agrawal Infracon Private Limited</b> Address: 401, The Grand Mall, S. M. Road, Ambawadi, Polytechnic, Ahmedabad -380015, Gujarat, India
<b>Name of the Holding Company of the SPV</b>	<b>PFC Consulting Limited</b> Address: First Floor, "Urjanidhi", 1 Barakhamba Lane, Connaught Place, New Delhi- 110001, India
<b>Company (Before Closing Date)</b>	<b>Project In-charge Raghanesda RE Transmission Limited</b> Address: First Floor, "Urjanidhi", 1 Barakhamba Lane, Connaught Place, New Delhi- 110001, India
<b>Company (After Closing Date)</b>	<b>Raghanesda RE Transmission Limited</b> Address: 161, First Floor, Vardhman Crown Mall, Plot No - 02, Sector 19, Dwarka, New Delhi-110075, Delhi, India


- c) Any Party may by notice of at least fifteen (15) days to the other Parties change the address and / or addresses to which such notices and communications to it are to be delivered or mailed.

## 6.2 RESOLUTION OF DISPUTES

6.2.1 If any dispute arises between the Parties, in connection with the validity, interpretation, implementation or alleged breach of any provision of this Agreement ("Dispute"), the disputing Parties hereto shall endeavour to settle such Dispute amicably. The attempt to bring about an amicable settlement shall be considered to have failed if not resolved within 60 days from the date of the Dispute.

6.2.2 If the Parties are unable to amicably settle the Dispute in accordance with Clause 6.2.1 within the period specified therein, any of the Parties shall be entitled to within 30 days after expiry of the aforesaid period, refer the Dispute to the Company Secretary of PFCCCL and Chief Executive/ Managing Director of the Selected Bidder for resolution of the said Dispute. The attempt to bring about such resolution shall be considered to have failed if not resolved within 30 days from the date of receipt of a written notification in this regard.

6.2.3 In the event the Dispute is not settled in accordance with Clause 6.2.2 above, any Party to the Dispute shall be entitled to serve a notice invoking this Clause and



making a reference to a sole arbitrator. If the Parties to the Dispute cannot agree as to the appointment of the sole arbitrator within 30 days of receipt of the notice of the Party making the reference, then the Shares Seller along with the Company shall appoint one arbitrator and the Selected Bidder shall appoint one arbitrator and the two arbitrators, so appointed shall appoint a third arbitrator. However, after the Closing Date, in such an event the Shares Seller shall appoint one arbitrator and the Selected Bidder along with the Company shall appoint one arbitrator and the two arbitrators, so appointed shall appoint the third arbitrator.

6.2.4 The place of the arbitration shall be New Delhi. The Arbitration proceedings shall be governed by the Arbitration and Conciliation Act, 1996.

6.2.5 The proceedings of arbitration shall be in English language.

6.2.6 The arbitrator's award shall be substantiated in writing. The arbitrators shall also decide on the costs of the arbitration proceedings. In case the arbitrators have not decided on the costs of the arbitration proceedings, each Party to the Dispute shall bear its own costs, in relation to the arbitration proceedings.

### 6.3 AUTHORISED PERSON

For the purposes of this Agreement, the Selected Bidder is severally represented by Mr. Amit Kumar, Sr. Vice President – Power T&D and RE, pursuant to an authorization granted to the above mentioned authorized representatives through necessary Board resolutions. Further, the above mentioned authorized representative is also severally authorized by such resolutions to take any decision, which may be required to be taken, do all acts and execute all documents, which are or may be required by the Selected Bidder for the proper and effective fulfillment of the rights and obligations under this Agreement. Any action taken or document executed by the above mentioned authorized representatives, shall be deemed to be acts done or documents executed by the Selected Bidder and shall be binding on the Selected Bidder.

### 6.4 RESERVATION OF RIGHTS

No forbearance, indulgence or relaxation or inaction by any Party at any time to require performance of any of the provisions of this Agreement shall in any way affect, diminish or prejudice the right of such Party to require performance of that provision, and any waiver or acquiescence by any Party of any breach of any of the provisions of this Agreement shall not be construed as a waiver or acquiescence of any continuing or succeeding breach of such provisions, a waiver of any right under or arising out of this Agreement or acquiescence to or recognition of rights other than that expressly stipulated in this Agreement.



425

**6.5 CUMULATIVE RIGHTS**

All remedies of either Party under this Agreement whether provided herein or conferred by statute, civil law, common law, custom or trade usage, are cumulative and not alternative and may be enforced successively or concurrently.

**6.6 PARTIAL INVALIDITY**

If any provision of this Agreement or the application thereof to any person or circumstance shall be invalid or unenforceable to any extent, the remainder of this Agreement and the application of such provision to persons or circumstances other than those as to which it is held invalid or unenforceable shall not be affected thereby, and each provision of this Agreement shall be valid and enforceable to the fullest extent permitted by law. Any invalid or unenforceable provision of this Agreement shall be replaced with a provision, which is valid and enforceable and most nearly reflects the original intent of the unenforceable provision.

**6.7 TERMINATION**

If (i) the Closing does not occur on the Closing Date for any reason whatsoever, or (ii) the Letter of Intent is withdrawn or terminated for any reason, or (iii) due to termination of the TSA by Central Transmission Utility of India Limited in accordance with Article 3.3.2 or Article 13 of the TSA thereof, PFCCCL shall have a right to terminate this Agreement forthwith by giving a written notice to the other Parties hereto.

**6.8 AMENDMENTS**

No modification or amendment of this Agreement and no waiver of any of the terms or conditions hereof shall be valid or binding unless made in writing and duly executed by all the Parties.

**6.9 ASSIGNMENT**

This Agreement and the rights and liabilities hereunder shall bind and inure to the benefit of the respective successors of the Parties hereto, but no Party hereto shall assign or transfer its rights and liabilities hereunder to any other Person without the prior written consent of the other Parties, which will not be unreasonably withheld.

**6.10 ENTIRE AGREEMENT**

This Agreement constitutes the entire Agreement between the Parties with respect to the subject matter herein and supersedes and cancels any prior oral or written agreement, representation, understanding, arrangement, communication or expression of intent relating to the subject matter of this Agreement.



6.11 COSTS

Each of the Parties hereto shall pay their own costs and expenses relating to the negotiation, preparation and execution of this Agreement and the transactions contemplated by this Agreement.

The Selected Bidder shall be liable to bear and pay the stamp duty and other costs in respect of this Agreement and the Share Transfer Forms.

6.12 RELATIONSHIP

None of the provisions of this Agreement shall be deemed to constitute a partnership between the Parties hereto and no Party shall have any authority to bind the other Party otherwise than under this Agreement or shall be deemed to be the agent of the other in any way.

6.13 GOVERNING LAW AND JURISDICTION

This Agreement shall be governed by and construed in accordance with the laws of India and shall be subject to the exclusive jurisdiction of the courts of Delhi.

6.14 COUNTERPARTS

This Agreement may be executed in counterparts by the Parties and each fully executed counterpart shall be deemed to be original.

6.15 CONFIDENTIALITY

The Parties undertake to hold in confidence and not to disclose the terms and conditions of the transaction contemplated hereby to third parties, except:

- (a) to their professional advisors;
- (b) to their officers, employees, agents or representatives, who need to have access to such information for the proper performance of their activities;
- (c) disclosures required under Law; without the prior written consent of the other Parties.

Provided that Central Transmission Utility of India Limited and PFCCCL may at any time, disclose the terms and conditions of transactions contemplated hereby to any person, to the extent stipulated under the law or the Bidding Guidelines.

6.16 INDEMNIFICATION

- The Parties hereby agree that transfer of Sale Shares to the Selected Bidder shall vest all the rights, privileges, licenses, responsibilities, liabilities and other obligations pertaining to the Company in the Selected Bidder.



- The Selected Bidder hereby agrees that the Selected Bidder shall not be entitled to any claims or initiate any legal proceedings, by itself or through the Transmission Service Provider against the Share Sellers, its directors, officers, employees and the subscribers including the members of any committees appointed by them in respect of any actions or decisions taken by any of them up to the Closing Date in furtherance of the Project referred to in recital A of this Agreement.
- Further, the Selected Bidder hereby indemnifies and holds harmless at all times the Share Seller against all losses, damages, charges, and expenses which the Share Seller may sustain or incur towards contractual obligations with respect to the contracts awarded by the Share Seller or any other liability arising with regard to any action/activity undertaken by the Share Seller for and on behalf of the Company in furtherance of the Project referred to above or otherwise concerning the Company. All such actions shall be defended by the Selected Bidder either itself or through the TSP at its own cost.
- The Parties hereby agree that the provisions of this clause shall survive the termination of this Agreement.

6.17 SURVIVAL

- The provisions of Clause 1 (Definitions and Interpretation), Clause 4 (Representations and Warranties), Clause 6.2 (Resolution of Disputes), Clause 6.7 (Termination), Clause 6.15 (Confidentiality), Clause 6.16 (Indemnification) and other representations, warranties, covenants and provisions contained herein that by their nature are intended to survive, shall survive the termination of this Agreement

6.18 FORCE MAJEURE

- No party shall be liable for its inability or delay in performing any of its obligations hereunder if such delay is caused by circumstances beyond the reasonable control of the party including delay caused through flood, riot, Act of God, lighting civil commotion, storm, tempest and earthquake.

IN WITNESS WHEREOF, THE PARTIES HERETO HAVE CAUSED THIS AGREEMENT TO BE DULY EXECUTED AND DELIVERED AS OF THE DAY AND YEAR FIRST ABOVE WRITTEN

*Arora*  
*12/31/25*  
SIGNED AND DELIVERED  
BY THE WITHIN NAMED "PFCCCL" PFC CONSULTING LIMITED  
BY THE HAND OF SHRI SACHIN ARORA, COMPANY SECRETARY



*R. Mishra*

IN THE PRESENCE OF: *Bryanesh Mishra, EA, PFCCCL*

WITNESS:

NAME, SIGNATURE, DESIGNATION AND ADDRESS:

*R. P. R.*

SIGNED AND DELIVERED

BY THE WITHIN NAMED "RAGHANESDA RE TRANSMISSION LIMITED"

BY THE HAND OF SHRI RAKESH MOHAN, DIRECTOR



PURSUANT TO THE RESOLUTION PASSED BY THE BOARD OF DIRECTORS ON 03<sup>RD</sup> JUNE, 2025

IN THE PRESENCE OF: *[Signature]* *Naveen Pharyat*  
WITNESS: *GM-PFCCCL*

NAME, SIGNATURE, DESIGNATION AND ADDRESS:

*[Signature]*

SIGNED AND DELIVERED

BY THE WITHIN NAMED "DINESHCHANDRA R. AGRAWAL INFRACON PRIVATE LIMITED"

BY THE HAND OF MR. AMIT KUMAR, THE SR. VICE PRESIDENT – POWER T&D AND RE

PURSUANT TO THE RESOLUTION PASSED BY THE BOARD OF DIRECTORS ON 04<sup>TH</sup> DAY OF JULY, 2025

IN THE PRESENCE OF:

WITNESS:

NAME, SIGNATURE, DESIGNATION AND ADDRESS: *VARUN SHARMA*  
*Asst. Manager*  
*DRATPL*



**ANNEXURE A****DESCRIPTION OF THE SALE SHARES**

SR. NO.	NAME OF THE SHAREHOLDERS	NUMBER OF EQUITY SHARES HELD	PERCENTAGE OF THE TOTAL PAID UP EQUITY CAPITAL
1.	PFC Consulting Limited	9400	94 %
2.	Shri Rakesh Mohan*	100	1 %
3.	Shri Neeraj Singh*	100	1 %
4.	Shri Sanjay Kumar Nayak*	100	1 %
5.	Shri Sachin Shukla*	100	1 %
6.	Shri Naveen Kumar*	100	1 %
7.	Shri Rishab Jain*	100	1 %
	<b>Total</b>	<b>10,000</b>	<b>100%</b>

Note:\* Nominee of PFC Consulting Limited.



**ANNEXURE XI : COPY OF TRANSMISSION SERVICE AGREEMENT**



**TRANSMISSION SERVICE AGREEMENT**

**FOR**

**DEVELOPMENT AND OPERATION OF INTER-STATE  
TRANSMISSION SYSTEM**

**FOR TRANSMISSION OF ELECTRICITY THROUGH TARIFF BASED  
COMPETITIVE BIDDING FOR**

**TRANSMISSION SYSTEM FOR EVACUATION OF 3GW RE POWER  
FROM RAGHANESDA AREA OF GUJARAT-3GW UNDER PHASE-I**

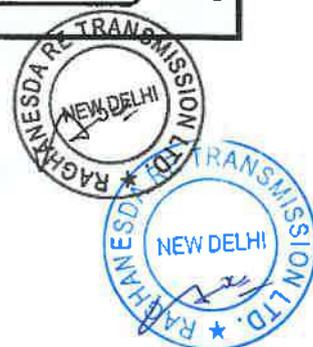
**BETWEEN**

**CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED  
(NODAL AGENCY)**

**AND**

**RAGHANESDA RE TRANSMISSION LIMITED**

**2025**



432

Transmission Service Agreement

CONTENTS

1 Definitions and Interpretations ..... 5

2 Effectiveness and Term of Agreement .....17

3 Conditions Subsequent .....19

4 Development of the Project ..... 23

5 Construction of the Project..... 27

6 Connection and commissioning of the Project.....31

7 Operation and Maintenance of the Project.....35

8 Availability of the project.....36

9 Insurances .....37

10 Billing And Payment of Transmission Charges.....38

11 Force Majeure .....39

12 Change in Law .....43

13 Events of Default and Termination.....45

14 Liability and Indemnification .....50

15 Assignments and Charges .....55

16 Governing Law and Dispute Resolution.....57

17 Representation and Warranties .....58

18 Independent Engineer .....60

19 Miscellaneous Provisions.....62



Central Transmission Utility of India Limited

2



Raichanesda RE Transmission Limited



423

Bond




**Indian-Non Judicial Stamp  
Haryana Government**



Date :21/07/2025

Certificate No. G0U2025G1376

GRN No. 137134655



Stamp Duty Paid : ₹ 101

(Rs. Only)

Penalty : ₹ 0

(Rs. Zero Only)

**Deponent**

Name: Central Transmission utility of India ltd

H.No/Floor : 2

Sector/Ward : 29

Landmark : Na

City/Village : Gurugram

District : Gurugram

State : Haryana

Phone : 98\*\*\*\*\*10



Purpose : ARTICLE 5 GENERAL AGREEMENT to be submitted at Concerned office

**THIS TRANSMISISON SERVICE AGREEMENT** (hereinafter referred to as "TSA" or "Agreement" or "the Agreement" or "this Agreement") is made on the ..... [insert day] of..... [insert month] of Two Thousand and Twenty Five.

**BETWEEN:**

The **CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED**, a company incorporated under the Companies Act, 2013, having its registered office at Plot No.2, Sector 29, Gurugram, Haryana 122001, India & Correspondence address at Floor No. 5-10, Tower 1, Plot No. 16, IRCON International Tower, Institutional Area, Sector 32, Gurugram, Haryana – 122001, India (hereinafter referred to as "Nodal Agency/CTU" which expression shall unless repugnant to the context or meaning thereof include its successors and assigns) as party of the one part;

**AND**

**RAGHANESDA RE TRANSMISSION LIMITED** incorporated under the Companies Act, 1956/ Companies Act, 2013 (as the case may be), having its registered office at 1st Floor, Urjanidhi, 1, Barakhamba Lane, Connaught Place, New Delhi-110001 (herein after referred to as "Transmission Service Provider" or "TSP" or "ISTS Licensee", which expression shall unless repugnant to the context or meaning thereof include its successors, and permitted assigns) as Party of the other part;

("Nodal Agency" and "TSP" are individually referred to as "Party" and collectively as the "Parties")



Central Transmission Utility of India Limited

3

Raghanesda RE Transmission Limited



424


Transmission Service Agreement

**AND WHEREAS:**

- A) In accordance with the Bidding Guidelines, the Bid Process Coordinator (hereinafter referred to as BPC) had initiated a competitive e-reverse bidding process through issue of RFP for selecting a Successful Bidder to build, own, operate and transfer the Project comprising of the Elements mentioned in Schedule 1 (hereinafter referred to as the Project)
- B) Pursuant to the said e-reverse bidding process, the BPC has identified the Successful Bidder, who will be responsible to set up the Project on build, own, operate and transfer basis to provide Transmission Service in accordance with the terms of this Agreement and the Transmission License.
- C) The Selected Bidder have submitted the Contract Performance Guarantee and acquired one hundred percent (100%) of the equity shareholding of RAGHANESDARE TRANSMISSION LIMITED, along with all its related assets and liabilities in terms of the provisions of the Share Purchase Agreement.
- D) The TSP has agreed to make an application for a Transmission License to the Commission for setting up the Project on build, own, operate and transfer basis.
- E) The TSP has further agreed to make an application to the Commission for the adoption of the Transmission Charges under Section 63 of the Electricity Act, 2003, along with a certification from the Bid Evaluation Committee in accordance with the Bidding Guidelines issued by Ministry of Power, Government of India.
- F) The TSP has agreed to execute the agreement(s) required, if any, under Sharing Regulations within fifteen (15) days from the date of grant of Transmission License from the Commission.
- G) The TSP agrees to the terms and conditions laid down under Sharing Regulations, for making available the ISTS and charge the Transmission Charges in accordance with the terms and conditions of Sharing Regulations.
- H) The billing, collection and disbursement of the Transmission Charges by the CTU to the ISTS Licensee shall be governed as per Sharing Regulations.
- I) The terms and conditions stipulated in the Transmission License issued by the Commission to the TSP shall be applicable to this Agreement and the TSP agrees to comply with these terms and conditions. In case of inconsistency between the Transmission License terms & conditions and the conditions of this Agreement, the conditions stipulated in the Transmission License granted by the Commission shall prevail.

NOW, THEREFORE, IN CONSIDERATION OF THE PREMISES AND MUTUAL AGREEMENTS, COVENANTS AND CONDITIONS SET FORTH HEREIN, IT IS HEREBY AGREED BY AND BETWEEN THE PARTIES HERETO AS FOLLOWS:



  
Central Transmission Utility of India Limited

4

  
Raghnesdare Transmission Limited



435

ARTICLE: 1

1. DEFINITIONS AND INTERPRETATIONS

1.1 Definitions:

1.1.1 The words / expressions used in this Agreement, unless as defined below or repugnant to the context, shall have the same meaning as assigned to them by the Electricity Act, 2003 and the rules or regulations framed there under including those issued / framed by the Commission (as defined hereunder), as amended or re-enacted from time to time or the General Clauses Act, falling which it shall bear its ordinary English meaning.

The words/expressions when used in this Agreement shall have the respective meanings as specified below:

“Acquisition Price” shall have the same meaning as defined in the Share Purchase Agreement;

“Act” or “Electricity Act” or “Electricity Act 2003” shall mean the Electricity Act, 2003 and any amendments made to the same or any succeeding enactment thereof;

“Affiliate” shall mean a company that either directly or indirectly

- i. controls or
- ii. is controlled by or
- iii. is under common control with

a Bidding Company (in the case of a single company) or a Member (in the case of a Consortium) and “control” means ownership by one entity of at least twenty six percent (26%) of the voting rights of the other entity;

“Availability” in relation to the Project or in relation to any Element of the Project, for a given period shall mean the time in hours during that period the Project is capable to transmit electricity at its Rated Voltage and shall be expressed in percentage of total hours in the given period and shall be calculated as per the procedure contained in Appendix -IV to Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2024, attached herewith in Schedule 6;

“Bid” shall mean technical bid and financial bid submitted by the Bidder, in response to the RFP, in accordance with the terms and conditions of the RFP;



*[Handwritten signature]*

Central Transmission Utility of India Limited



Raghu... Transmission Limited



**Transmission Service Agreement**

**"Bid Deadline"** shall mean the last date and time for submission of the Bid in response to RFP, as specified in the RFP;

**"Bidding Company"** shall refer to such single company that has made a Response to RFP for the Project;

**"Bidding Consortium / Consortium"** shall refer to a group of companies that has collectively made a Response to RFP for the Project;

**"Bid Documents" or "Bidding Documents"** shall mean the RFP, along with all attachments thereto or clarifications thereof;

**"Bidding Guidelines"** shall mean the "Tariff Based Competitive Bidding Guidelines for Transmission Service" and "Guidelines for Encouraging Competition in Development of Transmission Projects" issued by Government of India, Ministry of Power under Section – 63 of the Electricity Act as amended from time to time;

**"Bid Process Coordinator" or "BPC"** shall mean a person or its authorized representative as notified by the Government of India, responsible for carrying out the process for selection of Bidder who will acquire Transmission Service Provider;

**"Bill"** shall mean any bill raised by the CTU on the DICs to recover the Transmission Charges pursuant to the Sharing Regulations;

**"Business Day"** shall mean a day other than Sunday or a statutory holiday, on which the banks remain open for business in the State in which the Nodal Agency's registered office is located and the concerned TSP are located;

**"CEA"** shall mean the Central Electricity Authority constituted under Section -70 of the Electricity Act;

**"Change in law"** shall have the meaning ascribed thereto in Article 12;

**"Commercial Operation Date" or "COD"** shall mean the date as per Article 6.2;

**"Commission" or "CERC"** shall mean the Central Electricity Regulatory Commission referred to in sub-section (1) of Section 76 of the Electricity Act, 2003 or its successors and assigns;

**"Competent Court of Law"** shall mean the Supreme Court or any High Court, or any tribunal or any similar judicial or quasi-judicial body in India that has jurisdiction to adjudicate upon issues relating to the Project;



Central Transmission Utility of India Limited

6

Raghansda RFP Transmission Limited



437

Transmission Service Agreement

**"Connection Agreement"** shall mean the agreement between the CTU or STU or any other concerned parties and the TSP, setting out the terms relating to the connection of the Project to the Inter-connection Facilities and use of the Inter State Transmission System as per the provisions of the IEGC, as the case may be;

**"Consultation Period"** shall mean the period of sixty (60) days or such longer period as the Parties may agree, commencing from the date of issue of a TSP's Preliminary Notice or a Nodal Agency's Preliminary Termination Notice, as provided in Article 13 of this Agreement, for consultation between the Parties to mitigate the consequence of the relevant event having regard to all the circumstances;

**"Consents, Clearances and Permits"** shall mean all authorizations, licenses, approvals, registrations, permits, waivers, privileges, acknowledgements, agreements, or concessions required to be obtained from or provided by any concerned authority for the development, execution and operation of Project including without any limitation for the construction, ownership, operation and maintenance of the Transmission Lines and/or sub-stations;


**"Construction Period"** shall mean the period from (and including) the Effective Date of the Transmission Service Agreement up to (but not including) the COD of the Element of the Project in relation to an Element and up to (but not including) the COD of the Project in relation to the Project;

**"Contractors"** shall mean the engineering, procurement, construction, operation & maintenance contractors, surveyors, advisors, consultants, designers, suppliers to the TSP and each of their respective sub-contractors (and each of their respective successors and permitted assigns) in their respective capacities as such;

**"Contract Performance Guarantee"** shall mean the irrevocable unconditional bank guarantee, submitted and to be submitted by the TSP or by the Selected Bidder on behalf of the TSP to the Nodal Agency from a bank mentioned in Annexure 17 of the RFP, in the form attached here to as Schedule 8, in accordance with Article 3 of this Agreement and which shall include the additional bank guarantee furnished by the TSP under this Agreement;

**"Contract Year"**, for the purpose of payment of Transmission Charges, shall mean the period beginning on the COD, and ending on the immediately succeeding March 31 and thereafter each period of 12 months beginning on April 1 and ending on March 31 provided that the last Contract Year shall end on the last day of the term of the TSA;



  
Central Transmission Utility of India Limited

7



Raghavendra RE Transmission Limited



428

Transmission Service Agreement

**"CTU"** or **"Central Transmission Utility"** shall have same meaning as defined in the Electricity Act, 2003;

**"Day"** shall mean a day starting at 0000 hours and ending at 2400 hours;

**"D/C"** shall mean Double Circuit;

**"Designated ISTS Customers"** or **"DICs"** shall have the meaning as described in the Sharing Regulations;

**"Dispute"** shall mean any dispute or difference of any kind between the Parties, in connection with or arising out of this Agreement including any issue on the interpretation and scope of the terms of this Agreement as provided in Article 16;

**"Effective Date"** for the purposes of this Agreement, shall have the same meaning as per Article 2.1 of this Agreement;

**"Electrical Inspector"** shall mean a person appointed as such by the Government under sub-section (1) of Section 162 of the Electricity Act 2003 and also includes Chief Electrical Inspector;

**"Electricity Rules 2005"** shall mean the rules framed pursuant to the Electricity Act 2003 and as amended from time to time;

**"Element"** shall mean each Transmission Line or each circuit of the Transmission Lines (where there are more than one circuit) or each bay of Sub-station or switching station or HVDC terminal or inverter station of the Project, including ICTs, Reactors, SVC, FSC, etc. forming part of the ISTS, which will be owned, operated and maintained by the concerned ISTS Licensee, and which has a separate Scheduled COD as per Schedule 2 of this Agreement and has a separate percentage for recovery of Transmission Charges on achieving COD as per Schedule 5 of this Agreement;

**"Event of Default"** shall mean the events as defined in Article 13 of this Agreement;

**"Expiry Date"** shall be the date which is thirty five (35) years from the COD of the Project;

**"Financial Closure"** shall mean the first Business Day on which funds are made available to the TSP pursuant to the Financing Agreements;



Central Transmission Utility of India Limited

&



Raghnesda RE Transmission Limited



**Transmission Service Agreement**

**"Financially Evaluated Entity"** shall mean the company which has been evaluated for the satisfaction of the financial requirement set forth in the RFP;

**"Financing Agreements"** shall mean the agreements pursuant to which the TSP is to finance the Project including the loan agreements, security documents, notes, indentures, security agreements, letters of credit and other documents, as may be amended, modified, or replaced from time to time, but without in anyway increasing the liabilities of the Designated ISTS Customers / Nodal Agency;

**"Financial Year"** shall mean a period of twelve months at midnight Indian Standard Time (IST) between 1st April & 31st March;

**"Force Majeure"** and **"Force Majeure Event"** shall have the meaning assigned thereto in Article 11;

**"GOI"** shall mean Government of India;

**"Grid Code" / "IEGC"** shall mean the Grid Code specified by the Central Commission under Clause (h) of sub-section (1) of Section 79 of the Electricity Act;

**"Independent Engineer"** shall mean an agency/ company, appointed by Nodal Agency in accordance with the Guidelines for Encouraging Competition in Development of Transmission Projects.

**"Indian Governmental Instrumentality"** shall mean Government of India, Government of any State in India or any ministry, department, board, authority, agency, corporation, commission under the direct or indirect control of Government of India or any State Government or both, any political sub-division of any of them including any court or Commission or tribunal or judicial or quasi-judicial body in India but excluding the CTU, TSP and the Designated ISTS Customers;

**"Insurances"** shall mean the insurance cover to be obtained and maintained by the TSP in accordance with Article 9 of this Agreement;

**"Interconnection Facilities"** shall mean the facilities as may be set up for transmission of electricity through the use of the Project, on either one or both side of generating station's / CTU's / STU's / ISTS Licensee's / Designated ISTS Customer's substations (as the case may be) which shall include, without limitation, all other transmission lines, gantries, sub-stations and associated equipment's not forming part of the Project;



Central Transmission Utility of India Limited

*Signature*

9



Raghavendra R. Transmission Limited



440

**Transmission Service Agreement**

**"ISTS Licensee"** shall be the TSP under this Agreement, consequent to having been awarded a Transmission License by the CERC and shall be referred to as the TSP or the ISTS Licensee, as the context may require in this Agreement;

**"Law" or "Laws"** in relation to this Agreement, shall mean all laws including electricity laws in force in India and any statute, ordinance, rule, regulation, notification, order or code, or any interpretation of any of them by an Indian Governmental Instrumentality having force of law and shall include all rules, regulations, decisions and orders of the Commission;

**"Lead Member of the Bidding Consortium" or "Lead Member"** shall mean a company who commits at least 26% equity stake in the Project, meets the technical requirement as specified in the RFP and so designated by other Member(s) in Bidding Consortium;

**"Lenders"** means the banks, financial institutions, multilateral funding agencies, non banking financial companies registered with the Reserve Bank of India (RBI), insurance companies registered with the Insurance Regulatory & Development Authority (IRDA), pension funds regulated by the Pension Fund Regulatory & Development Authority (PFRDA), mutual funds registered with Securities & Exchange Board of India (SEBI), etc., including their successors and assigns, who have agreed on or before COD of the Project to provide the TSP with the debt financing described in the capital structure schedule, and any successor banks or financial institutions to whom their interests under the Financing Agreements may be transferred or assigned;

Provided that, such assignment or transfer shall not relieve the TSP of its obligations to the Nodal Agency under this Agreement in any manner and shall also does not lead to an increase in the liability of the Nodal Agency;

**"Lenders Representative"** shall mean the person notified by the Lender(s) in writing as being the representative of the Lender(s) or the Security Trustee and such person may from time to time be replaced by the Lender(s) pursuant to the Financing Agreements by written notice to the TSP;

**"Letter of Intent" or "LOI"** shall have the same meaning as in the RFP;

**"Member in a Bidding Consortium / Member"** shall mean each company in the Bidding Consortium;

**"Month"** shall mean a period of thirty (30) days from (and excluding) the date of the event;



Central Transmission Utility of India Limited

10

Raghnesda RE Transmission Limited



441

**Transmission Service Agreement**

**"Monthly Transmission Charges"** for any Element of the Project, after COD of the Element till COD of the Project, and for the Project after COD of the Project, shall mean the amount of Transmission Charges as specified in Schedule 5 of this Agreement multiplied by no. of days in the relevant month and divided by no. of days in the year;

**"National Load Despatch Centre"** shall mean the centre established as per sub-section (1) of Section 26 of the Electricity Act 2003;

**"Nodal Agency"** shall mean CTU, which shall execute and implement the Transmission Service Agreement (TSA);

Provided that while taking major decisions, CTU shall consult CEA on technical matters and any other matter it feels necessary.

**"Notification"** shall mean any notification, issued in the Gazette of India;

**"Operating Period"** for any Element of the Project shall mean the period from (and including) the COD of such Element of the Project, up to (and including) the Expiry Date and for the Project, shall mean the period from (and including) the COD of the Project, up to (and including) the Expiry Date;

**"Parent Company"** shall mean an entity that holds at least twenty six percent (26%) of the paid - up equity capital directly or indirectly in the Bidding Company or in the Member in a Bidding Consortium, as the case may be;

**"Preliminary Termination Notice"** shall mean a Nodal Agency's Preliminary Termination Notice as defined in Article 13 of this Agreement;

**"Project"** shall mean "Transmission system for evacuation of 3GW RE power from Raghnesda Area of Gujarat-3GW under Phase-I", as detailed in Schedule 1 of this Agreement;

**"Project Assets"** shall mean all physical and other assets relating to and forming part of the Project including:

- (a) rights over the Site for substations, ROW for transmission lines;
- (b) tangible & intangible assets such as civil works and equipment including foundations, embankments, pavements, electrical systems, communication systems, relief centres, administrative offices, Sub-stations, software, tower and sub-stations designs etc;



*[Handwritten signature]*

Central Transmission Utility of India Limited

11



Raghnesda RE Transmission Limited



442

**Transmission Service Agreement**

- (c) project facilities situated on the Site;
- (d) all rights of the TSP under the project agreements;
- (e) financial assets, such as receivables, security deposits etc;
- (f) insurance proceeds; and
- (g) Applicable Permits and authorisations relating to or in respect of the Transmission System;"

**"Project Execution Plan"** shall mean the plan referred to in Article 3.1.3(c) hereof;

**"Prudent Utility Practices"** shall mean the practices, methods and standards that are generally accepted internationally from time to time by electric transmission utilities for the purpose of ensuring the safe, efficient and economic design, construction, commissioning, operation, repair and maintenance of the Project and which practices, methods and standards shall be adjusted as necessary, to take account of:

- (i) operation, repair and maintenance guidelines given by the manufacturers to be incorporated in the Project,
- (ii) the requirements of Law, and
- (iii) the physical conditions at the Site;
- (iv) the safety of operating personnel and human beings;


**"Rated Voltage"** shall mean voltage at which the Transmission System is designed to operate or such lower voltage at which the line is charged, for the time being, in consultation with the Central Transmission Utility;

**"Rebate"** shall have the meaning as ascribed to in Article 10.3 of this Agreement;

**"RFP"** shall mean Request For Proposal dated September 14, 2024 along with all schedules, annexures and RFP Project Documents attached thereto, issued by the BPC for tariff based competitive bidding process for selection of Bidder as TSP to execute the Project, including any modifications, amendments or alterations thereto;

**"RFP Project Documents"** shall mean the following documents to be entered into in respect of the Project, by the Parties to the respective agreements:



  
Central Transmission Utility of India Limited

12

Raghnesda Transmission Limited



448

**Transmission Service Agreement**

- a. Transmission Service Agreement,
- b. Share Purchase Agreement,
- c. Agreement(s) required under Sharing Regulations and
- d. Any other agreement as may be required;

**"RLDC"** shall mean the relevant Regional Load Dispatch Centre as defined in the Electricity Act, 2003, in the region(s) in which the Project is located;

**"RPC"** shall mean the relevant Regional Power Committee established by the Government of India for the specific Region(s) in accordance with the Electricity Act, 2003 for facilitating integrated operation of the Power System in that Region;

**"Scheduled COD"** in relation to an Element(s) shall mean the date(s) as mentioned in Schedule 2 as against such Element(s) and in relation to the Project, shall mean the date as mentioned in Schedule 2 as against such Project, subject to the provisions of Article 4.4 of this Agreement, or such date as may be mutually agreed among the Parties;

**"Scheduled Outage"** shall mean the final outage plan as approved by the RPC as per the provisions of the Grid Code;

**"Selected Bid"** shall mean the technical Bid and the Final Offer of the Selected Bidder submitted during e-reverse bidding, which shall be downloaded and attached in Schedule 7 on or prior to the Effective Date;

**"Share Purchase Agreement"** shall mean the agreement amongst PFC Consulting Limited (PFCL), RAGHANESDA RE TRANSMISSION LIMITED and the Successful Bidder for the purchase of one hundred (100%) per cent of the shareholding of the RAGHANESDA RE TRANSMISSION LIMITED for the Acquisition Price, by the Successful Bidder on the terms and conditions as contained therein;

**"Sharing Regulations"** shall mean the Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations, 2020 and as amended from time to time;

**"Site"** in relation to a substation, switching station or HVDC terminal or inverter station, shall mean the land and other places upon which such station / terminal is to be established;



*[Signature]*  
Central Transmission Utility of India Limited

13



Raghanesda RE Transmission Limited



444

Transmission Service Agreement

**"SLDC"** shall mean the State Load Despatch Centre established as per sub-section (1) of Section 31 of the Electricity Act 2003;

**"STU"** or **"State Transmission Utility"** shall be the Board or the Government Company, specified as such by the State Government under sub-section (1) of Section 39 of the Electricity Act 2003;

**"Successful Bidder"** or **"Selected Bidder"** shall mean the Bidder selected pursuant to the RFP and who has to acquire one hundred percent (100%) equity shares of RAGHANESDA RE TRANSMISSION LIMITED, along with all its related assets and liabilities, which will be responsible as the TSP to establish the Project on build, own, operate and transfer basis as per the terms of the TSA and other RFP Project Documents;

**"TSP's Preliminary Notice"** shall mean a notice issued by the TSP in pursuant to the provisions of Article 13.3 of this Agreement;

**"Target Availability"** shall have the meaning as ascribed hereto in Article 8.2 of this Agreement;

**"Technically Evaluated Entity"** shall mean the company which has been evaluated for the satisfaction of the technical requirement set forth in RFP;

**"Termination Notice"** shall mean a Nodal Agency's Termination Notice given by the Nodal Agency to the TSP pursuant to the provisions of Articles 3.3.2, 3.3.4, 4.4.2, 5.8, 13.2 and 13.3 of this Agreement for the termination of this Agreement;

**"Term of Agreement"** for the purposes of this Agreement shall have the meaning ascribed thereto in Article 2.2 of this Agreement;

**"Transmission Charges"** shall mean the Final Offer of the Selected Bidder during the e-reverse bidding and adopted by the Commission, payable to the TSP as per Sharing Regulations;

**"Transmission License"** shall mean the license granted by the Commission in terms of the relevant regulations for grant of such license issued under the Electricity Act;

**"Transmission Service"** shall mean making the Project available as per the terms and conditions of this Agreement and Sharing Regulations;



Central Transmission Utility of India Limited

14



Raghnesda RE Transmission Limited



445

Transmission Service Agreement

**"Unscheduled Outage"** shall mean an interruption resulting in reduction of the Availability of the Element(s) / Project (as the case may be) that is not a result of a Scheduled Outage or a Force Majeure Event.

**"Ultimate Parent Company"** shall mean an entity which owns at least twenty six percent (26%) equity in the Bidding Company or Member of a Consortium, (as the case may be) and in the Technically Evaluated Entity and / or Financially Evaluated Entity (as the case may be) and such Bidding Company or Member of a Consortium, (as the case may be) and the Technically Evaluated Entity and / or Financially Evaluated Entity (as the case may be) shall be under the direct control or indirectly under the common control of such entity;

**1.2 Interpretation:**

*Save where the contrary is indicated, any reference in this Agreement to:*

**"Agreement"** shall be construed as including a reference to its Schedules, Appendices and Annexures;

**"Rupee", "Rupees" and "Rs."** shall denote lawful currency of India;

**"Crore"** shall mean a reference to ten million (1,00,00,000) and a **"lakh"** shall mean a reference to one tenth of a million (1,00,000);

**"encumbrance"** shall be construed as a reference to a mortgage, charge, pledge, lien or other encumbrance securing any obligation of any person or any other type of preferential arrangement (including, without limitation, title transfer and retention arrangements) having a similar effect;

**"holding company"** of a company or corporation shall be construed as a reference to any company or corporation of which the other company or corporation is a subsidiary;

**"indebtedness"** shall be construed so as to include any obligation (whether incurred as principal or surety) for the payment or repayment of money, whether present or future, actual or contingent;

**"person"** shall have the meaning as defined in Section 2 (49) of the Act;

**"subsidiary"** of a company or corporation (the holding company) shall be construed as a reference to any company or corporation:

- (i) which is controlled, directly or indirectly, by the holding company, or
- (ii) more than half of the issued share capital of which is beneficially owned, directly or indirectly, by the holding company.



Central Transmission Utility of India Limited

15



Raghavendra Transmission Limited



496

Transmission Service Agreement

(iii) which is a subsidiary of another subsidiary of the holding company,

for these purposes, a company or corporation shall be treated as being controlled by another if that other company or corporation is able to direct its affairs and/or to control the composition of its board of directors or equivalent body;

"winding-up", "dissolution", "insolvency", or "reorganization" in the context of a company or corporation shall have the same meaning as defined in the Companies Act, 1956/ Companies Act, 2013 (as the case may be).

- 1.2.1 Words importing the singular shall include the plural and vice versa.
- 1.2.2 This Agreement itself or any other agreement or document shall be construed as a reference to this or to such other agreement or document as it may have been, or may from time to time be, amended, varied, novated, replaced or supplemented.
- 1.2.3 A Law shall be construed as a reference to such Law including its amendments or re-enactments from time to time.
- 1.2.4 A time of day shall, save as otherwise provided in any agreement or document be construed as a reference to Indian Standard Time.
- 1.2.5 Different parts of this Agreement are to be taken as mutually explanatory and supplementary to each other and if there is any inconsistency between or among the parts of this Agreement, they shall be interpreted in a harmonious manner so as to give effect to each part.
- 1.2.6 The tables of contents and any headings or sub-headings in this Agreement have been inserted for ease of reference only and shall not affect the interpretation of this Agreement.
- 1.2.7 All interest payable under this Agreement shall accrue from day to day and be calculated on the basis of a year of three hundred and sixty five (365) days.
- 1.2.8 The words "hereof" or "herein", if and when used in this Agreement shall mean a reference to this Agreement.
- 1.2.9 The contents of Schedule 7 shall be referred to for ascertaining accuracy and correctness of the representations made by the Selected Bidder in Article 17.2.1 hereof.



Central Transmission Utility of India Limited

16

Raghnesda RE Transmission Limited



447

**Transmission Service Agreement**

**ARTICLE: 2**

**2. EFFECTIVENESS AND TERM OF AGREEMENT**

**2.1 Effective Date:**

This Agreement shall be effective from later of the dates of the following events:

- a. The Selected Bidder, on behalf of the TSP, has provided the Contract Performance Guarantee, as per terms of Article 3.1 of this Agreement; and
- b. The Selected Bidder has acquired for the Acquisition Price, one hundred percent (100%) of the equity shareholding of PFC Consulting Limited in RAGHANESDA RE TRANSMISSION LIMITED along with all its related assets and liabilities as per the provisions of the Share Purchase Agreement. and
- c. The Agreement is executed and delivered by the Parties;

**2.2 Term and Termination:**

2.2.1 Subject to Article 2.2.3 and Article 2.4, this Agreement shall continue to be effective in relation to the Project until the Expiry Date, when it shall automatically terminate.

2.2.2 Post the Expiry Date of this Agreement, the TSP shall ensure transfer of Project Assets to CTU or its successors or an agency as decided by the Central Government at zero cost and free from any encumbrance and liability. The transfer shall be completed within 90 days of expiry of this Agreement failing which CTU shall be entitled to take over the Project Assets Suo moto.

2.2.3 This Agreement shall terminate before the Expiry Date in accordance with Article 13 or Article 3.3.2 or Article 3.3.4.

**2.3 Conditions prior to the expiry of the Transmission License**

In order to continue the Project beyond the expiry of the Transmission License, the TSP shall be obligated to make an application to the Commission at least two (2) years before the date of expiry of the Transmission License, seeking the Commission's approval for the extension of the term of the Transmission License up to the Expiry Date.

2.3.1 The TSP shall timely comply with all the requirements that may be laid down by the Commission for extension of the term of the Transmission License beyond the initial term of twenty-five (25) years & upto the Expiry Date and the TSP shall keep the Nodal Agency fully informed about the progress on its application for extension of the term of the Transmission License.



Central Transmission Utility of India Limited

17



Raghnesda Re Transmission Limited



448

**Transmission Service Agreement**

**2.4 Survival:**

The expiry or termination of this Agreement shall not affect any accrued rights, obligations/ roles and liabilities of the Parties under this Agreement, including the right to receive liquidated damages as per the terms of this Agreement, nor shall it effect the survival of any continuing obligations/ roles for which this Agreement provides, either expressly or by necessary implication, which are to survive after the Expiry Date or termination including those under Articles 3.3.3, 3.3.5, Article 9.3 (Application of Insurance Proceeds), Article 11 (Force Majeure), Article 13 (Events of Default and Termination), Article 14 (Liability & Indemnification), Article 16 (Governing Law & Dispute Resolution), Article 19 (Miscellaneous).

**2.5 Applicability of the provisions of this Agreement**

2.5.1 For the purpose of Availability, Target Availability and the computation of Availability, Incentive, Penalty, the provisions provided in this Agreement shall apply and any future modifications in the relevant Rules and Regulations shall not be applicable for this Project.

2.5.2 For the purposes of this Agreement for ISTS systems developed under the tariff based competitive bidding framework, the provisions relating to the definitions (Availability and COD), Article 3 (Contract Performance Guarantee and Conditions Subsequent), Article 5 (Construction of the Project), Article 6 (Connection and Commissioning of the Project), Article 8 (Target Availability and calculation of Availability), Article 11 (Force Majeure), Article 12 (Change in Law), Article 13 (Event of Default), Article 14 (Indemnification), Article 15 (Assignment and Charges), Articles 16.1, 16.2 and 16.4 (Governing Laws and Dispute Resolution) and Article 17 (representation and warranties of the ISTS Licensee) of this agreement shall supersede the corresponding provisions under Sharing Regulations.



Central Transmission Utility of India Limited

18



Raghnesda RE Transmission Limited

449

**ARTICLE: 3**

**3. CONDITIONS SUBSEQUENT**

**3.1 Satisfaction of conditions subsequent by the TSP**

**3.1.1** Within ten (10) days from the date of issue of Letter of Intent, the Selected Bidder, shall:

- a. Provide the Contract Performance Guarantee, and
- b. Acquire, for the Acquisition Price, one hundred percent (100%) equity shareholding of RAGHANESDA RE TRANSMISSION LIMITED from PFC Consulting Limited, who shall sell to the Selected Bidder, the equity shareholding of RAGHANESDA RE TRANSMISSION LIMITED, along with all its related assets and liabilities.
- c. Execute this Agreement;

The TSP shall, within five (5) working days from the date of acquisition of SPV by the Selected Bidder, undertake to apply to the Commission for the grant of Transmission License and for the adoption of tariff as required under section-63 of the Electricity Act.

The Selected Bidder, on behalf of the TSP, will provide to the Central Transmission Utility of India Limited (being the Nodal Agency) the Contract Performance Guarantee for an amount of Rs.57.50 Crore (Rupees Fifty Seven Crore Fifty Lakh Only).

**3.1.2** The Contract Performance Guarantee shall be initially valid for a period up to three (3) months after the Scheduled COD of the Project and shall be extended from time to time to be valid for a period up to three (3) months after the COD of the Project. In case the validity of the Contract Performance Guarantee is expiring before the validity specified in this Article, the TSP shall, at least thirty (30) days before the expiry of the Contract Performance Guarantee, replace the Contract Performance Guarantee with another Contract Performance Guarantee or extend the validity of the existing Contract Performance Guarantee until the validity period specified in this Article.

**3.1.3** The TSP agrees and undertakes to duly perform and complete the following activities within six (6) months from the Effective Date (except for c) below), unless such completion is affected due to any Force Majeure Event, or if any of the activities is specifically waived in writing by the Nodal Agency:

- a. To obtain the Transmission License for the Project from the Commission;



  
Central Transmission Utility of India Limited

19



  
RAGHANESDA RE TRANSMISSION LIMITED



450

**Transmission Service Agreement**

- b. To obtain the order for adoption of Transmission Charges by the Commission, as required under Section 63 of the Electricity Act 2003;
- c. To submit to the Nodal Agency, CEA & Independent Engineer, the Project Execution Plan, immediately after award of contract(s) and maximum within one hundred and twenty (120) days from the Effective Date. Also, an approved copy each of Manufacturing Quality Plan (MQP) and Field Quality Plan (FQP) would be submitted to Independent Engineer & Nodal Agency in the same time period. The TSP's Project Execution Plan should be in conformity with the Scheduled COD as specified in Schedule 2 of this Agreement, and shall bring out clearly the organization structure, time plan and methodology for executing the Project, award of major contracts, designing, engineering, procurement, shipping, construction, testing and commissioning to commercial operation;
- d. To submit to the Nodal Agency, CEA & Independent Engineer a detailed bar (GANTT) chart of the Project outlining each activity (taking longer than one Month), linkages as well as durations;
- e. To submit to the Nodal Agency, CEA & Independent Engineer detailed specifications of conductor meeting the functional specifications specified in RFP;
- f. To achieve Financial Closure;
- g. To provide an irrevocable letter to the Lenders duly accepting and acknowledging the rights provided to the Lenders under the provisions of Article 15.3 of this Agreement and all other RFP Project Documents;
- h. To award the Engineering, Procurement and Construction contract ("EPC contract") for the design and construction of the Project and shall have given to such Contractor an irrevocable notice to proceed; and
- i. To sign the Agreement(s) required, if any, under Sharing Regulations.

**3.2 Recognition of Lenders' Rights by the Nodal Agency**

3.2.1 The Nodal Agency hereby accepts and acknowledges the rights provided to the Lenders as per Article 15.3 of this Agreement and all other RFP Project Documents.

**3.3 Consequences of non-fulfilment of conditions subsequent**


3.3.1 If any of the conditions specified in Article 3.1.3 is not duly fulfilled by the TSP even within three (3) Months after the time specified therein, then on and from the expiry of such period and until the TSP has satisfied all the conditions specified in Article 3.1.3, the TSP shall, on a monthly basis, be liable to furnish to



Central Transmission Utility of India Limited

20

Raghare Transmission Limited



151

Transmission Service Agreement

Central Transmission Utility of India Limited (being the Nodal Agency) additional Contract Performance Guarantee of Rs.5.75 Crore (Rupees Five Crore Seventy Five Lakh Only) within two (2) Business Days of expiry of every such Month. Such additional Contract Performance Guarantee shall be provided to Central Transmission Utility of India Limited (being the Nodal Agency) in the manner provided in Article 3.1.1 and shall become part of the Contract Performance Guarantee and all the provisions of this Agreement shall be construed accordingly. Central Transmission Utility of India Limited (being the Nodal Agency) shall be entitled to hold and / or invoke the Contract Performance Guarantee, including such additional Contract Performance Guarantee, in accordance with the provisions of this Agreement.

3.3.2 Subject to Article 3.3.4, if:

- (i) the fulfilment of any of the conditions specified in Article 3.1.3 is delayed beyond nine (9) Months from the Effective Date and the TSP fails to furnish additional Contract Performance Guarantee to the Nodal Agency in accordance with Article 3.3.1 hereof; or
- (ii) the TSP furnishes additional Performance Guarantee to the Nodal Agency in accordance with Article 3.3.1 hereof but fails to fulfil the conditions specified in Article 3.1.3 within a period of twelve (12) months from the Effective Date,


the Nodal Agency shall have the right to terminate this Agreement, by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement.

3.3.3 If the Nodal Agency elects to terminate this Agreement as per the provisions of Article 3.3.2, the TSP shall be liable to pay to the Nodal Agency an amount of Rs.57.50 Crore (Rupees Fifty Seven Crore Fifty Lakh Only) as liquidated damages. The Nodal Agency shall be entitled to recover this amount of damages by invoking the Contract Performance Guarantee to the extent of liquidated damages, which shall be required by the Nodal Agency, and the balance shall be returned to TSP, if any.

It is clarified for removal of doubt that this Article shall survive the termination of this Agreement.

3.3.4 In case of inability of the TSP to fulfil the conditions specified in Article 3.1.3 due to any Force Majeure Event, the time period for fulfilment of the condition subsequent as mentioned in Article 3.1.3, may be extended for a period of such Force Majeure Event. Alternatively, if deemed necessary, this Agreement may be terminated by the Nodal Agency by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this



  
Central Transmission Utility of India Limited

21



Raghavendra Transmission Limited



452

## Transmission Service Agreement

Agreement and the Contract Performance Guarantee shall be returned as per the provisions of Article 6.5.1.

Provided, that due to the provisions of this Article 3.3.4, any increase in the time period for completion of conditions subsequent mentioned under Article 3.1.3, shall lead to an equal increase in the time period for the Scheduled COD. If the Scheduled COD is extended beyond a period of one hundred eighty (180) days due to the provisions of this Article 3.3.4, the TSP will be allowed to recover the interest cost during construction corresponding to the period exceeding one hundred eighty (180) days by adjustment in the Transmission Charges in accordance with Schedule 9.

3.3.5 Upon termination of this Agreement as per Articles 3.3.2 and 3.3.4, the Nodal Agency may take steps to bid out the Project again.

3.3.6 The Nodal agency, on the failure of the TSP to fulfil its obligations, if it considers that there are sufficient grounds for so doing, apart from invoking the Contract Performance Guarantee under para 3.3.3 may also initiate proceedings for blacklisting the TSP as per provisions of Article 13.2 of TSA.

### 3.4 Progress Reports

The TSP shall notify the Nodal Agency and CEA in writing at least once a Month on the progress made in satisfying the conditions subsequent in Articles 3.1.3.



Central Transmission Utility of India Limited

22

Raghavendra Transmission Limited



452

Transmission Service Agreement

ARTICLE: 4

4. DEVELOPMENT OF THE PROJECT

4.1 TSP's obligations in development of the Project:

Subject to the terms and conditions of this Agreement, the TSP at its own cost and expense shall observe, comply with, perform, undertake and be responsible:

- a. for procuring and maintaining in full force and effect all Consents, Clearances and Permits, required in accordance with Law for development of the Project;
- b. for financing, constructing, owning and commissioning each of the Element of the Project for the scope of work set out in Schedule 1 of this Agreement in accordance with:

- i. the Electricity Act and the Rules made thereof;

- ii. the Grid Code;

- iii. the CEA Regulations applicable, and as amended from time to time, for Transmission Lines and sub-stations:

- the Central Electricity Authority (Technical Standards for Connectivity to the Grid) Regulations, 2007;
- Central Electricity Authority (Technical Standards for construction of Electrical Plants and Electric Lines) Regulation, 2010;
- Central Electricity Authority (Grid Standard) Regulations, 2010;
- Central Electricity Authority (Safety requirements for construction, operation and maintenance of Electrical Plants and Electrical Lines) Regulation, 2011;
- Central Electricity Authority (Measures relating to Safety and Electricity Supply) Regulation, 2010;
- Central Electricity Authority (Technical Standards for Communication System in Power System Operation) Regulations, 2020.

- iv. Safety/ security Guidelines laid down by the Government;

- v. Prudent Utility Practices, relevant Indian Standards and the Law;



Central Transmission Utility of India Limited

23



Raichandani Power Transmission Limited



454

**Transmission Service Agreement**

not later than the Scheduled COD as per Schedule 2 of this Agreement;

- c. for entering into a Connection Agreement with the concerned parties in accordance with the Grid Code.
- d. for owning the Project throughout the term of this Agreement free and clear of any encumbrances except those expressly permitted under Article 15 of this Agreement;
- e. to co-ordinate and liaise with concerned agencies and provide on a timely basis relevant information with regard to the specifications of the Project that may be required for interconnecting the Project with the Interconnection Facilities;
- f. for providing all assistance to the Arbitrators as they may require for the performance of their duties and responsibilities;
- g. to provide to the Nodal Agency and CEA, on a monthly basis, progress reports with regard to the Project and its execution (in accordance with prescribed form) to enable the CEA to monitor and co-ordinate the development of the Project matching with the Interconnection Facilities;
- h. to comply with Ministry of Power order no. 25-11/6/2018 – PG dated 02.07.2020 as well as other Guidelines issued by Govt. of India pertaining to this;
- i. to procure the products associated with the Transmission System as per provisions of Public Procurement (Preference to Make in India) orders issued by Ministry of Power vide orders No. P-45021/2/2017-PP (BE-II)-Part (4) Vol.II dated 19.07.2024 for transmission sector, as amended from time to time read with Department for Promotion of Industry and Internal Trade (DPIIT) orders in this regard (Procuring Entity as defined in above orders shall deemed to have included Selected Bidder and/ or TSP).

Also, to comply with Department of Expenditure, Ministry of Finance vide OM No. F.7/10/2021-PPD (1) dated 23.02.2023, as amended from time to time, regarding public procurement from a bidder of a country, which shares land border with India;

- j. to submit to Nodal Agency information in the prescribed format [To be devised by Nodal Agency] for ensuring compliance to Article 4.1 i) above.



Central Transmission Utility of India Limited

24

Raghunada Reddy Transmission Limited



455

**Transmission Service Agreement**

- k. to comply with all its obligations undertaken in this Agreement.

**4.2 Roles of the Nodal Agency in implementation of the Project:**

4.2.1 Subject to the terms and conditions of this Agreement, the Nodal Agency shall be the holder and administrator of this Agreement and shall inter alia:

- a. appoint an Independent Engineer within 90 days of the Effective Date
- b. provide letters of recommendation to the concerned Indian Governmental Instrumentality, as may be requested by the TSP from time to time, for obtaining the Consents, Clearances and Permits required for the Project;
- c. coordinate among TSP and upstream/downstream entities in respect of Interconnection Facilities; and
- d. monitor the implementation of the Agreement and take appropriate action for breach thereof including revocation of guarantees, cancellation of Agreement, blacklisting etc
- e. provide all assistance to the Arbitrators as required for the performance of their duties and responsibilities; and
- f. perform any other responsibility (ies) as specified in this Agreement.

**4.3 Time for Commencement and Completion:**

- a. The TSP shall take all necessary steps to commence work on the Project from the Effective Date of the Agreement and shall achieve Scheduled COD of the Project in accordance with the time schedule specified in Schedule 2 of this Agreement;
- b. The COD of each Element of the Project shall occur no later than the Scheduled COD or within such extended time to which the TSP shall be entitled under Article 4.4 hereto.

**4.4 Extension of time:**

4.4.1 In the event that the TSP is unable to perform its obligations for the reasons solely attributable to the Nodal Agency, the Scheduled COD shall be extended, by a 'day to day' basis, subject to the provisions of Article 13.



Central Transmission Utility of India Limited

25



Raghavendra RE Transmission Limited



458

## Transmission Service Agreement

4.4.2 In the event that an Element or the Project cannot be commissioned by its Scheduled COD on account of any Force Majeure Event as per Article 11, the Scheduled COD shall be extended, by a 'day to day' basis for a period of such Force Majeure Event. Alternatively, if deemed necessary, the Nodal Agency may terminate the Agreement as per the provisions of Article 13.4 by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement.

4.4.3 If the Parties have not agreed, within thirty (30) days after the affected Party's performance has ceased to be affected by the relevant circumstance, on how long the Scheduled COD should be deferred by, any Party may raise the Dispute to be resolved in accordance with Article 16.

### 4.5 Metering Arrangements:

4.5.1 The TSP shall comply with all the provisions of the IEGC and the Central Electricity Authority (Installation and Operation of Meters) Regulations, 2006 as amended from time to time, with regard to the metering arrangements for the Project. The TSP shall fully cooperate with the CTU / STU / RLDC and extend all necessary assistance in taking meter readings.

### 4.6 Interconnection Facilities:

4.6.1 Subject to the terms and conditions of this Agreement, the TSP shall be responsible for connecting the Project with the interconnection point(s) specified in Schedule 1 of this Agreement. The Interconnection Facilities shall be developed as per the scope of work and responsibilities assigned in Schedule 1 of this Agreement. The Nodal Agency shall be responsible for coordinating to make available the Interconnection Facilities.

4.6.2 In order to remove any doubts, it is made clear that the obligation of the TSP within the scope of the project is to construct the Project as per Schedule-1 of this Agreement and in particular to connect it to the Interconnection Facilities as specified in this Agreement.



Central Transmission Utility of India Limited

26



Raghavendra Transmission Limited



457

Transmission Service Agreement

ARTICLE: 5

5. CONSTRUCTION OF THE PROJECT

5.1 TSP's Construction Responsibilities:

- 5.1.1 The TSP, at its own cost and expense, shall be responsible for designing, constructing, erecting, testing and commissioning each Element of the Project by the Scheduled COD in accordance with the Regulations and other applicable Laws specified in Article 4.1 of this Agreement.
- 5.1.2 The TSP acknowledges and agrees that it shall not be relieved from any of its obligations under this Agreement or be entitled to any extension of time or any compensation whatsoever by reason of the unsuitability of the Site or Transmission Line route(s).
- 5.1.3 The TSP shall be responsible for obtaining all Consents, Clearances and Permits related but not limited to road / rail / river / canal / power line / crossings, Power and Telecom Coordination Committee (PTCC), defence, civil aviation, right of way / way-leaves and environmental & forest clearances from relevant authorities required for developing, financing, constructing, maintaining/ renewing all such Consents, Clearances and Permits in order to carry out its obligations under this Agreement in general and shall furnish to the Nodal Agency such copy/ies of each Consents, Clearances and Permits, on demand. Nodal Agency shall provide letters of recommendation to the concerned Indian Governmental Instrumentality, as may be requested by the TSP from time to time, for obtaining the Consents, Clearances and Permits required for the Project.
- 5.1.4 The TSP shall be responsible for:
- acquisition of land for location specific substations, switching stations or HVDC terminal or inverter stations. Also, the actual location of Greenfield substations (Switching Stations or HVDC Terminal or Inverter Stations) for a generation pooling substation and for load serving substations in the scope of TSP shall not be beyond 3 Km radius of the location proposed by the BPC in the survey report. However, actual location of any Greenfield intermediate Substations in the scope of TSP shall not be beyond 10 Km radius of the location proposed by the BPC in the Survey Report.
  - final selection of Site including its geo-technical investigation
  - Survey and geo-technical investigation of line route in order to determine the final route of the Transmission Lines;
  - Seeking access to the Site and other places where the Project is being executed, at its own risk and costs, including payment of any crop, tree compensation or any other compensation as may be required.



*[Handwritten signature]*

Central Transmission Utility of India Limited

27



Raghavendra Power Transmission Limited

458



**Transmission Service Agreement**

**5.1.5** In case the Project involves any resettlement and rehabilitation, the resettlement and rehabilitation package will be implemented by the State Government authorities, for which the costs is to be borne by the TSP and no changes would be allowed in the Transmission Charges on account of any variation in the resettlement and rehabilitation cost. The TSP shall provide assistance on best endeavour basis, in implementation of the resettlement and rehabilitation package, if execution of such package is in the interest of expeditious implementation of the Project and is beneficial to the Project affected persons.

**5.2 Appointing Contractors:**

**5.2.1** The TSP shall conform to the requirements as provided in this Agreement while appointing Contractor(s) for procurement of goods & services.

**5.2.2** The appointment of such Contractor(s) shall neither relieve the TSP of any of its obligations under this Agreement nor make the Nodal Agency liable for the performance of such Contractor(s).

**5.3 Monthly Progress Reporting:**


The TSP shall provide to the CEA, Nodal Agency & Independent Engineer, on a monthly basis, progress reports along with likely completion date of each Element with regard to the Project and its execution (in accordance with prescribed form). The Nodal Agency/ CEA shall monitor the development of the Project for its timely completion for improving and augmenting the electricity system as a part of its statutory responsibility.

**5.4 Quality of Workmanship:**


The TSP shall ensure that the Project is designed, built and completed in a good workmanship using sound engineering and construction practices, and using only materials and equipment that are new and manufactured as per the MQP and following approved FQP for erection, testing & commissioning and complying with Indian /International Standards such that, the useful life of the Project will be at least thirty five (35) years from the COD of the Project.

The TSP shall ensure that all major substation equipment / component (e.g. transformers, reactors, Circuit Breakers, Instrument Transformers (IT), Surge Arresters (SA), Protection relays, clamps & connectors etc.), equipment in terminal stations of HVDC installations including Thyristor/ IGBT valves, Converter Transformers, smoothing reactors, Transformer bushings and wall bushings, GIS bus ducts, towers and gantry structures and transmission towers or poles and line materials (conductors, earthwire, OPGW, insulator, accessories for conductors,



  
Central Transmission Utility of India Limited

28

  
Raghavendra Transmission Limited




**Transmission Service Agreement**

OPGW & earthwires, hardware fittings for insulators, aviation lights etc), facilities and system shall be designed, constructed and tested (Type test, Routine tests, Factory Acceptance Test (FAT)) in accordance with relevant CEA Regulations and Indian Standards. In case Indian Standards for any particular equipment/ system/ process is not available, IEC/ IEEE or equivalent International Standards and Codes shall be followed.

**5.5 Progress Monitoring & Quality Assurance:**

- 5.5.1 The Project Execution Plan submitted by the TSP in accordance with Article 3.1.3 c) shall comprise of detailed schedule of all the equipment/items /materials required for the Project, right from procurement of raw material till the dispatch from works and receipt at the site. Further, it should also include various stages of the construction schedule up to the commissioning of the Project.
- 5.5.2 Nodal Agency, CEA & Independent Engineer shall have access at all reasonable times to the Site and to the Manufacturer's works and to all such places where the Project is being executed.
- 5.5.3 Independent Engineer shall ensure conformity of the conductor specifications with the functional specifications specified in RFP.
- 5.5.4 The Independent Engineer shall monitor the following during construction of the Project:
- a) Quality of equipment, material, foundation, structures and workmanship etc. as laid down in Article 5.4 and 6.1.4 of the TSA. Specifically, quality of Sub-station equipment, transmission line material and workmanship etc. would be checked in accordance with the Article 5.4.
  - b) Progress in the activities specified in Condition Subsequent
  - c) Verification of readiness of the elements including the statutory clearances & completion of civil works, fixing of all components and finalisation of punch points (if any) prior to charging of the elements
  - d) Progress of construction of substation and Transmission Lines
- 5.5.5 The progress shall be reviewed by the Independent Engineer against the Project Execution Plan. The Independent Engineer shall prepare its report on monthly basis and submit the same to Nodal Agency highlighting the progress achieved till the end of respective month vis-à-vis milestone activities, areas of concern, if any, which may result in delay in the timely completion of the Project. Based on the progress, Nodal



  
Central Transmission Utility of India Limited

29



Raghavendra RE Transmission Limited



**Transmission Service Agreement**

Agency and/ or CEA shall issue written instructions to the TSP to take corrective measures, as may be prudent for the timely completion of the Project. In case of any deficiency, the Nodal Agency would be at liberty to take action in accordance with the procedure of this Agreement.

**5.5.6** For any delay in commissioning any critical Element(s), as identified in Schedule 1 & Schedule 2 of this Agreement, beyond a period of 45 days shall lead to a sequestration of 10% of the Contract Performance Guarantee.

**5.6 Site regulations and Construction Documents:**

The TSP shall abide by the Safety Rules and Procedures as mentioned in Schedule 3 of this Agreement

The TSP shall retain at the Site and make available for inspection at all reasonable times, copies of the Consents, Clearances and Permits, construction drawings and other documents related to construction.

**5.7 Supervision of work:**

The TSP shall provide all necessary superintendence for execution of the Project and its supervisory personnel shall be available to provide full-time superintendence for execution of the Project. The TSP shall provide skilled personnel who are experienced in their respective fields.

**5.8 Remedial Measures:**

The TSP shall take all necessary actions for remedying the shortfall in achievement of timely progress in execution of the Project, if any, as intimated by the Independent Engineer and/ or CEA and/ or the Nodal Agency. However, such intimation by the Independent Engineer and/ or CEA and/ or the Nodal Agency and the subsequent effect of such remedial measures carried out by the TSP shall not relieve the TSP of its obligations in the Agreement. Independent Engineer and/ or CEA and/ or the Nodal Agency may carry out random inspections during the Project execution, as and when deemed necessary by it. If the shortfalls as intimated to the TSP are not remedied to the satisfaction of the CEA and/ or the Nodal Agency, this Agreement may be terminated by the Nodal Agency by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement.



Central Transmission Utility of India Limited

30

Raghavendra Transmission Limited



Transmission Service Agreement

ARTICLE: 6

6. CONNECTION AND COMMISSIONING OF THE PROJECT

6.1 Connection with the Inter-Connection Facilities:

6.1.1 The TSP shall give the RLDC(s), CTU, / STU, as the case may be, and any other agencies as required, at least sixty (60) days advance written notice of the date on which it intends to connect an Element of the Project, which date shall not be earlier than its Scheduled COD or Schedule COD extended as per Article 4.4.1 & 4.4.2 of this Agreement, unless mutually agreed to by Parties. Further, any preponing of COD of any element prior to Scheduled COD must be approved by the Nodal Agency.

6.1.2 The RLDC / SLDC (as the case may be) or the CTU / STU (as the case may be), for reasonable cause, including non-availability of Interconnection Facilities as per Article 4.2, can defer the connection for up to fifteen (15) days from the date notified by the TSP pursuant to Article 6.1.1, if it notifies to the TSP in writing, before the date of connection, of the reason for the deferral and when the connection is to be rescheduled. However, no such deferment on one or more occasions would be for more than an aggregate period of thirty (30) days. Further, the Scheduled COD would be extended as required, for all such deferments on "day to day" basis.


6.1.3 Subject to Articles 6.1.1 and 6.1.2, any Element of Project may be connected with the Interconnection Facilities when:

- a. it has been completed in accordance with this Agreement and the Connection Agreement;
- b. it meets the Grid Code, Central Electricity Authority (Technical Standards for Connectivity to the Grid) Regulations, 2007 as amended from time to time and all other Indian legal requirements, and
- c. The TSP has obtained the approval in writing of the Electrical Inspector certifying that the Element is ready from the point of view of safety of supply and can be connected with the Interconnection Facilities.
- d. It has satisfactorily met all the testing requirements as per Articles 6.1.4.

6.1.4 Site Acceptance Test (SAT)/ pre-commissioning tests of all major substation equipment, component, system, facilities shall be successfully carried out before commissioning. The Type tests, FAT and SAT reports should be available at the substation / terminal station of HVDC installations for ready reference of operation and maintenance staff and has to be made available to the Independent Engineer appointed for quality monitoring or their authorised representatives, as and when they wish to examine the same.

6.2 Commercial Operation:



  
Central Transmission Utility of India Limited

31



Raghavendra RE Transmission Limited



462

**Transmission Service Agreement**

**6.2.1** An Element of the Project shall be declared to have achieved COD twenty four (24) hours following the connection of the Element with the Interconnection Facilities pursuant to Article 6.1 or seven (7) days after the date on which it is declared by the TSP to be ready for charging but is not able to be charged for reasons not attributable to the TSP subject to Article 6.1.2.

Provided that an Element shall be declared to have achieved COD only after all the Element(s), if any, which are pre-required to have achieved COD as defined in Schedule 2 of this Agreement, have been declared to have achieved their respective COD.

**6.2.2** Once any Element of the Project has been declared to have achieved deemed COD as per Article 6.2.1 above, such Element of the Project shall be deemed to have Availability equal to the Target Availability till the actual charging of the Element and to this extent, TSP shall be eligible for the Monthly Transmission Charges applicable for such Element.

**6.3 Compensation for Direct Non Natural Force Majeure Event or Indirect Non Natural Force Majeure Event or Natural Force Majeure Event (affecting the Nodal Agency)**

**6.3.1** If the TSP is otherwise ready to connect the Element(s) of the Project and has given due notice, as per provisions of Article 6.1.1, to the concerned agencies of the date of intention to connect the Element(s) of the Project, where such date is not before the Scheduled COD, but is not able to connect the Element(s) of the Project by the said date specified in the notice, due to Direct Non Natural Force Majeure Event or Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency, provided such Direct Non Natural Force Majeure Event or Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency has continued for a period of more than three (3) continuous or non-continuous Months, the TSP shall, until the effects of the Direct Non Natural Force Majeure Event or of Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency no longer prevent the TSP from connecting the Element(s) of the Project, be deemed to have achieved COD relevant to that date and to this extent, be deemed to have been providing Transmission Service with effect from the date notified, and shall be treated as follows:

- a. In case of delay due to Direct Non Natural Force Majeure Event, TSP is entitled for Transmission Charges calculated on Target Availability for the period of such events in excess of three (3) continuous or non-continuous Months in the manner provided in (c) below.
- b. In case of delay due to Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency, TSP is entitled for payment for debt service which is due under the Financing Agreements, subject to a maximum of Transmission Charges calculated on Target Availability, for the period of such events in excess of three (3)



Central Transmission Utility of India Limited

32

Raghavendra RE Transmission Limited



462

Transmission Service Agreement

continuous or non-continuous Months in the manner provided in (c) below.

- c. In case of delay due to Direct Non Natural Force Majeure Event or Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency, the TSP is entitled for payments mentioned in (a) and (b) above, after commencement of Transmission Service, in the form of an increase in Transmission Charges. These amounts shall be paid from the date, being the later of a) the date of cessation of such Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency and b) the completion of sixty (60) days from the receipt of the Financing Agreements by the Nodal Agency from the TSP.

Provided such increase in Transmission Charges shall be so as to put the TSP in the same economic position as the TSP would have been in case the TSP had been paid amounts mentioned in (a) and (b) above in a situation where the Force Majeure Event had not occurred.

For the avoidance of doubt, it is clarified that the charges payable under this Article 6.3.1 shall be recovered as per Sharing Regulations.

**6.4 Liquidated Damages for Delay in achieving COD of Project:**

6.4.1 If the TSP fails to achieve COD of any Element of the Project or the Project, by the Element's / Project's Scheduled COD or such Scheduled COD as extended under Articles 4.4.1 and 4.4.3, then the TSP shall pay to the Nodal Agency, a sum equivalent to 3.33% of Monthly Transmission Charges applicable for the Element of the Project [in case where no Elements have been defined, to be on the Project as a whole] / Project, for each day of delay up to sixty (60) days of delay and beyond that time limit, at the rate of five percent (5%) of the Monthly Transmission Charges applicable to such Element / Project, as liquidated damages for such delay and not as penalty, without prejudice to any rights of the Nodal Agency under the Agreement.


6.4.2 The TSP's maximum liability under this Article 6.4 shall be limited to the amount of liquidated damages calculated in accordance with Article 6.4.1 for and up to six (6) months of delay for the Element or the Project.

Provided that, in case of failure of the TSP to achieve COD of the Element of the Project even after the expiry of six (6) months from its Scheduled COD, the provisions of Article 13 shall apply.


- 6.4.3 The TSP shall make payment to the Nodal Agency of the liquidated damages calculated pursuant to Article 6.4.1 within ten (10) days of the earlier of:
- the date on which the applicable Element achieves COD; or
  - the date of termination of this Agreement.

The payment of such damages shall not relieve the TSP from its obligations to complete the Project or from any other obligation and liabilities under the



  
Central Transmission Utility of India Limited

33



Raghavendra RE Transmission Limited



464

**Transmission Service Agreement**

Agreement.

6.4.4 If the TSP fails to pay the amount of liquidated damages to the Nodal Agency within the said period of ten (10) days, the Nodal Agency shall be entitled to recover the said amount of the liquidated damages by invoking the Contract Performance Guarantee. If the then existing Contract Performance Guarantee is for an amount which is less than the amount of the liquidated damages payable by the TSP to the Nodal Agency under this Article 6.3 and the TSP fails to make payment of the balance amount of the liquidated damages not covered by the Contract Performance Guarantee, then such balance amount shall be deducted from the Transmission Charges payable to the TSP. The right of the Nodal Agency to encash the Contract Performance Guarantee is without prejudice to the other rights of the Nodal Agency under this Agreement.

6.4.5 For avoidance of doubt, it is clarified that amount payable by TSP under this Article is over and above the penalty payable by TSP under Article 5.5.6 of this Agreement.

**6.5 Return of Contract Performance Guarantee**

6.5.1 The Contract Performance Guarantee as submitted by TSP in accordance with Article 3.1.1 shall be released by the Nodal Agency within three (3) months from the COD of the Project. In the event of delay in achieving Scheduled COD of any of the Elements by the TSP (otherwise than due to reasons as mentioned in Article 3.1.3 or Article 11) and consequent part invocation of the Contract Performance Guarantee by the Nodal Agency, Nodal Agency shall release the Contract Performance Guarantee, if any remaining unadjusted, after the satisfactory completion by the TSP of all the requirements regarding achieving the Scheduled COD of the remaining Elements of the Project. It is clarified that the Nodal Agency shall also return / release the Contract Performance Guarantee in the event of (i) applicability of Article 3.3.2 to the extent the Contract Performance Guarantee is valid for an amount in excess of Rs.57.50 Crore (Rupees Fifty Seven Crore Fifty Lakh Only), or (ii) termination of this Agreement by the Nodal Agency as mentioned under Article 3.3.4 of this Agreement.

6.5.2 The release of the Contract Performance Guarantee shall be without prejudice to other rights of the Nodal Agency under this Agreement.



Central Transmission Utility of India Limited

34



Raghavendra Transmission Limited



415

**Transmission Service Agreement**

**ARTICLE: 7**

**7. OPERATION AND MAINTENANCE OF THE PROJECT**

**7.1 Operation and Maintenance of the Project:**

The TSP shall be responsible for ensuring that the Project is operated and maintained in accordance with the regulations made by the Commission and CEA from time to time and provisions of the Act.



Central Transmission Utility of India Limited

35



Raghavendra RE Transmission Limited



486

Transmission Service Agreement

ARTICLE: 8

8. AVAILABILITY OF THE PROJECT

8.1 Calculation of Availability of the Project:

Calculation of Availability for the Elements and for the Project, as the case may be, shall be as per Appendix –IV to Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2024, as applicable on the Bid Deadline and as appended in Schedule 6 of this Agreement.

8.2 Target Availability:

The Target Availability of each Element and the Project shall be 98%.

Payment of monthly Transmission charges based on actual availability will be calculated as per para 1.2 of Schedule 4 of this Agreement.

If the availability of any Element or the Project is below the Target Availability, for six consecutive months in a Contract Year, the DIC(s) or the Nodal Agency may issue a show cause notice to the TSP, asking them to show cause as to why the Transmission Service Agreement be not terminated, and if no satisfactory cause is shown it may terminate the Agreement. If the Nodal Agency is of the opinion that the transmission system is of critical importance, it may carry out or cause to carry out the operation and maintenance of transmission system at the risk and cost of TSP.

  
Central Transmission Utility of India Limited

36

  
Raghavendra RE Transmission Limited

  
RAGHAVENDRA RE TRANSMISSION LTD. \*  
NEW DELHI

657

**Transmission Service Agreement**

**ARTICLE: 9**

**9. INSURANCES**

**9.1 Insurance:**

9.1.1 The TSP shall effect and maintain or cause to be effected and maintained during the Construction Period and the Operating Period, adequate Insurances against such risks, with such deductibles including but not limited to any third party liability and endorsements and co-beneficiary/insured, as may be necessary under

- a. any of the Financing Agreements,
- b. the Laws, and
- c. in accordance with Prudent Utility Practices.

The Insurances shall be taken effective from a date prior to the date of the Financial Closure till the Expiry Date.

**9.2 Evidence of Insurance cover:**

9.2.1 The TSP shall furnish to the Nodal Agency copies of certificates and policies of the Insurances, as and when the Nodal Agency may seek from the TSP as per the terms of Article 9.1

**9.3 Application of Insurance Proceeds:**

9.3.1 Save as expressly provided in this Agreement, the policies of Insurances and the Financing Agreements, the proceeds of any insurance claim made due to loss or damage to the Project or any part of the Project shall be first applied to reinstatement, replacement or renewal of such loss or damage.

9.3.2 If a Natural Force Majeure Event renders the Project no longer economically and technically viable and the insurers under the Insurances make payment on a "total loss" or equivalent basis, the portion of the proceeds of such insurance available to the TSP (after making admissible payments to the Lenders as per the Financing Agreements) shall be allocated only to the TSP. Nodal Agency and / or concerned Designated ISTS Customers shall have no claim on such proceeds of the Insurance.

9.3.3 Subject to the requirements of the Lenders under the Financing Agreements, any dispute or difference between the Parties as to whether the Project is no longer economically and technically viable due to a Force Majeure Event or whether that event was adequately covered in accordance with this Agreement by the Insurances shall be determined in accordance with Article 16.

**9.4 Effect on liability of the Nodal Agency / Designated ISTS Customers**

9.4.1 The Nodal Agency and / or the Designated ISTS Customers shall have no financial obligations or liability whatsoever towards the TSP in respect of this Article 9.

  
Central Transmission Utility of India Limited

  
Raghavendra K.E. Transmission Limited

  
RAGHAVENDRA K.E. TRANSMISSION LTD.  
NEW DELHI

488

Transmission Service Agreement

ARTICLE: 10

10. BILLING AND PAYMENT OF TRANSMISSION CHARGES

10.1 Subject to provisions of this Article 10, the Monthly Transmission Charges shall be paid to the TSP, in Indian Rupees, on monthly basis as per the provisions of the Sharing Regulations, from the date on which an Element(s) has achieved COD until the Expiry Date of this Agreement, unless terminated earlier and in line with the provisions of Schedule 4 of this Agreement.

10.2 Calculation of Monthly Transmission Charges:

The Monthly Transmission Charges for each Contract Year including Incentive & Penalty payment shall be calculated in accordance with the provisions of Schedule 4 of this Agreement.

10.3 Rebate & Late Payment Surcharge:

The rebate and late payment surcharge shall be governed as per Sharing Regulations.

10.4 Disputed Bills, Default in payment by the Designated ISTS Customers & Annual Reconciliation:

Any Disputed Bill, Default in payment by the Designated ISTS Customers & Annual Reconciliation shall be governed as per Sharing Regulations.



Central Transmission Utility of India Limited

38



Raghavendra RE Transmission Limited



4/9

Transmission Service Agreement

ARTICLE: 11

11. FORCE MAJEURE

11.1 Definitions

11.1.1 The following terms shall have the meanings given hereunder.

11.2 Affected Party

11.2.1 An Affected Party means any Party whose performance has been affected by an event of Force Majeure.

11.2.2 Any event of Force Majeure shall be deemed to be an event of Force Majeure affecting the TSP only if the Force Majeure event affects and results in, late delivery of machinery and equipment for the Project or construction, completion, commissioning of the Project by Scheduled COD and/or operation thereafter;

11.3 Force Majeure

A 'Force Majeure' means any event or circumstance or combination of events and circumstances including those stated below that wholly or partly prevents or unavoidably delays an Affected Party in the performance of its obligations/ roles under this Agreement, but only if and to the extent that such events or circumstances are not within the reasonable control, directly or indirectly, of the Affected Party and could not have been avoided if the Affected Party had taken reasonable care or complied with Prudent Utility Practices:

a) Natural Force Majeure Events:

- i. act of God, including, but not limited to drought, fire and explosion (to the extent originating from a source external to the Site), earthquake, volcanic eruption, landslide, flood, cyclone, typhoon, tornado, or exceptionally adverse weather conditions, which are in excess of the statistical measures for the last hundred (100) years; and
- ii. Epidemic/ pandemic notified by Indian Governmental Instrumentality.

b) Non-Natural Force Majeure Events:

- i. Direct Non-Natural Force Majeure Events
  - Nationalization or compulsory acquisition by any Indian Governmental Instrumentality of any material assets or rights of the Affected Party; or
  - the unlawful, unreasonable or discriminatory revocation of, or refusal to renew, any Consents, Clearances and Permits required by the Affected Party to perform their obligations/ roles under the RFP Project Documents or any unlawful, unreasonable or discriminatory refusal to grant any other Consents, Clearances and Permits required for the development/ operation of the



Central Transmission Utility of India Limited

39



Raghavendra RE Transmission Limited



470

### Transmission Service Agreement

Project, provided that a Competent Court of Law declares the revocation or refusal to be unlawful, unreasonable and discriminatory and strikes the same down; or

- any other unlawful, unreasonable or discriminatory action on the part of an Indian Governmental Instrumentality which is directed against the Project, provided that a Competent Court of Law declares the action to be unlawful, unreasonable and discriminatory and strikes the same down.

#### ii. Indirect Non - Natural Force Majeure Events

- act of war (whether declared or undeclared), invasion, armed conflict or act of foreign enemy, blockade, embargo, revolution, riot, insurrection, terrorist or military action; or
- radio active contamination or ionising radiation originating from a source in India or resulting from any other Indirect Non Natural Force Majeure Event mentioned above, excluding circumstances where the source or cause of contamination or radiation is brought or has been brought into or near the Site by the Affected Party or those employed or engaged by the Affected Party; or
- industry-wide strikes and labour disturbances, having a nationwide impact in India.

#### 11.4 Force Majeure Exclusions

11.4.1 Force Majeure shall not include (i) any event or circumstance which is within the reasonable control of the Parties and (ii) the following conditions, except to the extent that they are consequences of an event of Force Majeure:

- (a) Unavailability, late delivery, or changes in cost of the machinery, equipment, materials, spare parts etc. for the Project;
- (b) Delay in the performance of any Contractors or their agents;
- (c) Non-performance resulting from normal wear and tear typically experienced in transmission materials and equipment;
- (d) Strikes or labour disturbance at the facilities of the Affected Party;
- (e) Insufficiency of finances or funds or the Agreement becoming onerous to perform; and
- (f) Non-performance caused by, or connected with, the Affected Party's:
  - i. negligent or intentional acts, errors or omissions;
  - ii. failure to comply with an Indian Law; or
  - iii. breach of, or default under this Agreement or any Project Documents.
- (g) Any error or omission in the survey report provided by BPC during the bidding process.



Transmission Service Agreement

**11.5 Notification of Force Majeure Event**

**11.5.1** The Affected Party shall give notice to the other Party of any event of Force Majeure as soon as reasonably practicable, but not later than seven (7) days after the date on which such Party knew or should reasonably have known of the commencement of the event of Force Majeure. If an event of Force Majeure results in a breakdown of communications rendering it unreasonable to give notice within the applicable time limit specified herein, then the Party claiming Force Majeure shall give such notice as soon as reasonably practicable after reinstatement of communications, but not later than one (1) day after such reinstatement.

Provided that, such notice shall be a pre-condition to the Affected Party's entitlement to claim relief under this Agreement. Such notice shall include full particulars of the event of Force Majeure, its effects on the Party claiming relief and the remedial measures proposed. The Affected Party shall give the other Party regular reports on the progress of those remedial measures and such other information as the other Party may reasonably request about the Force Majeure.

**11.5.2** The Affected Party shall give notice to the other Party of (i) the cessation of the relevant event of Force Majeure; and (ii) the cessation of the effects of such event of Force Majeure on the performance of its rights or obligations/ roles under this Agreement, as soon as practicable after becoming aware of each of these cessations.

**11.6 Duty to perform and duty to mitigate**

To the extent not prevented by a Force Majeure Event, the Affected Party shall continue to perform its obligations/ roles as provided in this Agreement. The Affected Party shall use its reasonable efforts to mitigate the effect of any event of Force Majeure as soon as practicable.

  
Central Transmission Utility of India Limited

  
Raghavendra RE Transmission Limited

  
Raghavendra RE Transmission Limited

472

**11.7 Available Relief for a Force Majeure Event**

Subject to this Article 11,

- (a) no Party shall be in breach of its obligations/ roles pursuant to this Agreement to the extent that the performance of its obligations/ roles was prevented, hindered or delayed due to a Force Majeure Event;
- (b) each Party shall be entitled to claim relief for a Force Majeure Event affecting its performance in relation to its obligations/ roles under Articles 3.3.4, 4.4.2 and 6.3.1 of this Agreement.
- (c) For the avoidance of doubt, it is clarified that the computation of Availability of the Element(s) under outage due to Force Majeure Event, as per Article 11.3 affecting the TSP shall be as per Appendix –IV to Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2024 as on Bid Deadline. For the event(s) for which the Element(s) is/are deemed to be available as per Appendix –IV to Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2024, then the Transmission Charges, as applicable to such Element(s), shall be payable as per Schedule 4, for the duration of such event(s).
- (d) For so long as the TSP is claiming relief due to any Force Majeure Event under this Agreement, the Nodal Agency may, if it so desires, from time to time on one (1) day notice, inspect the Project and the TSP shall provide the Nodal Agency's personnel with access to the Project to carry out such inspections.
- (e) For avoidance of doubt, the TSP acknowledges that for extension of Scheduled COD a period up to one hundred eighty (180) days due to Force Majeure event, no compensation on the grounds such as interest cost, incident expenditure, opportunity cost will be made to the TSP. However, if Scheduled COD is extended beyond a period of one hundred eighty (180) days due to Force Majeure event, the TSP will be allowed to recover the interest cost during construction corresponding to the period exceeding one hundred eighty (180) days by adjustment in the Transmission Charges in accordance with Schedule 9.



Central Transmission Utility of India Limited

42



Raghavendra RE Transmission Limited



473

Transmission Service Agreement

ARTICLE: 12

12. CHANGE IN LAW

12.1 Change in Law

12.1.1 Change in Law means the occurrence of any of the following after the Bid Deadline resulting into any additional recurring / non-recurring expenditure by the TSP or any savings of the TSP:

- the enactment, coming into effect, adoption, promulgation, amendment, modification or repeal (without re-enactment or consolidation) in India, of any Law, including rules and regulations framed pursuant to such Law, subject to the provisions under Article 12.1.2;
- a change in the interpretation or application of any Law by any Indian Governmental Instrumentality having the legal power to interpret or apply such Law, or any Competent Court of Law;
- the imposition of a requirement for obtaining any Consents, Clearances and Permits which was not required earlier;
- a change in the terms and conditions prescribed for obtaining any Consents, Clearances and Permits or the inclusion of any new terms or conditions for obtaining such Consents, Clearances and Permits;
- any change in the licensing regulations of the Commission, under which the Transmission License for the Project was granted if made applicable by such Commission to the TSP;
- change in wind zone; or
- any change in tax or introduction of any tax made applicable for providing Transmission Service by the TSP as per the terms of this Agreement.

12.1.2 Notwithstanding anything contained in this Agreement, Change in Law shall not cover any change:

- a) Taxes on corporate income; and
- b) Withholding tax on income or dividends distributed to the shareholders of the TSP.



474

**Transmission Service Agreement**

**12.2 Relief for Change in Law**

**12.2.1** During Construction Period, the impact of increase/decrease in the cost of the Project on the Transmission Charges shall be governed by the formula given in Schedule 9 of this Agreement.

**12.2.2** During the Operation Period:

During the operation period, if as a result of Change in Law, the TSP suffers or is benefited from a change in costs or revenue, the aggregate financial effect of which exceeds 0.30% (zero point three percent) of the Annual Transmission Charges in aggregate for a Contract Year, the TSP may notify so to the Nodal Agency and propose amendments to this Agreement so as to place the TSP in the same financial position as it would have enjoyed had there been no such Change in Law resulting in change in costs or revenue as aforesaid.

**12.2.3** For any claims made under Articles 12.2.1 and 12.2.2 above, the TSP shall provide to the Nodal Agency documentary proof of such increase / decrease in cost of the Project / revenue for establishing the impact of such Change in Law.

In cases where Change in Law results in decrease of cost and it comes to the notice of Nodal Agency that TSP has not informed Nodal Agency about such decrease in cost, Nodal Agency may initiate appropriate claim.

**12.3 Notification of Change in Law:**

**12.3.1** If the TSP is affected by a Change in Law in accordance with Article 12.1 and wishes to claim relief for such Change in Law under this Article 12, it shall give notice to Nodal Agency of such Change in Law as soon as reasonably practicable after becoming aware of the same.


**12.3.2** The TSP shall also be obliged to serve a notice to the Nodal Agency even when it is beneficially affected by a Change in Law.

**12.3.3** Any notice served pursuant to Articles 12.3.1 and 12.3.2 shall provide, amongst other things, precise details of the Change in Law and its estimated impact on the TSP.

**12.4 Payment on account of Change in Law**

**12.4.1** The payment for Change in Law shall be through a separate Bill. However, in case of any change in Monthly Transmission Charges by reason of Change in Law, as determined in accordance with this Agreement, the Bills to be raised by the Nodal Agency after such change in Transmission Charges shall appropriately reflect the changed Monthly Transmission Charges.



  
Central Transmission Utility of India Limited

44



Raghavendra RE Transmission Limited



475

Transmission Service Agreement

ARTICLE: 13

13. EVENTS OF DEFAULT AND TERMINATION

13.1 TSP's Event of Default


The occurrence and continuation of any of the following events shall constitute a TSP Event of Default, unless any such TSP Event of Default occurs as a result of any non-fulfilment of its obligations as prescribed under this Agreement by the Nodal Agency or a Force Majeure Event:

- a. After having taken up the construction of the Project, the abandonment by the TSP or the TSP's Contractors of the construction of the Project for a continuous period of two (2) months and such default is not rectified within thirty (30) days from the receipt of notice from the Nodal Agency in this regard;
- b. The failure to commission any Element of the Project by the date falling six (6) months after its Scheduled COD unless extended by Nodal Agency as per provisions of this Agreement;
- c. If the TSP:
  - i. assigns, mortgages or charges or purports to assign, mortgage or charge any of its assets or rights related to the Project in contravention of the provisions of this Agreement; or
  - ii. transfers or novates any of its obligations pursuant to this Agreement, in a manner contrary to the provisions of this Agreement;

Except where such transfer is in pursuance of a Law and

- it does not affect the ability of the transferee to perform, and such transferee has the financial and technical capability to perform, its obligations under this Agreement;
- is to a transferee who assumes such obligations under the Project and this Agreement remains effective with respect to the transferee;

- d. If:
  - i. The TSP becomes voluntarily or involuntarily the subject of any bankruptcy or insolvency or winding up proceedings and such



**Transmission Service Agreement**

proceedings remain uncontested for a period of thirty (30) days;  
or

- ii. any winding up or bankruptcy or insolvency order is passed against the TSP; or
- iii. the TSP goes into liquidation or dissolution or a receiver or any similar officer is appointed over all or substantially all of its assets or official liquidator is appointed to manage its affairs, pursuant to Law,

Provided that a dissolution or liquidation of the TSP will not be a TSP's Event of Default, where such dissolution or liquidation of the TSP is for the purpose of a merger, consolidation or reorganization with the prior approval of the Commission as per the provisions of Central Electricity Regulatory Commission (Procedure, terms and Conditions for grant of Transmission License and other related matters) Regulations, 2006 or as amended from time to time; or

- e. Failure on the part of the TSP to comply with the provisions of Article 19.1 of this Agreement; or
- f. the TSP repudiates this Agreement and does not rectify such breach even within a period of thirty (30) days from a notice from the Nodal Agency in this regard; or
- g. after Commercial Operation Date of the Project, the TSP fails to achieve monthly Target Availability of 98% for a period of six (6) consecutive months or within a non-consecutive period of six (6) months within any continuous aggregate period of eighteen(18) months except where the Availability is affected by Force Majeure Events as per Article 11; or
- h. Any of the representations and warranties made by the TSP in Article 17 of this Agreement being found to be untrue or inaccurate. Further, in addition to the above, any of the undertakings submitted by the Selected Bidder at the time of submission of the Bid being found to be breached or inaccurate, including but not limited to undertakings from its Parent Company / Affiliates related to the minimum equity obligation; or



  
Central Transmission Utility of India Limited

46



Raghnesda RE Transmission Limited



472


**Transmission Service Agreement**

- i. the TSP fails to complete / fulfil all the activities / conditions within the specified period as per Article 3; or
- j. except for the reasons solely attributable to Nodal Agency, the TSP is in material breach of any of its obligations under this Agreement and such material breach is not rectified by the TSP within thirty (30) days of receipt of notice in this regard from the Nodal Agency; or
- k. the TSP fails to take the possession of the land required for location specific substations, switching stations or HVDC terminal or inverter stations and / or fails to pay the requisite price to the parties and / or any State Government authority from whom the land is acquired, within twelve (12) months from the Effective Date.

**13.2 Termination Procedure for TSP Event of Default**

- a. Upon the occurrence and continuance of any TSP's Event of Default under Article 13.1 the Nodal Agency may serve notice on the TSP, with a copy to the CEA and the Lenders' Representative, of their intention to terminate this Agreement (a "Nodal Agency's Preliminary Termination Notice"), which shall specify in reasonable detail, the circumstances giving rise to such Nodal Agency's Preliminary Termination Notice.
- b. Following the issue of a Nodal Agency's Preliminary Termination Notice, the Consultation Period shall apply and would be for the Parties to discuss as to what steps shall be taken with a view to mitigate the consequences of the relevant Event of Default having regard to all the circumstances.
- c. During the Consultation Period, the Parties shall, save as otherwise provided in this Agreement, continue to perform their respective obligations/ roles under this Agreement, and the TSP shall not remove any material, equipment or any part of the Project, without prior consent of the Nodal Agency.

Following the expiry of the Consultation Period, unless the Parties shall have otherwise agreed to the contrary or the circumstances giving rise to Nodal Agency's Preliminary Termination Notice shall have ceased to exist or shall have been remedied, this Agreement may be terminated by the Nodal Agency by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement.

  
  
Central Transmission Utility of India Limited

47

  
Raghavendra RE Transmission Limited



478

### Transmission Service Agreement

Further, the Nodal Agency may also initiate proceedings to blacklist the TSP & its Affiliates from participation in any RFP issued by BPCs for a period of 5 years.

#### 13.3 Procedure for Nodal Agency's non-fulfilment of Role

- a. Upon the Nodal Agency not being able to fulfil its role under Article 4.2, the TSP may serve notice on the Nodal Agency, with a copy to CEA and the Lenders' Representative (a "TSP's Preliminary Notice"), which notice shall specify in reasonable detail the circumstances giving rise to such non-fulfilment of role by the Nodal Agency.
- b. Following the issue of a TSP's Preliminary Notice, the Consultation Period shall apply.
- c. The Consultation Period would be for the Parties to discuss as to what steps shall be taken with a view to mitigate the consequences of the relevant non-fulfilment of role by the Nodal Agency including giving time extension to TSP, having regard to all the circumstances.
- d. During the Consultation Period, both Parties shall, save as otherwise provided in this Agreement, continue to perform their respective obligations/ roles under this Agreement.

#### 13.4 Termination due to Force Majeure

13.4.1 In case the Parties could not reach an agreement pursuant to Articles 3.3.4 and 4.4.2 of this Agreement and the Force Majeure Event or its effects continue to be present, the Nodal Agency shall have the right to cause termination of the Agreement. In case of such termination, the Contract Performance Guarantee shall be returned to the TSP as per the provisions of Article 6.5.1.

13.4.2 In case of termination of this Agreement, the TSP shall provide to the Nodal Agency the full names and addresses of its Contractors as well as complete designs, design drawings, manufacturing drawings, material specifications and technical information, as required by the Nodal Agency within thirty (30) days of Termination Notice.



Central Transmission Utility of India Limited

48



Raghavendra Transmission Limited



479

**Transmission Service Agreement**

**13.5 Termination or amendment due to non-requirement of any Element or Project during construction**

- 13.5.1 In case any Element or Project, which is under construction, is no longer required due to any reason whatsoever, the Nodal Agency may issue a notice to this effect to the TSP.
- 13.5.2 Nodal agency may also issue notice to the TSP seeking their response to the proposed termination/ amendment (as the case may be) of the Agreement. The Nodal Agency shall issue copy of such notice to Lenders. In the notice, Nodal Agency shall also include an assessment of the physical progress made by TSP in the Element/ Project (as the case may be) that is no longer required.
- 13.5.3 The TSP shall neither carry out further investment nor carry out any work on the Element/ Project (as the case may be) that is no longer required after delivery of the notice.
- 13.5.4 After taking into account the comments of the TSP, the Nodal Agency may terminate the Agreement or amend it if both Parties agree to the amendment.

**13.6 Revocation of the Transmission License**

- 13.6.1 The Commission may, as per the provisions of the Electricity Act, 2003, revoke the Transmission License of the ISTS Licensee. Further, in such a case, the Agreement shall be deemed to have been terminated.

**13.7 Termination Payment**

- 13.7.1 If Agreement is terminated on account of Force Majeure Events, non-requirement of any Element or Project during Construction, Nodal Agency's non-fulfilment of Role & TSP's Event of Default, the TSP shall be entitled for Termination Payment equivalent to valuation of Project Assets. Upon payment, the Nodal Agency shall take over the Project Assets.

Transmission Service Agreement

ARTICLE: 14

14. LIABILITY AND INDEMNIFICATION

14.1 Indemnity

14.1.1 The TSP shall indemnify, defend and hold the Nodal Agency harmless against:

- (a) any and all third party claims, actions, suits or proceedings against the Nodal Agency for any loss of or damage to property of such third party, or death or injury to such third party, arising out of a breach by the TSP of any of its obligations under this Agreement, except to the extent that any such claim, action, suit or proceeding has arisen due to a negligent act or omission, breach of this Agreement or non-fulfilment of statutory duty on the part of Nodal Agency; and
- (b) any and all losses, damages, costs and expenses including legal costs, fines, penalties and interest actually suffered or incurred by the Nodal Agency from third party claims arising by reason of:
  - i. a breach by the TSP of any of its obligations under this Agreement, (provided that this Article 14 shall not apply to such breaches by the TSP, for which specific remedies have been provided for under this Agreement) except to the extent that any such losses, damages, costs and expenses including legal costs, fines, penalties and interest (together to constitute "Indemnifiable Losses") has arisen due to a negligent act or omission, breach of this Agreement or non-fulfilment of statutory duty on the part of the Nodal Agency, or
  - ii. Any of the representations and warranties of the TSP under this Agreement being found to be inaccurate or untrue.

14.1.2 The Nodal Agency shall, in accordance with the Regulations framed by CERC in this regard, indemnify, defend and hold the TSP harmless against:

- (a) any and all third party claims, actions, suits or proceedings against the TSP, for any loss of or damage to property of such third party, or death or injury to such third party, arising out of any material breach by the Nodal Agency of any of their roles under this Agreement, except to the extent that any such claim, action, suit or proceeding has arisen due to a negligent act or omission, breach of this Agreement or breach of statutory duty on the part of the TSP, its Contractors, servants or agents; and



*Signature*

Central Transmission Utility of India Limited

50



Raghamesha RE Transmission Limited



481

Transmission Service Agreement

(b) any and all losses, damages, costs and expenses including legal costs, fines, penalties and interest ('Indemnifiable Losses') actually suffered or incurred by the TSP from third party claims arising by reason of:

- i. any material breach by the Nodal Agency of any of its roles under this Agreement (provided that, this Article 14 shall not apply to such breaches by the Nodal Agency, for which specific remedies have been provided for under this Agreement), except to the extent that any such Indemnifiable Losses have arisen due to a negligent act or omission, breach of this Agreement or breach of statutory duty on the part of the TSP, its Contractors, servants or agents or
- ii. any of the representations and warranties of the Nodal Agency under this Agreement being found to be inaccurate or untrue.

**14.2 Patent Indemnity:**

**14.2.1**

- (a) The TSP shall, subject to the Nodal Agency's compliance with Article 14.2.1 (b), indemnify and hold harmless the Nodal Agency and its employees and officers from and against any and all suits, actions or administrative proceedings, claims, demands, losses, damages, costs, and expenses of whatsoever nature, including attorney's fees and expenses, which the Nodal Agency may suffer as a result of any infringement or alleged infringement of any patent, utility model, registered design, trademark, copyright or other intellectual property right registered or otherwise existing at the date of the Agreement by reason of the setting up of the Project by the TSP.

Such indemnity shall not cover any use of the Project or any part thereof other than for the purpose indicated by or to be reasonably inferred from the Agreement, any infringement resulting from the misuse of the Project or any part thereof, or any products produced in association or combination with any other equipment, plant or materials not supplied by the TSP, pursuant to the Agreement.

- (b) If any proceedings are brought or any claim is made against the Nodal Agency arising out of the matters referred to in Article 14.2.1(a), the Nodal Agency shall promptly give the TSP a notice thereof, and the TSP shall at its own expense take necessary steps and attend such proceedings or claim and any negotiations for the settlement of any such proceedings or claim. The TSP shall promptly notify the Nodal Agency of all actions taken in such

  
Central Transmission Utility of India Limited

51

  
Raghavendra RE Transmission Limited



482

Transmission Service Agreement

proceedings or claims.

- (c) If the TSP fails to notify the Nodal Agency within twenty-eight (28) days after receipt of such notice from the Nodal Agency under Article 14.2.1(b) above, that it intends to attend any such proceedings or claim, then the Nodal Agency shall be free to attend the same on their own behalf at the cost of the TSP. Unless the TSP has so failed to notify the Nodal Agency within the twenty eight (28) days period, the Nodal Agency shall make no admission that may be prejudicial to the defence of any such proceedings or claims.
- (d) The Nodal Agency shall, at the TSP's request, afford all available assistance to the TSP in attending to such proceedings or claim, and shall be reimbursed by the TSP for all reasonable expenses incurred in so doing.

14.2.2

- (a) The Nodal Agency, in accordance with the Regulations framed by CERC in this regard, subject to the TSP's compliance with Article 14.2.2(b) shall indemnify and hold harmless the TSP and its employees, officers from and against any and all suits, actions or administrative proceedings, claims, demands, losses, damages, costs and expenses of whatsoever nature, including attorney's fees and expenses, which the TSP may suffer as a result of any infringement or alleged infringement of any patent, utility model, registered design, trademark, copyright or other intellectual property right registered or otherwise existing at the date of the Agreement by reason of the setting up of the Project by the TSP.
- (b) If any proceedings are brought or any claim is made against the TSP arising out of the matters referred to in Article 14.2.2 (a) the TSP shall promptly give the Nodal Agency a notice thereof, and the Nodal Agency shall at its own expense take necessary steps and attend such proceedings or claim and any negotiations for the settlement of any such proceedings or claim. The Nodal Agency shall promptly notify the TSP of all actions taken in such proceedings or claims.
- (c) If the Nodal Agency fails to notify the TSP within twenty-eight (28) days after receipt of such notice from the TSP under Article 14.2.2(b) above, that it intends to attend any such proceedings or claim, then the TSP shall be free to attend the same on its own behalf at the cost of the Nodal Agency. Unless the Nodal Agency has so failed to notify the TSP within the twenty (28) days period, the TSP shall make no admission that may be prejudicial to the



  
Central Transmission Utility of India Limited

\$2

Raghavendra RE Transmission Limited



483

Transmission Service Agreement

defence of any such proceedings or claim.

- (d) The TSP shall, at the Nodal Agency request, afford all available assistance to the Nodal Agency in attending to such proceedings or claim, and shall be reimbursed by the Nodal Agency for all reasonable expenses incurred in so doing.

**14.3 Monetary Limitation of liability**

14.3.1 A Party ("Indemnifying Party") shall be liable to indemnify the other Party ("Indemnified Party") under this Article 14 for any indemnity claims made in a Contract Year only up to an amount of Rs.3.83 Crore (Rupees Three Crore Eighty Three Lakh Only).

**14.4 Procedure for claiming indemnity**


14.4.1 Where the Indemnified Party is entitled to indemnification from the indemnifying Party pursuant to Articles 14.1 or 14.2 the Indemnified Party shall promptly notify the Indemnifying Party of such claim, proceeding, action or suit referred to in Articles 14.1 or 14.2 in respect of which it is entitled to be indemnified. Such notice shall be given as soon as reasonably practicable after the Indemnified Party becomes aware of such claim, proceeding, action or suit. The Indemnifying Party shall be liable to settle the indemnification claim within thirty (30) days of receipt of the above notice.

Provided however that, if:

- i. the Parties choose to contest, defend or litigate such claim, action, suit or proceedings in accordance with Article 14.4.3 below; and
- ii. the claim amount is not required to be paid/deposited to such third party pending the resolution of the Dispute,

the Indemnifying Party shall become liable to pay the claim amount to the Indemnified Party or to the third party, as the case may be, promptly following the resolution of the Dispute, if such Dispute is not settled in favour of the Indemnified Party.

14.4.2 The Indemnified Party may contest, defend and litigate a claim, action, suit or proceeding for which it is entitled to be indemnified under Articles 14.1 or 14.2 and the Indemnifying Party shall reimburse to the Indemnified Party all reasonable costs and expenses incurred by the Indemnified Party. However, such Indemnified Party shall not settle or compromise such claim, action, suit or proceedings without first getting the consent of the Indemnifying Party, which consent shall not be unreasonably withheld or delayed.

  
Central Transmission Utility of India Limited

53



484

**Transmission Service Agreement**

**14.4.3** An Indemnifying Party may, at its own expense, assume control of the defence of any proceedings brought against the Indemnified Party if it acknowledges its obligation to indemnify such Indemnified Party, gives such Indemnified Party prompt notice of its intention to assume control of the defence, and employs an independent legal counsel at its own cost that is reasonably satisfactory to the Indemnified Party.

**14.5 Limitation on Liability**

**14.5.1** Except as expressly provided in this Agreement, neither the TSP nor the Nodal Agency nor their respective officers, directors, agents, employees or Affiliates (including, officers, directors, agents or employees of such Affiliates), shall be liable or responsible to the other Party or its Affiliates including its officers, directors, agents, employees, successors, insurers or permitted assigns for incidental, indirect or consequential, punitive or exemplary damages, connected with or resulting from performance or non-performance of this Agreement, or anything done in connection herewith, including claims in the nature of lost revenues, income or profits (other than payments expressly required and properly due under this Agreement), any increased expense of, reduction in or loss of transmission capacity or equipment used therefore, irrespective of whether such claims are based upon breach of warranty, tort (including negligence, whether of the Nodal Agency, the TSP or others), strict liability, contract, breach of statutory duty, operation of law or otherwise.

**14.5.2** The Nodal Agency shall have no recourse against any officer, director or shareholder of the TSP or any Affiliate of the TSP or any of its officers, directors or shareholders for such claims excluded under this Article. The TSP shall also have no recourse against any officer, director or shareholder of the Nodal Agency, or any Affiliate of the Nodal Agency or any of its officers, directors or shareholders for such claims excluded under this Article.

**14.6 Duty to Mitigate**

The party entitled to the benefit of an indemnity under this Article 14 shall take all reasonable measures to mitigate any loss or damage which has occurred. If the Party fails to take such measures, the other Party's liabilities shall be correspondingly reduced.



Central Transmission Utility of India Limited



Raghavendra RE Transmission Limited

485

Transmission Service Agreement

ARTICLE: 15

15. ASSIGNMENTS AND CHARGES

15.1 Assignments:

15.1.1 This Agreement shall be binding upon, and inure to the benefit of the Parties and their respective successors and permitted assigns. This Agreement shall not be assigned by any Party, except as provided in Article 15.3.

15.2 Permitted Charges:

15.2.1 Neither Party shall create or permit to subsist any encumbrance over all or any of its rights and benefits under this Agreement.


15.2.2 However, the TSP may create any encumbrance over all or part of the receivables, or the Project Assets of the Project in favour of the Lenders or the Lenders' Representative on their behalf, as security for amounts payable under the Financing Agreements and any other amounts agreed by the Parties.

Provided that:

- i. the Lenders or the Lenders' Representative on their behalf shall have entered into the Financing Agreements and agreed in writing to the provisions of this Agreement; and
- ii. any encumbrance granted by the TSP in accordance with this Article 15.2.2 shall contain provisions pursuant to which the Lenders or the Lender's Representative on their behalf agrees unconditionally with the TSP to release from such encumbrances upon payment by the TSP to the Lenders of all amounts due under the Financing Agreements.

15.2.3 Article 15.2.1 does not apply to:

- a. liens arising by operation of law (or by an agreement evidencing the same) in the ordinary course of the TSP developing and operating the Project;
- b. pledges of goods, the related documents of title and / or other related documents, arising or created in the ordinary course of the TSP developing and operating the Project; or
- c. security arising out of retention of title provisions in relation to goods acquired in the ordinary course of the TSP developing and operating the Project.

  
Central Transmission Utility of India Limited

55



488

Transmission Service Agreement

**15.3 Substitution Rights of the Lenders**

**15.3.1** The TSP would need to operate and maintain the Project under the provisions of this Agreement and cannot assign the Transmission License or transfer the Project or part thereof to any person by sale, lease, exchange or otherwise, without the prior approval of the Nodal Agency.

**15.3.2** However, in the case of default by the TSP in debt repayments or in the case of default by the TSP as per Article 13 of this Agreement during the debt repayments, the Commission may, on an application from the Lenders, assign the Transmission License to the nominee of the Lenders subject to the fulfilment of the qualification requirements and provisions of the Central Electricity Regulatory Commission (Procedure, terms and Conditions for grant of Transmission License and other related matters) Regulations, 2006 and as amended from time to time.



Central Transmission Utility of India Limited

56



Raghnesda RE Transmission Limited



407

Transmission Service Agreement

**ARTICLE: 16**

**16. GOVERNING LAW AND DISPUTE RESOLUTION**

**16.1 Governing Law:**

This Agreement shall be governed by and construed in accordance with the Laws of India. Any legal proceedings in respect of any matters, claims or disputes under this Agreement shall be under the jurisdiction of appropriate courts in Delhi.

**16.2 Amicable Settlement:**

**16.2.1** Either Party is entitled to raise any claim, dispute or difference of whatever nature arising under, out of or in connection with this Agreement, including its existence or validity or termination or whether during the execution of the Project or after its completion and whether prior to or after the abandonment of the Project or termination or breach of the Agreement by giving a written notice to the other Party, which shall contain:

- (i) a description of the Dispute;
- (ii) the grounds for such Dispute; and
- (iii) all written material in support of its claim.

**16.2.2** The other Party shall, within thirty (30) days of issue of notice issued under Article 16.2.1, furnish:

- (i) counter-claim and defences, if any, regarding the Dispute; and
- (ii) all written material in support of its defences and counter-claim.

**16.2.3** Within thirty (30) days of issue of notice by the Party pursuant to Article 16.2.1, if the other Party does not furnish any counter claim or defense under Article 16.2.2, or thirty (30) days from the date of furnishing counter claims or defence by the other Party, both the Parties to the Dispute shall meet to settle such Dispute amicably. If the Parties fail to resolve the Dispute amicably within thirty (30) days from the later of the dates mentioned in this Article 16.2.3, the Dispute shall be referred for dispute resolution in accordance with Article 16.3.

**16.3 Dispute Resolution:**

All Disputes shall be adjudicated by the Commission.

**16.4 Parties to Perform Obligations:**

Notwithstanding the existence of any Dispute and difference referred to the Commission as provided in Article 16.3 and save as the Commission may otherwise direct by a final or interim order, the Parties hereto shall continue to perform their respective obligations/ roles (which are not in dispute) under this Agreement.



Central Transmission Utility of India Limited

57



Raghamesda Re Transmission Limited



488

**ARTICLE: 17**

**17. REPRESENTATION AND WARRANTIES**

**17.1 Representation and warranties of the Nodal Agency**

**17.1.1** The Nodal Agency hereby represents and warrants to and agrees with the TSP as follows and acknowledges and confirms that the TSP is relying on such representations and warranties in connection with the transactions described in this Agreement:


- a. It has all requisite powers and authority to execute and consummate this Agreement;
- b. This Agreement is enforceable against the Nodal Agency in accordance with its terms;
- c. The consummation of the transactions contemplated by this Agreement on the part of Nodal Agency will not violate any provision of nor constitute a default under, nor give rise to a power to cancel any charter, mortgage, deed of trust or lien, lease, agreement, license, permit, evidence of indebtedness, restriction, or other contract to which the Nodal Agency is a Party or to which the Nodal Agency is bound, which violation, default or power has not been waived;

**17.2 Representation and Warranties of the TSP:**

**17.2.1** The TSP hereby represents and warrants to and agrees with the Nodal Agency as follows and acknowledges and confirms that the Nodal Agency is relying on such representations and warranties in connection with the transactions described in this Agreement:

- a. It has all requisite powers and has been duly authorized to execute and consummate this Agreement;
- b. This Agreement is enforceable against it, in accordance with its terms;
- c. The consummation of the transactions contemplated by this Agreement on the part of the TSP will not violate any provision of nor constitute a default under, nor give rise to a power to cancel any charter, mortgage, deed of trust or lien, lease, agreement, license, permit, evidence of indebtedness, restriction, or other contract to which the TSP is a Party or to which the TSP is bound which violation, default or power has not been waived;



  
Central Transmission Utility of India Limited

58

  
Raghnesda RE Transmission Limited



487

**Transmission Service Agreement**

- d. The TSP is not insolvent and no insolvency proceedings have been instituted, nor threatened or pending by or against the TSP;
- e. There are no actions, suits, claims, proceedings or investigations pending or, to the best of the TSP's knowledge, threatened in writing against the TSP at law, in equity, or otherwise, and whether civil or criminal in nature, before or by, any court, commission, arbitrator or governmental agency or authority, and there are no outstanding judgments, decrees or orders of any such courts, commission, arbitrator or governmental agencies or authorities, which materially adversely affect its ability to execute the Project or to comply with its obligations under this Agreement.

17.2.2 The TSP makes all the representations and warranties above to be valid as on the Effective Date of this Agreement.



*[Signature]*  
Central Transmission Utility of India Limited

59



*[Signature]*  
Raghnesda RE Transmission Limited



490

**ARTICLE: 18**

**18. INDEPENDENT ENGINEER**

**18.1 Appointment of Independent Engineer**

The Nodal Agency shall appoint an agency/ company as Independent Engineer as per framework provided in the Guidelines for Encouraging Competition in Development of Transmission Projects for selection of Independent Engineer.

**18.2 Roles and functions of Independent Engineer**

The role and functions of the Independent Engineer shall include the following:

- a. Progress Monitoring as required under this Agreement;
- b. Ensuring Quality as required under this Agreement;
- c. determining, as required under the Agreement, the costs of any works or services and/or their reasonableness during construction phase;
- d. determining, as required under the Agreement, the period or any extension thereof, for performing any duty or obligation during construction phase;
- e. determining, as required under the Agreement, the valuation of the Project Assets.
- f. Assisting the Parties in resolution of Disputes and
- g. Undertaking all other duties and functions in accordance with the Agreement.

**18.3 Remuneration of Independent Engineer**


The fee and charges of the Independent Engineer shall be paid by the Nodal Agency as per terms & conditions of appointment.

**18.4 Termination of appointment**

18.4.1 The Nodal Agency may, in its discretion, terminate the appointment of the Independent Engineer at any time, but only after appointment of another Independent Engineer.

18.4.2 If the TSP has reason to believe that the Independent Engineer is not discharging its duties and functions in a fair, efficient and diligent manner, it may make a written representation to the Nodal Agency and seek termination of the appointment of the Independent Engineer. Upon receipt of such representation, the Nodal Agency shall



  
Central Transmission Utility of India Limited

60

  
Raghnesda RE Transmission Limited



491

**Transmission Service Agreement**

hold a tripartite meeting with the TSP and Independent Engineer for an amicable resolution, and the decision of Nodal agency is final. In the event that the appointment of the Independent Engineer is terminated hereunder, the Nodal Agency shall appoint forthwith another Independent Engineer.

**18.5 Authorised signatories**

The Nodal Agency shall require the Independent Engineer to designate and notify to the Nodal Agency up to 2 (two) persons employed in its firm to sign for and on behalf of the Independent Engineer, and any communication or document required to be signed by the Independent Engineer shall be valid and effective only if signed by any of the designated persons; provided that the Independent Engineer may, by notice in writing, substitute any of the designated persons by any of its employees.



Central Transmission Utility of India Limited



61

Raghnesda RE Transmission Limited



492

**ARTICLE: 19**

**19. MISCELLANEOUS PROVISIONS**

**19.1 Equity Lock-in Commitment:**

**19.1.1** The aggregate equity share holding of the Selected Bidder in the issued and paid up equity share capital of **RAGHANESDA RE TRANSMISSION LIMITED** shall not be less than Fifty one percent (51%) up to a period of one (1) year after COD of the Project.

Provided that, in case the Lead Member or Bidding Company is holding equity through Affiliate/s, Ultimate Parent Company or Parent Company, such restriction as specified above shall apply to such entities.

Provided further, that in case the Selected Bidder is a Bidding Consortium, the Lead Member shall continue to hold equity of at least twenty six percent (26%) upto a period of one (1) year after COD of the Project and any Member of such Bidding Consortium shall be allowed to divest its equity as long as the other remaining Members (which shall always include the Lead Member) hold the minimum equity specified above.

**19.1.2** If equity is held by the Affiliates, Parent Company or Ultimate Parent Company of the Selected Bidder, then, subject to the second proviso to Article 19.1.1, such Affiliate, Parent Company or Ultimate Parent Company shall be eligible to transfer its shareholding in **RAGHANESDA RE TRANSMISSION LIMITED** to another Affiliate or to the Parent Company / Ultimate Parent Company of the Selected Bidder. If any such shareholding entity, qualifying as an Affiliate / Parent Company / Ultimate Parent Company, is likely to cease to meet the criteria to qualify as an Affiliate / Parent Company / Ultimate Parent Company, the shares held by such entity shall be transferred to another Affiliate / Parent Company / Ultimate Parent Company of the Selected Bidder.

**19.1.3** Subject to Article 19.1.1, all transfer(s) of shareholding of **RAGHANESDA RE TRANSMISSION LIMITED** by any of the entities referred to in Article 19.1.1 and 19.1.2 above, shall be after prior written intimation to the Nodal Agency.

**19.1.4** For computation of effective Equity holding, the Equity holding of the Selected Bidder or its Ultimate Parent Company in such Affiliate(s) or Parent Company and the equity holding of such Affiliate(s) or Ultimate Parent Company in **RAGHANESDA RE TRANSMISSION LIMITED** shall be computed in accordance with the example given below:

If the Parent Company or the Ultimate Parent Company of the Selected Bidder A directly holds thirty percent (30%) of the equity in **RAGHANESDA RE TRANSMISSION LIMITED**, then holding of Selected Bidder A in **RAGHANESDA RE TRANSMISSION LIMITED**



Central Transmission Utility of India Limited

Raghnesda RE Transmission Limited



493

Transmission Service Agreement

**TRANSMISSION LIMITED** shall be thirty percent (30%);

If Selected Bidder A holds thirty percent (30%) equity of the Affiliate and the Affiliate holds fifty percent (50%) equity in RAGHANESDA RE TRANSMISSION LIMITED, then, for the purposes of ascertaining the minimum equity/equity lock-in requirements specified above, the effective holding of Bidder A in RAGHANESDA RE TRANSMISSION LIMITED shall be fifteen percent (15%), (i.e.,  $30\% \times 50\%$ )

19.1.5 The provisions as contained in this Article 19.1 shall override the terms of the consortium agreement submitted as part of the Bid.

19.1.6 The TSP shall be responsible to report to Nodal Agency, within thirty (30) days from the occurrence of any event that would result in any change in its equity holding structure from that which existed as on the date of signing of the Share Purchase Agreement. In such cases, the Nodal Agency would reserve the right to ascertain the equity holding structure and to call for all such required documents / information / clarifications as may be required.

**19.2 Commitment of maintaining Qualification Requirement**

19.2.1 The Selected Bidder will be required to continue to maintain compliance with the Qualification Requirements, as stipulated in RFP Document, till the COD of the Project. Where the Technically Evaluated Entity and/or the Financially Evaluated Entity is not the Bidding Company or a Member in a Bidding Consortium, as the case may be, the Bidding Company or Member shall continue to be an Affiliate of the Technically Evaluated Entity and/or Financially Evaluated Entity till the COD of the Project.

19.2.2 Failure to comply with the aforesaid provisions shall be dealt in the same manner as TSP's Event of Default as under Article 13 of this Agreement.

**19.3 Language:**

19.3.1 All agreements, correspondence and communications between the Parties relating to this Agreement and all other documentation to be prepared and supplied under the Agreement shall be written in English, and the Agreement shall be construed and interpreted in accordance with English language.

19.3.2 If any of the agreements, correspondence, communications or documents are prepared in any language other than English, the English translation of such agreements, correspondence, communications or documents shall prevail in matters of interpretation.

**19.4 Affirmation**

The TSP and the Nodal Agency, each affirm that:



*Jha*  
Central Transmission Utility of India Limited

63

Raghanesda RE Transmission Limited



494

## Transmission Service Agreement

1. neither it nor its respective directors, employees, or agents has paid or undertaken to pay or shall in the future pay any unlawful commission, bribe, pay-off or kick-back; and
2. it has not in any other manner paid any sums, whether in Indian currency or foreign currency and whether in India or abroad to the other Party to procure this Agreement, and the TSP and the Nodal Agency hereby undertake not to engage in any similar acts during the Term of Agreement.

### 19.5 Severability

The invalidity or enforceability, for any reason, of any part of this Agreement shall not prejudice or affect the validity or enforceability of the remainder of this Agreement, unless the part held invalid or unenforceable is fundamental to this Agreement.

### 19.6 Counterparts

This Agreement may be executed in one or more counterparts, each of which shall be deemed an original and all of which collectively shall be deemed one and the same Agreement.

### 19.7 Breach of Obligations/ Roles

The Parties acknowledge that a breach of any of the obligations/ roles contained herein would result in injuries. The Parties further acknowledge that the amount of the liquidated damages or the method of calculating the liquidated damages specified in this Agreement is a genuine and reasonable pre-estimate of the damages that may be suffered by the non-defaulting Party in each case specified under this Agreement

### 19.8 Restriction of Shareholders / Owners Liability

19.8.1 Parties expressly agree and acknowledge that none of the shareholders of the Parties hereto shall be liable to the other Parties for any of the contractual obligations of the concerned Party under this Agreement.

19.8.2 Further, the financial liabilities of the shareholder(s) of each Party to this Agreement shall be restricted to the extent provided in the Indian Companies Act, 1956 / Companies Act, 2013 (as the case may be).

### 19.9 Taxes and Duties:

19.9.1 The TSP shall bear and promptly pay all statutory taxes, duties, levies and cess, assessed/levied on the TSP, its Contractors or their employees that are required to be paid by the TSP as per the Law in relation to the execution of the Project and for providing Transmission Service as per the terms of this Agreement.



Central Transmission Utility of India Limited

64



Raghnesda RE Transmission Limited

495

Transmission Service Agreement

19.9.2 The Nodal Agency shall be indemnified and held harmless by the TSP against any claims that may be made against the Nodal Agency in relation to the matters set out in Article 19.9.1.

19.9.3 The Nodal Agency shall not be liable for any payment of, taxes, duties, levies, cess whatsoever for discharging any obligation of the TSP by the Nodal Agency on behalf of TSP or its personnel, provided the TSP has consented in writing to the Nodal Agency for such work, for which consent shall not be unreasonably withheld.

**19.10 No Consequential or indirect Losses**

The liability of the TSP shall be limited to that explicitly provided in this Agreement.

Provided that, notwithstanding anything contained in this Agreement, under no event shall the Nodal Agency or the TSP claim from one another any indirect or consequential losses or damages.

**19.11 Discretion:**

Except where this Agreement expressly requires a Party to act fairly or reasonably, a Party may exercise any discretion given to it under this Agreement in any way it deems fit.

**19.12 Confidentiality**

19.12.1 The Parties undertake to hold in confidence this Agreement and RFP Project Documents and not to disclose the terms and conditions of the transaction contemplated hereby to third parties, except:

- (a) to their professional advisors;
  - (b) to their officers, contractors, employees, agents or representatives, financiers, who need to have access to such information for the proper performance of their activities; or
  - (c) disclosures required under Law,
- without the prior written consent of the other Parties.

Provided that, the TSP agrees and acknowledges that the Nodal Agency, may, at any time, disclose the terms and conditions of the Agreement and the RFP Project Documents to any person, to the extent stipulated under the Law and the Competitive Bidding Guidelines.

**19.13 Order of priority in application:**

Save as provided in Article 2.5, in case of inconsistencies between the terms and conditions stipulated in Transmission License issued by the Commission to the TSP, agreement(s) executed between the Parties, applicable LAW including rules and



Central Transmission Utility of India Limited

65

Raghamesha RE Transmission Limited



496

## Transmission Service Agreement

regulations framed thereunder, the order of priority as between them shall be the order in which they are placed below:

- terms and conditions of Transmission License;
- applicable Law, rules and regulations framed thereunder;
- this Agreement;
- Agreement(s), if any, under Sharing Regulations.

### 19.14 Independent Entity:

19.14.1 The TSP shall be an independent entity performing its obligations pursuant to the Agreement.

19.14.2 Subject to the provisions of the Agreement, the TSP shall be solely responsible for the manner in which its obligations under this Agreement are to be performed. All employees and representatives of the TSP or Contractors engaged by the TSP in connection with the performance of the Agreement shall be under the complete control of the TSP and shall not be deemed to be employees, representatives, Contractors of the Nodal Agency and nothing contained in the Agreement or in any agreement or contract awarded by the TSP shall be construed to create any contractual relationship between any such employees, representatives or Contractors and the Nodal Agency.

### 19.15 Amendments:

19.15.1 This Agreement may only be amended or supplemented by a written agreement between the Parties.

### 19.16 Waiver:


19.16.1 No waiver by either Party of any default or breach by the other Party in the performance of any of the provisions of this Agreement shall be effective unless in writing duly executed by an authorised representative of such Party.

19.16.2 Neither the failure by either Party to insist on any occasion upon the performance of the terms, conditions and provisions of this Agreement nor time or other indulgence granted by one Party to the other Parties shall act as a waiver of such breach or acceptance of any variation or the relinquishment of any such right or any other right under this Agreement, which shall remain in full force and effect.

### 19.17 Relationship of the Parties:

This Agreement shall not be interpreted or construed to create an association, joint venture, or partnership or agency or any such other relationship between the Parties or to impose any partnership obligation or liability upon either Party and neither Party shall have any right, power or authority to enter into any agreement or



  
Central Transmission Utility of India Limited

66

  
Raghnesda RE Transmission Limited



492

Transmission Service Agreement

undertaking for, or act on behalf of, or to act as or be an agent or representative of, or to otherwise bind, the other Party.

**19.18 Entirety:**

19.18.1 This Agreement along with its sections, schedules and appendices is intended by the Parties as the final expression of their agreement and is intended also as a complete and exclusive statement of the terms of their agreement.

19.18.2 Except as provided in this Agreement, all prior written or oral understandings, offers or other communications of every kind pertaining to this Agreement or the provision of Transmission Service under this Agreement to the Nodal Agency by the TSP shall stand superseded and abrogated.

**19.19 Notices:**

19.19.1 All notices or other communications which are required to be given under this Agreement shall be in writing and in the English language

19.19.2 If to the TSP, all notices or communications must be delivered personally or by registered post or facsimile or any other mode duly acknowledged to the addressee below:


Address : DRAIPL, 2<sup>nd</sup> Floor, IncusPaze, PLOT 13,  
Attention : PHASE-9, UDYOG VIHAR, SEC 18, GURUGRAM  
HARYANA - 122015  
Email : Mr. AMIT KUMAR  
Fax. No. : kumar.Amit@Draipl.com  
Telephone No. : 9717196796

19.19.3 If to the Nodal Agency, all notices or communications must be delivered personally or by registered post or facsimile or any other mode duly acknowledged to the addresses below:

**(i) Central Transmission Utility of India Limited (Nodal Agency)**

Address : 5th to 10th Floor, IRCON International Tower,  
Tower no-1, Plot no-16, Sector-32, Gurugram,  
Haryana: 122003  
Attention : Ramachandra, Sr GM  
Email : ramachand@powergrid.in  
Fax. No. :  
Telephone No. : 9910378128



  
Central Transmission Utility of India Limited

67

Raghanesda RE Transmission Limited



492

**Transmission Service Agreement**

**19.19.4** All notices or communications given by facsimile shall be confirmed by sending a copy of the same via post office in an envelope properly addressed to the appropriate Party for delivery by registered mail. All notices shall be deemed validly delivered upon receipt evidenced by an acknowledgement of the recipient, unless the Party delivering the notice can prove in case of delivery through the registered post that the recipient refused to acknowledge the receipt of the notice despite efforts of the postal authorities.

**19.19.5** Any Party may by notice of at least fifteen (15) days to the other Party change the address and/or addresses to which such notices and communications to it are to be delivered or mailed.

**19.20 Fraudulent and Corrupt Practices**

**19.20.1** The TSP and its respective officers, employees, agents and advisers shall observe the highest standard of ethics during the subsistence of this Agreement. Notwithstanding anything to the contrary contained in the Agreement, the Nodal Agency may terminate the Agreement without being liable in any manner whatsoever to the TSP, if it determines that the TSP has, directly or indirectly or through an agent, engaged in corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice in the Bid process. In such an event, the Nodal Agency shall forfeit the Contract Performance Guarantee of the TSP, without prejudice to any other right or remedy that may be available to the Nodal Agency hereunder or subsistence otherwise.

**19.20.2** Without prejudice to the rights of the Nodal Agency under Clause 19.20.1 hereinabove and the rights and remedies which the Nodal Agency may have under this Agreement, if a TSP is found by the Nodal Agency to have directly or indirectly or through an agent, engaged or indulged in any corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice during the Bid process, or after the issue of Letter of Intent (hereinafter referred to as Lol) or after the execution of the agreement(s) required under Sharing Regulations, the Nodal Agency may terminate the Agreement without being liable in any manner whatsoever to the TSP. Further, the TSP & its Affiliates shall not be eligible to participate in any tender or RFP issued by any BPC for an indefinite period from the date such TSP is found by the Nodal Agency to have directly or indirectly or through an agent, engaged or indulged in any corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practices, as the case may be.

**19.20.3** For the purposes of this Clause 19.20, the following terms shall have the meaning hereinafter respectively assigned to them:

(a) "corrupt practice" means (i) the offering, giving, receiving, or soliciting, directly or indirectly, of anything of value to influence the actions of any person connected



*Signature*  
Central Transmission Utility of India Limited

68

*Signature*  
Raghnesda RE Transmission Limited



499

## Transmission Service Agreement

with the Bid process (for avoidance of doubt, offering of employment to or employing or engaging in any manner whatsoever, directly or indirectly, any official of the BPC who is or has been associated or dealt in any manner, directly or indirectly with the Bid process or the Lol or has dealt with matters concerning the RFP Project Documents or arising there from, before or after the execution thereof, at any time prior to the expiry of one year from the date such official resigns or retires from or otherwise ceases to be in the service of the BPC, shall be deemed to constitute influencing the actions of a person connected with the Bid Process); or (ii) engaging in any manner whatsoever, whether during the Bid Process or after the issue of the Lol or after the execution of the RFP Project Documents, as the case may be, any person in respect of any matter relating to the Project or the Lol or the RFP Project Documents, who at any time has been or is a legal, financial or technical adviser of the BPC in relation to any matter concerning the Project;

(b) "fraudulent practice" means a misrepresentation or omission of facts or suppression of facts or disclosure of incomplete facts, in order to influence the Bid process;

(c) "coercive practice" means impairing or harming, or threatening to impair or harm, directly or indirectly, any person or property to influence any person's participation or action in the Bid process;

(d) "undesirable practice" means (i) establishing contact with any person connected with or employed or engaged by the BPC with the objective of canvassing, lobbying or in any manner influencing or attempting to influence the Bid process; or (ii) having a Conflict of Interest; and

(e) "restrictive practice" means forming a cartel or arriving at any understanding or arrangement among Bidders with the objective of restricting or manipulating a full and fair competition in the Bid process;

### 19.21 Compliance with Law:

Despite anything contained in this Agreement but without prejudice to Article 12, if any provision of this Agreement shall be in deviation or inconsistent with or repugnant to the provisions contained in the Electricity Act, 2003, or any rules and regulations made there under, such provision shall be deemed to be amended to the extent required to bring it into compliance with the aforesaid relevant provisions as amended from time to time.



Central Transmission Utility of India Limited

69




Raghnesda RE Transmission Limited



Transmission Service Agreement


IN WITNESS WHEREOF, THE PARTIES HAVE CAUSED THIS AGREEMENT TO BE EXECUTED BY THEIR DULY AUTHORISED REPRESENTATIVES AS OF THE DATE AND PLACE SET FORTH ABOVE.

1. For and on behalf of TSP

 Amit Kumar, Sr VP  
.....

[Signature, Name, Designation and Address]

2. For and on behalf of Central Transmission Utility of India Limited (Nodal Agency)



**KAMAL KUMAR JAIN**  
Senior General Manager

.....  
केन्द्रीय प्रसारण उपयोगिता लिमिटेड  
CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED  
(एक निरुद्ध संश्लेषण और इलेक्ट्रिसिटी लिमिटेड की पूर्ण स्वामित्व कंपनी)  
(A wholly owned subsidiary of POWERGRID)  
5th Floor, ITC International Tower-1, Plot No.-18, Sector-32, Gurgaon-122004

[Signature, Name, Designation and Address]

WITNESSES:

1. For and on behalf of

: BPC

  
.....  
[Signature]

..... Navendu Prangat, GM, P.F.C.L.  
.....

[Insert, Name, Designation and Address of the Witness]

2. For and on behalf of

: Nodal Agency

  
.....  
**DEEPAK KRISHNAN**  
Chief Manager  
[Signature] .....  
केन्द्रीय प्रसारण उपयोगिता लिमिटेड  
CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED  
(एक निरुद्ध संश्लेषण और इलेक्ट्रिसिटी लिमिटेड की पूर्ण स्वामित्व कंपनी)  
(A wholly owned subsidiary of POWERGRID)  
5th Floor, ITC International Tower-1, Plot No.-18, Sector-32, Gurgaon

[Insert Name, Designation and Address of the Witness]

  
Central Transmission Utility of India Limited

  
  
Raghnesda RE Transmission Limited  


Transmission Service Agreement

KAMAL KUMAR JAIN  
SPECIAL AGENT  
CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED  
NEW DELHI

# SCHEDULES

DEEPAK KRISHNAN  
Chief Manager  
CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED  
NEW DELHI



Central Transmission Utility of India Limited



71 Raghnesda RE Transmission Limited



**Schedule: 1**

**Project Description and Scope of Project**

**A. Description of the Transmission Scheme**

Govt. of India has set a target for establishing 500 GW capacity from non-fossil energy sources by 2030. In this direction, various RE Potential zones have been identified and declared in Gujarat. Raghnesda area of Gujarat is one among the identified zones with a RE potential of more than 5GW.

For evacuation of 3 GW capacity from Raghnesda region in Banaskantha district of Gujarat, the scheme "Transmission System for evacuation of RE power from Raghnesda area of Gujarat- 3 GW under Phase-I" was recommended under TBCB with PFCCIL as BPC in the 20th meeting of NCT held on 25.06.24 with an estimated cost of ₹1855 Crore and implementation time frame of 30 months from the date of SPV transfer.

The scope of the scheme includes Establishment of 765/400 kV Raghnesda (GIS) S/s along with 3x1500 MVA 765/400 kV ICTs & Raghnesda (GIS) – Banaskantha (PG) 765 kV D/c line. At the time of scheme conceptualization, 4 Nos. 400 kV bays were kept for RE injection directly at 400 kV level of Raghnesda (GIS) S/s.

Further, in order to accommodate cumulative capacity of 650 MW at 220 kV level of Raghnesda PS (out of the 3500 MW which can be evacuated on Ph-I system) as well as additional capacity for about 500 MW (beyond 3000 MW), augmentation of Transformation Capacity at Raghnesda PS by 1x1500 MVA, 765/400 kV ICT (4th) is required. Accordingly, transmission scheme "Network Expansion in Gujarat for RE interconnection at Raghnesda PS" which includes Installation of 1x1500 MVA, 765/400 kV ICT (4th) at Raghnesda PS (Sec-I), Creation of 220 kV switchyard (Bus Sec-I) at Raghnesda PS (GIS) along with installation of 2x500 MVA, 400/220 kV ICTs, and 2 Nos. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) was deliberated & agreed in 26th NCT meeting held on 06.01.2025. The subject two schemes were deliberated in 26th NCT meeting held on 06.01.2025, wherein, it was recommended that the above augmentation scheme may be added to the transmission scheme under bidding viz. "Transmission System for evacuation of RE power from Raghnesda area of Gujarat- 3 GW under Phase-I" with modified implementation timeframe.

Central Transmission Utility of India Limited

72

Raghnesda RE Transmission Limited



Transmission Service Agreement


B. Detailed Scope of Work

Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I		
S No.	Name of Transmission Element	Scheduled COD from Effective Date
1.	<p>Establishment 4x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVA, 765 kV bus reactor and 2x125 MVA, 420 kV bus reactor</p> <ul style="list-style-type: none"> <li>• 765/400 kV, 1500 MVA ICT – 4 Nos. (13x500 MVA single phase units including one spare ICT Unit)</li> <li>• 765 kV ICT bays – 4 Nos.</li> <li>• 400 kV ICT bays – 4 Nos.</li> <li>• 765 kV Line bays – 2 Nos.</li> <li>• 1x330 MVA, 765 kV bus reactor- 2 Nos. (7x110 MVA single phase Reactors including one spare Unit for bus /line reactor)</li> <li>• 765 kV Bus reactor bay – 2 Nos.</li> <li>• 125 MVA, 420 kV reactor- 2 Nos.</li> <li>• 400 kV Reactor bay- 2 Nos.</li> <li>• 400 kV line bays - 4 Nos. (for interconnection of RE Projects)</li> </ul> <p><b>Future Scope (Space for):</b></p> <ul style="list-style-type: none"> <li>• 765/400 kV ICT along with bays- 4 Nos. (on Sec-II)</li> <li>• 765 kV line bays along with switchable line reactors – 8 Nos. (4 Nos. on Sec-I and 4 Nos. on Sec-II)</li> <li>• 765 kV Bus Reactor along with bay: 2 Nos. (on Sec-II)</li> <li>• 765 kV Sectionalizer: 1 -set</li> <li>• 400 kV line bays along with switchable line reactors– 12 Nos. (4 Nos. on Sec-I and 8 Nos. on Sec-II)</li> <li>• 400/220 kV ICT along with bays - 6 Nos. (2 Nos. on Sec-I &amp; 4 Nos. on Sec-II) (in addn. to 2 Nos. 400/220 ICTs on Sec-I in present scope)</li> <li>• 400 kV Bus Reactor along with bays: 2 Nos. (Sec-II)</li> <li>• 400 kV Sectionalization bay: 1- set</li> <li>• 220 kV line bays: 10 Nos. (4 Nos. on Section-I and 6 Nos. on Section-II) (in addition to 2 Nos. 220 kV bays on Section-I)</li> </ul>	27 Months (23.10.2027)

Central Transmission Utility of India Limited

73

Raghnesda RE Transmission Limited



Transmission Service Agreement

Transmission system for evacuation of RE power from Raghnesda Area of Gujarat-3GW under Phase-I		
S No.	Name of Transmission Element	Scheduled COD from Effective Date
	<p>present scope)</p> <ul style="list-style-type: none"> <li>• 220 kV Sectionalization bay: 1 set</li> <li>• 220 kV BC: 1 No. (For Section-II)</li> <li>• Establishment of 6000 MW, ± 800 kV Raghnesda (HVDC) [LCC] terminal station (4x1500 MW) along with associated interconnections with 400 kV HVAC Switchyard and all associated equipment (incl. filters)/bus extension, etc.</li> </ul>	
2.	Raghnesda (GIS) – Banaskantha (PG) 765 kV D/c line	
3.	<p>2 Nos. 765 kV line bays at Banaskantha (PG) S/s</p> <ul style="list-style-type: none"> <li>• 765 kV line bays – 2 Nos.</li> </ul>	
4.	<p>Creation of 220kV switchyard (Bus Sec-I) at Raghnesda PS (GIS) along with installation of 2x500MVA, 400/220 kV ICTs</p> <ul style="list-style-type: none"> <li>• 500MVA, 400/220kV ICT – 2 Nos.</li> <li>• 400kV ICT bay – 2 Nos.</li> <li>• 220kV ICT bay – 2 Nos.</li> <li>• 220kV BC – 1 No.</li> </ul>	30.09.2027 (subject to minimum 27 Months)
5.	<p>1 no. 220kV line bay (GIS) (on 220kV Bus Sec-I) for interconnection of Solar project of Azure Power Sixty Three Pvt. Ltd. (2200001107) (300MW)</p> <ul style="list-style-type: none"> <li>• 220kV line bay–1 no.</li> </ul>	
6.	<p>1 no. 220kV line bay (GIS) (on 220kV Bus Sec-I) for interconnection of Solar project of Sunsure Solarpark RJ One Pvt. Ltd. (2200001018) (350MW)</p> <ul style="list-style-type: none"> <li>• 220kV line bay–1 no.</li> </ul>	31.03.2028

**Note:**

- TSP of Banaskantha S/s (POWERGRID) shall provide space for scope at Sl. 3 above.
- Bay(s) required for completion of diameter (GIS) in one-and-half breaker scheme shall also be executed by the TSP.

Central Transmission Utility of India Limited

74

Raghnesda RE Transmission Limited



505

Transmission Service Agreement


**SPECIFIC TECHNICAL REQUIREMENTS FOR TRANSMISSION LINE**

The design, routing and construction of transmission lines shall be in accordance with Chapter V, Part-A of CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022, as amended from time to time. Other CEA Regulations and MoP guidelines, as applicable, shall also be followed.

- A.1.0 Selection of tower type shall be made as per CEA Regulations, however in case lattice type towers are used, the following shall also be applicable:
- A.2.0 Steel section of grade E 250 and/or grade E 350 as per IS 2062, only are permitted for use in towers, extensions, gantry structures and stub setting templates. For towers in snowbound areas, steel sections shall conform to Grade-C of IS-2062.
- A.3.0 Towers shall be designed as per IS-802:2015, however the drag coefficient of the tower shall be as follows: -

Solidity Ratio	Drag Coefficient
Up to 0.05	3.6
0.1	3.4
0.2	2.9
0.3	2.5
0.4	2.2
0.5 and above	2.0

- A.4.0 Transmission Service Provider (TSP) shall adopt any additional loading/design criteria for ensuring reliability of the line, if so desired and /or deemed necessary.
- A.5.0 Transmission line shall be designed considering wind zones as specified in wind map given in National Building Code 2016, Vol.1. The developer shall also make his own assessment of local wind conditions and frequent occurrences of high intensity winds (HIW) due to thunderstorms, dust-storms, downburst etc. along the line route and wherever required, higher wind zone than that given in wind map shall be considered for tower design for ensuring reliability of line. Further, for transmission line sections passing within a distance of 50 km from the boundary of two wind zones, higher of the two wind zones shall be considered for design of towers located in such sections.
- A.6.0 Selection of reliability level for design of tower shall be as per CEA Regulation (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022, as amended from time to time.

  
Central Transmission Utility of India Limited

75

  
Raghamesda RE Transmission Limited



**Transmission Service Agreement**

- A.7.0**
- A) Under crossing of the existing transmission line of same Voltage shall not be allowed. In the case where it is inevitable to under-cross the existing transmission line then TSP shall seek prior approval from Chief Electrical Inspector, CEA with detailed study ensuring that all statutory electrical clearances and Electric Field limit of 10 kV/m at 1 m and 1.8 m from ground level is not violated.
- B) For power line crossing of 400 kV or above voltage level, large angle and dead end towers (i.e. D/DD/QD) shall be used on either side of power line crossing.
- C) For power line crossing of 132 kV and 220 kV (or 230 kV) voltage level, angle towers (B/C/D/DB/DC/DD/ QB/QC/QD) shall be used on either side of power line crossing depending upon the merit of the prevailing site condition and line deviation requirement. For crossing of railways, national highways and state highways, the rules/regulations of appropriate authorities shall be followed.
- D) For power line crossing of 66 kV and below voltage level, suspension/tension towers shall be provided on either side of power line crossing depending upon the merit of the prevailing site condition and line deviation requirement.
- E) For crossing of railways, national highways and state highways, the rules/ regulations of appropriate authorities shall be followed.

**A.8.0** The relevant conductor configuration shall be as follows: -

Name of line: **Raghnesda (GIS) – Banaskantha (PG) 765 kV D/c line**

Type of conductor: **ACSR / AAAC / AL59**

Basic parameters:

Transmission line	ACSR Conductor specified	Equivalent AAAC conductor based on 53.5 % conductivity of Al Alloy	Equivalent minimum size of AL59 conductor based on 59% conductivity of AL Alloy*	Sub-conductor Spacing
765 kV D/C (Hexa Bundle) Transmissio	Zebra : Stranding 54/3.18 mm-Al + 7/3.18 mm-	Stranding details: 61/3.19 mm,	Stranding details: 61/3.08 mm,	

Central Transmission Utility of India Limited

76

Raghnesda RE Transmission Limited



**Transmission Service Agreement**

<b>Transmission line</b>	<b>ACSR Conductor specified</b>	<b>Equivalent AAAC conductor based on 53.5 % conductivity of Al Alloy</b>	<b>Equivalent minimum size of AL59 conductor based on 59% conductivity of AL Alloy*</b>	<b>Sub-conductor Spacing</b>
n Lines	Steel, 428 mm <sup>2</sup> , Aluminium area,  28.62 mm diameter  Maximum DC Resistance at 20°C (Ω/km): 0.06868  Minimum UTS: 130.32 kN	487.5 mm <sup>2</sup> Aluminium alloy area 28.71 mm diameter  Maximum DC Resistance at 20°C (Ω/km): 0.06815  Minimum UTS: 135.6 kN	454 mm <sup>2</sup> Aluminium alloy area 27.72 mm diameter  Maximum DC Resistance at 20°C (Ω/km): 0.0653  Minimum UTS: 108 kN	457 mm

Note:

- \*To select any size above the minimum, the sizes mentioned in the Indian standard IS-398 (part-6) shall be followed.*
- The transmission lines shall have to be designed for a maximum operating conductor temperature of 85 °C.*

**A.9.0** The required phase to phase spacing and horizontal spacing for 765 kV line shall be governed by the tower design as well as minimum live metal clearances for 765 kV voltage level under different insulator swing angles. However, the phase to phase spacing for 765 kV line shall not be less than 15 m.

**A.10.0** All electrical clearances including minimum live metal clearance, ground clearance and minimum mid span separation between earth wire and conductor as given below shall be considered.

- Minimum live metal clearances for 765 kV line:

*ghm*  
Central Transmission Utility of India Limited

77



Raghnesda Transmission Limited



*508*

Transmission Service Agreement

a) (i) Under stationary conditions:

From tower body: For 765 kV D/C: 6.1 m

For 765 kV S/C: 5.6 m

(ii) Under Swing conditions

Wind Pressure Condition	Minimum Electrical Clearance
a) Swing angle (25°)	4.4 m
b) Swing angle (55°)	1.3 m

b) Minimum ground clearance for 765 kV line: 18 m

c) Minimum mid span separation between earth wire and conductor for 765 kV line:  
9.0 m

A.11.0 Shielding angle shall not exceed 10 deg for 765 kV D/C transmission line.


A.12.0 The Fault current for design of line shall be 50 kA for 1 sec for 765 kV.

A.13.0 In case of 400 kV voltage class lines, at least one out of two earth wires shall be OPGW and second earth wire, if not OPGW, shall be either of galvanized stranded steel (GSS) or Aluminum Alloy Conductor Steel Reinforced (AACSR) conductor type or any other suitable conductor type depending upon span length and other technical consideration.


A.14.0 Each tower shall be earthed such that tower footing impedance does not exceed 10 ohms. Pipe type or Counterpoise type earthing shall be provided in accordance with relevant IS. Additional earthing shall be provided on every 7 to 8 kms distance for direct earthing of both shield wires. If site condition demands, multiple earthing or use of earthing enhancement compound shall be used.

A.15.0 Pile type foundation shall be used for towers located in river or creek bed or on bank of river having scourable strata or in areas where river flow or change in river course is anticipated, based on detailed soil investigation and previous years' maximum flood discharge of the river, maximum velocity of water, highest flood level, scour depth and anticipated change in course of river based on river morphology data of at least past 20 years to ensure availability and reliability of the transmission line.

A.16.0 Transmission line route shall be finalized, in consultation with appropriate authorities so as to avoid the habitant zones of endangered species and other protected species.

  
Central Transmission Utility of India Limited

78

  
Raghavendra Transmission Limited



509

**Transmission Service Agreement**


Bird diverters, wherever required, shall be provided on the line. In order to optimize the route, use of GATISHAKTI platform shall also be made.

**A.17.0** Wherever, transmission lines are passing through cyclone prone areas i.e. areas up to 60 km from coast following shall also be applicable:

- a) Terrain category-I, with terrain roughness factor (K2) of 1.08 shall be considered for tower design for exposed open terrain with few or no obstruction which also includes open sea coasts, open stretch of water, desert and flat treeless plains.
- b) Importance factor for cyclonic region (K4) of 1.3 shall be considered for tower design.
- c) The number of consecutive spans between the section points/ angle point shall not exceed 10 spans or 3 km instead of conventional practice of 15 spans or 5 km, in order to reduce the failure of such towers in coastal areas due to cascading effect. The section shall be terminated with tension tower/ angle tower and angle of deviation should be based on the site requirement.

**A.18.0** Wherever, transmission lines are passing through cyclone prone areas (i.e. areas up to 60 km from coast)/ creek regions/ aggressive soil areas following shall also be applicable:

- a) The fabricated tower parts and stubs shall have a minimum overall zinc coating of 900 g/m<sup>2</sup> of surface area except for plates and sections below 5 mm which shall have a minimum overall zinc coating of 610 g/m<sup>2</sup> of surface area. The average zinc coating for all sections and plates 5 mm and above shall be maintained as 127 microns and that for plates and sections below 5 mm shall be maintained as 87 microns.
- b) Ready mix concrete of M30 Grade shall be used to avoid use of locally available saline water. However, design mix concrete of M30 Grade conforming to IS 456 with potable water can be used at locations where transportation of ready-mix concrete is not feasible. Minimum cement content in any case shall not be less than 330 kg/m<sup>3</sup>.
- c) The surface of the reinforced steel shall be treated with epoxy-based coating to enhance corrosion performance of foundation. Use of epoxy coated reinforcement in foundation shall be as per IS 13620. In addition, two (2) coats of bituminous painting of minimum 1.6 kg/m<sup>2</sup> per coat shall be applied on all

  
Central Transmission Utility of India Limited

79

  
Raghavendra R.K. Transmission Limited



**Transmission Service Agreement**

exposed faces of foundation (i.e. pedestal and base slab).

- d) Double coat of 20 mm thick cement plaster shall be provided on all exposed concrete surface as well up to 300 mm below ground level to give protection to concrete surface from environmental and saline effect.
- e) Before coping of chimney top portion, three coats of anti-corrosive paint of minimum 30-35 microns dry film thickness each shall be applied on the stub in the 50 mm coping portion as well as up to 350 mm above CL portion.

A.19.0 The raised chimney foundation is to be provided in areas prone to flooding/water stagnation like paddy field /agricultural field and undulated areas to avoid direct contact of water with steel part of tower. The top of the chimney of foundation should be at least above HFL (High Flood Level) or the historical water stagnation/ logging level (based on locally available data) or above High Tide Level or 500 mm above Natural Ground level (whichever is higher).


A.20.0 Routing of transmission line through protected areas of India shall be avoided to the extent possible. In case, it is not possible to avoid protected areas, the towers of the transmission line up to 400 kV level which are installed in protected areas shall be designed for Multi-circuit (4 circuits) configuration of same voltage level considering reliability level of at least two (2). The top two circuits of these multi-circuit towers shall be used for stringing of the transmission line under present scope and the bottom two circuits shall be made available for stringing of any future transmission line of any transmission service providers/ State transmission utilities/Central transmission utilities passing through the same protected area. Further, the configuration and coordinates of such transmission towers shall be submitted to CEA, CTU and BPC by the TSP.

A.21.0 The TSP shall abide by the Guidelines of CEA w.r.t. shifting of transmission lines for NHA/ projects and other projects.

A.22.0 Safety precautions in regards to gas/oil pipe lines in vicinity of Transmission lines shall be taken in coordination with gas/ petroleum authorities.

A.23.0 The stringing of the transmission line in forest area shall be carried out through drone.

A.24.0 RoW width and Span in different terrain shall be as per Schedule VII of CEA (Technical Standards for Construction of Electrical plants and Electric Lines) Regulations 2022 and RoW guidelines issued vide CEA-PS-14-86/2/2019-PSEAD Division dated 24.09.2024.

  
Central Transmission Utility of India Limited

80

  
Raghavendra Transmission Limited



**Transmission Service Agreement**

**SPECIFIC TECHNICAL REQUIREMENTS FOR SUBSTATION**

The proposed 765/400 kV Raghnesda S/s shall be Gas Insulated Switchgear (GIS) type conforming to the requirements of CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022, as amended from time to time.

The extension of 765/400 kV Banaskantha S/s shall be conventional Air Insulated Switchgear (AIS) type conforming to the requirements of CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations, 2022, as amended from time to time.

Other CEA Regulations/guidelines as amended up to date and MoP guidelines, as applicable, shall also be followed.

**B.1.0 Salient features of Substation Equipment and Facilities**

The design and specification of substation equipment are to be governed by the following factors:

**B.1.1 Insulation Coordination**

The system design parameters for substations/switchyards shall be as given below:

Sl. No.	Description of parameters	765/400 kV Raghnesda S/s (GIS)			765/400 kV Banaskantha S/s Extn.
		765 kV System	400 kV System	220 kV System	765 kV System
1.	System operating voltage	765 kV	400 kV	220 kV	765 kV
2.	Maximum voltage of the system (rms)	800 kV	420 kV	245 kV	800 kV
3.	Rated frequency	50 Hz	50 Hz	50 Hz	50 Hz
4.	No. of phases	3	3	3	3
5.	Rated Insulation levels				
i)	Lightning Impulse withstand voltage for (1.2/50 micro sec.)	2100 kVp 2100 kVp	1425 kVp 1550 kVp	1050 kVp 1050 kVp	2100 kVp 2100 kVp


*S/n*  
Central Transmission Utility of India Limited

Raghnesda RE Transmission Limited  
NEW DELHI



**Transmission Service Agreement**

Sl. No.	Description of parameters	765/400 kV Raghnesda S/s (GIS)			765/400 kV Banaskantha S/s Extn.
		765 kV System	400 kV System	220 kV System	765 kV System
	- for Equipment other than Transformer and reactor for Insulator String				
ii)	Switching impulse withstand voltage (250/2500 micro sec.) dry and wet	1425 kVp (for GIS) 1550 kVp (for AIS)	1050 kVp		1550 kVp
iii)	One minute power frequency dry withstand voltage (rms)	960 kV (for GIS) 830 kV (for AIS)	650 kV (for GIS) 630 kV (for AIS)		830 kV
iv)	One minute power frequency dry and wet withstand voltage (rms)			460 kV	
6.	Corona extinction voltage	508 kV	320 kV		508 kV
7.	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz	2500 micro-volt at 508 kV rms	1000 micro-volt at 266 kV rms	1000 micro-volts at 156 kV rms	2500 micro-volts at 508 kV rms
8.	Minimum creepage distance for insulator string/ longrod insulators/ outdoor bushings	24800 mm (31 mm/kV)	13020 mm (31 mm/kV)	7595 mm (31mm/kV)	24800 mm (31 mm/kV)

  
 Central Transmission Utility of India Limited

82

  
 Raghnesda RE Transmission Limited



5/3



**Transmission Service Agreement**

Sl. No.	Description of parameters	765/400 kV Raghanesda S/s (GIS)			765/400 kV Banaskantha S/s Extn.
		765 kV System	400 kV System	220 kV System	765 kV System
9.	Minimum creepage distance for switchyard equipment	24800 mm (31 mm/ kV)	13020 mm (31 mm/ kV)	7595 mm (31 mm/kV)	20000 mm (25 mm/kV)
10.	Max. fault current	50 kA	63 kA	50 kA	50 kA
11.	Duration of fault	1 sec	1 sec	1 Sec	1 sec


**B.1.2 Switching Scheme**

The switching schemes, as mentioned below, shall be adopted at various voltage levels of substation/switchyard:

Substation	765 kV side	400 kV side	220 kV side
765/400 kV Raghanesda S/s (GIS)	One and Half Breaker	One and Half Breaker	Double Main Scheme
765/400 kV Banaskantha S/s Extn.	One and Half Breaker	--	--

Notes: -

- i) For one and half breaker switching scheme, any double circuit line consisting of two numbers of feeders and originating from the same transmission or generating switchyard shall not be terminated in one diameter.
- ii) Two transformers of the same HV rating shall not be connected in the same diameter and similarly two bus reactors of same HV rating shall also not be connected in the same diameter.
- iii) A diameter in one and half breaker scheme is a set of 3 circuit breakers with associated isolators, earth switches, current transformers etc. for controlling two (2) numbers of feeders.
- iv) In case of GIS substation where the bus scheme is One and Half breaker scheme, the

  
Central Transmission Utility of India Limited

83

  
Raghanesda RE Transmission Limited



Transmission Service Agreement

diameters shall be complete with feeder/ line side isolator and GIS duct of the future bay shall be brought outside the GIS hall/building with extension/interface module suitably.

v) Connection arrangement of Switchable Line reactors shall be such that it can be used as Line reactor as well as Bus reactor with suitable NGR bypass arrangement. Further, Spare 1-phase Shunt Reactor unit shall be placed and connected in such a way that the spare unit can be utilized for all the bus and switchable line reactor banks (including future reactor banks) without its physical movement.

vi) Space provision for 765 kV and 400 kV future lines shall be kept considering switchable Line reactor for the lines.

vii) Space Provision for Future Bus sectionalizer:

One (1) set of future bus sectionalizer for 765 kV shall comprise two (2) Nos. of bus sectionalizer bays with associated Circuit Breakers, Isolators and Current Transformers for both buses.

One (1) set of future bus sectionalizer for 400 kV shall comprise two (2) Nos. of bus sectionalizer bays with associated Circuit Breakers, Isolators and Current Transformers for both buses.

One (1) set of future bus sectionalizer for 220 kV shall comprise two (2) Nos. of bus sectionalizer bays with associated Circuit Breakers, Isolators and Current Transformers for both buses.


viii) TSP shall plan distribution of line and transformer feeders to bus bar in such a way that all power can be evacuated successfully without crossing thermal limit at any point of bus-bar.

ix) 765/400 kV Raghnesda S/s (GIS)

In line with the above, four (4) Nos. full diameters for 765 kV and six (6) Nos. full diameters for 400 kV shall be provided. Further, 400 kV and 220 kV Line bays shall be complete along with line side equipment (such as LA, CVT, Wave Trap), gantry, protection panel etc. for termination of 400 kV and 220 kV lines for interconnection of RE Projects.

x) 765/400 kV Raghnesda S/s (GIS)

Provision of 765 kV Bus Sectionalization (Future) and space provision shall be with the following feeder distribution.

  
Central Transmission Utility of India Limited

84

Raghnesda RE Transmission Limited



**Transmission Service Agreement**

765 kV Bus Section-1	765 kV Bus Section-2 (Future)
a) 2 Nos. of present 765 kV Line b) 4 Nos. of present 765/400 kV ICT c) 2 Nos. of present 765 kV Bus Reactor d) 4 Nos. of future 765 kV line along with switchable line reactor	a) 4 Nos. of future 765 kV line along with switchable line reactor b) 4 Nos. of future 765/400 kV ICT c) 2 Nos. of future 765 kV Bus Reactor

Provision of 400 kV Bus Sectionalization (Future) and space provision shall be with the following feeder distribution.

400 kV Bus Section-1	400 kV Bus Section-2 (Future)
a) 4 Nos. of present 765/400 kV ICT b) 2 No. of present Bus Reactor c) 4 Nos. of present 400 kV Lines d) 2 Nos. of present 400/220 kV ICT e) 4 Nos. of future 400 kV Line along with switchable line reactor f) 2 Nos. of future 400/220 kV ICT g) 2 Nos. for future interconnection of (2x1500 MW) for 6000 MW, $\pm$ 800 kV Raghnesda (HVDC) [LCC]	a) 4 Nos. of future 765/400 kV ICT b) 4 Nos. of future 400/220 kV ICT c) 8 Nos. of future 400 kV Line along with switchable line reactor d) 2 Nos. of future 400 kV Bus Reactor e) 2 Nos. for future interconnection of (2x1500 MW) for 6000 MW, $\pm$ 800 kV Raghnesda (HVDC) [LCC]

Provision of 220 kV Bus Sectionalization (Future) and space provision shall be with the following feeder distribution.

220 kV Bus Section-1	220 kV Bus Section-2 (Future)
a) 2 Nos. of present 400/220 kV ICT b) 2 Nos. of present 220 kV Line c) 1 No. of present Bus coupler d) 2 Nos. of future 400/220 kV ICT e) 4 Nos. of future 220 kV Line	a) 4 Nos. of future 400/220 kV ICT b) 6 Nos. of future 220 kV Line c) 1 No. of future Bus coupler

**xi) 765 kV Banaskantha Extn:**

Refer attached SLD (Drg. No. C/ENGG/WR-II/BANASKANTHA/SLD/1) and GA drawing (GNB-PGCIL-BNK-ELE-003) of Banaskantha S/s. One circuit of Radhanesda -

Central Transmission Utility of India Limited



**Transmission Service Agreement**

Banaskantha (PG) 765 kV D/C line shall be terminated in new diameter for which Main and Tie bays shall be constructed under present scope. Other circuit of Radhanesda – Banaskantha (PG) 765 kV D/C line shall be terminated in existing diameter for which Main Bay shall be constructed (Tie bay is existing) under present scope. Further, all associated interconnection work shall also be in the present scope of TSP.

**B.2.0 Substation Equipment and facilities (Voltage level as applicable):**

The switchgear shall be designed and specified to withstand operating conditions and duty requirements. All equipment shall be designed considering the following capacity.

Sl. No	Description of bay	765/400 kV Raghnesda S/s (GIS)			765 kV Banaskantha S/s (AIS)
		765 kV	400 kV	220 kV	765 kV
1.	Bus Bar	4000 A	4000 A	3000 A	As per existing
2.	Line bay	3150 A	3150 A	1600 A	3150 A
3.	ICT bay	3150 A	3150 A	1600 A	N/A
4.	Reactor bay	3150 A	3150 A	N/A	N/A
5.	Bus Coupler Bay	N/A	N/A	3000 A	N/A


**B.2.1 Power Transformers**

**B.2.1.1 (765/√3)/(400/√3)/33 kV Single Phase Autotransformer**

500 MVA 765/√3)/(400/√3)/33 kV, 1-phase Autoransformer (including arrangement for 3-phase bank formation of 1500 MVA) shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA website.

Spare transformer (1-phase) unit shall be placed and connected in such a way that in case of fault in any unit of any of the transformer banks (including for future transformer banks) can be replaced by spare unit without physically moving it.

**B.2.1.2 400/220/33 kV, 3-phase Autotransformer**

  
Central Transmission Utility of India Limited

  
Radhanesda RE Transmission Limited



**Transmission Service Agreement**

500 MVA, 400/220/33 kV, 3-phase autotransformer shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA website.

**B.2.2 Shunt Reactors**

**B.2.2.1 (765/ $\sqrt{3}$ ) kV Single Phase Shunt Reactor**

110 MVAR, 765/ $\sqrt{3}$  kV, 1-Phase Reactor (including arrangement for 3-phase bank formation of 330 MVAR) shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA website.

Spare 1-phase Shunt Reactor unit shall be placed and connected in such a way that the spare unit can be utilized for all the bus and switchable line reactor banks (including for future reactor banks) without its physical movement.


**B.2.2.2 420 kV, 3-Phase, Shunt Reactor**

125 MVAR, 420 kV, 3-Phase Reactor shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA website.

**B.2.3 765 kV, 400 kV and 220 kV GIS Substation equipment**

GIS (Gas Insulated Switchgear) shall be Indoor type in accordance to IEC: 62271-203. The switchgear shall be designed and specified to withstand operating conditions and duty requirements. All the switchgear such as Circuit Breaker, isolator, earth switch including CT, PT etc. shall be GIS type. The Surge Arrestor and Voltage Transformer shall be either GIS or outdoor AIS type.

The GIS assembly shall consist of separate modular compartments e.g. Circuit Breaker compartment, Bus bar compartment filled with SF6 Gas and separated by gas tight partitions so as to minimize risk to human life, allow ease of maintenance and limit the effects of gas leaks failures and internal arcs etc. These compartments shall be designed to minimize the risk of damage to adjacent sections and protection of personnel in the event of a failure occurring within the compartments. Rupture diaphragms with suitable deflectors shall be provided to prevent uncontrolled bursting pressures developing within the enclosures under worst operating conditions, thus providing controlled pressure relief in the affected compartment. The arrangement of gas sections or compartments shall be such as to facilitate future expansion of any make without any

  
Central Transmission Utility of India Limited

87



Raghnesda RE Transmission Limited



**Transmission Service Agreement**

drilling, cutting or welding on the existing equipment. To add equipment, it shall not be necessary to move or dislocate the existing switchgear bays. The layout of Gas Insulated Bus Ducts shall be properly planned to optimize the length of bus ducts and for easy accessibility for maintenance. The length of busbars, bus ducts, isolator sections shall be optimized considering effects of fast transient voltage due to isolator operations.

The bus bar modules including auxiliary bus modules (wherever applicable) shall be provided with suitable End Piece (Interface) module on both sides with the test link facility for future extension as per provisions of future requirements. The end piece module shall be designed in such a way so that future GIS modules may be tested without extending test voltage to existing bus and vice-versa by removing the test link.

TSP shall make available the complete details for the design of interface module such as cross section, enclosure material, enclosure dimensions (inner and outer), Flange diameter (inner and outer), conductor cross-section and connection arrangement, bolt spacing and dimension, rated gas pressure, Gasket detail etc. Further, adequate space for GIS busbar interface module shall be taken into account for future scope.

Each section shall have plug-in or easily removable connection pieces to allow for easy replacement of any component with the minimum disturbance to the remainder of the equipment. Inspection windows (View Ports) shall be provided for Disconnectors Switches and both type of earth switches i.e. Maintenance and fast operating.

Local Control Cabinets (LCC) shall be provided as per requirement. The alarm and annunciation of GIS equipment shall be wired to the SCADA System.

The material and thickness of the enclosures shall be such as to withstand an internal flashover without burns through for a period of 300 ms at rated short time withstand current. The material shall be such that it has no effect of environment as well as from the by-products of SF6 breakdown under arcing conditions. This shall be validated with Type Test.

Service continuity requirement for GIS:

The GIS equipment with the given bus switching arrangement shall be divided into different gas compartments. During the work such as a fault repair or major maintenance, requiring the dismantling of a gas compartment for which more than one compartments may need to be de-gassed.

TSP shall meet following Service continuity conditions (to the extent possible) with ensuring equipment and operating personnel's safety:

  
Central Transmission Utility of India Limited

88

  
Raghavendra RE Transmission Limited



## Transmission Service Agreement

- For One and half breaker bus switching scheme, during a fault in Circuit Breaker compartment, no bus bar and feeder is permitted out of service during maintenance and repair/replacement.
- During a fault in a GIS compartment other than the Circuit Breaker compartment, maximum of one bus bar and/or one feeder is permitted out of service during maintenance and repair/replacement.

### UHF sensors in GIS for PD (Partial Discharge) detection:


The adequate number of Ultra High Frequency (UHF) sensors shall be provided in the offered GIS along with suitable portable type Partial Discharge (PD) measuring instrument for detection of Partial discharge (of 5 pC and above as per IEC 60270). The number and location of these sensors shall be based on laboratory tests on the typical design of GIS as per recommendations of CIGRE Document No. 654 (Application Guide for sensitivity verification for UHF Partial discharge detection system for GIS).

#### B.2.3.1 Circuit Breakers (GIS)

GIS Circuit breakers shall in general be of C2-M2 class and comply to IEC-62271-100. The rated break time shall not exceed 40 ms (milli second) for 765 kV and 400 kV. The rated break time shall not exceed 60 ms for 220 kV. Circuit breakers shall be suitable for single phase and three phase auto reclosing. Each breaker would have two sets of trip circuits which would be connected to separate DC supplies for greater reliability. The Circuit breakers controlling 765 kV lines shall be provided with pre-insertion closing resistor of about 450 ohms with 9 ms insertion time or Controlled Switching Device (CSD). The Circuit breakers controlling 400 kV lines wherever required shall be provided with pre-insertion closing resistor of about 400 ohms with 8 ms insertion time or Controlled Switching Device (CSD) for lines longer than 200 km. The short line fault capacity shall be the same as the rated capacity and this is proposed to be achieved without use of opening resistors. Controlled switching device shall be provided in the Circuit Breaker of the switchable line reactor bay and in Main and Tie bay circuit breakers of line with non-switchable line reactors, Bus reactors and Transformers for 400 kV and above voltage class.

#### B.2.3.2 Isolators (GIS)

The isolators shall comply to IEC 62271-102 in general. Earth switches shall be provided at various locations to facilitate maintenance. Main blades and earth blades shall be interlocked and interlock shall be fail safe type. All isolators and earth switches shall be motor operated type.

  
Central Transmission Utility of India Limited

89



Raghnesda Re Transmission Limited



**Transmission Service Agreement**

The isolator shall be of extended mechanical endurance class-M2 and suitable for Bus Transfer Current Switching duty as per IEC standards. High speed earthing switches shall be provided for grounding purposes at overhead line terminations and cable terminations and shall have fault making capability as specified. Earth switch for line isolator shall be of earthing switch class E1 and shall be suitable for induced current switching duty as defined for Class-B as per relevant standard.


**B.2.3.3 Current Transformers (GIS)**

Current Transformers shall comply with IEC 61869 in general. All ratios shall be obtained by secondary taps only. Generally, Current Transformers (CT) shall have five cores (four for protection and one for metering) whereas; CT in Tie bays shall have six cores (four for protections and two for metering) suitably distributed on both sides of CB (for 400 kV and above voltage class). 220 kV Current Transformers shall have five cores (four for protection and one for metering). The burden and knee point voltage shall be in accordance with the requirements of the system including possible feeds for telemetry. The accuracy class for protection core shall be PX and for the metering core it shall be 0.2S. The rated burden of cores shall be closer to the maximum burden requirement of metering and protection system (not more than 20 VA for metering core) for better sensitivity and accuracy.

The instrument security factor shall be less than 5 for CTs up to 400 kV voltage class and less than 10 for CTs of 765 kV voltage class.

**B.2.3.4 Voltage Transformer (GIS)**

The voltage transformers shall conform to IEC-61869. Voltage transformers shall be of electromagnetic type with SF6 gas insulation. The earth end of the high voltage winding and the ends of the secondary winding shall be brought out in the terminal box. The voltage transformers shall be located as a separate bay module and will be connected phase to ground and shall be used for protection, metering and synchronization. The voltage transformers shall be of inductive type, nonresistant and shall be contained in their own-SF6 compartment, separated from other parts of installation. The voltage transformer shall be effectively shielded against high frequency electromagnetic transients. The voltage transformer shall have three secondary windings out of which two shall be used for protection and one for metering. The voltage transformer should be thermally and dielectrically safe when the secondary terminals are loaded with the guaranteed thermal burdens. The accuracy class for protection cores shall be 3P. The accuracy of 0.2 on metering core should be maintained throughout the entire burden range on all the three windings without any adjustments during operation. The rated

  
Central Transmission Utility of India Limited

90

  
Raghavendra RE Transmission Limited



## Transmission Service Agreement

burden of cores shall be closer to the maximum burden requirement of metering and protection system (not more than 50 VA for metering core) for better sensitivity and accuracy.

### B.2.3.5 Surge Arresters (GIS) (If applicable)

624 kV Station High (SH) duty, 336 kV Station High (SH) and 216 kV Station Medium (SM) duty gapless type Surge arresters with thermal energy (Wth) of minimum 13 kJ/ kV , 12 kJ/ kV and 7 kJ/kV respectively shall be provided for 800 kV ,420 kV and 245 kV system respectively conforming to IEC 60099-4 in general. Other characteristics of Surge arrester shall be chosen in accordance with system requirements. Surge arresters shall be provided at line entrances, near transformers and reactors so as to achieve proper insulation coordination. A leakage current monitor with surge counter shall be provided with each surge arrester.

### B.2.3.6 SF<sub>6</sub> to Air Bushing

Outdoor bushings, for the connection of conventional external conductors to the SF<sub>6</sub> metal enclosed switchgear, shall be provided. Bushings shall generally be in accordance with the requirements of IEC-60137. The creepage distance over the external surface of outdoor bushings shall not be less than 31 mm/ kV. SF<sub>6</sub> to air Bushing shall be of Polymer/ composite type and shall be robust and designed for adequate cantilever strength to meet the requirement of seismic conditions. The electrical and mechanical characteristics of bushings shall be in accordance with IEC-60137. Polymer/composite insulator shall be seamless sheath of silicon rubber compound. The housing and weather sheds should have silicon content of minimum 30% by weight. It should protect the bushing against environmental influences, external pollution and humidity. The hollow silicon composite insulators shall comply with the requirements of IEC 61462 and the relevant parts of IEC-62217.

### B.2.4 765 kV, 400 kV and 220 kV AIS Substation equipment (as applicable)

#### B.2.4.1 Circuit Breakers (AIS)

The circuit breakers and accessories shall conform to IEC: 62271-100, IEC: 62271-1 and shall be of SF<sub>6</sub> Type. The circuit breakers shall be of class C2-M2 (as per IEC) with regard to restrike probability during capacitive current breaking and mechanical endurance. The rated break time shall not exceed 40 ms for 765 kV circuit breakers. The 765 kV circuit breakers shall be provided with single phase and three phase auto reclosing. Each breaker would have two sets of trip circuits, which would be connected to separate DC supplies for greater reliability. The circuit breakers controlling 765 kV lines shall be



522

Transmission Service Agreement

provided with pre-insertion closing resistor of about 450 ohm maximum with 9 ms insertion time or Controlled Switching Device. The short line fault capacity shall be same as the rated capacity and this is proposed to achieve without use of opening resistors. The controlled switching device shall be provided in circuit breakers of switchable line reactor bay and in Main and Tie bay circuit breakers of line with non-switchable line reactors, Bus Reactors and Transformers of voltage class 400 kV and above.

**B.2.4.2 Isolators (AIS)**

The isolators shall comply with IEC 62271-102 in general. 765 kV isolator design shall be double break or vertical break or knee-type. All isolators and earth switches shall be motor operated. Earth switches shall be provided at various locations to facilitate maintenance. Isolator shall be of extended mechanical endurance class – M2 as per IEC-62271-102. Main blades and earth blades shall be interlocked and interlock shall be fail safe type. The 765 kV earth switch for line isolator shall be suitable for induced current switching duty as defined for Class-B.

**B.2.4.3 Current Transformers (AIS)**

Current Transformers shall comply with IEC 61869 in general. All ratios shall be obtained by secondary taps only. Generally, Current Transformers (CT) for 765 kV shall have six cores (four for protection and two for metering). The burden and knee point voltage shall be in accordance with the requirements of the system including possible feeds for telemetry. The accuracy class for the protection core shall be PX and for the metering core it shall be 0.25. The rated burden of cores shall be closer to the maximum burden requirement of the metering and protection system (not more than 20 VA for metering core) for better sensitivity and accuracy. The instrument security factor shall be less than ten (10) for CTs of 765 kV voltage class.

**B.2.4.4 Capacitive Voltage Transformers (AIS)**

Capacitive Voltage transformers shall comply with IEC 61869 in general. These shall have three secondaries out of which two shall be used for protection and one for metering. The accuracy class for protection cores shall be 3P and for metering core it shall be 0.2. The Capacitive Voltage Transformers on lines shall be suitable for Carrier Coupling. The Capacitance of CVT for 765 kV shall be 8800 pF. The Capacitance of CVT for 400 kV and 220 kV shall be of 4400/ 8800 pF depending on PLCC requirements. The rated burden of cores shall be closer to the maximum burden requirement of metering and protection system (not more than 50 VA for metering core) for better sensitivity and accuracy.

**B.2.4.5 Surge Arresters (AIS)**

*Ch hm*  
Central Transmission Utility of India Limited

92



Raghnesda RE Transmission Limited



523

## Transmission Service Agreement

624 kV Station High (SH) duty, 336 kV Station High (SH) duty and 216 kV Station Medium (SM) duty gapless type Surge arresters with thermal energy (Wth) of minimum 13 kJ/kV, 12 kJ/kV and 7 kJ/kV respectively shall be provided for 800 kV, 420 kV and 220 kV system respectively conforming to IEC 60099-4 in general. Other characteristics of Surge arrester shall be chosen in accordance with system requirements. Surge arresters shall be provided at line entrances, near Transformers and Reactors so as to achieve proper insulation coordination. Surge Arresters shall be provided with porcelain/ polymer housing fitted with pressure relief devices. A leakage current monitor with surge counter shall be provided with each surge arrester.

### B.2.5 Protection Relaying and Control System


The protective relaying system proposed to be provided for transmission lines, auto-transformers, reactors and bus bars to minimize the damage to the equipment in the events of faults and abnormal conditions, is dealt in this section. All main protective relays shall be numerical type with IEC 61850 communication interface and should have interoperability during integration of numerical relays to communicate over IEC61850 protocol with RTU/SAS/IEDs of different OEMs. All numerical relays shall have built in disturbance recording feature.

The protection circuits and relays of transformer and reactor shall be electrically and physically segregated into two groups each being independent and capable of providing uninterrupted protection even in the event of one of the protection groups failing, to obtain redundancy, and to take protection systems out for maintenance while the equipment remains in service.

#### a) Transmission Lines Protection

765 kV, 400 kV and 220 kV lines shall have Main-I numerical three zone distance protection scheme with carrier aided inter-tripping feature. 765 kV, 400 kV and 220 kV lines shall also have Main-II numerical distance protection scheme like Main-I but from different make that of Main-I. The Main-I and Main-II protection relays of same make may be provided only if they are of different hardware and manufacturing platform or different principle of operation.

However, Line Current Differential relay (with back up distance protection feature) as Main-I and Main-II shall be considered at both ends for short lines (line length below 30 km) having Fibre Optic Communication Link. Differential relay at remote end shall be provided by the TSP. Associated power and control cabling and integration with SAS at remote end shall be provided by respective bay owners.

  
Central Transmission Utility of India Limited

93

  
Raghavendra RE Transmission Limited



## Transmission Service Agreement

In case of 220 kV line bays for RE Generators, Line Current differential relay (with back up distance protection feature) as Main-I and Main-II shall be provided. Further, in such cases, the matching line current differential relay for remote end shall be provided by the TSP as loose supply.

In case of loop in loop out of transmission lines, the existing protection scheme shall be studied and suitable up-gradation (if required) shall be carried out.

Further, all 765 kV, 400 kV and 220 kV lines shall be provided with single and three phase auto-reclosing facility to allow reclosing of circuit breakers in case of transient faults. These lines shall also be provided with distance to fault locators to identify the location of fault on transmission lines.

All 765 kV, 400 kV and 220 kV lines shall also be provided with two stages over voltage protection. Over voltage protection and distance to fault locator may be provided as in-built feature of Main-I and Main-II protection relays. Auto reclose as built-in function of Bay Control Unit (BCU) is also acceptable.

The Main-I and Main-II protection relays shall be fed from separate DC sources and shall be mounted in separate panels.


For 765 kV, 400 kV and 220 kV transmission lines, directional IDMT earth fault relay should be provided as standalone unit or in-built feature of Main-I and Main -II feature.

### b) Auto Transformer Protection

These shall have the following protections:

- i) Numerical Differential protection
- ii) Numerical Restricted earth fault protection
- iii) Numerical Back-up Over-current and earth fault protection on High Voltage (HV) and Intermediate Voltage (IV) side
- iv) Numerical Over fluxing protection on HV and IV side
- v) Numerical Overload alarm

Further, Numerical Back-up Over-current and earth fault protection on HV and IV side of autotransformer shall not be combined with other protective functions in the main relays and shall be independent relays. Besides these, power transformers shall also be provided with Buchholz relay, Magnetic oil Gauge (MOG) with low oil level alarm, protection against high oil and winding temperature and pressure relief device etc.

  
Central Transmission Utility of India Limited

94

  
Raghnesda RE Transmission Limited



525

**Transmission Service Agreement**

Suitable monitoring, control (operation of associated circuit breaker and isolator) and protection for LT auxiliary transformer connected to tertiary winding of auto-transformer for the purpose of auxiliary supply shall be provided. The over current and other necessary protection shall be provided for the auxiliary transformer. These protection and control may be provided as built in feature either in the bay controller to be provided for the auxiliary system or in the control and protection IEDs to be provided for autotransformer.

**c) 765 kV and 400 kV Reactor Protection**

**Reactor shall be provided with the following protections:**

- i) Numerical Differential protection.
- ii) Numerical Restricted earth fault protection
- iii) Numerical Back-up impedance protection

Besides these, reactors shall also be provided with Buchholz relay, Magnetic Oil Gauge (MOG) with low oil level alarm, protection against oil and winding temperatures and pressure relief device, etc.


**d) Bus bar Protection**

The high speed low impedance type bus bar differential protection, which is essential to minimize the damage and maintain system stability at the time of bus bar faults, shall be provided for 765 kV, 400 kV and 220 kV. Duplicated bus bar protection is envisaged for 765 kV and 400 kV bus-bar protection. Bus bar protection scheme shall be such that it operates selectively for each bus and incorporate necessary features required for ensuring security. The scheme shall have complete bus bar protection for present as well as envisaged future bays i.e. input / output modules for future bays shall also be provided.

Bus Bar protection system for new substation shall be de-centralized (distributed) type.

The scheme shall have complete bus bar protection for present as well as envisaged future bays i.e. input / output modules for future bays for the bus sections under present scope and PUs shall be provided by the respective bay owners.

In case, the bus section is provided, then each side of bus section shall have separate set of bus bar protection schemes.

  
Central Transmission Utility of India Limited

95



Raghnesda RE Transmission Limited



## Transmission Service Agreement

For existing substations, the existing bus bar protection shall be augmented as per requirement.

### e) Local Breaker Back up Protection

This shall be provided for each 765 kV , 400 kV and 220 kV circuit breakers and will be connected to de-energize the affected stuck breaker from both sides.

#### Notes:

1. LBB and REF relays shall be provided separately from transformer differential relay.
2. LBB relay may also be provided as built-in protection function of distributed bus bar protection scheme; however in such case separate LBB relay shall be provided for tie bays (in case of One and Half breaker scheme).
3. Over fluxing and overload protection can be provided as built-in feature of differential relay.
4. In 765 kV and 400 kV switchyard, if spare bay of half diameter is identified as future, Tie CB relay panel shall be with Auto-reclosure feature.


### B.2.6 Substation Automation System

For all the new substations, state of art Substation Automation System (SAS) conforming to IEC-61850 shall be provided. The distributed architecture shall be used for Substation Automation system, where the controls shall be provided through Bay control units. The Bay control unit is to be provided bay wise for voltage level 220 kV and above. All bay control units as well as protection units are normally connected through an Optical fibre high speed network. The control and monitoring of circuit breaker, dis-connector, re-setting of relays etc. can be done from Human Machine Interface (HMI) from the Relay Control Room.

The functions of control, annunciation, disturbance recording, event logging and measurement of electrical parameters shall be integrated in Substation Automation System.

At new substations, the Substation Automation System (SAS) shall be suitable for operation and monitoring of the complete substation including proposed future bays/elements.

In existing substations with Substation automation system (SAS), augmentation of existing SAS shall be done for bays under present scope.

  
Central Transmission Utility of India Limited

96

  
Raghamesda RE Transmission Limited



529

## Transmission Service Agreement

In existing Substations where Substation automation is not provided, control functions shall be done through control panels.

Necessary gateway and modems (as required) shall be provided to send data to RLDC/SLDC as per their requirement and shall be provisioned with 2+2 redundancy i.e. 2 channels for Main Control Centre and 2 channels for Backup Control Centre. In order to meet this requirement, suitable redundancy at port and card level need to be ensured by the TSP to avoid any single point of failure which may lead to interruption in real-time grid operation. Accordingly, all the hardware for communication services of station as stated above shall support dual redundancy for data transmission of station to respective main and backup RLDCs. Any augmentation work at RLDC/SLDC is excluded from TSP's scope. However, all the configuration work at substation end required to send data to RLDC/SLDC shall be in the scope of TSP.

### a) Time synchronization equipment

Time synchronization equipment complete in all respect including antenna, cable, processing equipment required to receive time signal through GPS or from National Physical Laboratory (NPL) through INSAT shall be provided at new substations. This equipment shall be used to synchronize SAS and IEDs etc.

### B.3.0 Substation Support facilities


Certain facilities required for operation and maintenance of substations as described below shall be provided at new substation. In existing substation, these facilities have already been provided and shall be extended/ augmented as per requirement.

### B.3.1 AC and DC power supplies

For catering the requirements of three phase and single phase AC supply and DC supply for various substation equipment (for present and future scope), the following arrangement is envisaged:-

- (i) For LT Supply at each new Substation, two (2) Nos. of LT Transformers (minimum 800 kVA for substations with highest voltage rating as 765 kV) shall be provided which shall be fed from two independent sources as per CEA (Technical Standards for Connectivity to the Grid) Regulations, 2007.

Metering arrangement with Special Energy Meters (SEMs) shall be provided by TSP at 33 kV tertiary of 765/400 kV Transformer for drawing auxiliary supply at new substation. Such SEMs shall be provided by CTU at the cost of the TSP. Accounting of such energy drawn by the TSP shall be done by RMD/ RPC as part of Regional



**Transmission Service Agreement**


**Energy Accounting.**

Additionally, Active Energy Meters may be provided at the same point in the 33 kV tertiary of 765/400/33 kV Transformer by local SEB/DISCOM for energy accounting.

- (ii) 2 sets of 220 V battery banks for control and protection and 2 sets of 48 V battery banks for PLCC/ communication equipment shall be provided at each new Substation. Each battery bank shall have a float-cum-boost charger.  
At new substation, sizing of 220 V battery and battery charger shall be done based on the number of bays specified (including future bays) as per CEA Regulations and relevant IS. 2 sets of 48 V battery banks for PLCC and communication equipment for present and future scope shall be provided at each new Substation with at least 10-hour battery backup and extended backup, if required. 48 V DC can be achieved from 220 V DC battery bank using adapter, if so desired by TSP, without compromising backup time.
- (iii) Suitable AC and DC distribution boards and associated LT Switchgear shall be provided at new substation.
- (iv) For new substation, following switch boards shall be considered with duplicate supply with bus coupler/ sectionalizer and duplicate outgoing feeders except for Emergency lighting distribution board which shall have only one incoming feeder:
- (a) 415 V Main Switch board – 1 No.
  - (b) AC distribution board – 1 No.
  - (c) Main lighting distribution board – 1 No.
  - (d) Emergency lighting distribution board – 1 No.
  - (e) 220 Volt DC distribution board – 2 Nos.
  - (f) 48 Volt DC distribution board – 2 Nos.

Sizing of LT Switchgear shall be suitable to cater the requirement for all present and future bays. AC and DC distribution boards shall have modules for all the feeders (including future as specified).

- (v) At new Substation, one No. of DG set (minimum 500 kVA for substations with highest voltage rating as 765 kV) shall be provided for emergency applications.
- (vi) At new substation, sizing of battery and battery chargers shall be done based on the number of bays specified (including future bays).
- (vii) For substation extensions, existing facilities shall be augmented as required.

  
Central Transmission Utility of India Limited

98



Raghunadesa RE Transmission Limited



**B.3.2 Fire Fighting System**

Fire-fighting system for substation including transformer and reactor shall conform to CEA (Measures Relating to Safety and Electric Supply) Regulations, 2023 as amendment time to time.

Further, adequate water hydrants and portable fire extinguishers shall be provided in the substations. The main header of firefighting system shall be suitable for extension to bays covered under the future scope; necessary piping interface in this regard shall be provided.

Optical Beam type heat detection for GIS hall fire protection system shall be provided for all the GIS halls.

At existing substations, the fire-fighting systems, as available, shall be augmented/extended to meet the additional requirements.

**B.3.3 Oil Evacuating, Filtering, Testing and Filling apparatus**

To monitor the quality of oil for satisfactory performance of transformers, shunt reactors and for periodical maintenance necessary oil evacuating, filtering, testing and filling apparatus would be provided at new substations. Oil storage tanks of adequate capacities for storage of transformer oil would be provided.

Online Transformer Oil Drying Out System shall be provided in line with the provisions of Standard Specification and Technical Parameters for Transformers and Reactors (66 kV and above Voltage Class) as amended up to date available on CEA website.

**B.3.4 Illumination**

Normal and emergency AC and DC illumination shall be provided adequately in the control room and other buildings of the substation. The switchyard shall also be provided with adequate illumination.

Lighting of the entire control room building, fire-fighting pump house, other building (if any) and switchyard shall be done by LED based low power consumption luminaries.

**B.3.5 Control Room**

For new substation, substation control room shall be provided to house substation work stations for station level control (SAS) along with its peripheral and recording equipment, AC and DC distribution boards, DC batteries and associated battery chargers, Fire Protection panels, Telecommunication panels and other panels as per requirements. Air conditioning shall be provided in the building as functional requirements. Main cable trenches from the control room shall have adequate space provision for laying of cables from control room for all the future bays also. **As the GIS hall shall be extendable on both sides, Control Room building shall be separate from the GIS hall building.**

At existing substations, the adequacy of size of control room shall be ascertained and the same shall be augmented as per requirement.



Transmission Service Agreement

**B.3.6 GIS hall**

The Gas Insulated Switchgear (GIS) of each voltage level along with other associated equipment shall be housed inside separate GIS building. The panels i.e. Bay level units, bay mimic, relay and protection panels, RTCC panels, PLCC panels, panels for telecommunication system etc. are to be placed in a separate room in the GIS building. The size of the room shall be such that all the panels for the bays under present scope shall be accommodated. The panel room shall be air-conditioned. Further, the temperature of the room shall be monitored through substation automation system by providing necessary temperature transducers. Ventilation system of suitable capacity shall be provided for each GIS hall.

One EOT Crane of suitable capacity for erection and maintenance of largest GIS component/assembly and all plant installed in the GIS switchgear room shall be provided in each GIS hall. The crane shall be capable of fulfilling all special requirements for erection and maintenance of GIS equipment. The capacity of the crane shall be sized to lift the heaviest GIS switchgear component.


For extension of existing GIS, existing facilities shall be suitably augmented/ extended for GIS equipment under present scope.

**B.3.7 Control Concept**

All the EHV circuit breakers in substation/switching stations shall be controlled and synchronized from the switchyard control room/remote control center. All the isolators shall have control from remote/local whereas the earth switches shall have local control only.

**B.3.8 Visual Monitoring System (VMS) for watch and ward of substation premises:**

Visual monitoring system for effective watch and ward of substation premises shall cover all the transformers and reactors, all other major AIS Equipment (such as CB, isolators, CT, CVT, SA etc. as applicable), GIS bays, panel room, all the gates of switchyard and all entry and exit points of control room building and accordingly the location of cameras shall be decided. In addition to the gates of the switchyard, the cameras shall also be located around the boundaries at suitable locations. The camera shall be high-definition color CCD camera with night vision feature. The VMS data partly/completely shall be recorded (minimum for 15 days) at least @25fps (or better) and stored on network video recorder. The system shall use video signals from various cameras installed at different locations, process them for viewing on workstations/monitors in the control room and simultaneously record all the cameras. The VMS data should go only to the intended personnel/facility and not to the remote server of the camera (VMS supplier).

  
Central Transmission Utility of India Limited

100

  
Raghnesda Re Transmission Limited



## Transmission Service Agreement

Mouse/keyboard controllers shall be used for pan, tilt, zoom and other functions of the desired camera. The Visual Monitoring System shall have provision of WAN connectivity for remote monitoring.

All camera recordings shall have Camera ID and location/area of recording as well as date/time stamp. The equipment should generally conform to Electromagnetic compatibility requirement for outdoor equipment in EHV substation.

At existing substations, the Visual Monitoring System if available shall be augmented as per existing or better specification as required.

### 8.4 General Facilities

- a) Line Gantry/Towers are envisaged for bays under present scope only. However, for adjacent future line bay, tower shall be designed for extension (considering Hexa conductors for 765 kV and Quad conductors for 400 kV future lines and Twin conductor for 220 kV future lines) wherever applicable.
- b) Bay extension works at existing substation shall be executed by TSP in accordance with the requirement/provisions mentioned above. However, interface points shall be considered keeping in view the existing design/arrangement at the substation.
- c) TSP has to arrange for construction power and water on its own.
- d) All outdoor steel structures including anchor/foundation bolts shall be fully galvanized. The weight of the zinc coating shall be at least 610 g/m<sup>2</sup>. However, for coastal/creek regions it shall be at least 900 g/m<sup>2</sup>.
- e) In 765 kV and 400 kV switchyard, if spare bay of half diameter is identified as future, all the equipment for Tie and Future Bay shall be designed considering the current rating of line bay i.e. 3150 A.
- f) Boundary wall shall be brick masonry wall with RCC frame or Stone masonry wall or Precast RCC wall under present scope along the property line of complete substation area including future switchyard area to prevent encroachment and unauthorized access. Minimum height of the boundary wall shall be of 1.8 m from finished ground level (FGL).
- g) All electrical equipment shall be installed above Highest Flood Level (HFL) and



Transmission Service Agreement

where such equipment is not possible to be installed above Highest Flood Level, it shall be ensured that there is no seepage or leakage or logging of water.


- h) As per CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022/CEA Manual on Transmissions Planning criteria 2023, line approaching substation shall normally be perpendicular to the substation boundary for a stretch of 2-3 km. Accordingly, TSP shall ensure that line terminations at substations are arranged in a manner to avoid hindrance to future line terminations at the substations.

**B.5 EXTENSION OF EXISTING SUBSTATION**

The following drawings/details of existing substation is attached with the RFP documents for further engineering by the bidder.

Sl. No.	Drawing Title	Drawing No./Details	Rev. No.
A.	765/400 kV Banaskantha S/s		
1.0	Single Line Diagram	C/ENGG/WR-II/BANASKANTHA/SLD/1	-
2.0	General Arrangement	C/ENGG/WR-II/BANASKANTHA/GA/1	-
3.0	Earthmat Layout	TR202135-1001587-SS1623-EMAT-LAYOUT	R2
4.0	Visual Monitoring System	TB-384-510-018	R1
5.0	Bus Bar Protection	Make: NR Model: PCS 915	-
6.0	Substation Automation System (SAS)	Make: NR electric Model: PCS 9700 Ver 1.16 (Drg. No. 2028-NR-IN.SASAR)	R2

Note: Bidder is advised to visit the substation sites and acquaint themselves with the topography, infrastructure such as requirement of roads, cable trench, drainage, space availability in control rooms and LT panel room etc. and also the design philosophy.

  
Central Transmission Utility of India Limited

102

  
Raghavendra RE Transmission Limited



532



**SPECIFIC TECHNICAL REQUIREMENTS FOR COMMUNICATION**

The communication requirement shall be in accordance to CEA (Technical Standards for Communication System in Power System Operations) Regulations, 2020, CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations, 2022, CERC (Communication System for Inter-State transmission of electricity) Regulations, 2017, and CEA (Cyber Security in Power Sector) Guidelines, 2021, all above documents as amended from time to time.

The complete ISTS communication system commissioned by TSP under the RFP shall be the asset of ISTS and shall be available for usage of ISTS requirements as suggested by CTU from time to time.

The communication services viz. SCADA, VoIP, PMU, AGC and AMR (wherever applicable) have been identified as critical services and therefore shall be provisioned with 2+2 redundancy i.e. 2 channels for Main Control Centre and 2 channels for Backup Control Centre. In order to meet this requirement, suitable redundancy at port and card level need to be ensured by the TSP to avoid any single point of failure which may lead to interruption in real-time grid operation.

PMU to PDC communication (wherever required) shall be through 2 channels to the PDC (main) as there is no backup PDC at present.

Accordingly, all the hardware for communication services of station as stated above shall support dual redundancy for data transmission of station to respective main and backup RLDCs.

In order to meet the requirement for grid management and operation of substations, Transmission Service Provider (TSP) shall provide the following:

**C.1.0 Establishment 3x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVA, 765 kV bus reactor and 2x125 MVA, 420 kV bus reactor**

- (I) TSP shall supply, install and commission One or more Nos. of FODP (336F or higher) alongwith panel and required Approach Cables (48F) with all associated hardware fittings from gantry tower to Control Room for all the incoming lines envisaged under the present scope.
- (II) TSP shall supply, install and commission One or more STM-16 (FOTE) equipment alongwith panel/s supporting minimum Nine (9) directions with MSP (Multiplex Section Protection – 1+1). These directions shall exclude protected (1+1) local patching among equipment (if any). Communication Equipment shall be provided with necessary interfaces to meet the voice and data communication requirement among Banaskantha (PG), Raghnesda GIS, M/s Azure Power Sixty Three Pvt. Ltd., M/s Sunsire Solarpark RJ One Pvt. Ltd. and upcoming RE generation S/s. The suitable DC Power Supply and backup to be provided for communication equipment.

  
Central Transmission Utility of India Limited

103



Raghnesda RE Transmission Limited



534

**Transmission Service Agreement**


- (III) FODP and FOTE equipment with panels shall be provided in Control Room of Raghnesda GIS S/s. FOTE and FODP Eq can be accommodated in same panel to optimize space.
- (IV) The new communication equipment under the present scope shall be compatible for integration with existing regional level centralized NMS. The local configuration of the new communication equipment shall be the responsibility of TSP. The configuration work in the existing centralized NMS for integration of new Communication equipment shall be done by Regional ULDC Team, however all the necessary support in this regard shall be ensured by TSP.
- (V) TSP shall supply, install and commission Firewall in redundant mode (1+1) in line with the specification attached at Annexure F.1.
- (VI) The maintenance of all the communication equipment and software thereof including FOTE, FODP, approach cable, PMU, DCPS alongwith Battery Bank and Firewall shall be the responsibility of TSP.

**C.2.0 Raghnesda (GIS) – Banaskantha (PG) 765 kV D/C line**


- (I) On Raghnesda (GIS) – Banaskantha (PG) 765 kV D/C line, TSP shall supply, install and commission One (1) No. OPGW cable containing 48 Fibres (48F) on one E/W peak and conventional earth wire on other E/W peak.  
Proposed OPGW Hardware, Joint Box and other accessories shall be as per 48 Fiber OPGW.
- (II) The TSP shall install this OPGW from gantry of Raghnesda GIS up to the gantry of Banaskantha (PG) with all associated hardware including Vibration Dampers, mid-way and gantry Joint Boxes (called OPGW Hardware hereafter) and finally terminate in Joint Boxes at end Substations. The transmission line length is 95 kms (approx.) where repeater is not required to meet link budget requirement of Raghnesda (GIS) – Banaskantha (PG) link.
- (III) Maintenance of OPGW Cable, and OPGW Hardware shall be the responsibility of TSP.

**C.3.0 2 Nos. 765 kV line bays at Banaskantha (PG) S/s**

- (I) TSP shall supply, install and commission One or more Nos. of FODP (144F or higher) alongwith panel and required Approach Cables (48F) with all associated hardware fittings from gantry tower to Bay Kiosk and from the Bay Kiosk to Control room.
- (II) TSP shall supply, install and commission One STM-16 (FOTE) equipment alongwith panel/s supporting minimum three (3) directions with MSP (Multiplex Section Protection – 1+1) with necessary interfaces to meet the voice and data communication requirement between Raghnesda GIS and Banaskantha (PG) S/s. The suitable DC Power Supply and backup to be provided for communication equipment.

  
Central Transmission Utility of India Limited

104

  
Raghnesda RE Transmission Limited



525

Transmission Service Agreement

- (iii) FOTE/FODP panel shall be installed in the new Bay Kiosk/ Switchyard Panel Room (SPR). The FOTE under present scope shall be integrated by TSP with the existing FOTE at control room of Banaskantha (PG) S/s which shall be communicating with respective control center. TSP to provide necessary FODP sub rack / Splice trays/ Patch cords etc. and optical interfaces/equipment in the existing FOTE/FODP panels in control room for integration with the existing FOTE for onwards data transmission.

In case spare optical direction is not available in the existing FOTE at the control room, the TSP shall coordinate with station owner to reconfigure the directions in existing FOTE at control room. Alternatively, The TSP may integrate the FOTE under the present scope with existing FOTE in the nearby Kiosk connected to the control room FOTE (if available with spare direction). For this purpose, TSP shall provide necessary FODP sub rack / Splice trays/ Patch cords etc. and suitable optical interfaces/ equipment in the existing FOTE/FODP panels in another Kiosk (SPR).

FOTE and FODP can be accommodated in same panel to optimize space.

The new communication equipment under the present scope shall be compatible for integration with existing regional level centralized NMS. The local configuration of the new communication equipment shall be the responsibility of TSP. The configuration work in the existing centralized NMS for integration of new Communication equipment shall be done by Regional ULDC Team, however all the necessary support in this regard shall be ensured by TSP.

The maintenance of all the communication equipment and software thereof including FOTE, PMU, FODP, approach cable, DCPS along with Battery Bank shall be the responsibility of TSP.

**C.4.0 Specific Requirement for Phasor Measurement Units (PMUs)**

TSP shall supply, install and commission required No. of Phasor Measurement Units (PMUs) PMUs at all the locations under the scope of TSP under this RFP as per CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations, 2022 (alongwith all amendments if any), and all the applicable Regulations, Standards, Guidelines issued time to time. The signal list shall be as per the Annexure-I Part-B of CERC Guidelines on "Interface Requirements" 2024. These PMUs shall be provided with GPS clock and LAN switch and shall connect with LAN switch of control room of respective substations/ generating stations with Fibre Optic cable. These PMUs shall be connected with the FOTE at Substation/ generating stations for onwards data transmission to the PDC (Phasor Data Concentrator) located at respective RLDC. Configuration work in existing PDC at RLDC for new PMU integration shall be done by respective RLDC, however all the necessary support in this regard shall be ensured by TSP. The maintenance of all the PMUs and associated equipment shall be the responsibility of TSP.

  
Central Transmission Utility of India Limited

105




Raghavendra RE Transmission Limited



**Transmission Service Agreement**

**Note: Existing Station owner/s to provide necessary support to integrate different equipment and applications of new extended bays with the existing substation e.g. Communication (through FOTE), Voice etc. for smooth operation and monitoring of new added grid elements.**

**C.5.0 For the extension / By pass portion of existing line with OPGW: OPGW requirement on extended line / By pass portion shall be of same OPGW fiber capacity of existing line.**

  
Central Transmission Utility of India Limited



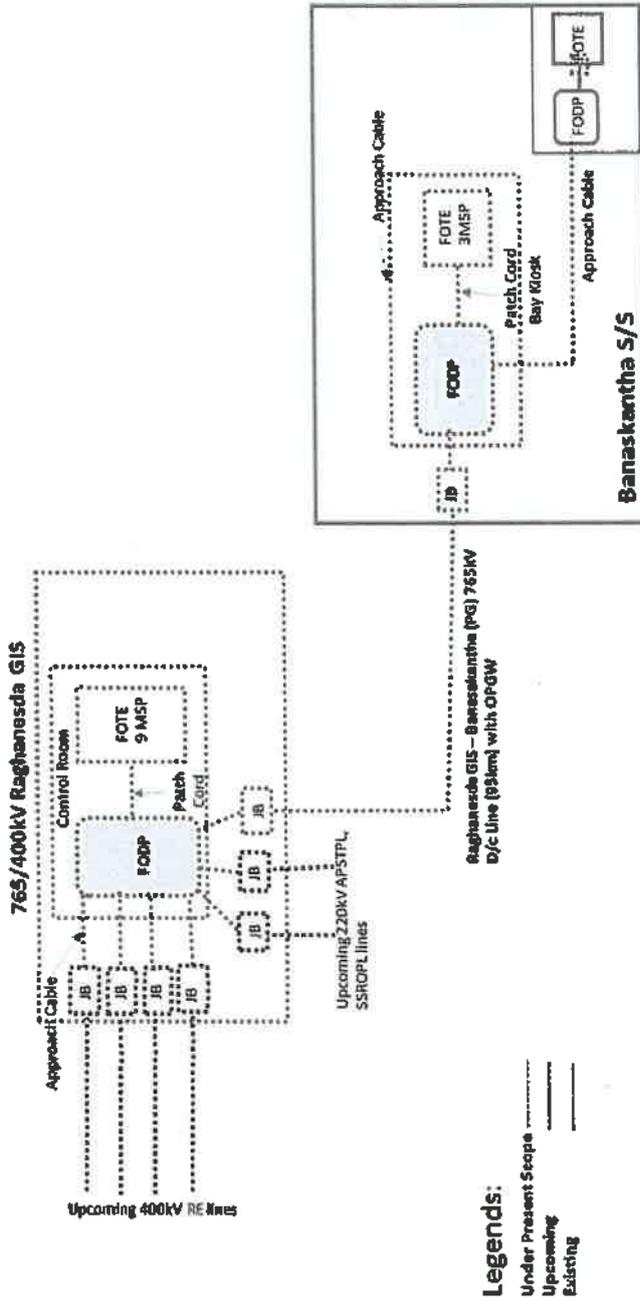
106

Raghavendra R.K. Transmission Limited



537

Proposed Communication for Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3  
GW under Phase-I



Legends:

- Under Present Scope
- Upcoming
- Existing

Figure F.1



*Handwritten initials*



*Handwritten number 835*

**Next Generation Firewall (NGFW)**

TSP shall provide 2 NGFW one in Main and another in Standby mode having electrical ethernet interfaces/ports and placed between FOTE and SAS gateway/s at the substation. All ethernet based applications shall be terminated in the firewall ports directly (e.g. PMU, AMR, VOIP, SAS/SCADA etc.). Each port of firewall shall work as a separate zone. Firewall shall be hardware based with features of Block/Allow/drop and IPSec VPN (network encryption).


The number of ports/interfaces in each firewall (i.e. Main and Standby) shall be minimum 16 Nos. TSP shall provide either single firewall or multiple firewalls to meet this interfaces requirement, each for main as well as standby firewall. Minimum throughput of firewall shall be 300 Mbps.

The Firewall shall be managed/ configured as standalone at present and shall also have compatibility to manage/configure through Centralized Management Console (CMC) remotely in future.

Firewall shall be tested and certified for ISO15408 Common Criteria for least EAL4+.

Further, the OEM must certify that it conforms to Secure Product Development Life Cycle requirements as per IEC62443-4-1. The firewall shall generate reports for NERC-CIP Compliance.

The specifications for the firewalls are given at Annexure-F.2 and schematic diagram showing firewall placement given at Figure F.2.

  
Central Transmission Utility of India Limited

108



Raghavendra Transmission Limited



**Specifications of Next Generation Firewall (NGFW)**

1. NGFW shall have following features including but not limited to:  
Encryption through IPSec VPN (Virtual Private Network), Deep Packet Inspection (DPI), Denial of service (DoS) and Distributed Denial of Service (DDoS) prevention, Port Block/ Allow, rules/ policies for block/allow, IP (Internet Protocol) and Media Access Control (MAC) spoofing protection, threat detection, Intrusion Prevention System (IPS), Anti-Virus, Anti-Spyware, Man In The Middle (MITM) attack prevention.
2. The proposed firewall shall be able to handle (alert, block or allow) unknown /unidentified applications e.g. unknown TCP and UDP packets. It shall have the provision to define application control list based on application group and/or list.
3. Firewall shall have feature and also have capability to update the definition/ Signatures of Anti-Virus online as well as offline. Firewall shall also be compatible to update the definitions/signatures through CMC. There shall be a defined process for security patching and firmware up-gradation. There shall be a feature to field validate firmware checksum. The same shall also be validated before using the OEM provided file/binary in the process of firmware up-gradation and security patching
4. Firewall shall have Management Console port to configure remotely.
5. Firewall shall be EMI/EMC compliant in Substation environment as per IEC 61850-3.
6. Firewall shall be rack mounted in existing standard equipment cabinets.
7. Firewall shall have support of SCADA applications (IEC-60870-5-104), IEC, PMU (IEEE C37.118), Sub-Station Automation System (IEC 61850), Ethernet and other substation environment protocols.
8. Client based Encryption/ VPN must support different Operating System platforms e.g. Windows, Linux and Mac.
9. The solution must have content and comprehensive file detection policies, blocking the files as function of their types, protocols and directions.
10. Firewall shall have logging facility as per standard logs/events format. Firewall shall have features to export the generated/stored logs/events in csv (Comma Separated Value) and also any other standard formats for offline usage, analysis and compliance. Firewall shall have suitable memory architecture and solution to store and be enable to export all logs/events for a period of last 90 days at any given time.
11. Firewall shall have features and be compatible with local as well as central authentication system (RADIUS, LDAP, or TACACS+) for user account and access right management. It shall also have Role Based User management feature.
12. Firewall shall have the capability to configure sufficient number of VLANs.



570

**Transmission Service Agreement**

13. Firewall shall have the capability to support sufficient number of sessions.
14. Firewall shall have provision to configure multiple IP Sec VPNs, at least 100 Nos., (one-to-many or many-to-one). Shall support redundant operation with a similar router after creation of all the IP Sec VPN. IPsec VPN shall support encryption protocols as AES128, AES256 and hashing algorithms as MD5 and SHA1. IPsec VPN throughput shall support at least 300 Mbps
15. Firewall shall be capable of SNMP v3 for monitoring from Network Management system. It shall also have SNMPv3 encrypted authentication and access security
16. Firewall shall support in Active/Passive or Active-Active mode with High Availability features like load balancing, failover for firewall and IPsec VPN without losing the session connectivity.
17. Firewall should have integrated traffic shaping (bandwidth, allocation, prioritisation, etc.) functionality
18. Shall support simultaneous operation with both IPv4 and IPv6 traffic
19. Firewall shall be compatible with SNTP/NTP or any other standards for clock synchronization
20. Firewall shall have the features of port as well as MAC based security
21. Firewall shall support exporting of logs to a centralized log management system (e.g. syslog) for security event and information management.
22. Firewall time shall be kept synchronised to official Indian Timekeeping agency, time.nplindia.org.
23. Firewall product shall be provided with all applicable updates at least until 36 months since the applicable date of product shipping to the concerned utility.

*Shan*  
Central Transmission Utility of India Limited

110

Rajhansda RE Transmission Limited



541

### Firewall Placement Diagram

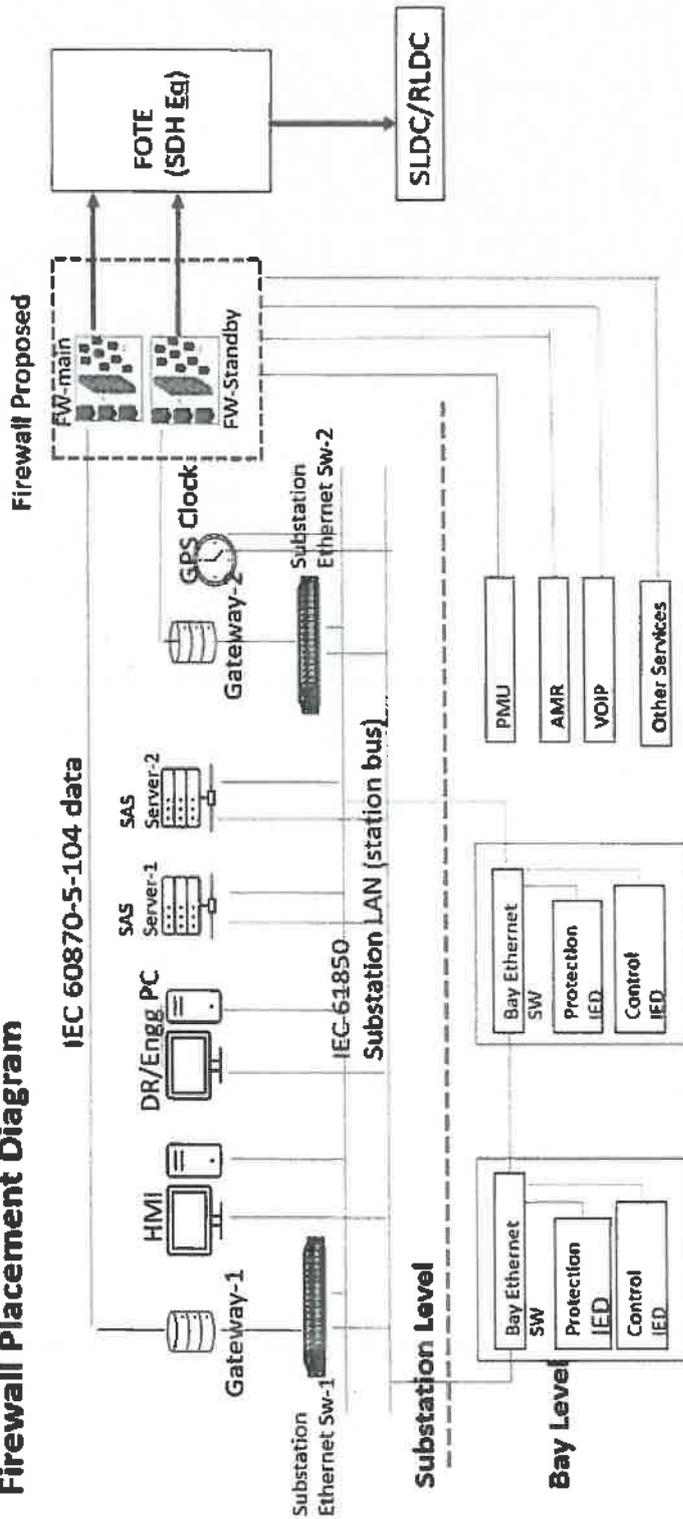


Figure F.2

542

Mr. A



Transmission Service Agreement

C.5.0 PLCC and PABX:


Power line carrier communication (PLCC) equipment complete for speech, tele-protection commands and data channels shall be provided on each transmission line. The PLCC equipment shall in brief include the following: -

- (i) Coupling device, line traps, carrier terminals, protection couplers, HF cables, PABX (if applicable) and maintenance and testing instruments.
- (ii) At new substation, a telephone exchange (PABX) of 24 lines shall be provided at as means of effective communication among various buildings of the substation, remote end substations and with control centers (RLDC/SLDC) etc.
- (iii) Coupling devices shall be suitable for phase to phase coupling for 400 kV Transmission lines. The pass band of coupling devices shall have sufficient margin for adding communication channel in future if required. Necessary protection devices for safety of personnel and low voltage part against power frequency voltages and transient over voltage shall also be provided.
- (iv) The line traps shall be broad band tuned suitable for blocking the complete range of carrier frequencies. Line Trap shall have necessary protective devices such as lightning arresters for the protection of tuning device. Decoupling network consisting of line traps and coupling capacitors may also be required at certain substation in case of extreme frequency congestion.
- (v) The carrier terminals shall be of single side-band (SSB) amplitude modulation (AM) type and shall have 4 kHz band width. PLCC Carrier terminals and Protection couplers shall be considered for both ends of the line.
- (vi) PLCC equipment for all the transmission lines covered under the scheme shall be provided by TSP. PLCC to be provided for following lines under present scope:

Sl. No	Line name	PLCC configuration
1	Raghanesda (GIS) – Banaskantha 765 kV D/C line	1 set Analog PLCC + 1 set Digital Protec Coupler for each circuit at both ends.

Further, CVT and Wave trap for all 765 kV and 400 kV line bays under present scope shall be provided by TSP.

- (vii) All other associated equipment like cabling, coupling device and HF cable shall also be provided by the TSP.
- (viii) 2 sets of 48 V battery banks for PLCC and communication equipment shall be provided at each new Substation with at least 10-hour battery backup and extended backup, if required.

  
Central Transmission Utility of India Limited

112



Raghanesda RE Transmission Limited



573

SPECIFIC TECHNICAL REQUIREMENTS FOR INTEGRATION OF COMMUNICATION EQUIPMENT


WITH REGIONAL LEVEL NMS / REGIONAL UNMS:

The new communication equipment/ system for all the substations under the present scope shall be compatible for integration with existing regional level NMS system/ Centralized Supervision and Monitoring System (CSMS) i.e. Regional UNMS. The local configuration of the new communication equipment at the station end shall be the responsibility of TSP as per Annexure E.1. The configuration work in the existing centralized NMS/ CSMS at Control center end, for integration of new Communication equipment/ system shall be done by Regional ULDC Team/ NMT, however all the necessary support in this regard shall be ensured by TSP.

**Annexure E.1**

Requirement for integration of Communication Equipment with Regional UNMS:

- (i) TSP shall ensure that NMS/EMS/NE supplied by them is NBI compliant and all FCAPS functionality is supported in the NBI such as NE Inventory, Hardware Inventory – Shelf/Slot/Card/SFP/Port, Topology, Protections, Alarms, Performance- real time and periodic, Performance KPI parameters ( E-1, STM, Ethernet) , Remote Configuration, Cross Connects, Trails and Circuits, Services Provisioning (NE), E-1 , STM, Ethernet , TX and RS Trace, loop back and details are published in the NBI guide for the configuration parameters.
- (ii) TSP shall be obliged to provide/share all necessary documentations such as NBI Guide/MIB/IDL/WSDL/API files/ etc. for onward integration of their NMS/EMS/NE with regional UNMS.
- (iii) The following support shall be provided by TSP for integration of their supplied equipment with regional UNMS:
  - Enabling and activating NBI license in their EMS/NMS and providing NBI login access along with User credentials
  - Assist in verifying NBI Connectivity with UNMS vendor for the successful communication and retrieval of data.
  - Assist in troubleshooting (if required) for NBI connectivity along with UNMS vendor for the communication and retrieval of data.
- (iv) For standalone NE which is not integrated with any EMS/NMS, TSP shall provide modality of complete FCAPS data acquisition as above through industry standard programmatic methods and provide the CLI command manual.

  
Central Transmission Utility of India Limited

113



Raghavendra RE Transmission Limited



Transmission Service Agreement

Frequently Asked Queries:

1.0 Transmission Line:

1.1 Please clarify that whether shutdowns for crossing of existing transmission lines of POWERGRID/STUs/ Power Evacuation Lines from Generation Plants/ Any other Transmission Licensee will be given to TSP on chargeable basis or free of cost

**Reply:** Shutdowns for crossing of existing transmission lines of POWERGRID/ STUs/ Power Evacuation Lines from Generation Plants/ Any other Transmission Licensee will be given to TSP by the concerned owner of the lines as per their own terms and conditions. As far as shutdown of ISTS lines are concerned the same can be availed by approaching respective Regional Power Committee.

1.2 We understand that the suggested swing angle criteria are applicable for Suspension Insulator in Suspension Tower. Further, you are requested to provide similar swing angle and clearance criteria for Pilot Insulator with Jumper and Jumper.


**Reply:** It is clarified that the swing angle criteria (as mentioned in RFP) for transmission lines is applicable for Suspension Insulator in Suspension Tower. Further, as per Clause 3.0 of Specific Technical Requirements for transmission lines, Transmission service Provider (TSP) shall adopt any additional loading/design criteria for ensuring reliability of the line, if so desired and /or deemed necessary.


1.3 We request you to kindly allow that use of diamond configuration at Power line crossings and the existing owner of the lines may be directed to allow the same for the successful bidders.

**Reply:** Power line crossing including Diamond configuration is responsibility of the TSP. TSP shall formally submit the profile of the crossing section to the owner of the existing line suggesting proposed crossing alternatives. The crossing will have to be carried out as per approval of owner of the existing line.

1.4 It is requested you to kindly provide present status of Forest Clearances if any transmission line corridor area falling in wildlife forest / reserve forest/ mangroves

**Reply:** Based on the preliminary route survey, the process of initiation of forest clearance for the forest stretches, if any, enroute the proposed line alignment will be initiated by way of writing letters to the concerned authority (ies). However, it may be noted that it will be the responsibility of TSP for obtaining forest clearance for the forest stretches as provided in the survey report and also for any forest area

  
Central Transmission Utility of India Limited

114  Raghavendra RE Transmission Limited



545

**Transmission Service Agreement**

encountered during detailed survey.

1.5 For transmission line, no special requirement is specified for type of Insulator and creepage in RFP document. Hence it is understood that bidder can decide the type of insulator along with creepage requirement based on general CEA regulations and relevant standards. Kindly confirm.

**Reply:** The minimum specific creepage distances shall be decided for the pollution condition in the area of installation. It shall be as per CEA regulations and relevant standards.

**2.0 Substation**

2.1 We understand that space for storage of O&M spare shall be provided by existing owner within the station boundary without any cost. Kindly confirm.

**Reply:** Space for storage of O&M spares shall be arranged by TSP on its own.

2.2 We presume that the O&M for the end Termination bays will be in the scope of the TSP and TSP shall not be liable for any payment towards O&M to the existing owner of the substation. Kindly confirm.

**Reply:** Operation and maintenance of the bays is solely responsibility of the TSP. Further, TSP shall follow CEA's "Operation and Maintenance (O&M) guidelines and Standard Format for Memorandum of Understanding between New TSP and Existing TSP" issued by CEA vide its letter No. 1/28514/2023 dated 22.06.2023. Copy of the guideline is available on CEA website at following link:


[https://cea.nic.in/wpcontent/uploads/pse\\_\\_\\_td/2023/06/om\\_guidelines.pdf](https://cea.nic.in/wpcontent/uploads/pse___td/2023/06/om_guidelines.pdf)

2.3 With reference to subject scheme of existing sub-station, we assumed following scope of work:

- (a) We assumed internal road is available and need not to consider in the present scope of work.
- (b) Drainage is available and need not to consider in the present scope of work.
- (c) Cable trench extension in adjacent to Main cable trench only under present scope of work.
- (d) Levelled area being provided by developer for bay extension.

**Reply:** Regarding requirement of internal road, drainage, cable trench, leveling of the bay extension area, bidder is advised to visit site and acquaint themselves with the provisions/facilities available at substation.

2.4 Kindly provide the soil investigation report of soil parameters of existing substation.

  
Central Transmission Utility of India Limited

115



Raghavendra RE Transmission Limited



546

**Transmission Service Agreement**

**Reply:** Bidder is advised to visit the substation site and ascertain the requisite parameters.

2.5 Kindly confirm, energy accounting of aux. power consumption. Whether it will be on chargeable basis or part of transmission loss.

**Reply:** It will be on chargeable basis.

2.6 We understand that VMS requirement is for unmanned stations only. For Manned stations VMS is not compulsory.

**Reply:** VMS shall be provided in line with requirements of RfP document.

2.7 It is understood that Construction water and power shall be provided free of cost to TSP by respective substation owner for construction of new bays.

**Reply:** Arrangement of construction power and water is in the scope of TSP.

2.8 It is understood that existing fire hydrant system shall be extended by the TSP for bay extension.

**Reply:** Existing fire hydrant system shall be extended from existing system (if required)

2.9 Please clarify that Status of land acquisition for Substations. Whether the lands have been acquired by BPC and will be transferred to TSP.

**Reply:** The acquisition of land for substation is in the scope of TSP.

2.10 We understood that no any dedicated metering CT and CVT required for Line/feeders. Further, we understood that requisite Energy meters for various 765 kV, 400 kV and 220 kV Feeders shall be provided and installed by CTU free of cost to TSP.


**Reply:** Dedicated metering CT and CVT are not required for line/feeders. Metering core of existing CT/CVT can be used provided accuracy class is matching with metering requirement. Requisite Special Energy Meters shall be provided and installed by CTU at the cost of TSP in C&P panel subject to space availability, else, in separate metering panel (to be provided by TSP at its cost).

2.11 A draft copy of the Connection Agreement may be furnished. A draft copy of the Connection Agreement may be furnished.

**Reply:** Web page link [https://www.ctuil.in/formats\\_gna\\_transition](https://www.ctuil.in/formats_gna_transition)


2.12 Please clarify whether the spare 765 kV single phase Reactor unit for Bus reactor shall be provided with 1ph 765 kV CB.

**Reply:** As per RfP, the spare 1-Ph reactor unit shall be utilized for all the bus and switchable line reactor banks (including for future reactor banks). Hence, 1ph 765 kV CB shall also be

  
Central Transmission Utility of India Limited

116

  
Raghnesda Re Transmission Limited



*Handwritten mark*



**Transmission Service Agreement**

provided with spare 1-Ph reactor for utilizing with bus reactor as well as switchable line reactor.

2.13 It is understood that existing busbar protection have provision for future bays and also PUs are available for future bays. BPC to confirm availability of CU and PU for bays under present scope of work at existing substations. BPC may kindly confirm availability of communication ports for integrating new PUs with the existing CUs at existing substations.

**Reply:** Bus Bar Protection with Central Unit (CU) is required for new bus section as specified in RFP. Peripheral Units (PUs) shall be provided by the respective bay owner. Further, augmentation/replacement of existing CU, if required, to meet the system requirement shall also be provided for proper functioning of bus bar protection.

2.14 For SCADA, it is understood that necessary process I/O shall be available for future bays and accordingly license for same. BPC to confirm.

**Reply:** Necessary process I/O along with license shall be in the scope of the successful bidder.

2.15 No separate FF system is envisaged under the present scope of work for existing substation. BPC to confirm.

**Reply:** Existing fire-fighting systems shall be extended to meet the additional requirements under present scope.

2.16 PLCC for 220 kV Lines are not under the scope of TSP. BPC to Confirm. It is requested to provide Type of Coupling for 220 kV Transmission Lines under present scope.

**Reply:** PLCC for 220 kV line is in the scope of developer of the line. Inter circuit coupling for 220 kV D/C and phase to phase coupling for 220 kV S/C shall be applicable for PLCC.

2.17 BPC is requested to confirm the availability of space in the existing control rooms at existing substation for execution of extension work under current project.

**Reply:** Switchyard Panel Rooms are generally required for AIS type substation and relay room are required for GIS type substation. Further, if needed, control room shall be augmented as per requirement.

**3.0 Communication**

3.1 What are the usage of OPGW, FOTE, PMU etc. under communication requirement of RFP?

Central Transmission Utility of India Limited

117



548

**Transmission Service Agreement**

**Reply:** User shall be responsible for providing compatible equipment along with appropriate interface for uninterrupted communication with the concerned control center and shall be responsible for successful integration with the communication system provided by CTU.

Communication systems e.g. OPGW, FOTE etc. and PMU are required for grid operation through RLDC/SLDC, speech communication, tele-protection and tele-metering.

**3.2** Is space for installation of communication panels are provided to TSP in existing Substations in case new bays are in the scope of TSP?

**Reply:** The space related issues are deliberated in the RFP itself. TSP to install FOTE/FODP panels in the new Bay Kiosk (Switchyard Panel Room (SPR)) / Bay Kiosk/ Relay Panel Room (in case of GIS S/s). Further, TSP to connect and integrate the proposed FOTE with the existing FOTE in the control room to complete communication path upto RLDC.

In Case 132 kV Substation TSP shall accommodate the said panels either by extension of existing control room or other arrangements.

**3.3** How is the OPGW laying done in case of LILO lines?

**Reply:** In case LILO lines are on same towers (e.g. both Line In and Line Out portion are on same towers, generally done LILO of S/C lines). Then 2x48F OPGW shall be required to install by TSP on both earthwire peak on 400 kV and 765 kV lines where two E/W peaks are available. On 220 and 132 kV lines where only one E/W peak is available TSP to install one no. 96F OPGW.

In case LILO lines are on different towers (e.g. both Line In and Line Out portion are on different towers, generally done LILO of D/C lines). Then 1x48F OPGW shall be required to install by TSP on one earthwire peak and conventional earthwire on second earthwire peak, on both Line In and Line Out portion towers of 400 kV and 765 kV lines. On 220 kV and 132 kV lines where only one E/W peak is available TSP to install one No. 48F OPGW in place of conventional earthwire.

**3.4** How is the OPGW laying done in case Multi circuit Towers?

**Reply:** In case two different lines are using common multi circuit portion for some distance (originating from different stations, may be terminating on same or on different stations). Two No. 48F OPGW to be installed on both E/W peaks for common M/C portion of 765 kV and 400 kV lines.

In case 220/132 kV lines using multi circuit portion where single E/W peak is available one No. 96F may be installed for common multi circuit portion.

**3.5** How PMUs are integrated for new bays at existing Substations?

**Reply:** PMU data of new bays to be provided in the ethernet port of switch at control room and thereafter to be connected with existing FOTE of existing substation to send data to PDC of RLDC by TSP. These PMUs shall be provided with GPS clock and LAN switch and

Central Transmission Utility of India Limited

118

Raghnesda RE Transmission Limited



549



**Transmission Service Agreement**

shall connect with LAN switch of control room of respective substations with Fibre Optic cable.

**3.6 Is Spare direction available in existing FOTE for integration with new bay kiosk FOTE**

**Reply:** The FOTE under present scope shall be integrated by TSP with the existing FOTE at control room of substation for onwards data transmission.

In case spare optical direction is not available in the existing FOTE at the control room, the TSP shall coordinate with station owner to reconfigure the directions in existing FOTE at control room.

**3.7 What is the distance from LILO point to proposed substation for feasibility of repeater station?**

**Reply:** Tentative Location of LILO point shall be as per survey report of BPC however exact location to be ascertained after detailed survey by TSP.

**What is the make and model of existing OPGW in case LILO of main line at new substation?**

**Reply:** All OPGW (along with optical fibers) meet Central Electricity Authority (Technical Standards for Communication System in Power System Operations) Regulations, 2020 and bidder shall install OPGW accordingly.

**3.9 In case of LILO of existing line at new substation who shall provide PMUs at existing substation bays?**

**Reply:** TSP to provide PMUs for all bays under their scope of RFP.

**4.0 Planning :**

**4.1 Whether the Project/ Elements are eligible for early commissioning incentive as per MoP, GoI order dated 15.07.2015.?**

**Reply:** Commissioning is to be done as per the timeline mentioned in RfP. However, early commissioning shall be treated as per applicable CERC Regulations/orders.



Central Transmission Utility of India Limited

119



Raghnesda RE Transmission Limited



055

Transmission Service Agreement

Scheduled: 2

Scheduled COD

[Note: As referred to in the definition of "Element", "Scheduled COD", and in Articles 3.1.3 (c), 4.1 (b) and 4.3 (a) of this Agreement]

Sl. No	Name of the Transmission Element	Scheduled COD	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre-required for declaring the commercial operation (COD) of the respective Element
1.	Establishment 4x1500 MVA, 765/400 kV Substation near Raghnesda (GIS) with 2x330 MVA, 765 kV bus reactor and 2x125 MVA, 420 kV bus reactor	27 months from effective date (23.10.2027)	52.69%	All Elements are required to be commissioned simultaneously as their utilization is dependent on commissioning of each other.
2.	Raghnesda (GIS) – Banaskantha (PG) 765 kV D/C line		36.50%	
3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s		2.80%	
4.	Creation of 220 kV switchyard (Bus Sec-I) at Raghnesda PS (GIS) along with installation of 2x500 MVA, 400/220 kV ICTs	30.09.2027*	7.28%	

Central Transmission Utility of India Limited

120

Raghnesda RE Transmission Limited



551

**Transmission Service Agreement**

5.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Azure Power Sixty-Three Pvt. Ltd. (2200001107) (300 MW)	30.09.2027*	0.36%	
6.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Sunsure Solarpark RJ One Pvt. Ltd. (2200001018) (350 MW)	31.03.2028	0.37%	Element at Sl. No. 6 can be commissioned separately subject to commissioning of elements at sl. No. 1 to 4.

\*Subject to minimum schedule of 27 months from effective date.



Central Transmission Utility of India Limited

121



Raghnesda RE Transmission Limited



552

Transmission Service Agreement

Schedule: 3

Safety Rules and Procedures

[Note: As referred to in Articles 5.6 of this Agreement]

1. Site Regulations and Safety:

The TSP shall establish Site regulations within sixty (60) days from fulfilment of conditions subsequent, as per Prudent Utility Practices setting out the rules to be observed till expiry of the Agreement at the Site and shall comply therewith.

Such Site regulations shall include, but shall not be limited to, rules in respect of security, safety of the Project, gate control, sanitation, medical care, and fire prevention, public health, environment protection, security of public life, etc.

Copies of such Site regulations shall be provided to the Nodal Agency and the CEA for the purpose of monitoring of the Project.

2. Emergency Work:

In cases of any emergency, the TSP shall carry out all necessary remedial work as may be necessary.


If the work done or caused to be done by any entity, other than the TSP, the TSP shall, reimburse the actual costs incurred, to the other Party carrying out such remedial works.

3. Site Clearance:

In the course of execution of the Agreement, the TSP shall keep the Site reasonably free from all unnecessary obstruction, storage, remove any surplus materials, clear away any wreckage, rubbish and temporary works from the Site, and remove any equipment no longer required for execution of the Agreement. After completion of all Elements of the Project, the TSP shall clear away and remove all wreckage, rubbish and debris of any kind from the Site, and shall leave the Site clean and safe.

4. Watching and Lighting:

The TSP shall provide and maintain at its own expense all lighting, fencing, and watching when and where necessary for the proper construction, operation, maintenance / repair of any of the Elements of the Project, or for the safety of the owners and occupiers of adjacent property and for the safety of the public, during such maintenance / repair.

  
Central Transmission Utility of India Limited



122



Raghnesda RE Transmission Limited



Transmission Service Agreement

Schedule: 4

Computation of Transmission Charges

1.1 General

The Monthly Transmission Charges to be paid to the TSP for providing Transmission Service for any Contract Year during the term of the Agreement shall be computed in accordance with this Schedule and paid as per Sharing Regulations.

Illustration regarding payment of Transmission Charges under various scenarios (considering definitions of Contract Year, Expiry Date and Monthly Transmission Charges above) is as below: -

Illustration-1: In case the Project Elements achieve COD as per Schedule

Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the Element
Element 1	28	1-Feb-2018	1-Feb-2018	25%
Element 2	38	1-Dec-2018	1-Dec-2018	75%

Tariff Payable as follows:

Transmission Charges for Element 1			Transmission Charges for Element 2		
1-Feb-18 to 31-Mar-18	140 X 25% X ((28+31)/365)	5.65		--	0.00
1-Apr-18 to 30-Nov-18	140 X 25% X (244/365)	23.39		--	0.00
1-Dec-18 to 31-Mar-19	140 X 100% X (121/365)				46.41
2	140 X 100% X 1				140
3	140 X 100% X 1				140
4	140 X 100% X 1				140
5	140 X 100% X 1				140
.....					

Central Transmission Utility of India Limited

123



Raghnesda RE Transmission Limited



554

**Transmission Service Agreement**

.....		
36 (1-Apr to 30-Nov)	140 X 100% X (244/365)	93.59

**Illustration-2: In case of extension of Scheduled COD as per Article 4.4.1 & 4.4.2 of this Agreement**

**Quoted Transmission Charges: Rs. 140 Million**

**Completion Schedule:**

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the Element
Element 1	20	1-Feb-2018	1-Jul-2018	25%
Element 2	28	1-Oct-2018	1-Dec-2018	75%

**Tariff Payable as follows:**

Transmission Charges for Element 1			Transmission Charges for Element 2		
1-Feb-18 to 31-Mar-18	--	0.00		--	0.00
1-Apr-18 to 30-Jun-18	--	0.00		--	0.00
1-Jul-18 to 30-Nov-18	140 X 25% X (153/365)	14.67		--	0.00
1-Dec-18 to 31-Mar-19	140 X 100% X (121/365)				46.41
2		140 X 100% X 1			140
3		140 X 100% X 1			140
4		140 X 100% X 1			140
5		140 X 100% X 1			140
.....					
.....					
36 (1-Apr to 30-Nov)	140 X 100% X (244/365)				93.59

*Signature*  
Central Transmission Utility of India Limited

124



Raghnesda RE Transmission Limited



555

**Transmission Service Agreement**

**Illustration-3: In case of delay in achieving COD of Project & all individual Elements (COD of the Project achieved in Contract Year 1)**

**Quoted Transmission Charges: Rs. 140 Million**

**Completion Schedule:**

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the Element
Element 1	20	1-Feb-2018	1-Dec-2018	25%
Element 2	28	1-Oct-2018	1-Dec-2018	75%

**Tariff Payable as follows:**

Transmission Charges for Element 1			Transmission Charges for Element 2		
1-Feb-18 to 31-Mar-18	--	0.00		--	0.00
1-Apr-18 to 30-Sept-18	--	0.00		--	0.00
1-Oct-18 to 30-Nov-18	--	0.00	1-Oct-18 to 30-Nov-18	--	0.00
1-Dec-18 to 31-Mar-19	140 X 100% X (121/365)				46.41
2	140 X 100% X 1				140
3	140 X 100% X 1				140
4	140 X 100% X 1				140
5	140 X 100% X 1				140
.....					
.....					
36 (1-Apr to 30-Nov)	140 X 100% X (244/365)				93.59

Central Transmission Utility of India Limited

125



Raghmesda Re Transmission Limited



558

**Transmission Service Agreement**

**Illustration-4: In case of delay in achieving COD of Project & all individual Elements (COD of the Project achieved in Contract Year other than Contract Year 1)**


Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the Element
Element 1	38	1-Oct-2019	1-May-2020	25%
Element 2	38	1-Oct-2019	1-May-2020	75%

Tariff Payment to be paid as:

Transmission Charges for Element 1			Transmission Charges for Element 2		
1-Oct-19 to 31-Mar-20	--	0.00	1-Oct-19 to 31-Mar-20	--	0.00
1-Apr-20 to 30-Apr-20	-	0.00	1-Apr-20 to 30-Apr-20	-	0.00
1-May-20 to 31-Mar-21	140 X 100% X (335/365)				128.49
2	140 X 100% X 1				140
3	140 X 100% X 1				140
4	140 X 100% X 1				140
5	140 X 100% X 1				140
.....					
.....					
36 (1-Apr to 30-Apr)	140 X 100% X (30/ 365)				11.51

  
Central Transmission Utility of India Limited

126



Raghavendra RE Transmission Limited



552

**Transmission Service Agreement**

**Illustration5: In case of delay in achieving COD of Element but Project COD achieved on time**

**Quoted Transmission Charges: Rs. 140 Million**

**Completion Schedule:**

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the Element
Element 1	20	1-Feb-2018	1-Jul-2018	25%
Element 2	30	1-Dec-2018	1-Dec-2018	75%

**Tariff Payable as follows:**

Transmission Charges for Element 1			Transmission Charges for Element 2		
1-Feb-18 to 31-Mar-18	--	0.00		--	0.00
1-Apr-18 to 30-Jun-18	--	0.00		--	0.00
1-Jul-18 to 30-Nov-18	140 X 25% X (153/365)	14.67		--	0.00
1-Dec-18 to 31-Mar-19	140 X 100% X (121/365)				46.41
2	140 X 100% X 1				140
3	140 X 100% X 1				140
4	140 X 100% X 1				140
5	140 X 100% X 1				140
.....					
.....					
36 (1-Apr to 30-Nov)	140 X 100% X (244/365)				93.59

*THM*  
Central Transmission Utility of India Limited

127



Raghavendra RE Transmission Limited



*558*

**Transmission Service Agreement**

**Illustration-6: In case of early commissioning of Project**

Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the Element
Element 1	38	1-Oct-2019	1-Jul-2019	25%
Element 2	38	1-Oct-2019	1-Jul-2019	75%

Tariff Payment to be paid as:

Transmission Charges for Element 1		Transmission Charges for Element 2	
1-July-19 to 31-Mar-20	140 X 100% X (274/365)		105.09
2	140 X 100% X 1		140
3	140 X 100% X 1		140
4	140 X 100% X 1		140
5	140 X 100% X 1		140
.....			
.....			
36 (1-Apr to 30-Jun)	140 X 100% X (91/365)		34.91

Central Transmission Utility of India Limited

128

Raghnesda RE Transmission Limited



559

**Transmission Service Agreement**

**Illustration-7: In case of early commissioning of an element**

Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the Element
Element 1	38	1-Oct-2019	1-Apr-2019	25%
Element 2	38	1-Jul-2019	1-Jul-2019	75%

Tariff Payment to be paid as:

Transmission Charges for Element 1			Transmission Charges for Element 2		
1-Apr-2019 to 30-Jun-19	140 X 25% X (91/365)	8.72	1-Apr-2019 to 30-Jun-19	--	0.00
1-July-19 to 31-Mar-20	140 X 100% X (274/ 365)				105.09
2	140 X 100% X 1				140
3	140 X 100% X 1				140
4	140 X 100% X 1				140
5	140 X 100% X 1				140
.....					
.....					
36 (1-Apr-30-Jun)	140 X 100% X (91/365)				34.91

The Transmission Charges shall be payable on monthly basis as computed above.

**1.2 Computation of Monthly Transmission Charges**

The Monthly Transmission Charges for any month m in a Contract Year n shall be calculated as below:

For AC System:

- a. If Actual Transmission System Availability for the month m of contract year n is greater than or equal to 98% and less than or equal to 98.5%;

Central Transmission Utility of India Limited

129



Raghavendra RE Transmission Limited



580

Transmission Service Agreement

Monthly Transmission Charges  $MTC(m) = Tmn * 1$

- a. If Actual Transmission System Availability for the month m of contract year n exceeds 98.5% and less than or equal to 99.75%;

Monthly Transmission Charges  $MTC(m) = Tmn * (AA/ 98.5\%)$

- c. If Actual Transmission System Availability for the month m of contract year n is greater than 99.75%;

Monthly Transmission Charges  $MTC(m) = Tmn * (99.75\% / 98.5\%)$

- d. If Actual Transmission System Availability for the month m of contract year n is less than 98% and greater than or equal to 95.00%;

Monthly Transmission Charges  $MTC(m) = Tmn * (AA/ 98\%)$

- e. If Actual Transmission System Availability for the month m of contract year falls below 95%;

Monthly Transmission Charges  $MTC(m) = Tmn * (AA/ 98\%) - 0.02 * (Tmn * (AA/ 95\%))$

For DC System:

- a. If Actual Transmission System Availability for the month m of contract year n is greater than or equal to 95% and less than or equal to 96%;

Monthly Transmission Charges  $MTC(m) = Tmn * 1$

- b. If Actual Transmission System Availability for the month m of contract year n exceeds 96% and less than or equal to 99.75%;

Monthly Transmission Charges  $MTC(m) = Tmn * (AA/ 96\%)$

- c. If Actual Transmission System Availability for the month m of contract year n is greater than 99.75%;

Monthly Transmission Charges  $MTC(m) = Tmn * (99.75\% / 96\%)$

- d. If Actual Transmission System Availability for the month m of contract year n is less than 95% and greater than or equal to 92.00%;

Monthly Transmission Charges  $MTC(m) = Tmn * (AA/ 95\%)$

- e. If Actual Transmission System Availability for the month m of contract year falls below 92%;

Monthly Transmission Charges  $MTC(m) = Tmn * (AA/ 95\%) - 0.02 * (Tmn * (AA/ 92\%))$

where:

Central Transmission Utility of India Limited

130



Raghansda RE Transmission Limited




**Transmission Service Agreement**

- AA is the actual Availability, as certified by RPC, as per procedure provided in Schedule 6.
- m is the month in Contract Year 'n'
- $T_{mn}$  = Transmission Charges for the month 'm' in Contract Year 'n' = (Transmission Charge/ no. of days in the Year n)\* no. of days in month m

Provided, no Transmission Charges shall be paid during the period for which the RLDC has not allowed the operation of the Element/Project due to the failure of the TSP to operate it as per the provisions of the Grid Code.

**1.3 RLDC Fee & Charges**

The payment of RLDC fee & charges, in accordance with relevant regulations of CERC, shall be the responsibility of the TSP.

  
Central Transmission Utility of India Limited



131



Raghnesda RE Transmission Limited



Transmission Service Agreement

Schedule: 5

Quoted Transmission Charges

[Quoted Transmission Charges from Annexure - 21 of the RFP of the Selected Bidder to be inserted here]

[To be incorporated from the Bid of the Selected Bidder submitted during the e-reverse auction after its selection]

Quoted annual Transmission Charges: Rs. 2328.71 Million

Proportionate Transmission Charges payable for each Element of the Project:

Sl. No.	Name of the Transmission Element	Scheduled COD	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre-required for declaring the commercial operation (COD) of the respective Element
1.	Establishment 4x1500 MVA, 765/400 kV Substation near Raghanesda (GIS) with 2x330 MVA, 765 kV bus reactor and 2x125 MVA, 420 kV bus reactor	27 months from effective date (23.10.2027)	52.69%	All Elements are required to be commissioned simultaneously as their utilization is dependent on commissioning of each other.
2.	Raghanesda (GIS) - Banaskantha (PG) 765 kV D/C line		36.50%	
3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s		2.80%	
4.	Creation of 220 kV switchyard (Bus Sec-I) at Raghanesda PS (GIS) along	30.09.2027*	7.28%	Elements at Sl. No. 1, 2 and 3 are pre-required for

Central Transmission Utility of India Limited

132



Raghanesda RE Transmission Limited



573

**Transmission Service Agreement**

Sl. No.	Name of the Transmission Element	Scheduled COD	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre-required for declaring the commercial operation (COD) of the respective Element
	with installation of 2x500 MVA, 400/220 kV ICTs			declaring the commercial operation (COD)
5.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Azure Power Sixty-Three Pvt. Ltd. (2200001107) (300 MW)	30.09.2027*	0.36%	
6.	1 No. 220 kV line bay (GIS) (on 220 kV Bus Sec-I) for interconnection of Solar project of Sunsure Solarpark RJ One Pvt. Ltd. (2200001018) (350 MW)	31.03.2028	0.37%	Element at Sl. No. 6 can be commissioned separately subject to commissioning of elements at sl. No. 1 to 4.

\*Subject to minimum schedule of 27 months from effective date.

Central Transmission Utility of India Limited



133



Raghavendra RE Transmission Limited



584

Transmission Service Agreement

Schedule: 6

Appendix –IV to Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2024

Procedure for Calculation of Transmission System Availability Factor for a Month

1. Transmission system availability factor for nth calendar month ("TAFPn") shall be calculated by the respective transmission licensee, verified by the concerned Regional Load Dispatch Centre (RLDC) and certified by the Member-Secretary, Regional Power Committee of the region concerned, separately for each AC and HVDC transmission system and grouped according to sharing of transmission charges. In the case of the AC system, transmission System Availability shall be calculated separately for each Regional Transmission System and inter-regional transmission system. In the case of the HVDC system, transmission System Availability shall be calculated on a consolidated basis for all inter-state HVDC systems.
2. Transmission system availability factor for nth calendar month ("TAFPn") shall be calculated by considering the following:
  - i) **AC transmission lines:** Each circuit of AC transmission line shall be considered as one element;
  - ii) **Inter-Connecting Transformers (ICTs):** Each ICT bank (three single- phase transformers together) shall form one element;
  - iii) **Static VAR Compensator (SVC):** SVC, along with SVC transformer, shall form one element;
  - iv) **Bus Reactors or Switchable line reactors:** Each Bus Reactors or Switchable line reactors shall be considered as one element;
  - v) **HVDC Bi-pole links:** Each pole of the HVDC link, along with associated equipment at both ends, shall be considered as one element;
  - vi) **HVDC back-to-back station:** Each block of the HVDC back-to-back station shall be considered as one element. If the associated AC line (necessary for the transfer of inter-regional power through the HVDC back-to-back station) is not available, the HVDC back-to-back station block shall also be considered unavailable;

Central Transmission Utility of India Limited

134



Raghnesda RE Transmission Limited



565

**Transmission Service Agreement**

vii) **Static Synchronous Compensation ("STATCOM")**: Each STATCOM shall be considered as a separate element.

3. The Availability of the AC and HVDC portion of the Transmission system shall be calculated by considering each category of transmission elements as under:

**TAFPN (in %) for AC system:**

$$\frac{(o \times AVo) - (p \times AVp) + (q \times AVq) - (r \times AVr) - (u \times AVu)}{(o + p + q + r + u)} \times 100$$

Where,

- o** = Total number of AC lines.
- AVo** = Availability of o number of AC lines
- p** = Total number of bus reactors/switchable line reactors
- AVp** = Availability of p number of bus reactors/switchable line reactors
- q** = Total number of ICTs
- AVq** = Availability of q number of ICTs
- r** = Total number of SVCs
- AVr** = Availability of r number of SVCs
- u** = Total number of STATCOM
- AVu** = Availability of u number of STATCOM

**TAFMn (in %) for HVDC System:**

$$\sum_{x=1}^s Cxbp - \sum_{y=1}^t Cybtb$$

Where

- Cxbp(act)** = Total actual operated capacity of x<sup>th</sup> HVDC pole
- Cxbp** = Total rated capacity of x<sup>th</sup> HVDC pole
- AVxbp** = Availability of x<sup>th</sup> HVDC pole
- Cybtb(act)** = Total actual operated capacity of y<sup>th</sup> HVDC back-to-back station block
- Cybtb** = Total rated capacity of y<sup>th</sup> HVDC back-to-back station block
- AVybtb** = Availability of y<sup>th</sup> HVDC back-to-back station block
- s** = Total no of HVDC poles
- t** = Total no of HVDC Back to Back blocks

Central Transmission Utility of India Limited

135



Raghavendra RE Transmission Limited



596

**Transmission Service Agreement**

4. The availability for each category of transmission elements shall be calculated based on the weightage factor, total hours under consideration and non-available hours for each element of that category. The formulae for calculation of the Availability of each category of the transmission elements are as per Appendix-V. The weightage factor for each category of transmission elements shall be considered as under:
- (a) For each circuit of the AC line – The number of sub-conductors in the line multiplied by ckt-km;
  - (b) For each HVDC pole- The rated MW capacity x ckt-km;
  - (c) For each ICT bank – The rated MVA capacity;
  - (d) For SVC- The rated MVAR capacity (inductive and capacitive);
  - (e) For Bus Reactor/switchable line reactors – The rated MVAR capacity;
  - (f) For HVDC back-to-back stations connecting two Regional grids- Rated MW capacity of each block; and
  - (g) For STATCOM – Total rated MVAR Capacity.
5. The transmission elements under outage due to the following reasons shall be deemed to be available:
- i) Shut down availed for maintenance of another transmission scheme or construction of new element or renovation/upgradation/additional capitalization in an existing system approved by the Commission. If the other transmission scheme belongs to the transmission licensee, the Member Secretary, RPC may restrict the deemed availability period to that considered reasonable by him for the work involved. In case of a dispute regarding deemed availability, the matter may be referred to the Chairperson, CEA, within 30 days.
  - ii) Switching off of a transmission line to restrict over-voltage and manual tripping of switched reactors as per the directions of the concerned RLDC.
  - iii) Shut down of a transmission line due to the Project(s) of NHAI, Railways and Border Road Organization, including for shifting or modification of such transmission line or any other infrastructure project approved by Ministry of Power. Member Secretary, RPC may restrict the deemed availability period to that considered reasonable by him for the work involved; Provided that apart from the deemed availability, any other costs involved in the process of such

Central Transmission Utility of India Limited

136



Raghavendra RE Transmission Limited



567

**Transmission Service Agreement**

shutdown of transmission line shall not be borne by the DICs.

- iv) Provided that such deemed availability shall be considered only for the period for which DICs are not affected by the shutdown of such transmission line.
6. For the following contingencies, the outage period of transmission elements, as certified by the Member Secretary, RPC, shall be excluded from the total time of the element under the period of consideration for the following contingencies:
- i) Outage of elements due to force majeure events beyond the control of the transmission licensee. However, whether the same outage is due to force majeure (not design failure) will be verified by the Member Secretary, RPC. A reasonable restoration time for the element shall be considered by the Member Secretary, RPC, and any additional time taken by the transmission licensee for restoration of the element beyond the reasonable time shall be treated as outage time attributable to the transmission licensee. Member Secretary, RPC may consult the transmission licensee or any expert for estimation of reasonable restoration time. Circuits restored through ERS (Emergency Restoration System) shall be considered as available;
- ii) Outage caused by grid incident/disturbance not attributable to the transmission licensee, e.g. faults in a substation or bays owned by another agency causing an outage of the transmission licensee's elements, and tripping of lines, ICTs, HVDC, etc., due to grid disturbance. However, if the element is not restored on receipt of direction from RLDC while normalizing the system following grid incident/disturbance within reasonable time, the element will be considered not available for the period of outage after issuance of RLDC's direction for restoration;
- iii) The outage period which can be excluded for the purpose of sub-clause (i) and (ii) of this clause shall be declared as under:
- a. Maximum up to one month by the Member Secretary, RPC;
- b. Beyond one month and up to three months after the decision at RPC;
- c. Beyond three months by the Commission for which the transmission licensee shall approach the Commission along with reasons and steps taken to mitigate the outage and restoration timeline.
7. Time frame for certification of transmission system availability: (1) The following schedule shall be followed for certification of availability by the Member Secretary of the concerned

Central Transmission Utility of India Limited

137




Raghnesda RE Transmission Limited



**Transmission Service Agreement**

RPC:

- Submission of outage data along with documentary proof (if any) and TAFPn calculation by Transmission Licensees to RLDC/ constituents  
– By the 5th of the following month;
- Review of the outage data by RLDC / constituents and forward the same to respective RPC – by 20th of the month;
- Issue of availability certificate by respective RPC – by the 3rd of the next month.

  
Central Transmission Utility of India Limited

138



Raghavendra RE Transmission Limited



Transmission Service Agreement

Appendix-V

FORMULAE FOR CALCULATION OF AVAILABILITY OF EACH CATEGORY OF TRANSMISSION ELEMENTS

For AC transmission system

$$AV_o(\text{Availability of } o \text{ no. of AC lines}) = \frac{\sum_{i=1}^o W_i(T_i - TNA_i)/T_i}{\sum_{i=1}^o W_i}$$

$$AV_q(\text{Availability of } q \text{ no. of ICTs}) = \frac{\sum_{i=1}^q W_i(T_i - TNA_i)/T_i}{\sum_{i=1}^q W_i}$$

$$AV_r(\text{Availability of } r \text{ no. of SVCs}) = \frac{\sum_{i=1}^r W_i(T_i - TNA_i)/T_i}{\sum_{i=1}^r W_i}$$

$$AV_p(\text{Availability of } p \text{ no. of Switched Bus reactors}) = \frac{\sum_{m=1}^p W_m(T_m - TNA_m)/T_m}{\sum_{m=1}^p W_m}$$

$$AV_u(\text{Availability of } u \text{ no. of STATCOMs}) = \frac{\sum_{n=1}^u W_n(T_n - TNA_n)/T_n}{\sum_{n=1}^u W_n}$$

$$AV_{xpp}(\text{Availability of an individual HVDC pole}) = \frac{(T_x - TN)}{T_x}$$

$AV_{ypp}$  (Availability of an individual HVDC

$$\text{Back-to-back Blocks}) = \frac{(T_y - TNA_y)}{T_y}$$

Central Transmission Utility of India Limited

139

Raghunada RE Transmission Limited



SJO

Transmission Service Agreement

For the HVDC transmission system

For the new HVDC commissioned but not completed twelve months;

For first 12 months:  $[(AV_{sbp} \text{ or } AV_{yrb}) \times 95\%/85\%]$ , subject to a ceiling of 95%.

Where,

- $o$  = Total number of AC lines;  
 $AV_o$  = Availability of  $o$  number of AC lines;  
 $p$  = Total number of bus reactors/switchable line reactors;  
 $AV_p$  = Availability of  $p$  number of bus reactors/switchable line reactors;  
 $q$  = Total number of ICTs;  
 $AV_q$  = Availability of  $q$  number of ICTs;  
 $r$  = Total number of SVCs;  
 $AV_r$  = Availability of  $r$  number of SVCs;  
 $U$  = Total number of STATCOM;  
 $AV_u$  = Availability of  $u$  number of STATCOMs;  
 $W_i$  = Weightage factor for  $i$ th transmission line;  
 $W_k$  = Weightage factor for  $k$ th ICT;  
 $W_l$  = Weightage factors for inductive & capacitive operation of  $l$ th SVC;  
 $W_m$  = Weightage factor for  $m$ th bus reactor;  
 $W_n$  = Weightage factor for  $n$ th STATCOM  
 $T_i, T_k, T_l$  = The total hours of  $i$ th AC line,  $k$ th ICT,  $l$ th SVC,  $m$ th Switched Bus Reactor &  $n$ th STATCOM,  $x$ th HVDC pole,  $y$ th HVDC back-to-back blocks during the period under consideration (excluding time period for outages not attributed to transmission licensee for the reasons given in Para 5 of the procedure)  
 $T_{NAi}, T_{NAk}$  = The non-availability hours (excluding the time period for outages not  $T_{NAi}, T_{NAm}$ , attributable to transmission licensee taken as deemed availability as  $T_{NAi}, T_{NAk}, T_{NAx}, T_{NAy}$  per Para 5 of the procedure) for  $i$ th AC line,  $k$ th ICT,  $l$ th SVC,  $m$ th Switched Bus Reactor,  $n$ th STATCOM,  $x$ th HVDC pole and  $y$ th HVDC back-to-back block.

Central Transmission Utility of India Limited

140

Raghuvesda RE Transmission Limited




145

**Transmission Service Agreement**

**Schedule: 7**

**Entire Bid (both financial bid and technical bid) of the Selected Bidder to be attached here**

**Bid dated 28.04.2025 and 23.05.2025 shall be an integral part of this agreement.**

  
Central Transmission Utility of India Limited

141



Raghunadasa RE Transmission Limited



572

Transmission Service Agreement

Schedule: 8

Contract Performance Guarantee

(To be on non-judicial stamp paper of appropriate value as per Stamp Act relevant to place of execution. Foreign entities submitting Bids are required to follow the applicable law in their country.)

In consideration of the..... [Insert name of the SPV or Selected Bidder on behalf of the TSP, or Lead Member in case of the Consortium, with address] agreeing to undertake the obligations under the Transmission Service Agreement dated and the other RFP Project Documents and the Nodal Agency and the PFC Consulting Limited, agreeing to execute the RFP Project Documents with the Selected Bidder, regarding setting up the Project, the ..... [Insert name and address of the bank issuing the guarantee and address of the head office] (hereinafter referred to as "Guarantor Bank") hereby agrees unequivocally, irrevocably and unconditionally to pay to.....(being the Nodal Agency) at .....[Insert the Place from the address of the Nodal Agency indicated in the TSA] forthwith on demand in writing from the Nodal Agency or any Officer authorized by it in this behalf, any amount up to and not exceeding Rupees ..... Crores (Rs. ....) only [Insert the amount of the bank guarantee] on behalf of M/s..... [Insert name of the Selected Bidder or SPV]

This guarantee shall be valid and binding on the Guarantor Bank up to and including .....and shall not be terminable by notice or any change in the constitution of the Bank or the term of the Transmission Service Agreement or by any other reasons whatsoever and our liability hereunder shall not be impaired or discharged by any extension of time or variations or alternations made, given, or agreed with or without our knowledge or consent, by or between parties to the respective agreement.

Our liability under this Guarantee is restricted to Rs. .... Crores (Rs. ....) only. Our Guarantee shall remain in force until ..... [Insert the date of validity of the Guarantee as per Article 3.1.2 of this Agreement]. The Nodal Agency, shall be entitled to invoke this Guarantee up to three hundred sixty five (365) days of the last date of the validity of this Guarantee.

The Guarantor Bank hereby expressly agrees that it shall not require any proof in addition to the written demand from ..... (In its roles as the Nodal Agency), made in any format, raised at the above mentioned address of the Guarantor Bank, in order to make the said payment to Nodal Agency.

  
Central Transmission Utility of India Limited

142



Raghnesda RE Transmission Limited



CS

**Transmission Service Agreement**

The Guarantor Bank shall make payment hereunder on first demand without restriction or conditions and notwithstanding any objection by ..... (Insert name of the Selected Bidder), ..... (Insert name of the TSP) and / or any other person. The Guarantor Bank shall not require Nodal Agency to justify the invocation of this BANK GUARANTEE, nor shall the Guarantor Bank have any recourse against Nodal Agency in respect of any payment made hereunder.

**THIS BANK GUARANTEE** shall be interpreted in accordance with the laws of India.

The Guarantor Bank represents that this BANK GUARANTEE has been established in such form and with such content that it is fully enforceable in accordance with its terms as against the Guarantor Bank in the manner provided herein.

**THIS BANK GUARANTEE** shall not be affected in any manner by reason of merger, amalgamation, restructuring, liquidation, winding up, dissolution or any other change in the constitution of the Guarantor Bank.

**THIS BANK GUARANTEE** shall be a primary obligation of the Guarantor Bank and accordingly Nodal Agency shall not be obliged before enforcing this BANK GUARANTEE to take any action in any court or arbitral proceedings against ..... (Insert name of the SPV) or the Selected Bidder, as the case may be, to make any claim against or any demand on ..... (Insert name of the SPV) or the Selected Bidder, as the case may be, or to give any notice to ..... (Insert name of the SPV) or the Selected Bidder, as the case may be, or to enforce any security held by the Nodal Agency or to exercise, levy or enforce any distress, diligence or other process against ..... (Insert name of the SPV) or the Selected Bidder, as the case may be.

The Guarantor Bank acknowledges that this BANK GUARANTEE is not personal to Nodal Agency and may be assigned, in whole or in part, (whether absolutely or by way of security) by Nodal Agency to any entity to whom the Nodal Agency is entitled to assign its rights and obligations under the Transmission Service Agreement.

The Guarantor Bank hereby agrees and acknowledges that Nodal Agency shall have a right to invoke this Bank Guarantee either in part or in full, as it may deem fit.

Notwithstanding anything contained hereinabove, our liability under this Guarantee is restricted to Rs. .... Crores (Rs. ....) only and it shall remain in force until ..... [Date to be inserted on the basis of Article 3.1.2 of the Transmission Service Agreement], with an additional claim period of three hundred sixty five (365) days thereafter. This BANK GUARANTEE shall be extended from time to time for such period, as may be desired by RAGHANESDA RE TRANSMISSION LIMITED. We are liable to pay the guaranteed amount or

Central Transmission Utility of India Limited

143

Raghanesda RE Transmission Limited



475

**Transmission Service Agreement**

any part thereof under this Bank Guarantee only if Nodal Agency serves upon us a written claim or demand.

**In witness where of:**

Signature .....

Name: .....

Power of attorney No.: .....

**For:**

..... [Insert Name of the Bank]

**Banker's Seal and Full Address, including mailing address of the Head Office**

Central Transmission Utility of India Limited

144

Raghnesda RE Transmission Limited



SES

Transmission Service Agreement

Schedule: 9

**Methodology for determining the Relief Under Force Majeure Event & Change in Law during Construction Period**

The relief in the form of revision in tariff due to Force Majeure Event leading to extension of Scheduled COD for a period beyond one hundred eighty (180) days and/ or Change in Law during the construction period shall be as under:

$$\Delta T = [(P \times d)] \div [1 - (1 + d)^{-n}]$$

Where,


$\Delta T$  = Change in Transmission Charges for each year

$P$  = Sum of cumulative increase or decrease in the cost of the Project due to Change in Law and interest cost during construction corresponding to the period exceeding one hundred eighty (180) due to Force Majeure Event leading to extension of Scheduled COD for a period beyond one hundred eighty (180) days

$n$  = number of years over which the Transmission Charges has to be paid

$d$  = Discount rate as notified by the CERC, applicable on the Bid Deadline

The increase in Transmission Charges as stated above shall be applicable only if the value of increase in Transmission Charges as calculated above exceeds 0.30% (zero point three percent) of the quoted Transmission Charges of the TSP.

  
Central Transmission Utility of India Limited

145



Raghunadasa RE Transmission Limited



965



**ANNEXURE XII : PRIOR APPROVAL UNDER SECTION 68 OF THE ELECTRICITY ACT 2003  
FOR TRANSMISSION SYSTEM**



577

No. 25-17/18/2025-PG  
Government of India  
Ministry of Power  
\*\*\*

Shram Shakti Bhawan, Rafi Marg  
New Delhi Dated 28<sup>th</sup> January 2025

To,

Shri Naveen Kumar (Director),  
M/s Raghnesda RE Transmission Limited,  
9th Floor, A-Wing, Statesman House,  
Connaught Place, New Delhi-110001  
Email- naveen.phougal@pfcindia.com

Subject: Prior approval of the Government of India under Section 68 (1) of the Electricity Act, 2003, for installation of overhead transmission lines under the transmission scheme "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I" to M/s Raghnesda RE Transmission Limited - regarding.

Sir,

I am directed to refer to M/s PFCCL's online application on NSWS portal dated 18.12.2024, seeking prior approval of Government of India under Section 68 (1) of the Electricity Act 2003, in favour of M/s Raghnesda RE Transmission Limited (a wholly owned subsidiary of PFC Consulting Limited) for installation of the following overhead transmission lines under the transmission scheme "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I":

- Raghnesda (GIS) - Banaskantha (PG) 765 kV D/c line

2. Ministry of Power vide Gazette no. CG-DL-E-22082024-256561 dated 21.08.2024 has appointed PFC Consulting Limited as Bid Process Coordinator for the purpose of selection of Bidder as Transmission Service Provider (TSP) to establish the transmission scheme "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I" to be implemented through Tariff Based Competitive Bidding (TBCB) route. PFC Consulting Limited, the Bid Process Coordinator, has incorporated the SPV, M/s Raghnesda RE Transmission Limited, for implementation of the above mentioned transmission scheme.

3. Based on the recommendation of Central Electricity Authority (CEA); Ministry of Power, Government of India conveys the prior approval under Section 68 (1) of the Electricity Act, 2003 to the SPV, M/s Raghnesda RE Transmission Limited for installation of the following overhead transmission line under the transmission scheme "Transmission system for evacuation of RE power from Raghnesda area of Gujarat - 3 GW under Phase-I":

- Raghnesda (GIS) - Banaskantha (PG) 765 kV D/c line [Route length is 95 km (approx.)]

4. The approval would be subject to compliance of:

- (i) The relevant provisions of the Electricity Act, 2003, as amended from time to time and the rules and regulations made there under, and
- (ii) CEA (Measures relating to Safety and Electric Supply) Regulations, 2023, and any subsequent amendments made thereto.

5. The approval would also be subject to the following conditions:

- (i) The implementing agency will commence construction of the project within three years of grant of approval, unless this term is extended by Ministry of Power.



28/1

(ii) Ministry of Power may withdraw the approval before the expiry of the period of three years after giving a one-month notice.

(iii) The implementing agencies shall abide by the provisions of Works of Licensees Rules, 2006 notified by the Govt. of India, Ministry of Power in the Gazette of India, extra-ordinary Part-II, Section 3(i) dated 18-04-2006 (vide GSR 217 (E) dated 18-04-2006).

Yours faithfully,

*M.V.N. Vara Prasad*

(M.V.N. Vara Prasad)  
Under Secretary to the Government of India  
Tele: 011-23730264

Copy to:

The Chairperson,  
Central Electricity Authority,  
Sewa Bhawan, R.K. Puram, New Delhi 110066.

\*\*\*



65

**ANNEXURE XIII : COPY OF POWER OF ATTORNEY**





महाराष्ट्र MAHARASHTRA

2025

DV 618747



Sub-Treasury Office  
Vasai  
23 JUL 2025  
Sd/- Treasury Officer

23/07/25



THIS STAMP PAPER IS IN RELATION  
TO THE POWER OF ATTORNEY ISSUED  
BY RAGHANESDA RE TRANSMISSION LIMITED  
IN FAVOUR OF SHRI AMIT KUMAR.

*Sivaprasad*



521

517153

23/07/2023 JUL 2023



अनुबंध - १ / Annexure - 1  
**फक्त प्रविज्ञापनासाठी / ONLY FOR AFFIDAVIT**

१. सुट्यांक विक्री नोंदवही अनु. क्रमांक -/ दिनांक  
 (Serial No. / Date)

२. सुट्यांक विकत घेणाऱ्याचे नांव, राहिवेवासाचा पत्ता व सही  
 (Stamp Purchaser's Name  
 Place of residence & Signature)

३. परवानाधारक सुट्यांक विक्रेत्याची सही  
 व परवाना क्रमांक (सुट्यांक विक्री नोंदवही मध्ये नोंदवलेले क्रमांक)

**Krishna Chandra Upadhyay**  
 B.A.L.L.B.  
 Advocate High Court, Mumbai  
 Shri Prastha Complex, Flat No. 201.

B. S. ...  
 ...  
 ...



56



### SPECIFIC POWER OF ATTORNEY

Know all men by these presents, we Raghnesda RE Transmission Limited (hereinafter referred to as RRTL) which expression shall unless repugnant to the context or meaning thereof, include its successors, administrators, and assigns) having its Registered Office at 161, First Floor, Vardhman Crown Mall, Amberhai, South West Delhi, New Delhi, India, 110075, do hereby constitute, appoint and authorize Shri Amit Kumar, residing at C-1704, Pioneer Park Sector 61, Gurugram -122011, as our true and lawful attorney, to do in our name and our behalf, all of the acts, or things hereinafter mentioned, that is to say

1. To constitute, and defend legal cases, sign and verify complaints, written statements, petitions and objections. memorandum of appeal, claims, affidavits, applications, re-applications and pleadings of all kinds and to file them in Central Electricity Regulatory Commission (CERC), State Electricity Regulatory Commissions (SERCs), Appellate Tribunal for Electricity (ATE), Civil, Criminal or Revenue courts, Arbitration, Labour Court, Industrial Tribunal, High Court and Supreme Court, whether having original or appellate jurisdiction and before Government or Local Authorities or Registration Authorities, Tax Authorities, Tribunals, etc.
2. To appear, before various Courts / Tribunals / CERC / SERCs / Appellate Tribunal for Electricity.
3. To appoint any Advocate, Vakil, Pleader, Solicitor or any other legal practitioner as Attorney to appear and conduct case proceedings on behalf of the company and to sign Vakalatnama.
4. To compromise, compound or withdraw cases from any Court / Tribunal / CERC / SERCs / Appellate Tribunal for Electricity.
5. To file petitions/applications or affidavits before the Supreme Court / High Court / CERC / SERCs / Appellate Tribunal for Electricity and to obtain the copies of documents, papers, records etc.
6. To file and receive back documents, to deposit and withdraw money from Courts, Tribunal, Registrar's Office and other Government or Local Authorities and to issue valid receipts thereof.

*Svempasla*



7  
8

7. To apply for and obtain refund of stamp duty or court fee, etc.
8. To issue notices and accept service of any summons, notices or orders issued by any Court/ Tribunal/CERC/SERCs / Appellate Tribunal for Electricity on behalf of the Company.
9. To execute deeds, agreements, bonds and other documents and returns in connection with the affairs of the company and file them or cause to be filed for Registration, whenever necessary.
10. To issue Project Authority Certificate(s) in respect of contracts for Load Despatch & Communication Systems, Transmission Systems etc. and to lodge claims with the Railways, Transporters, Shipping Agents and Clearing Agents and to settle/compromise such claims.
11. To lodge claims with the Insurance companies, to settle/compromise such claims and on satisfactory settlement thereof, to issue letters of subrogation/power of attorney in favour of Insurance companies.
12. To execute, sign and file applications, undertakings, agreements etc. to or with the Central / State Government(s) / Body(ies) to obtain 'right of way' or any of other Right(s) Privilege(s) etc.
13. To execute, sign and file applications, undertakings, agreements, bills, documents etc. to or with the Central/State Government(s)/Body(ies) and other authorities/entities including Central Transmission Utility (CTU)/Power System Operation Corporation Limited (POSOCO)/ Central Electricity Authority (CEA)/ CERC with respect to Commissioning of the Project, realization of Transmission charges to obtain 'right of way' or any of other Right(s)/ Privilege(s) etc.
14. To execute Transmission Service Agreement (TSA) with Central Transmission Utility of India Limited (CTUIL).
15. To execute Consultancy, Funding and other Agreements.
16. To act as administrator for e-filing process with CERC and other statutory authorities.
17. It is hereby expressly made clear that the authorized representative shall not have any such power as in the nature of creation of any liability, financial or otherwise, in any manner whatsoever, without there being any specific written authority and /or confirmation for any such specific act for and on behalf of RRTL.

*Svempal*





It is expressly made clear that the Attorney holder should perform all duties and always work within the framework of existing law and as per Rules & Regulations laid down by Central Government, State Government or any authority/agency/body of the Government organization in the best interest of RRTL. RRTL does not promote any illegal or unlawful activity, thus if found performing unlawful activity shall be accountable and responsible individually for his conduct.

This Power of Attorney is issued in the authorized representative's favour on this 23<sup>rd</sup> day of July 2025 and will remain valid up to 31<sup>st</sup> day of March 2028, unless revoked earlier or shall expire on the date of cessation of employment of the said Attorney with RRTL, whichever is earlier and shall be operative only for the works and purpose mentioned above.

IN WITNESS WHEREOF, I, Shrinivass Vemparla, Director, for and on behalf of M/s. Raghnesda RE Transmission Limited, have hereto respectively signed at Mumbai, on this 23<sup>rd</sup> day of July 2025 and request the Notary Public to duly attest this power of attorney.

For M/s. Raghnesda RE Transmission Limited

*Svemparla*  
Shrinivass Vemparla  
(Director)

Accepted by:

*[Signature]*  
(Signature of the Attorney)

Amit Kumar  
(Authorized Signatory)  
Address - C-1704, Pioneer Park Sector 61,  
Gurgaon, 122011

Attested by:  
*Svemparla*  
Shrinivass Vemparla  
(Director)

*[Signature]*  
28/7/25

WITNESSES

1. *[Signature]*  
Nikhil Desai



2. *[Signature]*  
SAVIA  
gomes

SUDARSHAN UPADHYAY  
ADVOCATE & NOTARY  
GOVT. OF INDIA  
Reg. No. 29370  
Room No. 25, Santa Siddhi Vinayak HSO Soc.,  
Filter Pada Aarey Colony Road,  
NITIE Mumbai-400 047  
Page 3 of 3

*[Signature]*

